

designated according to Article 29 of the Regulation (EU) No 305/2011 and member of EOTA (European Organisation for Technical Assessment, www.eota.eu)

European Technical Assessment

ETA 23/0050
of 04/12/2024

Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: **UL International (Netherlands) B.V.**

Trade name of the construction product Mulcol® Multimastic C System

Product family to which the construction product belongs Fire Stopping and Sealing Product:
• Penetration Seals

Manufacturer Mulcol International BV
Promenade 75
5401GM Uden
The Netherlands

Manufacturing plant(s) L/002

This European Technical Assessment contains 331 pages including 3 Annexes which form an integral part of this assessment.

This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of EAD 350454-00-1104, September 2017

This version replaces ETA 23/0050 issued on 29/08/2023

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

I.	SPECIFIC PARTS OF THE EUROPEAN TECHNICAL ASSESMENT	3
1.	Technical description of the product	3
2.	Specification of the intended uses of the product in accordance with the applicable European Assessment Document (hereinafter EAD): EAD 350454-00-1104	3
3.	Performance of the product and references to the methods used for its assessment	5
4.	Assessment and Verification of Constancy of Performance (hereinafter AVCP) applied, with reference to its legal base	6
5.	Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD	6
	Annex - Resistance to Fire Classification - Mulcol® Multimastic C	
	Annex A - Flexible and rigid walls	15
	Annex B - Rigid floors	197
	Annex C - General	314

I. SPECIFIC PARTS OF THE EUROPEAN TECHNICAL ASSESSMENT

1. Technical description of the product

- 1) Mulcol® Multimastic FB is a mineral wool board coated with waterborne Mulcol® Multimastic C ablative firestop coating based on a sustainable polymer system used to reinstate the fire resistance performance of wall and floor constructions where they have been provided with apertures for the penetration of single or multiple services.
- 2) The Mulcol® Multimastic FB is supplied coated on one face, referenced FB1, or on both faces, referenced FB2. The board or boards are then cut to allow the penetration of the required services, before being inserted into or over the aperture in the wall or floor.
- 3) The products below can be used in conjunction with Mulcol® Multimastic FB depending upon the required application and classification (see Annex A/B). These products are subject to separate ETAs.
 - Mulcol® Multimastic SP, firestop mastic
 - Mulcol® Multicollar *Slim*, universal fire collar
 - Mulcol® Multiwrap, fire wrap
 - Mulcol® Multisealant GR, firestop intumescent graphite
 - Mulcol® Multitherm Bandage, thermal insulation
 - Mulcol® Multidisc, firestop disc
 - Mulcol® Multifoam 2K, 2 component fire protection Foam
 - Mulcol® Multifoam Stone, fire protection stone

The applicant has submitted a written declaration that Mulcol® Multimastic FB, Mulcol® Multimastic C and Mulcol® Multimastic SP do not contain substances which have to be classified as dangerous according to Directive 67/548/EEC and Regulation (EC) No 1272/2008 and listed in the "Indicative list on dangerous substances" of the EGDS - taking into account the installation conditions of the construction product and the release scenarios resulting from there.

In addition to the specific clauses relating to dangerous substances contained in this European technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

2. Specification of the intended uses of the product in accordance with the applicable European Assessment Document (hereinafter EAD): EAD 350454-00-1104

Detailed information and data is given in Annex A, B and C.

- 1) The intended use of Mulcol® Multimastic FB is to reinstate the fire resistance performance of flexible wall, rigid wall and floor constructions where they are penetrated by various services.
- 2) The specific elements of construction that the system Mulcol® Multimastic FB may be used to provide a penetration seal in, are as follows:
 - a) Flexible walls*: The wall must have a minimum thickness of 100 mm. Apertures in flexible walls are not required to be lined
 - b) Rigid walls*: The wall must have a minimum thickness of 100 mm and comprise concrete, aerated concrete or masonry, with a minimum density of 400 kg/m³
 - c) CLT walls: The wall must have a minimum thickness of 100 mm, with a minimum density of 376 kg/m³
 - d) Sandwich panel walls: The wall must have a minimum thickness of 100 mm, consisting of a stone wool core with a minimum density of 115 kg/m³
 - e) Rigid floors: The floor must have a minimum thickness of 150 mm and comprise aerated concrete or concrete with a minimum density of 400 kg/m³
 - f) CLT floors: The floor must have a minimum thickness of 140 mm, with a minimum density of 350 kg/m³
* See Annex C for the field of application.
The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period.
- 3) The system Mulcol® Multimastic FB may be used to provide a penetration seal with services e.g. cables, cable trays, metal pipes, composite pipes and plastic pipes, with and without insulation, with mixed services within the same seal/aperture (for details see Annex A and B).
- 4) The Mulcol® Multimastic FB panels have a minimum density of 150 kg/m³ and are of type Isover BSP, Paroc Pyrotech, Rockwool Hardrock, SVT/Flamro or equal.
- 5) The Mulcol® Multimastic C System FB1 (2x 50 mm) and System FB2 (1x 60 mm) may be used to seal apertures in separating elements up to a maximum seal size given in Annex C. The minimum permitted separation between adjacent seals/apertures is 100 mm. Where seals are installed without services (blank), precautions need to be taken to prevent a person stepping onto a horizontal seal or falling onto a vertical seal.
- 6) The provisions made in this European Technical Assessment are based on an assumed working life of 25 years, provided that the conditions laid down in the product datasheet for the packaging/ transport/ storage/ installation/ use/ repair are met. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.
- 7) Type Z₂: Intended for uses in internal conditions with humidity lower than 85 % RH excluding temperatures below 0°C, without exposure to rain or UV.

- 8) Mutual distances between services and minimum support distances are given in Annex C.
- 9) It is allowed, for aesthetic reasons, to apply a ≥ 25 mm overlap of Multimastic C coating on the adjacent construction around the penetration seal, but it is not mandatory.
- 11) If the solution is in combination with the Mulcol® Multiwrap, a maximum of 5 mm protrusion from the surface of the separating element or penetration seal is allowed.
- 12) Insulation types
The following acoustic insulation types are allowed (or equal):
- ABSound Sonocool
 - Jacomassa / Sonimass
 - Merfisol Silver Alu
 - ThermaCompact TF
- The following elastomeric insulation types are given in Annex A and B (or equal, not limited by brand or type):
- Reaction to fire class $\leq$ B-s1, d0 – e.g. ArmaFlex Ultima, Kaiflex KK Plus S1
 - Reaction to fire class $\leq$ B-s2, d0 – e.g. ArmaFlex AF EVO, Kaiflex KK Plus S2 / ST, K-Flex ST
 - Reaction to fire class $\leq$ B-s3, d0 – e.g. ArmaFlex AF / XG / SH, K-Flex H
 - Reaction to fire class $\leq$ C-s2, d0 – e.g. Kaiflex HT S2
 - Reaction to fire class $\leq$ D-s3, d0 – e.g. ArmaFlex NH / SH / HT
- The insulations may also have a B_L, C_L or D_L classification (linear insulation).
- 13) Pipes types
The following multi layered pipes (or equal) are allowed:
- Alpex DUO, Valsir Pexal, Valsir Mixal and APE Plain (PE-Xb/AL/PE-Xb)
 - Uponor and Geberit Mepla (PE-RT/AL/PE-RT)
 - Uponor and Henco (PE-Xc/AL/PE-Xc)
 - Uponor and REHAU (PE-Xa) and REHAU (PE-Xc)
 - SP Superpipe and POLYGON PEX (PE-X/AL/PE-X)
 - Valsir Pexal and Valsir Mixal (PE/AL/PE-Xb)
 - Wavin Tigris, Protecta-Line System and Alpex F50 Profi (PE-X/AL/PE)
 - Kelox Modulrohr
 - Kelox Plus-Rohr (PE-RT/AL/PE-RT)
- The following fibre composite pipes (or equal) are allowed:
- Aquatechnik Fusio PP-R 80, Aquatechnik Fusio PP-RCT
 - Aquatherm Blue-MF, Aquatherm Blue-S, Aquatherm Red-MF, Aquatherm Green-MF, Aquatherm Green-MS, Aquatherm Green-S, Aquatherm Lilac-S, Aquatherm Grey-MS and Aquatherm Orange M
 - Bänninger PP-R, Bänninger Climatec PP-RCT and Bänninger Watertec PP-RCT
- The following low-noise (Silent) pipes (or equal) are allowed:
- Coes PhoNoFire and Coestilen BluePower
 - Geberit Silent PP and Geberit Silent dB 20
 - Girpi Friaphon and Marley Silent
 - Pipelife Master 3 and PhonEX AS
 - Poloplast POLO-KAL NG and Poloplast POLO-KAL 3S
 - Skolan dB
 - Raupiano Plus
 - Valsir Triplus,
 - DykaSono
 - Uponor Decibel
 - Geberit Silent Pro
 - Wavin SiTech+
 - Wavin SiTech B1
 - Wavin AS

3. Performance of the product and references to the methods used for its assessment

Product-type: Coated Board		Intended use: Penetration Seal
Assesment method	Essential characteristic	Product Performance
<u>BWR 2 Safety in case of fire</u>		
EN 13501-1	Reaction to fire	E
EN 13501-1	Resistance to fire	Annex A, B & C
<u>BWR 3 Hygiene, health and enviroment</u>		
EN 1026	Air permeability	No performance determined
EAD 350454-00-1104, Annex C	Water permeability	No performance determined
Declaration of manufacturer & EN 16516	Release of dangerous substances	IA1, S/W 1 - Declaration of manufacturer
<u>BWR 4 Safety in use</u>		
EOTA TR 001:2003	Mechanical resistance and stability	No performance determined
EOTA TR 001:2003	Resistance to impact/movement	No performance determined
EOTA TR 001:2003	Adhesion	No performance determined
EAD 350454-00-1104, Clause 2.2.9	Durability	Z ₂
<u>BWR 5 Protection against noise</u>		
EN 10140-1,2,4,5 / EN ISO 7171-1	Airborne sound insulation	R _w (C;C _{tr}) = 28 (-1;-3) dB
<u>BWR 6 Energy economy and theat retention</u>		
EN 12664, EN 12667, EN 13319, EN ISO 8990, EN ISO 6946, EN ISO 14683, EN ISO 10211, EN ISO 10456	Thermal properties	No performance determined
EN ISO 12572, EN 12086, EN ISO 10456	Water vapour permeability	No performance determined

4. Assessment and Verification of Constancy of Performance (hereinafter AVCP) applied, with reference to its legal base

According to the decision 1999/454/EC – Commission Decision of date 22nd June 1999 on the procedure for attesting the conformity of construction products pursuant to Article 20(2) of Council Directive 89/106/EEC as regards to fire stopping, fire sealing and fire protective products, published in the Official Journal of the European Union (OJEU) L178/52 of 14/07/1999, see <http://eur-lex.europa.eu/JOIndex.do> of the European Commission¹, as amended, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table(s) applies (apply).

Product(s)	Intended use(s)	Level(s) or class(es)	System(s)
Fire stopping and Fire Sealing Products	For fire compartmentation and/or fire protection or fire performance	Any	1

5. Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Tasks of the manufacturer:

Factory production control

The manufacturer shall exercise permanent internal control of production. All the elements, requirements and provisions adopted by the manufacturer shall be documented in a systematic manner in the form of written policies and procedures, including records of results performed. This production control system shall ensure that the product is in conformity with this European Technical Assessment.

The factory production control shall be in accordance with the Control Plan of 14th September 2023 relating to the European Technical Assessment ETA 23/0050 issued on 04/12/2024 which is part of the technical documentation of this European Technical Assessment. The “Control Plan” is laid down in the context of the factory production control system operated by the manufacturer and deposited at UL International (Netherlands) B.V.

The results of factory production control shall be recorded and evaluated in accordance with the provisions of the Control Plan.

Other tasks of the manufacturer:

Additional information

The manufacturer shall provide a technical data sheet and an installation instruction with the following minimum information:

(a) Technical data sheet:

- Field of application:
- Building elements for which the penetration seal is suitable, type and properties of the building elements like minimum thickness, density, and - in case of lightweight constructions - the construction requirements.
- Limits in size, minimum thickness etc. of the penetration seal
- Construction of the penetration seal including the necessary components and additional products (e.g. backfilling material) with clear indication whether they are generic or specific.
- Services which the penetration seal is suitable, type and properties of the services like material, diameter, thickness etc. in case of pipes including insulation materials; necessary/allowed supports/fixings (e.g. pipe trays)

(b) Installation instruction:

- Steps to be followed
- Procedure in case of retrofitting
- Stipulations on maintenance, repair and replacement

6. Issued on:

04-12-2024

Report by:



C. Johnson

Senior Staff Engineer

Built Environment

Verified by:



D. Yates

Staff Engineer

Built Environment

Validated by:



Erik Teubler

Head of TAB

Built Environment

For and on behalf of UL International (Netherlands) B.V.

Annex - Resistance to Fire Classification - Mulcol® Multimastic C

Annex A.1 - Flexible and rigid walls

A.1.1	Multimastic FB1 - 2x 50 mm - Cables, trays and conduits	15
A.1.1.1	Cables, trays and conduits - Multimastic C - 50 mm	15
A.1.1.2	Cables, trays and conduits - Multimastic C - 150 mm	16
A.1.1.3	Cables and trays - Multitherm Bandage	17
A.1.1.4	Cables and trays - Multi foam 2K	18
A.1.1.5	Single plastic conduits - Multidisc	19
A.1.1.6	Multiple plastic conduits - Multidisc	20
A.1.1.7	Single plastic conduits - Multisealant GR	21
A.1.1.8	Multiple plastic conduits - Multisealant GR	22
A.1.1.9	Single cables - Multidisc	23
A.1.1.10	Multiple cables - Multidisc	24
A.1.2	Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Cables, trays and conduits	25
A.1.2.1	Cables, trays and conduits - Multimastic C	25
A.1.2.2	Single plastic conduits - Multidisc	26
A.1.2.3	Single cables - Multidisc	27
A.1.2.4	Multiple cables - Multidisc	28
A.1.3	Multimastic FB2 - 1x 60 mm - Cables, trays and conduits	29
A.1.3.1	Cables, trays and conduits - Multimastic C	29
A.1.3.2	Single plastic conduits - Multidisc	30
A.1.3.3	Single plastic conduits - Multisealant GR	31
A.1.3.4	Single cables - Multidisc	32
A.1.3.5	Multiple cables - Multidisc	33
A.1.4	Multimastic FB1 - 2x 50 mm - Combustible pipes	34
A.1.4.1	Plastic pipes - Multicollar <i>Slim</i>	34
A.1.4.2	Plastic pipes perpendicular to 45° - Multicollar <i>Slim</i>	37
A.1.4.3	Plastic pipes - Multiwrap	38
A.1.4.4	Plastic pipes with cables - Multiwrap	40
A.1.4.5	Plastic pipes - Multimastic SP	41
A.1.4.6	Plastic pipes - Multisealant GR	42
A.1.4.7	Plastic pipes (Silent) - Multicollar <i>Slim</i>	43
A.1.4.8	Plastic pipes (Silent) - Multiwrap	44
A.1.4.9	PP-R multilayer pipes - Multicollar <i>Slim</i>	46
A.1.4.10	PP-R multilayer pipes - Multiwrap	47
A.1.4.11	PP-R multilayer pipes - Elastomer LI 300 / CI - Multicollar <i>Slim</i>	48
A.1.4.12	PP-R multilayer pipes - With or without Thermoplast Elastomer CS - Multisealant GR	49
A.1.4.13	Flexible drinking hose - Multisealant GR	50
A.1.4.14	Drinks tubing system - Multicollar <i>Slim</i>	51
A.1.4.15	Rectangular duct - Multicollar <i>Slim</i>	52
A.1.4.16	Flexible plastic hoses with cables - Multisealant GR	53
A.1.5	Multimastic FB2 - 1x 60 mm - Combustible pipes	54
A.1.5.1	Plastic pipes - Multicollar <i>Slim</i>	54
A.1.5.2	Plastic pipes - Multiwrap	55
A.1.5.3	Plastic pipes (Silent) - Multicollar <i>Slim</i>	56
A.1.5.4	Flexible plastic hoses with cables - Multicollar <i>Slim</i>	57
A.1.6	Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)	58
A.1.6.1	Multilayer pipes (MLC) - Multicollar <i>Slim</i>	59
A.1.6.2	Multilayer pipes (MLC) - Multisealant GR	60
A.1.6.3	Multilayer pipes (MLC) - Conduit - Multisealant GR	61
A.1.6.4	Multilayer pipes (MLC) - Stone wool LS 400 / CS	62
A.1.6.5	Multilayer pipes (MLC) - Stone wool LI 400 / CI	63
A.1.6.6	Multilayer pipes (MLC) - Elastomer LS 300 / CS - Multisealant GR	64
A.1.6.7	Multilayer pipes (MLC) - Elastomer LI 300 / CI - Multicollar <i>Slim</i>	65
A.1.6.8	Multilayer pipes (MLC) - ArmaFlex Protect LS 400 / CS - Multimastic SP	66
A.1.6.9	Multilayer pipes (MLC) - Phenolic foam LS 400 / CS - Multicollar <i>Slim</i>	67
A.1.6.10	Multiple Multilayer pipes (MLC) - PE foam - Multicollar <i>Slim</i>	68
A.1.6.11	Multilayer pipes (MLC) - PE foam - Multisealant GR	69
A.1.6.12	Multilayer pipes (MLC) - Multidisc	70
A.1.6.13	Multilayer pipes (MLC) - Multitherm Bandage	71
A.1.7	Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Multilayer pipes (MLC)	72
A.1.7.1	Multilayer pipes (MLC) - Multidisc	72
A.1.8	Multimastic FB2 - 1x 60 mm - Multilayer pipes (MLC)	73
A.1.8.1	Multilayer pipes (MLC) - Multidisc	73
A.1.9	Multimastic FB1 - 2x 50 mm - Metal pipes insulated mineral wool	75
A.1.9.1	Copper and steel pipes - Stone wool LS 400 / CS	75
A.1.9.2	Copper and steel pipes - Stone wool LI 400 / CI	76
A.1.9.3	Steel pipes - Glass wool LS 400 / CS - Multicollar <i>Slim</i>	77

A.1.10	Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Metal pipes insulated mineral wool	78
A.1.10.1	Copper and steel pipes - Stone wool LS 400 / CS	78
A.1.10.2	Copper and steel pipes - Stone wool LI 400 / CI	79
A.1.11	Multimastic FB2 - 1x 60 mm - Metal pipes insulated mineral wool	80
A.1.11.1	Copper and steel pipes - Stone wool LS 400 / CS	80
A.1.11.2	Copper and steel pipes - Stone wool LI 400 / CI	81
A.1.12	Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer	82
A.1.12.1	Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR	82
A.1.12.2	Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR - Multitherm Bandage	84
A.1.12.3	Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap	86
A.1.12.4	Copper and steel pipes - ArmaFlex Protect LS 400 / CS	88
A.1.13	Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Metal pipes insulated elastomer	89
A.1.13.1	Copper and steel pipes - Elastomer LS400 / CS - Multiwrap	89
A.1.13.2	Copper and steel pipes - ArmaFlex Protect LS 400 / CS	90
A.1.14	Multimastic FB2 - 1x 60 mm - Metal pipes insulated elastomer	91
A.1.14.1	Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR	91
A.1.14.2	Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR - Multitherm Bandage	93
A.1.14.3	Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap	95
A.1.14.4	Steel pipes - ArmaFlex Protect LS 400 / CS	96
A.1.15	Multimastic FB1 - 2x 50 mm - Metal pipes insulated phenolic foam	97
A.1.15.1	Steel pipes - Phenolic foam LS 400 / CS - Multisealant GR	97
A.1.16	Multimastic FB1 - 2x 50 mm - Metal pipes insulated PIR foam	98
A.1.16.1	Copper and steel pipes - PIR foam LS 400 / CS - Multisealant GR	98
A.1.17	Multimastic FB2 - 1x 60 mm - Metal pipes insulated PIR foam	99
A.1.17.1	Copper and steel pipes - PIR foam LS 400 / CS - Multiwrap	99
A.1.18	Multimastic FB1 - 2x 50 mm - Metal pipes uninsulated	100
A.1.18.1	Copper and steel pipes - Multimastic SP	100
A.1.18.2	Steel pipes - Multisealant GR	101
A.1.18.3	Copper and steel pipes - Multidisc	102
A.1.18.4	Copper and steel pipes - Multitherm Bandage	103
A.1.19	Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Metal pipes uninsulated	104
A.1.19.1	Copper and steel pipes - Multidisc	104
A.1.19.2	Copper and steel pipes - Multitherm Bandage	105
A.1.20	Multimastic FB2 - 1x 60 mm - Metal pipes uninsulated	106
A.1.20.1	Copper and steel pipes - Multimastic SP	106
A.1.20.2	Steel pipes - Multisealant GR	107
A.1.21	Multimastic FB1 - 2x 50 mm - Busbars	108
A.1.21.1	Single busbar - LI 300	108
A.1.21.2	Single busbar - LI 400	110
A.1.21.3	Multiple busbars - LI 300	112
A.1.21.4	Multiple busbars - LI 400	114
A.1.22	Multimastic FB1 - 2x 50 mm - Multiple services	116
A.1.22.1	Airconditioning set - Multicollar <i>Slim</i>	116
A.1.23	Multimastic FB2 - 1x 60 mm - Multiple services	117
A.1.23.1	Airconditioning set - Multicollar <i>Slim</i>	117
A.1.24	Multimastic FB1 - 2x 50 mm - Gas pipes	118
A.1.24.1	Corrugated stainless steel tube gas (CSST) pipes	118
A.1.24.2	Corrugated stainless steel tube gas (CSST) pipes - Multisealant GR - Multitherm Bandage	119
A.1.25	Directly through wall - Cables, trays and conduits	120
A.1.25.1	Cables, trays and conduits - Multimastic C - 50 mm	120
A.1.25.2	Cables, trays and conduits - Multimastic C - 150 mm	121
A.1.25.3	Cables, trays and conduits - Multitherm Bandage	122
A.1.26	Directly through wall - Busbars	123
A.1.26.1	Single busbar - LI 300	123
A.1.26.2	Single busbar - LI 400	125
A.1.26.3	Multiple busbars - LI 300	127
A.1.26.4	Multiple busbars - LI 400	129

Annex A.2 - Rigid walls

A.2.1	Multimastic FB2 - 2x 60 mm - Cables, trays and conduits	131
A.2.1.1	Cables and trays - Multimastic C	131
A.2.2	Multimastic FB2 Pattress - 2x 60 mm - Cables, trays and conduits	132
A.2.2.1	Cables and trays - Multimastic C	132
A.2.3	Multimastic FB2 - 2x 60 mm - Combustible pipes	133
A.2.3.1	Plastic pipes - Multiwrap	133
A.2.4	Multimastic FB2 - 2x 60 mm - Multilayer pipes (MLC)	134
A.2.4.1	Multilayer pipes (MLC) - Stone wool LI 600 / CI	134
A.2.5	Multimastic FB2 - 2x 60 mm - Metal pipes insulated mineral wool	135
A.2.5.1	Steel pipes - Stone wool LS 400 / CS	135
A.2.5.2	Copper and steel pipes - Stone wool LI / CI	136
A.2.6	Multimastic FB2 - 1x 60 mm - Cables, trays and conduits	137
A.2.6.1	Cables - Multimastic C	137
A.2.7	Multimastic FB2 - 1x 60 mm - Metal pipes insulated mineral wool	138
A.2.7.1	Copper and steel pipes - Stone wool LI / CI	138
A.2.8	Directly through wall - Cables, trays and conduits	139
A.2.8.1	Cables, trays and conduits - Multimastic C - 150 mm	139

Annex A.3 - CLT walls

A.3.1	Multimastic FB1 - 2x 50 mm - Cables, trays and conduits	140
A.3.1.1	Cables, trays and conduits - Multimastic C - 50 mm	140
A.3.1.2	Cables, trays and conduits - Multimastic C - 150 mm	141
A.3.1.3	Single plastic conduits - Multidisc	142
A.3.1.4	Multiple cables - Multidisc	143
A.3.2	Multimastic FB1 - 2x 50 mm - Combustible pipes	144
A.3.2.1	Plastic pipes - Multicollar <i>Slim</i>	144
A.3.2.2	Plastic pipes perpendicular to 45° - Multicollar <i>Slim</i>	145
A.3.2.3	Plastic pipes perpendicular to 45° - Multicollar <i>Slim</i>	146
A.3.2.4	Plastic pipes - Multiwrap	147
A.3.2.5	Plastic pipes (Silent) - Multiwrap	149
A.3.2.6	PP-R multilayer pipes - Multicollar <i>Slim</i>	151
A.3.2.7	PP-R multilayer pipes - Multiwrap	152
A.3.2.8	Drinks tubing system - Multicollar <i>Slim</i>	153
A.3.3	Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)	154
A.3.3.1	Multilayer pipes (MLC) - Multisealant GR	154
A.3.3.2	Multilayer pipes (MLC) - Conduit - Multisealant GR	155
A.3.3.3	Multilayer pipes (MLC) - Elastomer LS 300 / CS - Multisealant GR	156
A.3.3.4	Multilayer pipes (MLC) - PE foam - Multisealant GR	157
A.3.3.5	Multilayer pipes (MLC) - Multidisc	158
A.3.4	Multimastic FB1 - 2x 50 mm - Metal pipes insulated mineral wool	159
A.3.4.1	Copper and steel pipes - Stone wool LS 400 / CS	159
A.3.5	Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer	160
A.3.5.1	Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR	160
A.3.5.2	Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap	161
A.3.6	Multimastic FB1 - 2x 50 mm - Metal pipes uninsulated	162
A.3.6.1	Copper and steel pipes - Multidisc	162

Annex A.4 - Sandwich panel walls

A.4.1	Multimastic FB1 - 2x 50 mm - Cables, trays and conduits	163
A.4.1.1	Cables, trays and conduits - Multimastic C - 50 mm	163
A.4.1.2	Cables, trays and conduits - Multimastic C - 150 mm	164
A.4.1.3	Single plastic conduits - Multidisc	165
A.4.1.4	Multiple cables - Multidisc	166
A.4.2	Multimastic FB1 - 2x 50 mm - Combustible pipes	167
A.4.2.1	Plastic pipes - Multicollar <i>Slim</i>	167
A.4.2.2	Plastic pipes perpendicular to 45° - Multicollar <i>Slim</i>	169
A.4.2.3	Plastic pipes perpendicular to 45° - double Multicollar <i>Slim</i>	170
A.4.2.4	Plastic pipes - Multiwrap	171
A.4.2.5	Plastic pipes (Silent) - Multicollar <i>Slim</i>	173
A.4.2.6	Plastic pipes (Silent) - Multiwrap	174
A.4.2.7	PP-R multilayer pipes - Multicollar <i>Slim</i>	176
A.4.2.8	PP-R multilayer pipes - Multiwrap	177
A.4.2.9	Drinks tubing system - Multicollar <i>Slim</i>	178
A.4.2.10	PE Pipe insulated PIR - Multicollar <i>Slim</i>	179
A.4.3	Multimastic FB1 Pattress fixed to wall - 2x50 mm - Combustible pipes	180
A.4.3.1	Plastic pipes - Multicollar <i>Slim</i>	180
A.4.4	Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)	181
A.4.4.1	Multilayer pipes (MLC) - Multisealant GR	181
A.4.4.2	Multilayer pipes (MLC) - Multidisc	182
A.4.4.3	Multilayer pipes (MLC) - PE Conduit - Multisealant GR	183
A.4.4.4	Multilayer pipes (MLC) - Elastomer LS 400 / CS - Multisealant GR	184
A.4.4.5	Multilayer pipes (MLC) - PE foam - Multisealant GR	185
A.4.5	Multimastic FB1 Pattress fixed to wall - 2x50 mm - Multilayer pipe (MLC)	186
A.4.5.1	Multilayer pipe (MLC) - Elastomer LS 400 / CS - Multicollar <i>Slim</i>	186
A.4.6	Multimastic FB1 - 2x 50 mm - Metal pipes insulated mineral wool	187
A.4.6.1	Copper and steel pipes - Stone wool LS 400 / CS	187
A.4.7	Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer	188
A.4.7.1	Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR	188
A.4.7.2	Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap	190
A.4.8	Multimastic FB1 - 2x50 mm - Metal pipes uninsulated	191
A.4.8.1	Copper and steel pipes - Multidisc	191
A.4.9	Multimastic FB1 - 2x 50 mm - Multiple penetrations	192
A.4.9.1	Airconditioning set - Multisealant GR	192
A.4.10	Multimastic FB1 - 2x 50 mm - Busbar	193
A.4.10.1	Single busbar - LI 300	193
A.4.10.2	Multiple busbars - LI 300	195

Annex B.1 - Rigid floors

B.1.1	Multimastic FB1 - 2x 50 mm no cavity - Cables, trays and conduits	197
B.1.1.1	Cables, trays and conduits - Multimastic C	197
B.1.1.2	Cables and trays - Multitherm Bandage	198
B.1.1.3	Cables and trays - Multifoam 2K	200
B.1.1.4	Single plastic conduits - Multidisc	201
B.1.1.5	Multiple plastic conduits - Multidisc	202
B.1.1.6	Single cables - Multidisc	203
B.1.1.7	Multiple cables - Multidisc	204
B.1.1.8	Multiple plastic conduits - Multisealant GR	205
B.1.2	Multimastic FB1 - 2x 50 mm cavity 50 mm - Cables, trays and conduits	206
B.1.2.1	Cables, trays and conduits - Multimastic C	206
B.1.2.2	Cables and trays - Multitherm Bandage	207
B.1.2.3	Cables and trays - Multifoam 2K	209
B.1.2.4	Single plastic conduits - Multidisc	210
B.1.2.5	Multiple plastic conduits - Multidisc	211
B.1.2.6	Single cables - Multidisc	212
B.1.2.7	Multiple cables - Multidisc	213
B.1.3	Multimastic FB2 - 1x 60 mm - Cables, trays and conduits	214
B.1.3.1	Cables, trays and conduits - Multimastic C	214
B.1.3.2	Single plastic conduits - Multidisc	215
B.1.3.3	Single cables - Multidisc	216
B.1.4	Multimastic FB1 - 2x 50 mm no cavity - Combustible pipes	217
B.1.4.1	Plastic pipes - Multicollar <i>Slim</i>	217
B.1.4.2	Plastic pipes - Multiwrap	218
B.1.4.3	Plastic pipes (Silent) - Multicollar <i>Slim</i>	219
B.1.4.4	Plastic pipes (Silent) - Multiwrap	220
B.1.4.5	PP-R Multilayer pipes - Multicollar <i>Slim</i>	221
B.1.5	Multimastic FB1 - 2x 50 mm cavity 50 mm - Combustible pipes	222
B.1.5.1	Plastic pipes - Multicollar <i>Slim</i>	222
B.1.5.2	Plastic pipes - Multiwrap	223
B.1.5.3	Plastic pipes - Multimastic SP	224
B.1.5.4	Plastic pipes - Multisealant GR	225
B.1.5.5	Plastic pipes (Silent) - Multicollar <i>Slim</i>	226
B.1.5.6	Plastic pipes (Silent) - Multiwrap	227
B.1.5.7	PP-R Multilayer pipes - Multicollar <i>Slim</i>	228
B.1.5.8	Drinks tubing system - Multicollar <i>Slim</i>	229
B.1.6	Multimastic FB2 - 1x 60 mm - Combustible pipes	230
B.1.6.1	Plastic pipes - Multicollar <i>Slim</i>	230
B.1.6.2	Plastic pipes - Multiwrap	231
B.1.6.3	Plastic pipes - Multiwrap - both sides	232
B.1.7	SVT Flamro BS60 - 1x60 mm - Combustible pipes	233
B.1.7.1	Plastic pipes - Multicollar <i>Slim</i>	233
B.1.8	Multimastic FB1 - 2x 50 mm no cavity - Multilayer pipes (MLC)	234
B.1.8.1	Multilayer pipes (MLC) - Multisealant GR	234
B.1.8.2	Multilayer pipes (MLC) - Elastomer LS 300 / CS - Multisealant GR	235
B.1.8.3	Multilayer pipes (MLC) - Elastomer LI 300 / CI - Multisealant GR	236
B.1.8.4	Multilayer pipes (MLC) - PE foam LS 300 / CS - Multisealant GR	237
B.1.8.5	Multilayer pipes (MLC) - Multimastic SP	239
B.1.8.6	Multilayer pipes (MLC) - Multidisc	240
B.1.9	Multimastic FB1 - 2x 50 mm cavity 50 mm - Multilayer pipes (MLC)	241
B.1.9.1	Multilayer pipes (MLC) - Multisealant GR	241
B.1.9.2	Multilayer pipes (MLC) - Elastomer LS 300 / CS - Multisealant GR	242
B.1.9.3	Multilayer pipes (MLC) - PE foam - Multisealant GR	244
B.1.9.4	Multilayer pipes (MLC) - Multimastic SP	246
B.1.9.5	Multilayer pipes (MLC) - Multidisc	247
B.1.10	Multimastic FB2 - 1x 60 mm - Multilayer pipes (MLC)	248
B.1.10.1	Multilayer pipes (MLC) - Multidisc	248
B.1.11	Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated mineral wool	249
B.1.11.1	Copper and steel pipes - Stone wool LS 400 / CS	249
B.1.11.2	Copper and steel pipes - Stone wool LI 400 / CI	250
B.1.11.3	Copper and steel pipes - Glass wool LI 400 / CI	251
B.1.12	Multimastic FB1 - 2x 50 mm cavity 50 mm - Metal pipes insulated mineral wool	252
B.1.12.1	Copper and steel pipes - Stone wool LS 400 / CS	252
B.1.12.2	Copper and steel pipes - Stone wool LI 400 / CI	253
B.1.12.3	Copper and steel pipes - Glass wool LI 400 / CI	254
B.1.13	Multimastic FB2 - 1x 60 mm - Metal pipes insulated mineral wool	255
B.1.13.1	Copper and steel pipes - Stone wool LS 400 / CS	255
B.1.13.2	Copper and steel pipes - Stone wool LI 400 / CI	256

B.1.14	Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated elastomer	257
B.1.14.1	Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR	257
B.1.14.2	Steel pipes - Elastomer LI 300 / CI - Multicollar <i>Slim</i>	259
B.1.14.3	Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap	260
B.1.14.4	Copper and steel pipes - ArmaFlex Protect LS 400 / CS	261
B.1.15	Multimastic FB1 - 2x 50 mm cavity 50 mm - Metal pipes insulated elastomer	262
B.1.15.1	Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR	262
B.1.15.2	Steel pipes - Elastomer LI 300 / CI - Multicollar <i>Slim</i>	264
B.1.15.3	Steel pipes - Elastomer LS 400 / CS - Multiwrap	265
B.1.15.4	Copper and steel pipes - ArmaFlex Protect LS 400 / CS	267
B.1.16	Multimastic FB2 - 1x 60 mm - Metal pipes insulated elastomer	268
B.1.16.1	Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR	268
B.1.16.2	Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap	270
B.1.17	Multimastic FB2 - 1x60 mm - Metal pipes insulated PIR foam	271
B.1.17.1	Steel pipes - PIR foam CS - Multiwrap - both sides	271
B.1.18	Multimastic FB1 - 2x 50 mm no cavity - Metal pipes uninsulated	272
B.1.18.1	Copper and steel pipes - Multimastic SP	272
B.1.18.2	Copper and steel pipes - Multisealant GR	273
B.1.18.3	Copper and steel pipes - Multidisc	274
B.1.19	Multimastic FB1 - 2x 50 mm cavity 50 mm - Metal pipes uninsulated	275
B.1.19.1	Copper and steel pipes - Multimastic SP	275
B.1.19.2	Copper and steel pipes - Multisealant GR	276
B.1.19.3	Copper and steel pipes - Multidisc	277
B.1.19.4	Copper and steel pipes - Multitherm Bandage	278
B.1.20	Multimastic FB2 - 1x 60 mm - Metal pipes uninsulated	279
B.1.20.1	Copper and steel pipes - Multimastic SP	279
B.1.20.2	Copper and steel pipes - Multisealant GR	280
B.1.21	Multimastic FB1 - 2x 50 mm cavity 50 mm - Gas pipes	281
B.1.21.1	Corrugated stainless steel tube gas (CSST) pipes - Multicollar - Multitherm Bandage	281
B.1.21.2	Corrugated stainless steel tube gas (CSST) pipes - Multisealant GR - Multitherm Bandage	282
B.1.22	Multimastic FB1 - 2x 50 mm no cavity - Busbars	283
B.1.22.1	Single busbar	283
B.1.22.2	Multiple busbars	285
B.1.23	Multimastic FB1 - 2x 50 mm cavity 50 mm - Busbars	287
B.1.23.1	Single busbar	287
B.1.23.2	Multiple busbars	289
B.1.24	Directly through floor - Cables, trays and conduits	291
B.1.24.1	Cables, trays and conduits - Multimastic C - 50 mm	291
B.1.24.2	Cables, trays and conduits - Multimastic C - 150 mm	292
B.1.25	Directly through floor - Busbars	293
B.1.25.1	Single busbar	293
B.1.25.2	Multiple busbars	295

Annex B.2 - CLT floors




B.2.1	Multimastic FB1 - 2x 50 mm no cavity - Cables, trays and conduits	297
B.2.1.1	Cables, trays and conduits - Multimastic C	297
B.2.1.2	Single plastic conduits - Multidisc	298
B.2.1.3	Single cables - Multidisc	299
B.2.2	Multimastic FB1 - 2x 50 mm no cavity - Combustible pipes	300
B.2.2.1	Plastic pipes - Multicollar <i>Slim</i>	300
B.2.2.2	Plastic pipes - Multiwrap	301
B.2.2.3	Plastic pipes (Silent) - Multicollar <i>Slim</i>	302
B.2.2.4	Plastic pipes (Silent) - Multiwrap	303
B.2.2.5	PP-R Multilayer pipes - Multicollar <i>Slim</i>	304
B.2.3	Multimastic FB1 - 2x 50 mm no cavity - Multilayer pipes (MLC)	305
B.2.3.1	Multilayer pipes (MLC) - Multisealant GR	305
B.2.3.2	Multilayer pipes (MLC) - Elastomer LS 400 / CS - Multisealant GR	306
B.2.3.3	Multilayer pipes (MLC) - PE foam LS 300 / CS - Multisealant GR	307
B.2.3.4	Multilayer pipes (MLC) - Multidisc	308
B.2.4	Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated mineral wool	309
B.2.4.1	Copper and steel pipes - Stone wool LS 400 / CS	309
B.2.5	Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated elastomer	310
B.2.5.1	Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR	310
B.2.5.2	Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap	312
B.2.6	Multimastic FB1 - 2x 50 mm no cavity - Metal pipes uninsulated	313
B.2.6.1	Copper and steel pipes - Multidisc	313

Annex C - General

C.1	Wall constructions - General	314
C.1.1	Mutual distances & distance to first support	314
C.1.2	Wall constructions - Maximum seal dimensions flexible or rigid wall	315
C.1.2.1	Maximum seal dimensions - Multimastic FB1 - 2x 50 mm no aperture framing	315
C.1.2.2	Maximum seal dimensions - Multimastic FB1 - 2x 50 mm with aperture framing	316
C.1.2.3	Maximum seal dimensions - Multimastic FB1 - 2x 50 mm - Pattress fixed to the wall	317
C.1.2.4	Maximum seal dimensions - Multimastic FB2 - 1x 60 mm with aperture framing	318
C.1.2.5	Maximum seal dimensions - Multimastic FB2 - 1x 60 mm with aperture framing	319
C.1.2.6	Maximum seal dimensions - Multimastic FB2 - 2x 60 mm with cavity 30 mm	320
C.1.2.7	Maximum seal dimensions - Multimastic FB2 - 2x 60 mm - Pattress fixed to wall	321
C.1.3	Wall constructions - Maximum seal dimensions CLT	322
C.1.3.1	Maximum seal dimensions - Multimastic FB1 - 2x 50 mm	322
C.1.4	Wall constructions - Maximum seal dimensions Sandwich panel	323
C.1.4.1	Maximum seal dimensions - Multimastic FB1 - 2x 50 mm no aperture framing	323
C.1.4.2	Maximum seal dimensions - Multimastic FB1 - 2x 50 mm with aperture framing	324
C.2	Floor constructions - General	325
C.2.1	Mutual distances & distance to first support	325
C.2.2	Floor constructions - Maximum seal dimensions rigid floor	326
C.2.2.1	Maximum seal dimensions - Multimastic FB1 - 2x 50 mm no cavity	326
C.2.2.2	Maximum seal dimensions - Multimastic FB1 - 2x 50 mm cavity 50 mm	327
C.2.2.3	Maximum seal dimensions - Multimastic FB2 - 1x 60 mm	328
C.2.3	Floor constructions - Maximum seal dimensions CLT floor	329
C.2.3.1	Maximum seal dimensions - Multimastic FB1 - 2x 50 mm	329
C.3	Wall configurations	330
C.3.1	Allowed wall configurations	330

A.1.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits

A.1.1.1 Cables, trays and conduits - Multimastic C - 50 mm

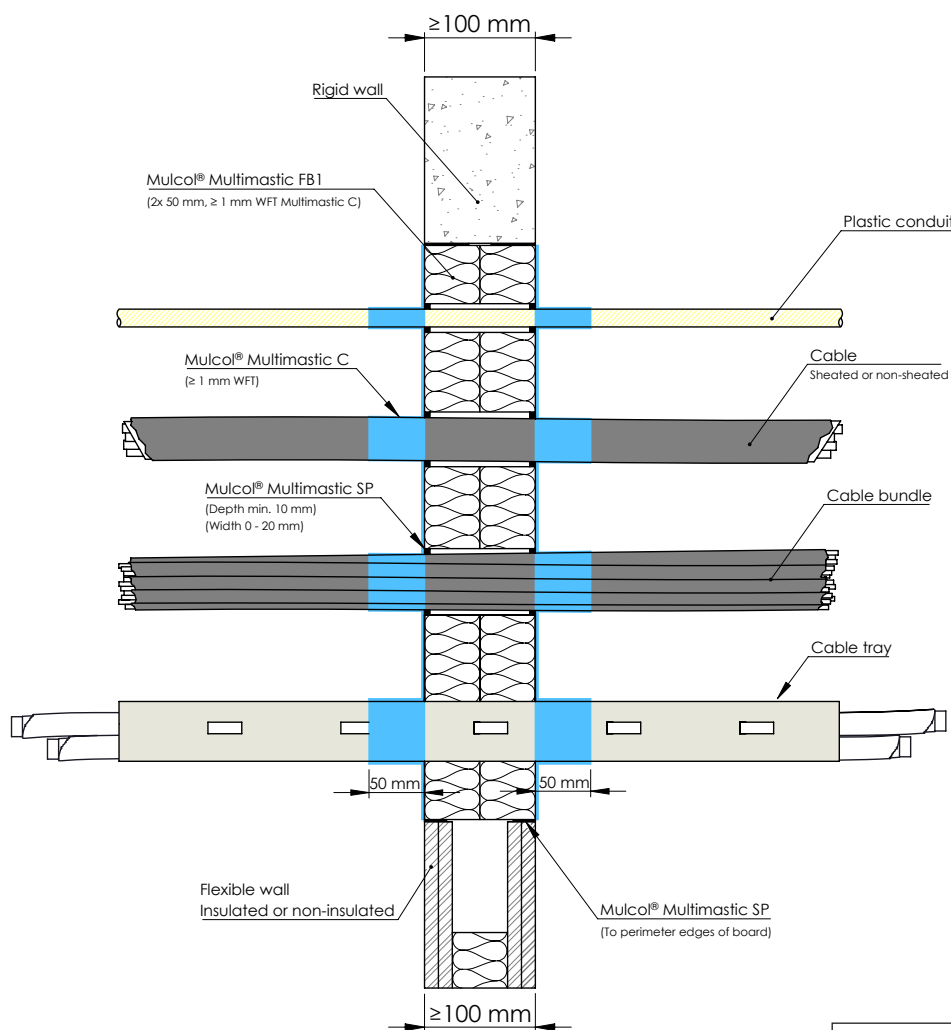

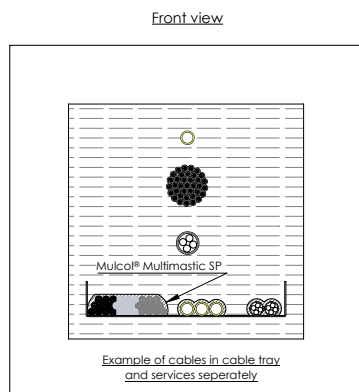


Drawing: PBfw.E-CT-4-MFB1.2.10

Services	Coating	Classification
Metal cable ladders	Coat back 50 mm ≥ 1 mm WFT Multimastic C	EI 60, E 90
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 80 mm		
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 45, E 90
Non sheathed cables ≤ Ø 24 mm		EI 60 U/C, E 90 U/C
Plastic conduits ≤ Ø 16 mm		EI 45 C/U, E 60 C/U
Copper conduits ≤ Ø 16 mm		EI 60 C/U
Steel conduits ≤ Ø 16 mm		

A.1.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits

A.1.1.2 Cables, trays and conduits - Multimastic C - 150 mm

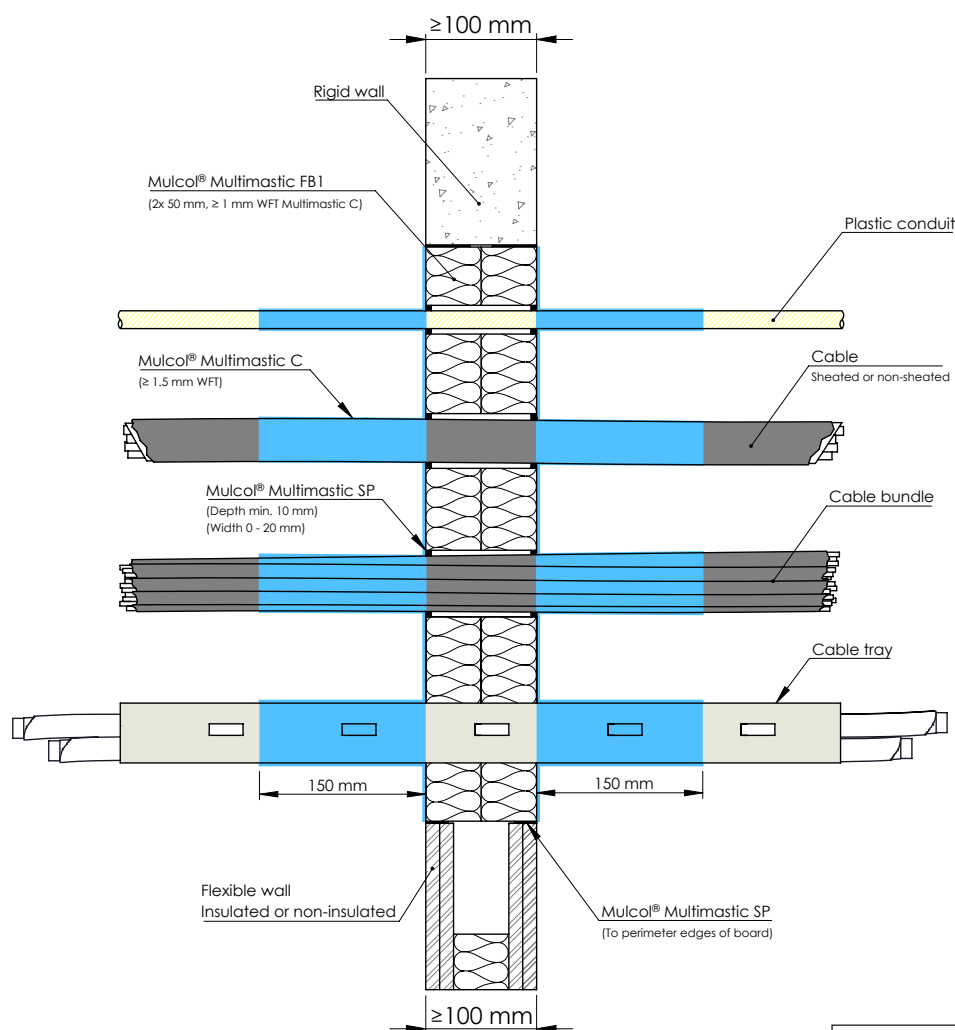

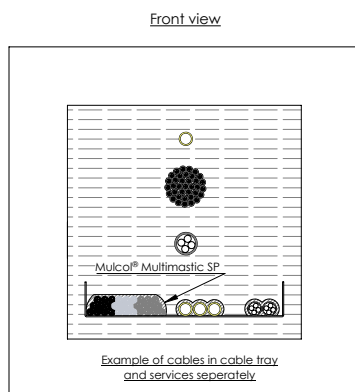


Drawing: PBfw.E-CT-4-MFB1.2.10

Services	Coating	Classification
Metal cable ladders	Coat back 150 mm ≥ 1.5 mm WFT Multimastic C	EI 90, E 120
Metal (non-)perforated cable trays		EI 120
Steel wire mesh cable trays (baskets)		EI 90, E 120
Cables ≤ Ø 80 mm		EI 60, E 120
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 120 U/C
Non sheathed cables ≤ Ø 24 mm		EI 45 C/U, E 90 C/U
Plastic conduits ≤ Ø 16 mm		EI 90 C/U
Copper conduits ≤ Ø 16 mm		
Steel conduits ≤ Ø 16 mm		

A.1.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits

A.1.1.3 Cables and trays - Multitherm Bandage

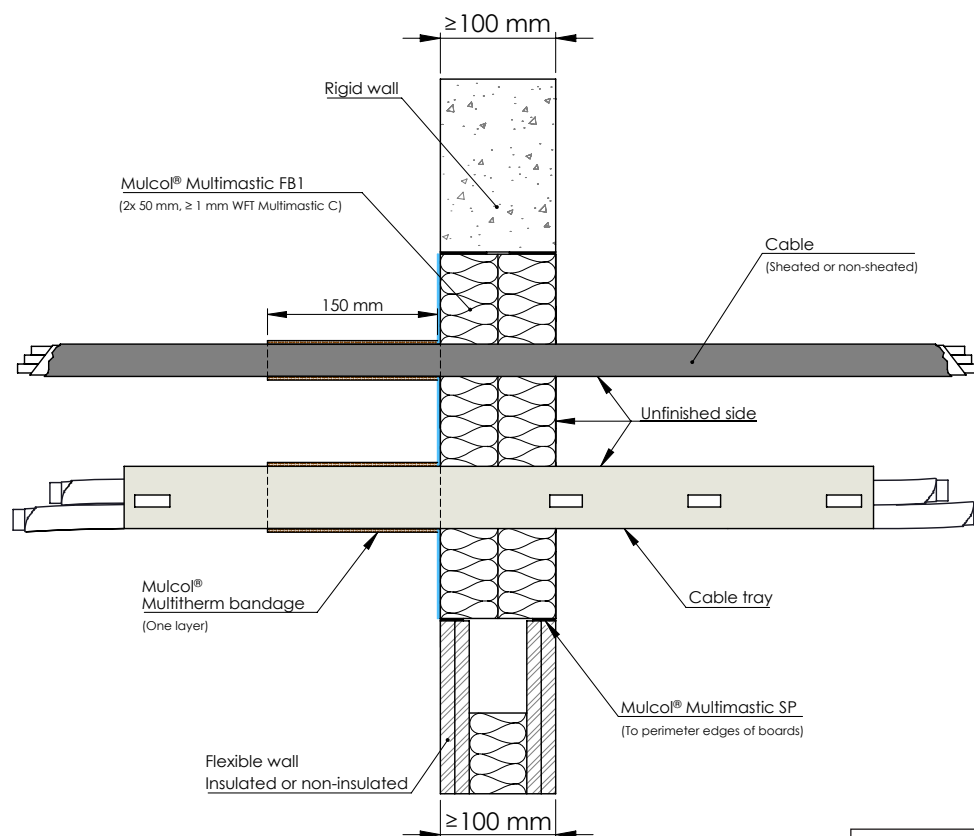




Drawing: PBfw.E-CT-2-MFB1-B1.3.10

Services	Insulation (mm)	Classification
Metal (non-)perforated cable trays	LI 150 - Multitherm Bandage either side	EI 120
Steel wire mesh cable trays (baskets)		
Cables $\leq \varnothing 21$ mm		

A.1.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits

A.1.1.4 Cables and trays - Multifoam 2K

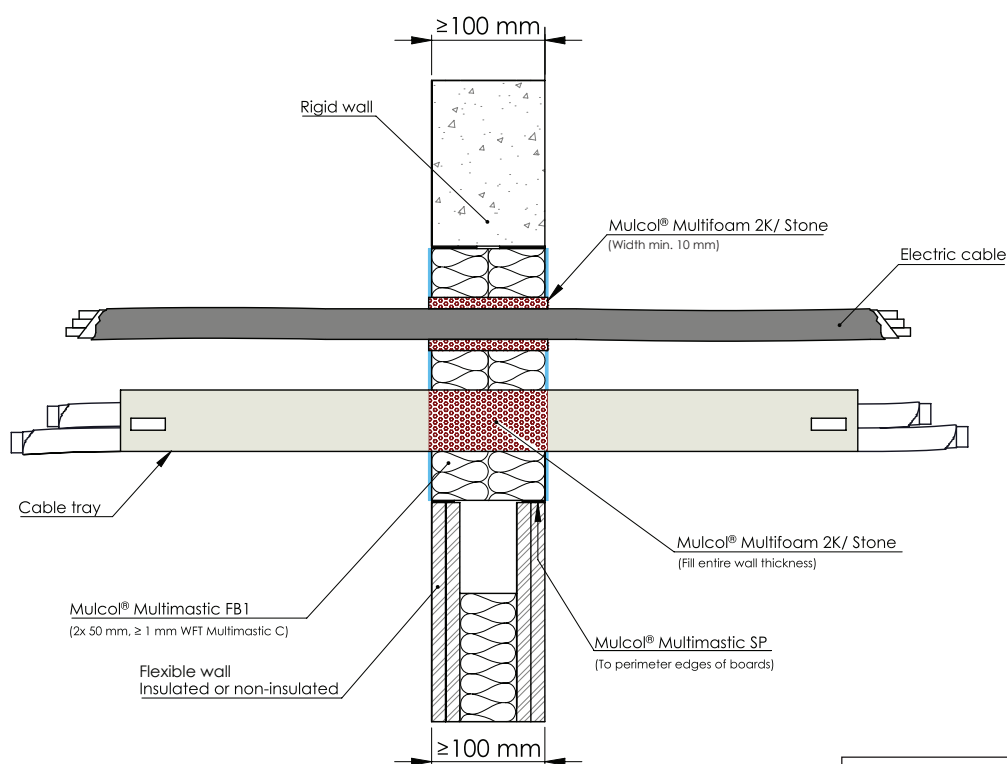

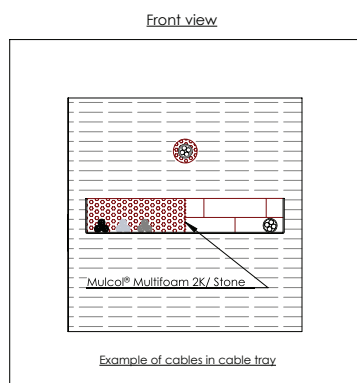


Drawing: PBfw.E-CT-2-MF-MFB1.2.10

Services	Sealing (mm)	Classification
Metal (non-)perforated cable trays	Multifoam 2K / Stone ≥ 0 x 100 (w x d)	EI 120
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 21 mm	Multifoam 2K / Stone ≥ 10 x 100 (w x d)	EI 60, E 120

A.1.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits

A.1.1.5 Single plastic conduits - Multidisc

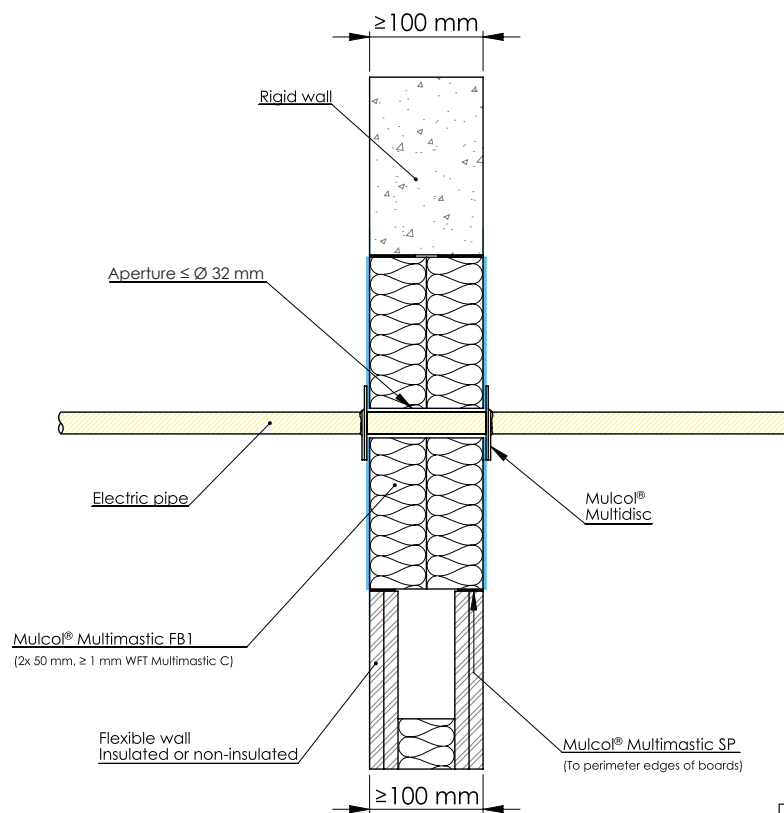

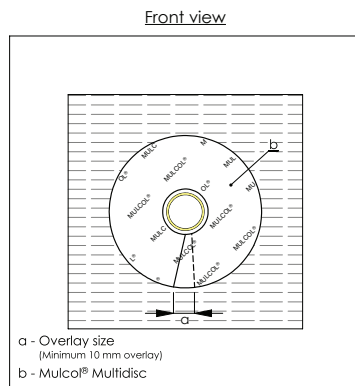


Drawing: PBfw.E-EP-M2.0.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Plastic conduits ≤ Ø 25 mm, with or without cables	Multidisc	≤ Ø 32	Not required	EI 90 U/U E 120 U/U

A.1.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits

A.1.1.6 Multiple plastic conduits - Multidisc

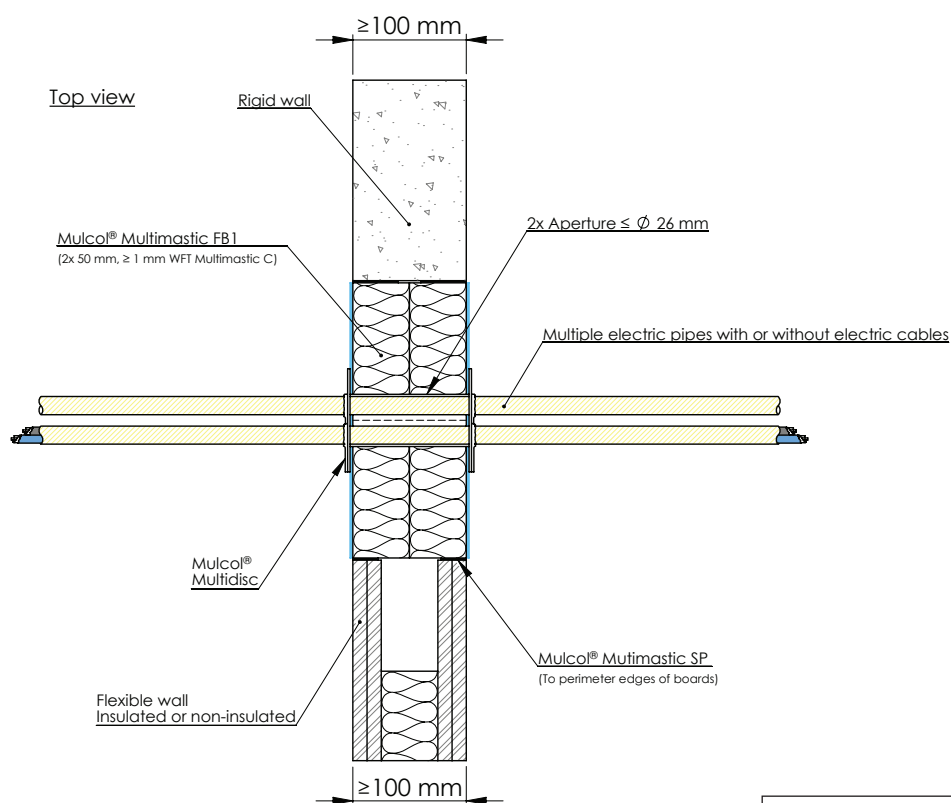

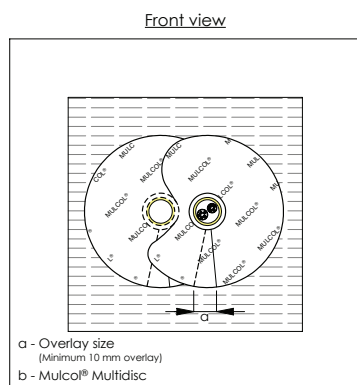


Drawing: PBfw.E-EPs-M2.0.30

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Multiple plastic conduits $\leq \varnothing 16$, up to 5 pcs. with or without cables	Multidisc	$\leq \varnothing 32$	Not required	EI 90 U/U E 120 U/U

A.1.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits

A.1.1.7 Single plastic conduits - Multisealant GR

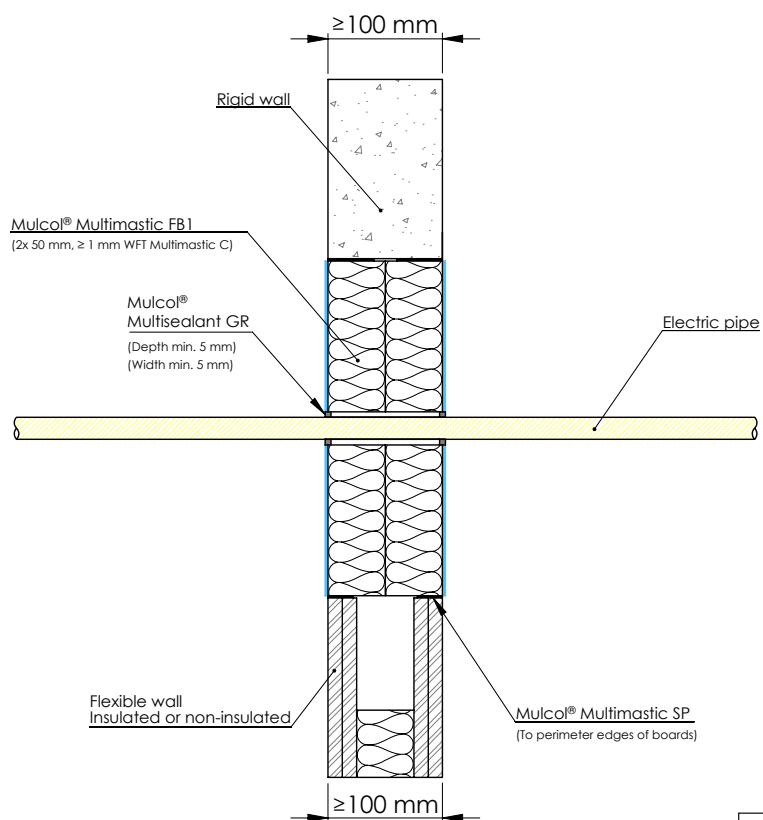

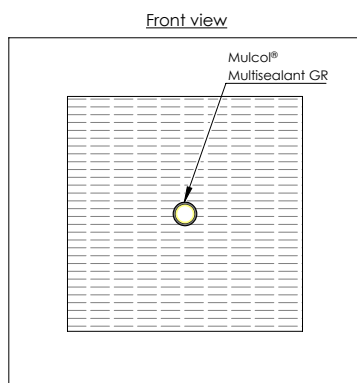


Drawing: PBfw.E-EP-MFB1-G2.0.10

Services	Sealing (mm)	Classification
Plastic conduits ≤ Ø 19 mm, with or without cables	Multisealant GR ≥ 5 x 5 (wxd)	EI 60 U/U, E 90 U/U

A.1.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits

A.1.1.8 Multiple plastic conduits - Multisealant GR

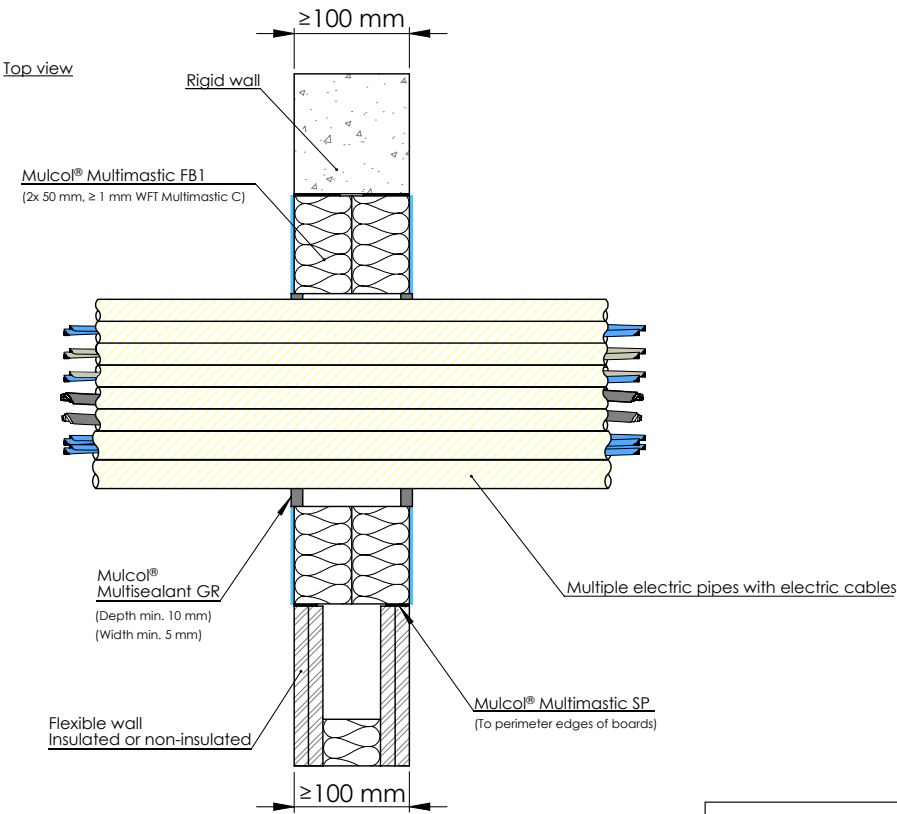

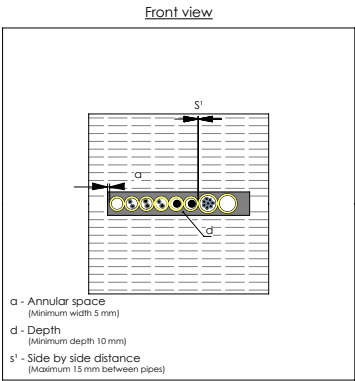


Drawing: PBfw.E-EP8-G2.1.10

Services	Sealing (mm)	Classification
Plastic conduits ≤ Ø 25 mm, with or without cables, max 8 pcs.	Multisealant GR ≥ 5 x 10 (wxd)	EI 90 U/U

A.1.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits

A.1.1.9 Single cables - Multidisc

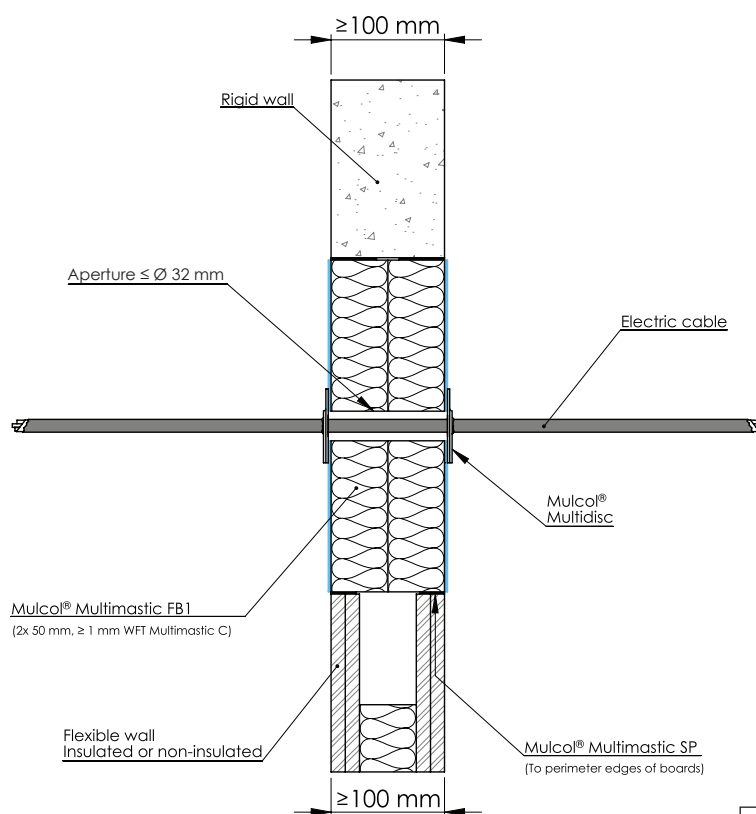

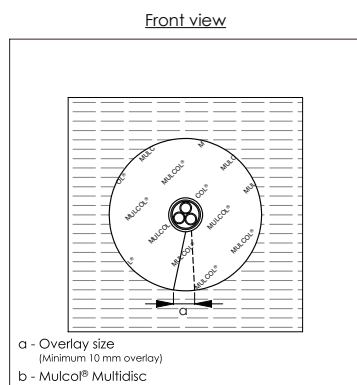


Drawing: PBfw.E-EC-M2.0.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Single electrical cables $\leq \varnothing 21$ mm	Multidisc	$\leq \varnothing 32$	Not required	EI 90

A.1.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits

A.1.1.10 Multiple cables - Multidisc

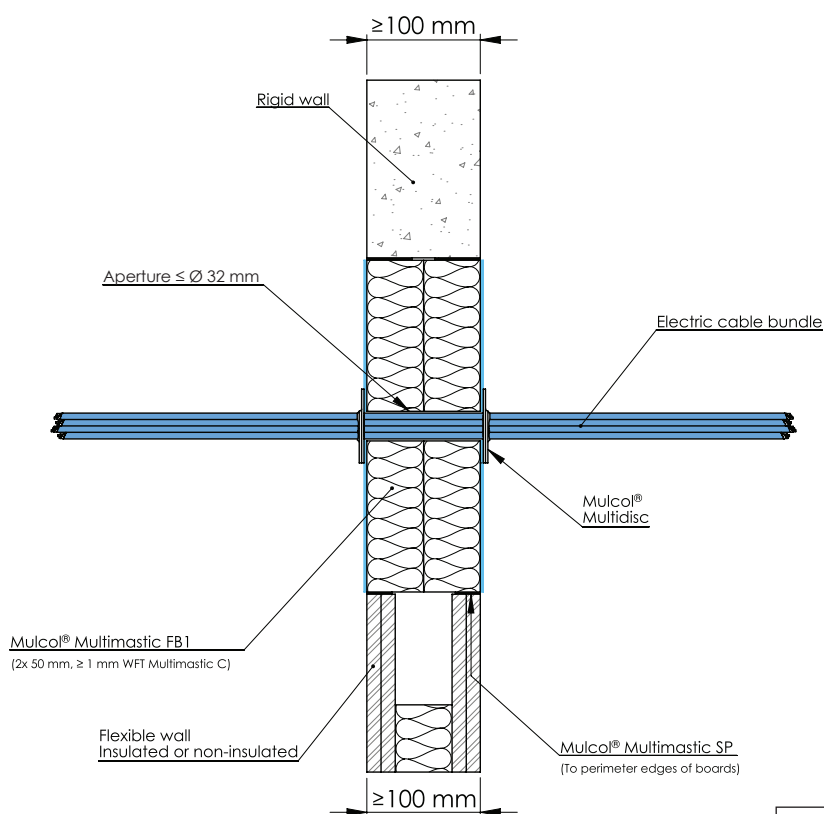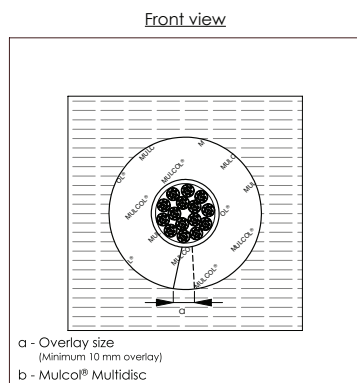

Drawing: PBfw.E-ECB-M2.0.10



Services	Product	Aperture (mm)	Sealing (mm)	Classification
Multiple electrical / telecommunication cables max. 15 pcs., max. $\leq \varnothing 25$	Multidisc	$\leq \varnothing 32$	Not required	EI 60, E 120

A.1.2

Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Cables, trays and conduits

A.1.2.1

Cables, trays and conduits - Multimastic C

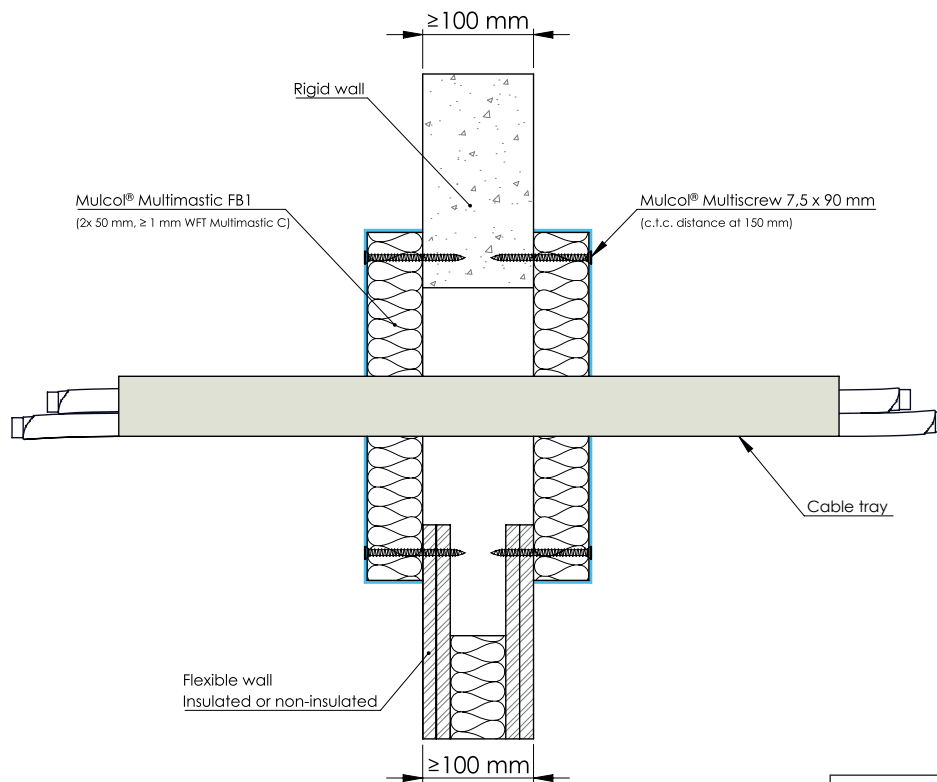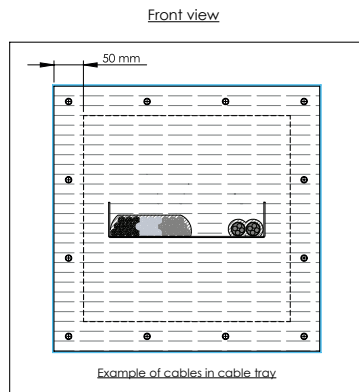

Drawing: PBfw.E-CT-MFB1.2.10



Services	Coating	Classification
Metal cable ladders	Not required	EI 90, E 120
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 21 mm		EI 60, E 120

A.1.2

Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Cables, trays and conduits

A.1.2.2

Single plastic conduits - Multidisc

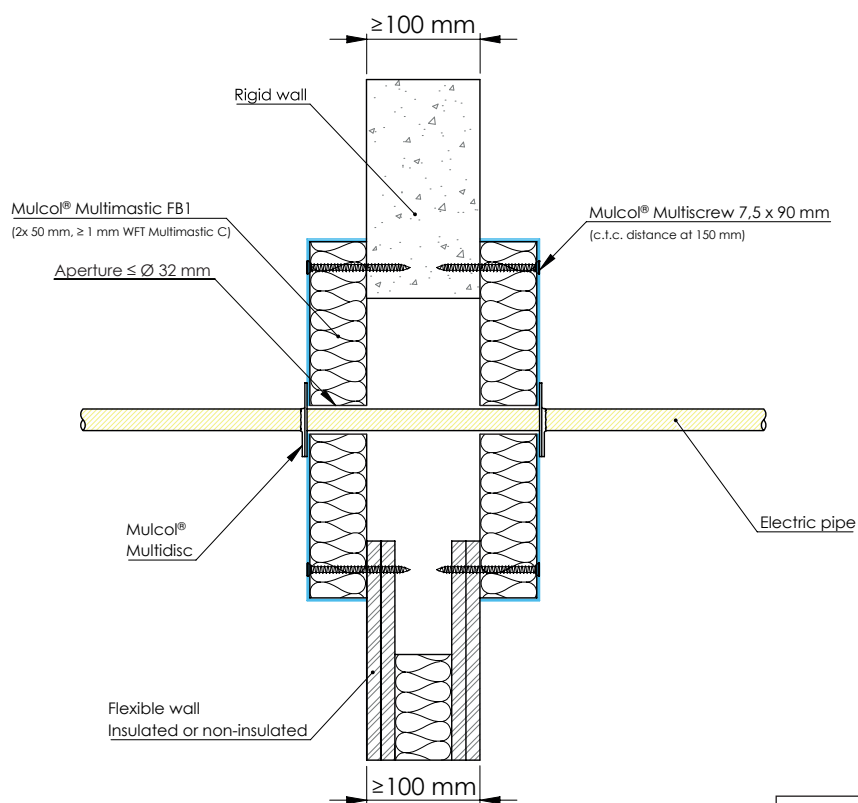
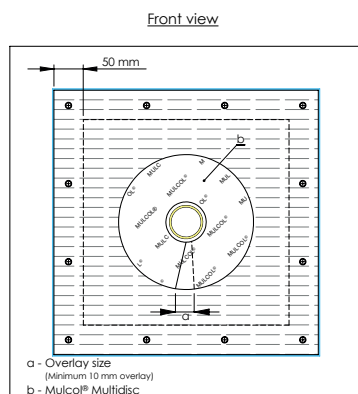


Drawing: PBPfw.E-EP-M2.0.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Plastic conduits ≤ Ø 19 mm, with or without cables	Multidisc	≤ Ø 32	Not required	EI 120 U/U
Plastic conduits ≤ Ø 25 mm, with or without cables				EI 90 U/U E 120 U/U

Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Cables, trays and conduits

A.1.2.3 Single cables - Multidisc

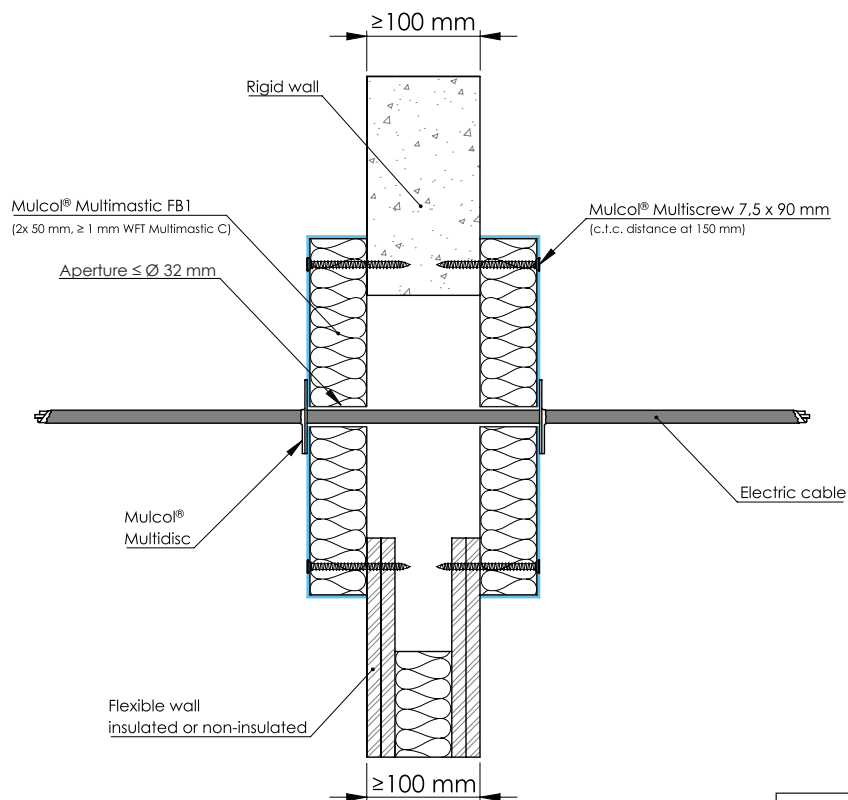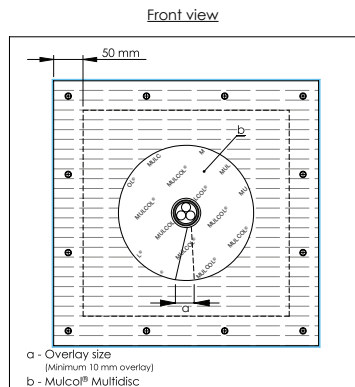

Drawing: PBfw.E-EC-M2.0.10



Services	Product	Aperture (mm)	Sealing (mm)	Classification
Single electrical cables $\leq \varnothing 16$ mm	Multidisc	$\leq \varnothing 32$	Not required	EI 60, E 90

A.1.2

Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Cables, trays and conduits

A.1.2.4

Multiple cables - Multidisc

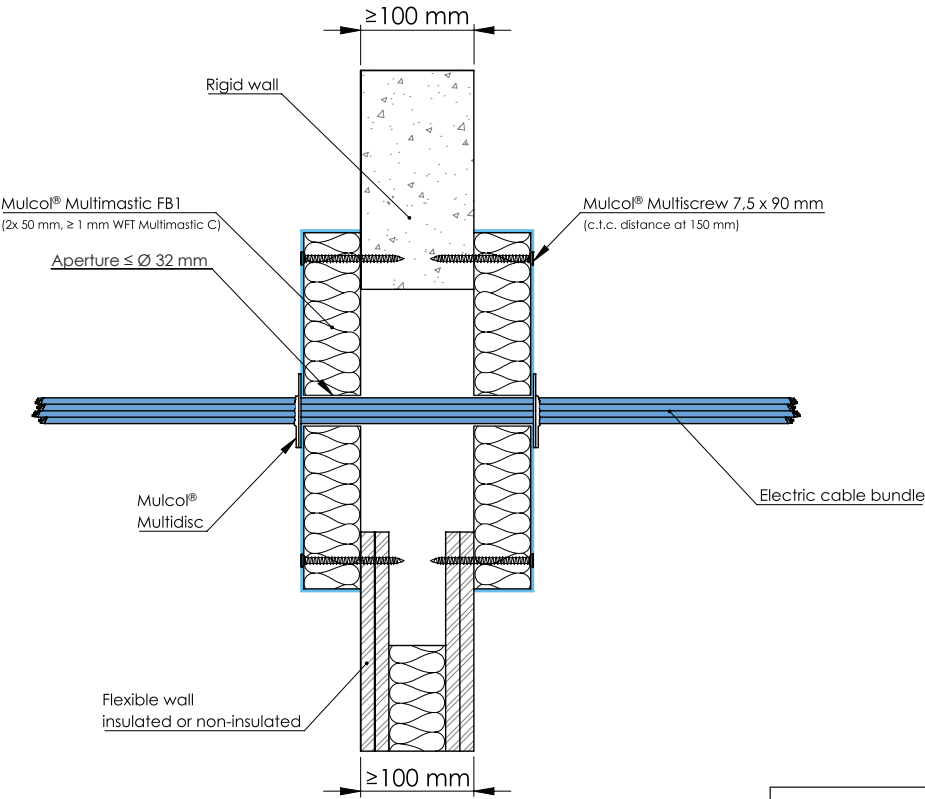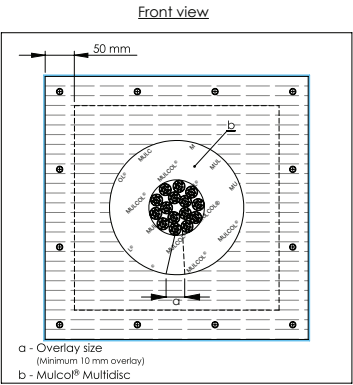


Drawing: PBfw.E-ECB-M2.0.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Multiple electrical / telecommunication cables max. 15 pcs., max. ≤ Ø 25	Multidisc	≤ Ø 32	Not required	EI 60, E 120

A.1.3 Multimastic FB2 - 1x 60 mm - Cables, trays and conduits




A.1.3.1 Cables, trays and conduits - Multimastic C

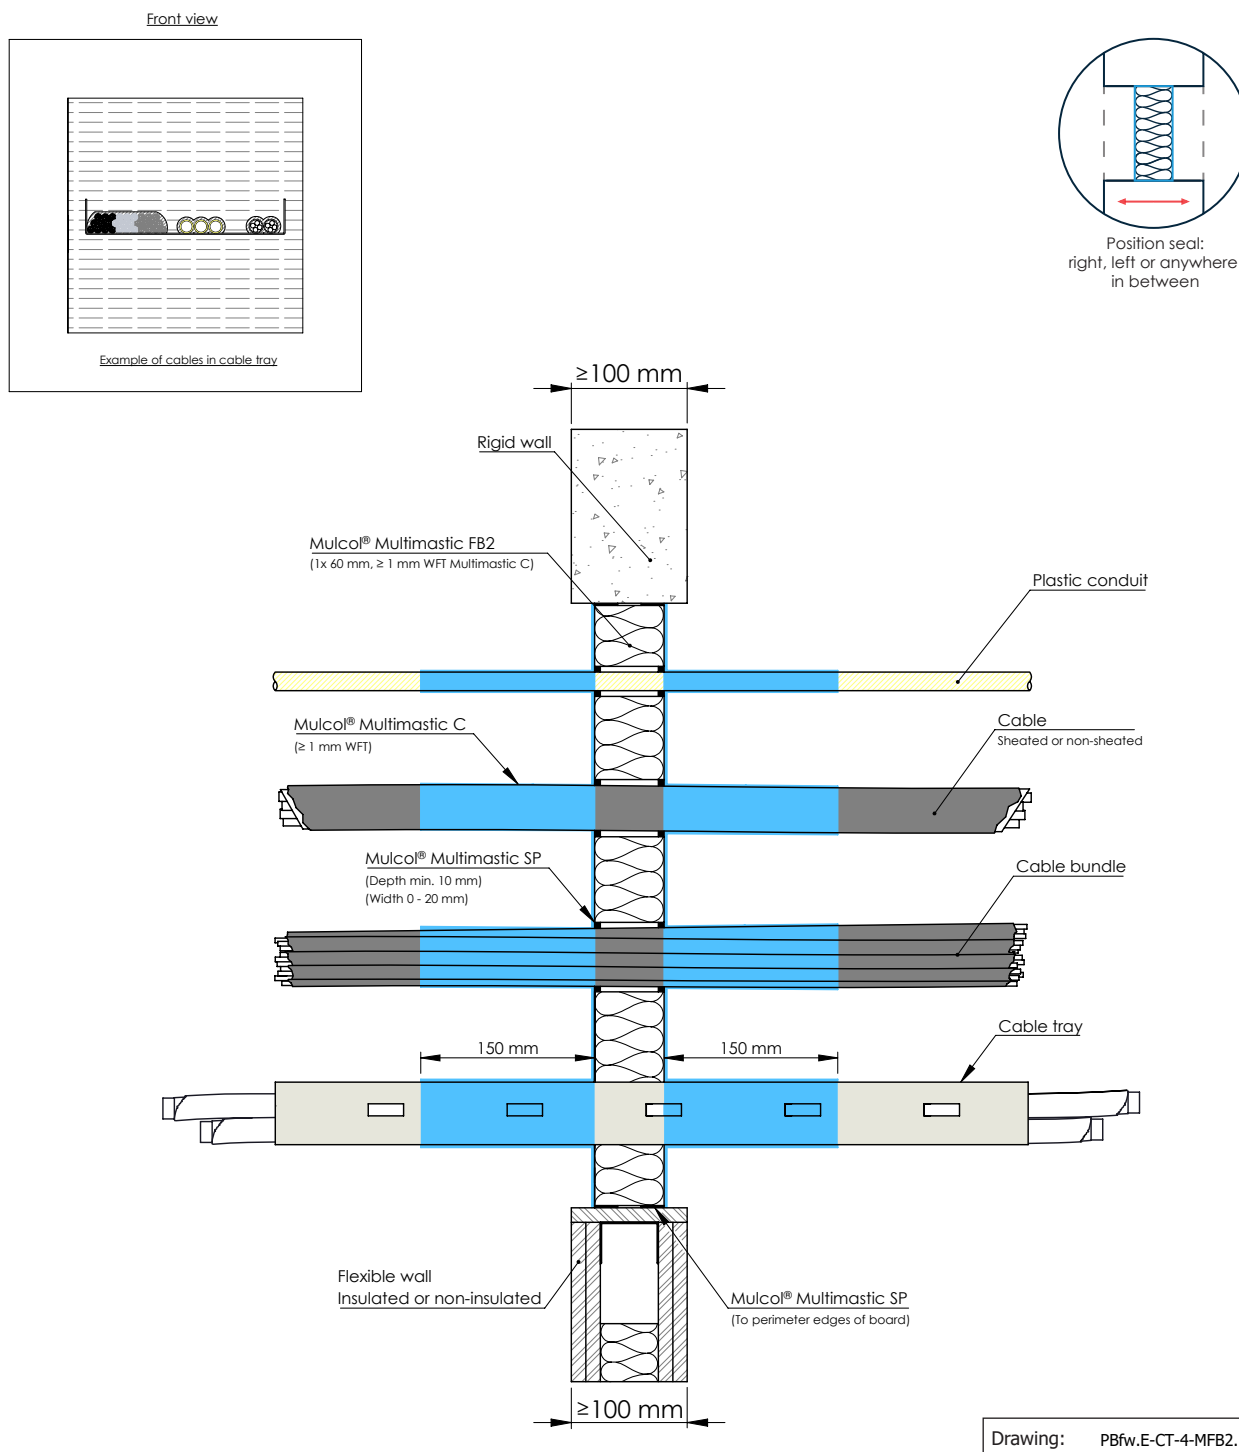

Services	Coating	Classification
Metal cable ladders	Coat back 150 mm ≥ 1 mm WFT	EI 60, E 90
Metal (non-)perforated cable trays		EI 60
Steel wire mesh cable trays (baskets)		EI 60, E 90
Cables ≤ Ø 80 mm		EI 45, E 90
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 60 U/C, E 90 U/C
Non sheathed cables ≤ Ø 24 mm		EI 45 C/U, E 60 C/U
Plastic conduits ≤ Ø 16 mm		EI 60 C/U
Copper conduits ≤ Ø 16 mm		
Steel conduits ≤ Ø 16 mm		

A.1.3 Multimastic FB2 - 1x 60 mm - Cables, trays and conduits

A.1.3.2 Single plastic conduits - Multidisc

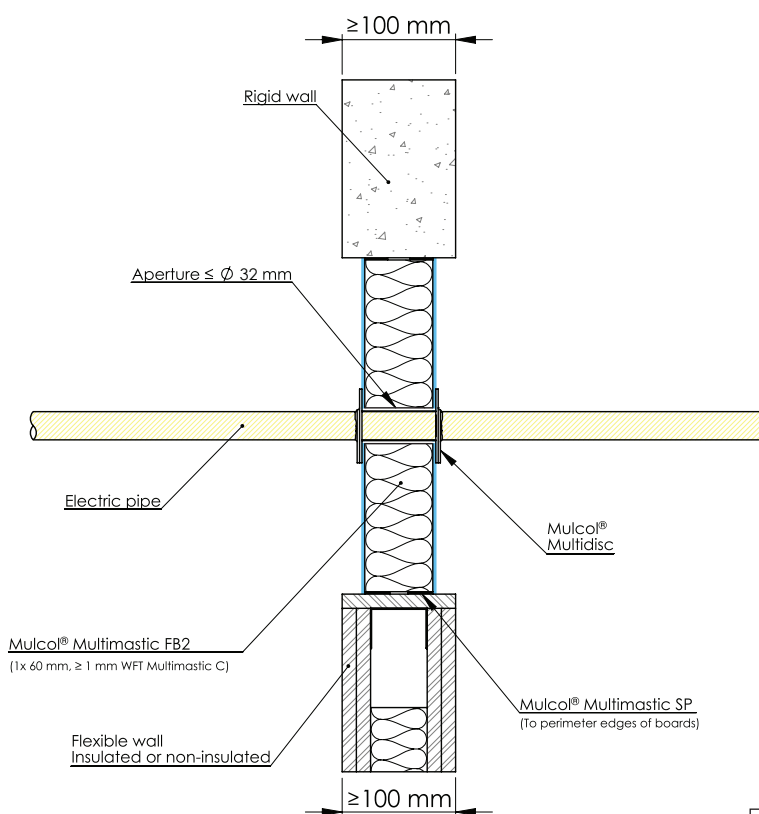

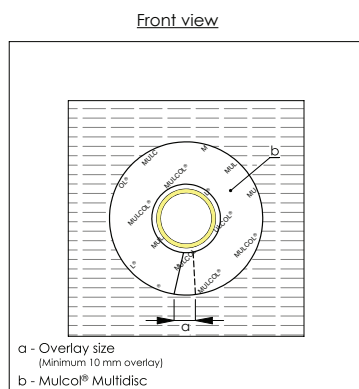


Drawing: PBfw.E-EP-M2-MFB2.1.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Plastic conduits $\leq \varnothing 25$ mm, with or without cables	Multidisc	$\leq \varnothing 32$	Not required	EI 60 U/U, E 90 U/U

A.1.3 Multimastic FB2 - 1x 60 mm - Cables, trays and conduits

A.1.3.3 Single plastic conduits - Multisealant GR

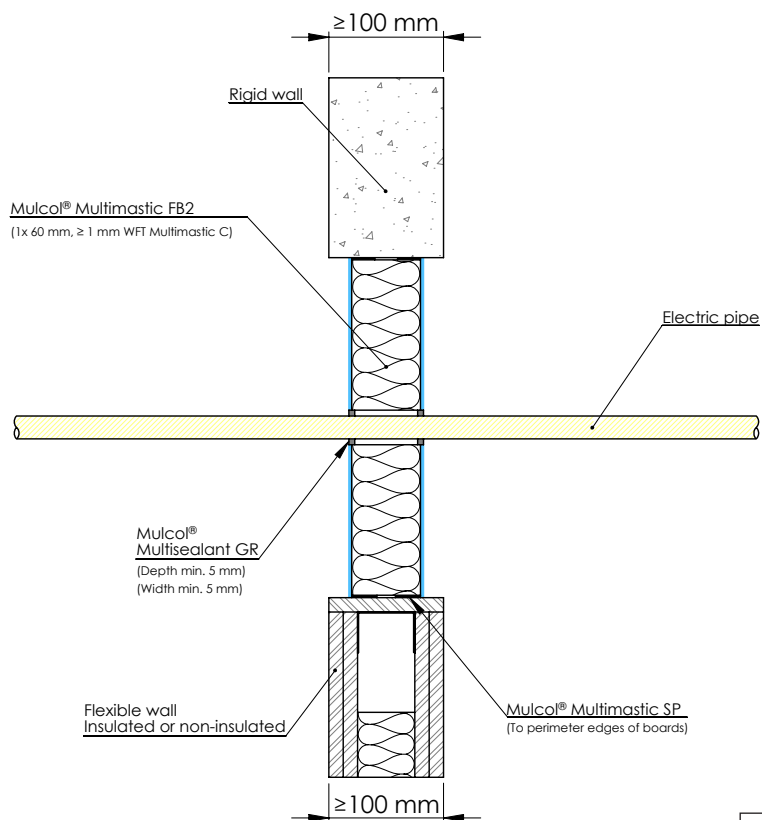




Drawing: PBfw.E-EP-MFB2-G2.0.10

Services	Sealing (mm)	Classification
Plastic conduits ≤ Ø 19 mm, with or without cables	Multisealant GR ≥ 5 x 5 (wxd)	EI 60 U/U, E 90 U/U

A.1.3 Multimastic FB2 - 1x 60 mm - Cables, trays and conduits

A.1.3.4 Single cables - Multidisc

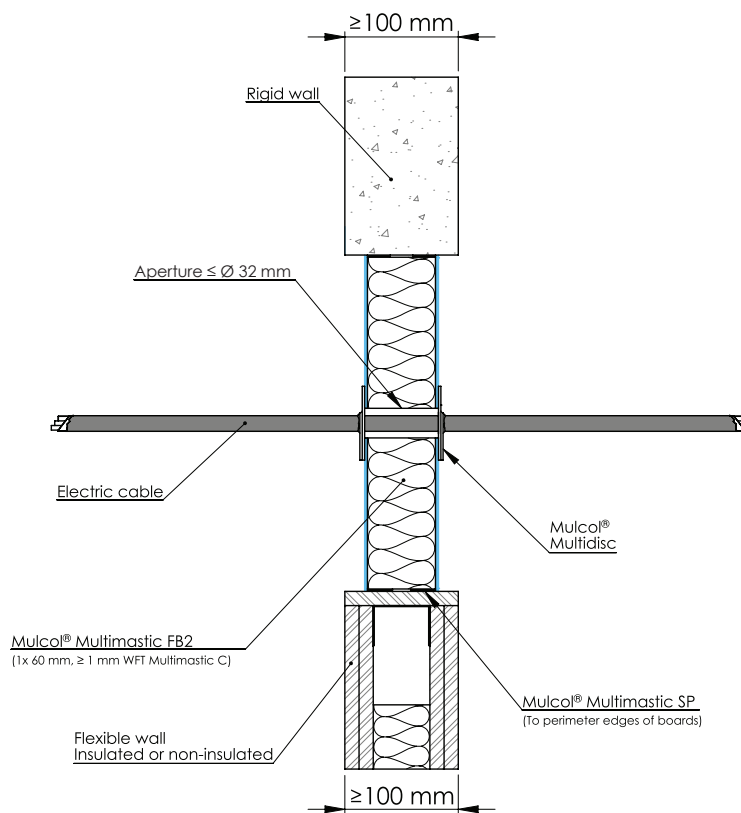

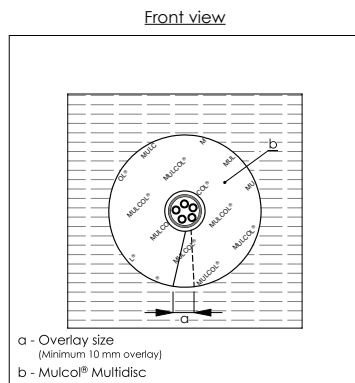


Drawing: PBfw.E-EC-M2-MFB2.1.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Single electrical cables $\leq \varnothing 21$ mm	Multidisc	$\leq \varnothing 32$	Not required	EI 60, E 90

A.1.3 Multimastic FB2 - 1x 60 mm - Cables, trays and conduits

A.1.3.5 Multiple cables - Multidisc

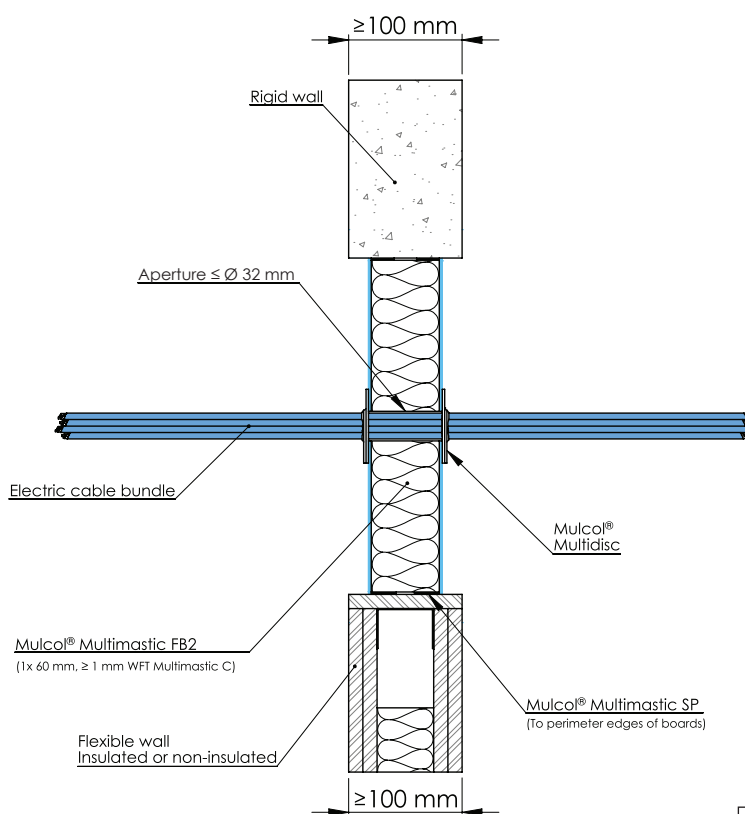

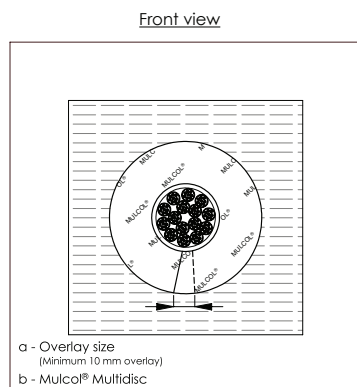


Drawing: PBfw.E-ECB-M2-MFB2.1.10

Services	System	Aperture (mm)	Sealing (mm)	Classification
Multiple electrical / telecommunication cables $\leq \varnothing 25$ mm	Multidisc	$\leq \varnothing 32$	Not required	EI 45, E 90

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.1.4.1 Plastic pipes - Multicollar *Slim*

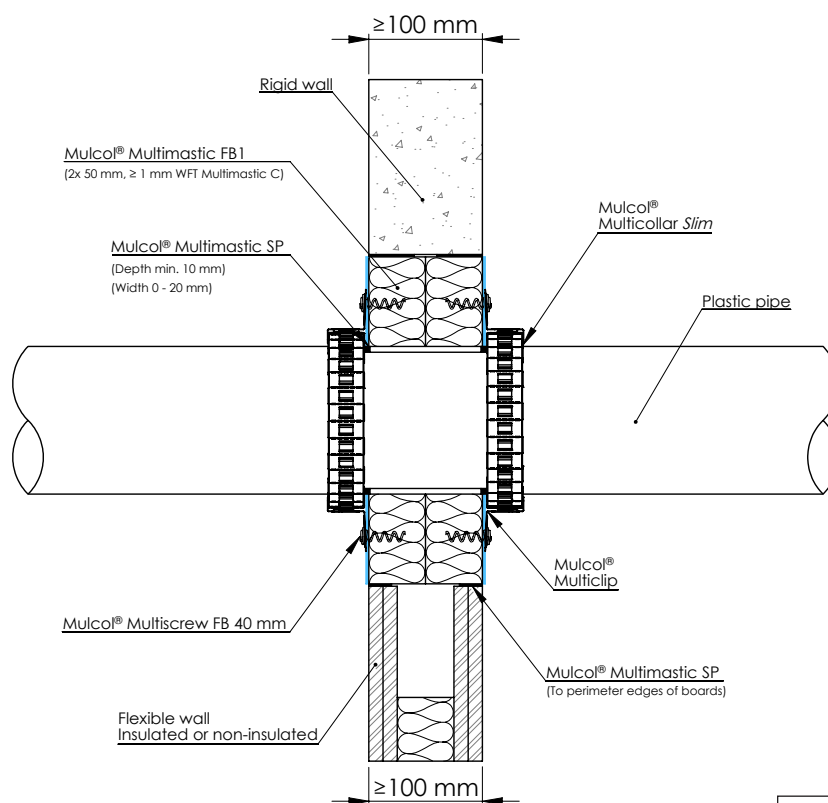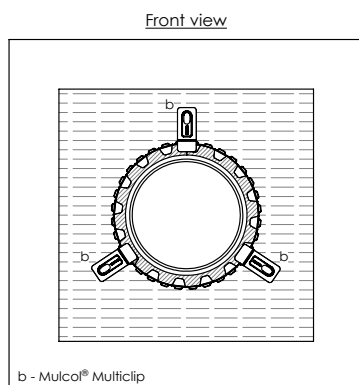

Drawing: PBfw.E-MC30-PP-MFB1.2.10




Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 40	2.3 - 9.3	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 60 U/U
PP					
PVC(-U/-C)					
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	2.7 - 6.6			EI 120 U/U
		6.6 - 9.3			EI 60 U/U
		2.7			EI 120 U/U
PP		2.7 - 9.3			EI 60 U/U
		2.7			EI 120 U/U
PVC(-U/-C)		2.7 - 9.3			EI 60 U/U

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes**A.1.4.1 Plastic pipes - Multicollar *Slim***

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 125	3.1 - 9.3	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 60 U/U
PP					
PVC(-U/-C)	≤ Ø 160	4.0 - 9.5			EI 60 U/C
PE(-HD) / PE-X / ABS / SAN+PVC		4.0 - 9.1			
PP					

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.1.4.1 Plastic pipes - Multicollar *Slim*

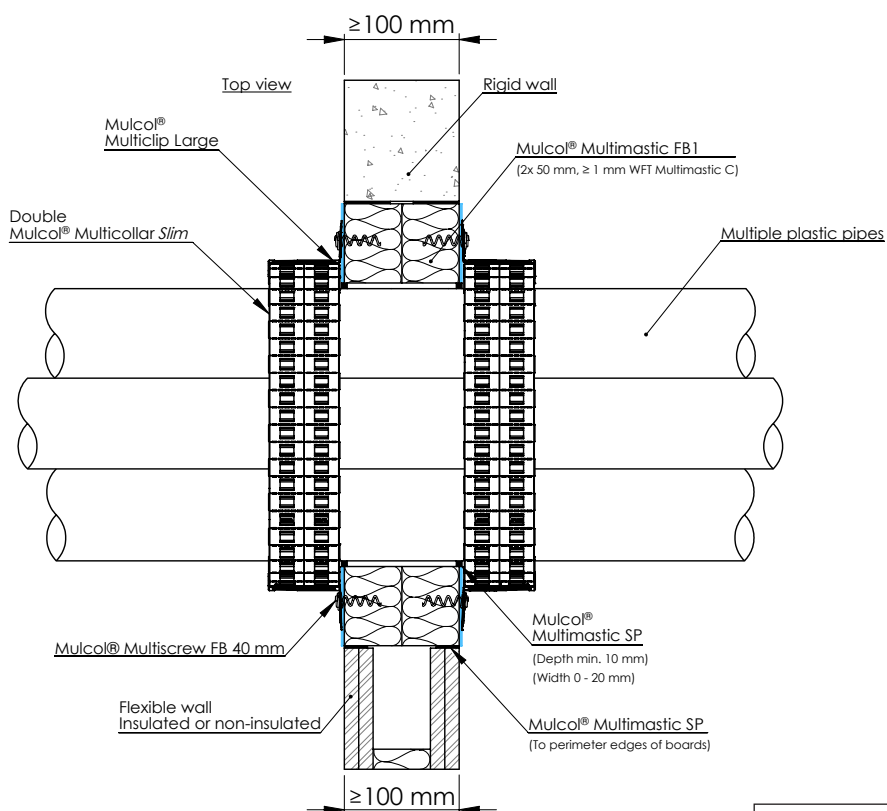

Drawing: PBfw.E-MLP3-20.0.10



Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	$3x \leq \varnothing 110$	2.7	Multicollar <i>Slim</i> Double	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 90 U/C, E 120 U/C

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes


A.1.4.2 Plastic pipes perpendicular to 45° - Multicollar *Slim*

Front view

- a - Annular space
(Maximum 15 mm between pipe and Mulcol® Multicollar *Slim*)
b - Mulcol® Multiclip

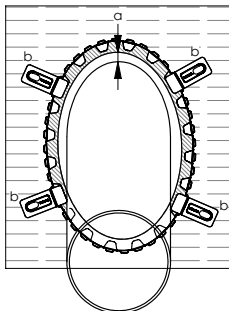

Position seal:
right, left or anywhere
in between



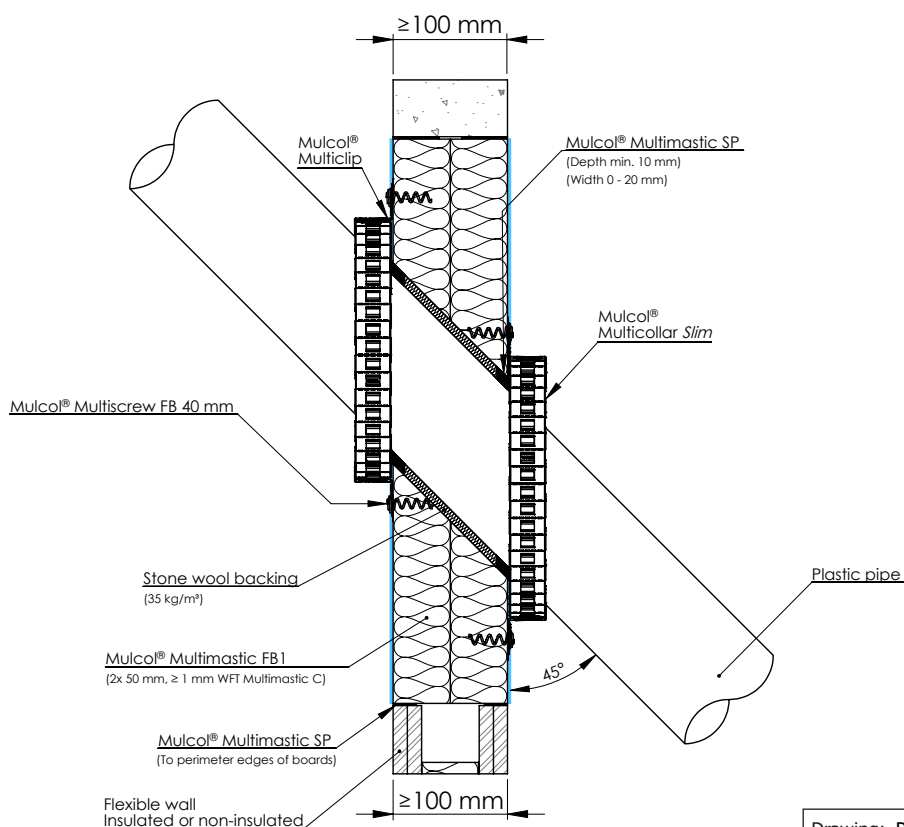


Drawing: PBfw.E-PP-MFB1-10.1.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	2.7	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 60 U/U, E 90 U/U
PP					
PVC(-U/-C)					

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.1.4.3 Plastic pipes - Multiwrap

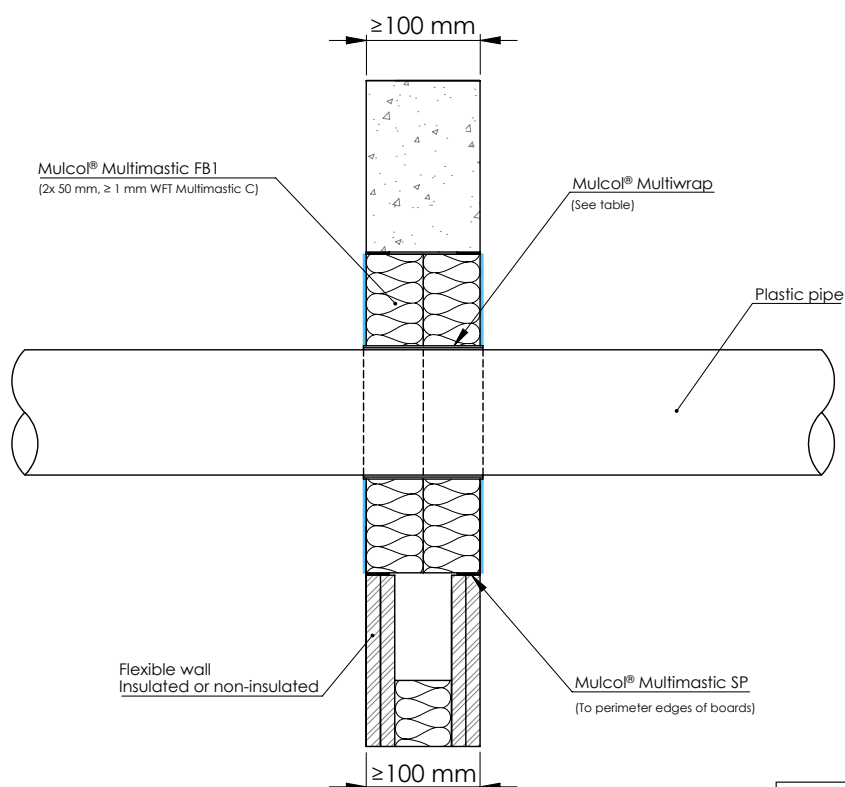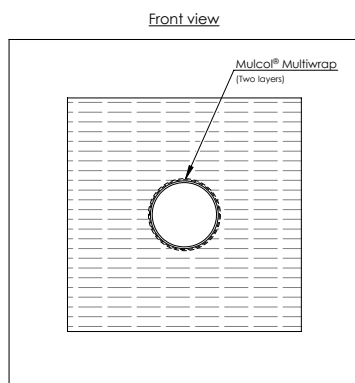

Drawing: PBfw.E-PP-MW2-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 40	2.3 - 3.7	Multiwrap (2 layers)	EI 120 U/U
	≤ Ø 110	2.7 - 10		EI 120 U/C
PP	≤ Ø 40	2.3 - 3.7		EI 120 U/U
		5.5		EI 120 U/C
	≤ Ø 110	3.4		EI 120 U/C
PVC(-U/-C)	≤ Ø 40	1.8 - 3.7		EI 120 U/U
	≤ Ø 110	1.6		E 120 U/C, EI 90 U/C
		1.6 - 8.1		EI 90 U/C

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes**A.1.4.3 Plastic pipes - Multiwrap**


Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PE(-HD) / PE / ABS / SAN+PVC	≤ Ø 125	3.9	Multiwrap (3 layers)	EI 120 U/C
		3.9 - 4.8		EI 90 U/C, E 120 U/C
PP		3.1		EI 120 U/C
		3.1 - 11.4		EI 90 U/C, E 120 U/C
PVC(-U/-C)		3.7 - 4.8		

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PP	≤ Ø 110	10.0	Multiwrap (4 layers)	EI 120 U/U
		10.0 - 14.6		EI 90 U/U
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 160	14.6		EI 90 U/C
		5.0		EI 90 U/C, E 120 U/C
PVC(-U/-C)		5.0 - 14.6		EI 90 U/C

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PE(-HD) / PE / ABS / SAN+PVC	≤ Ø 125	11.4	Multiwrap (5 layers)	EI 120 U/U
PVC(-U/-C)		9.2		

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes




A.1.4.4 Plastic pipes with cables - Multiwrap

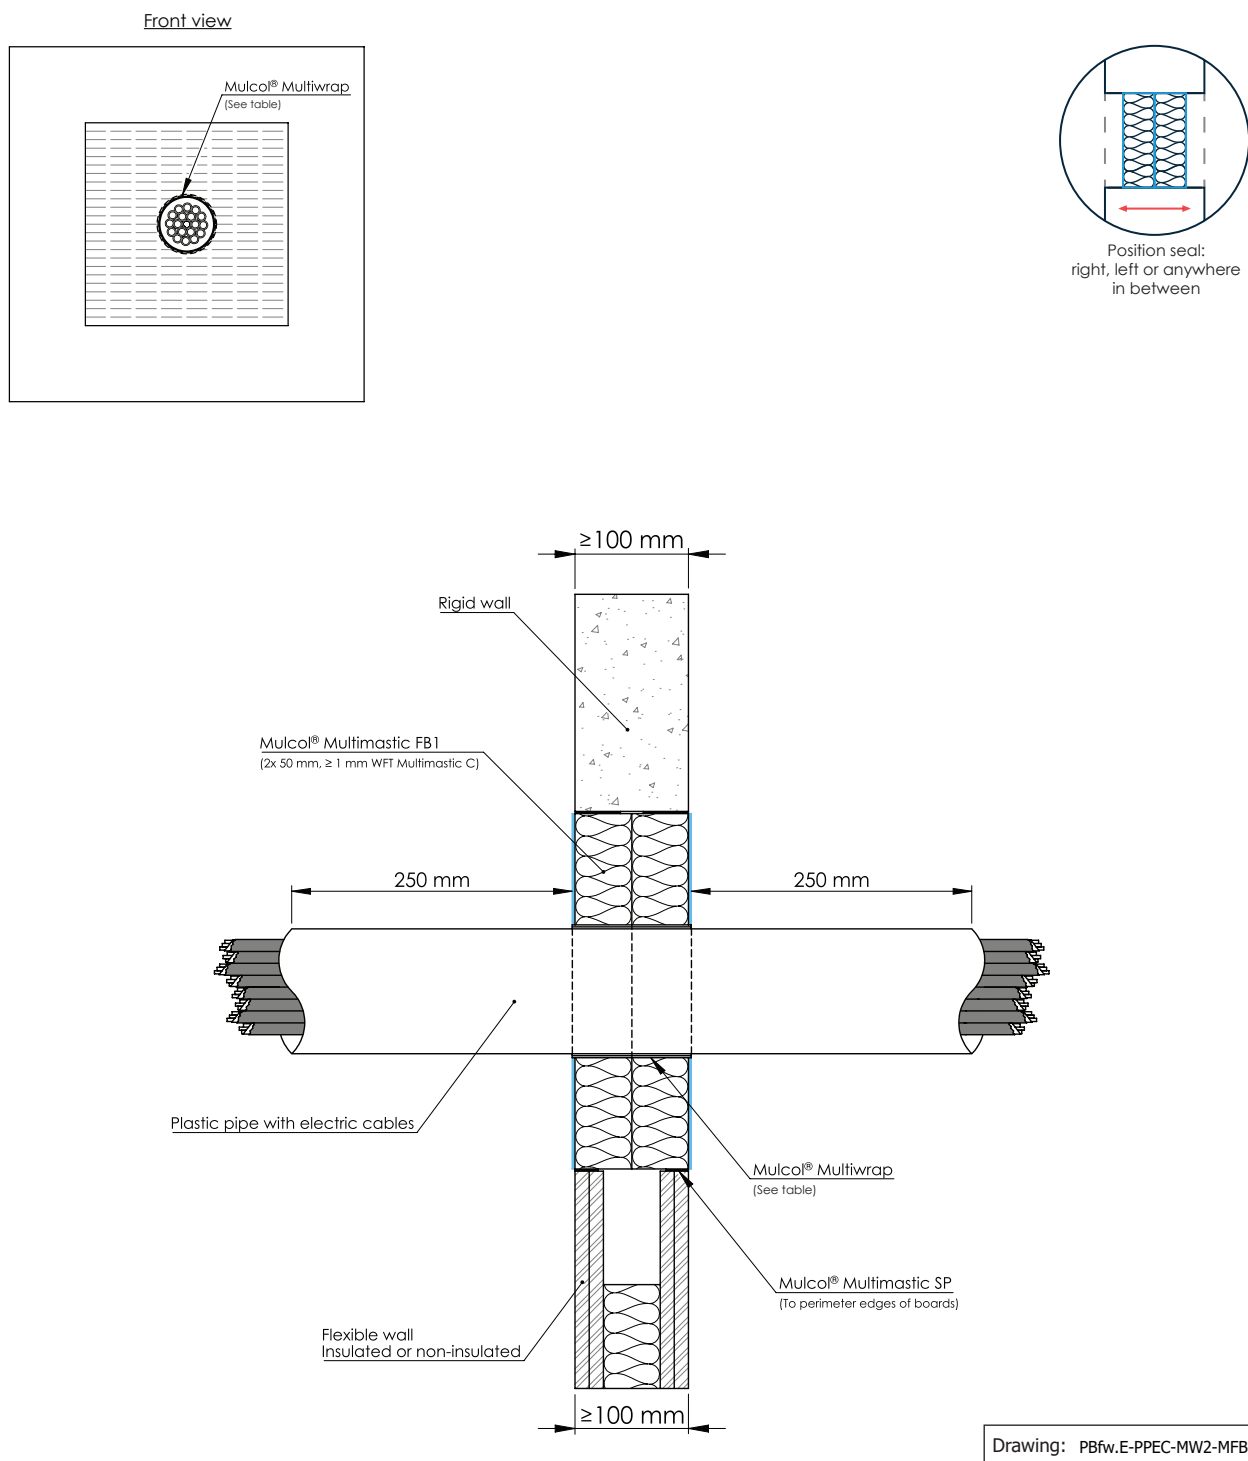

Services	Pipe dimensions (mm)		Product	Allowed Cables	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	2.7 - 10	Multiwrap (2 layers)	Sheathed cables ≤ Ø 80 mm (single or bundled)	EI 90 U/C, E 120 U/C
PP				Cables ≤ Ø 21 mm in a tied bundle	
PVC(-U/-C)				≤ Ø 100 mm	

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.1.4.5 Plastic pipes - Multimastic SP

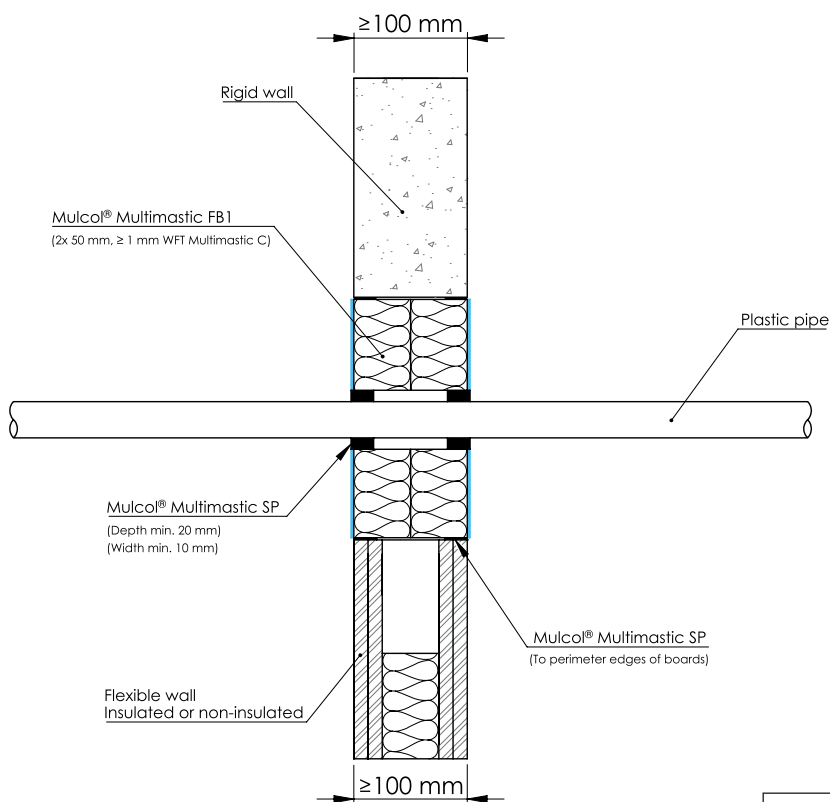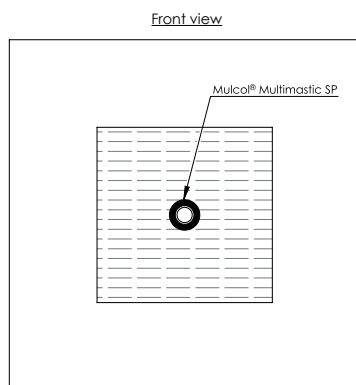


Drawing: PBfw.E-PP-MFB1.2.10

Services	Pipe dimensions (mm)		Sealing (mm)	Classification
	Outer dimension	Wall thickness		
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 32	2.0 - 3.0	Multimastic SP ≥ 10 x 20 (wxd)	EI 60 U/C
PP		2.0 - 5.4		EI 90 U/C
PVC(-U/-C)		2.0 - 3.0		EI 60 U/C

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.1.4.6 Plastic pipes - Multisealant GR



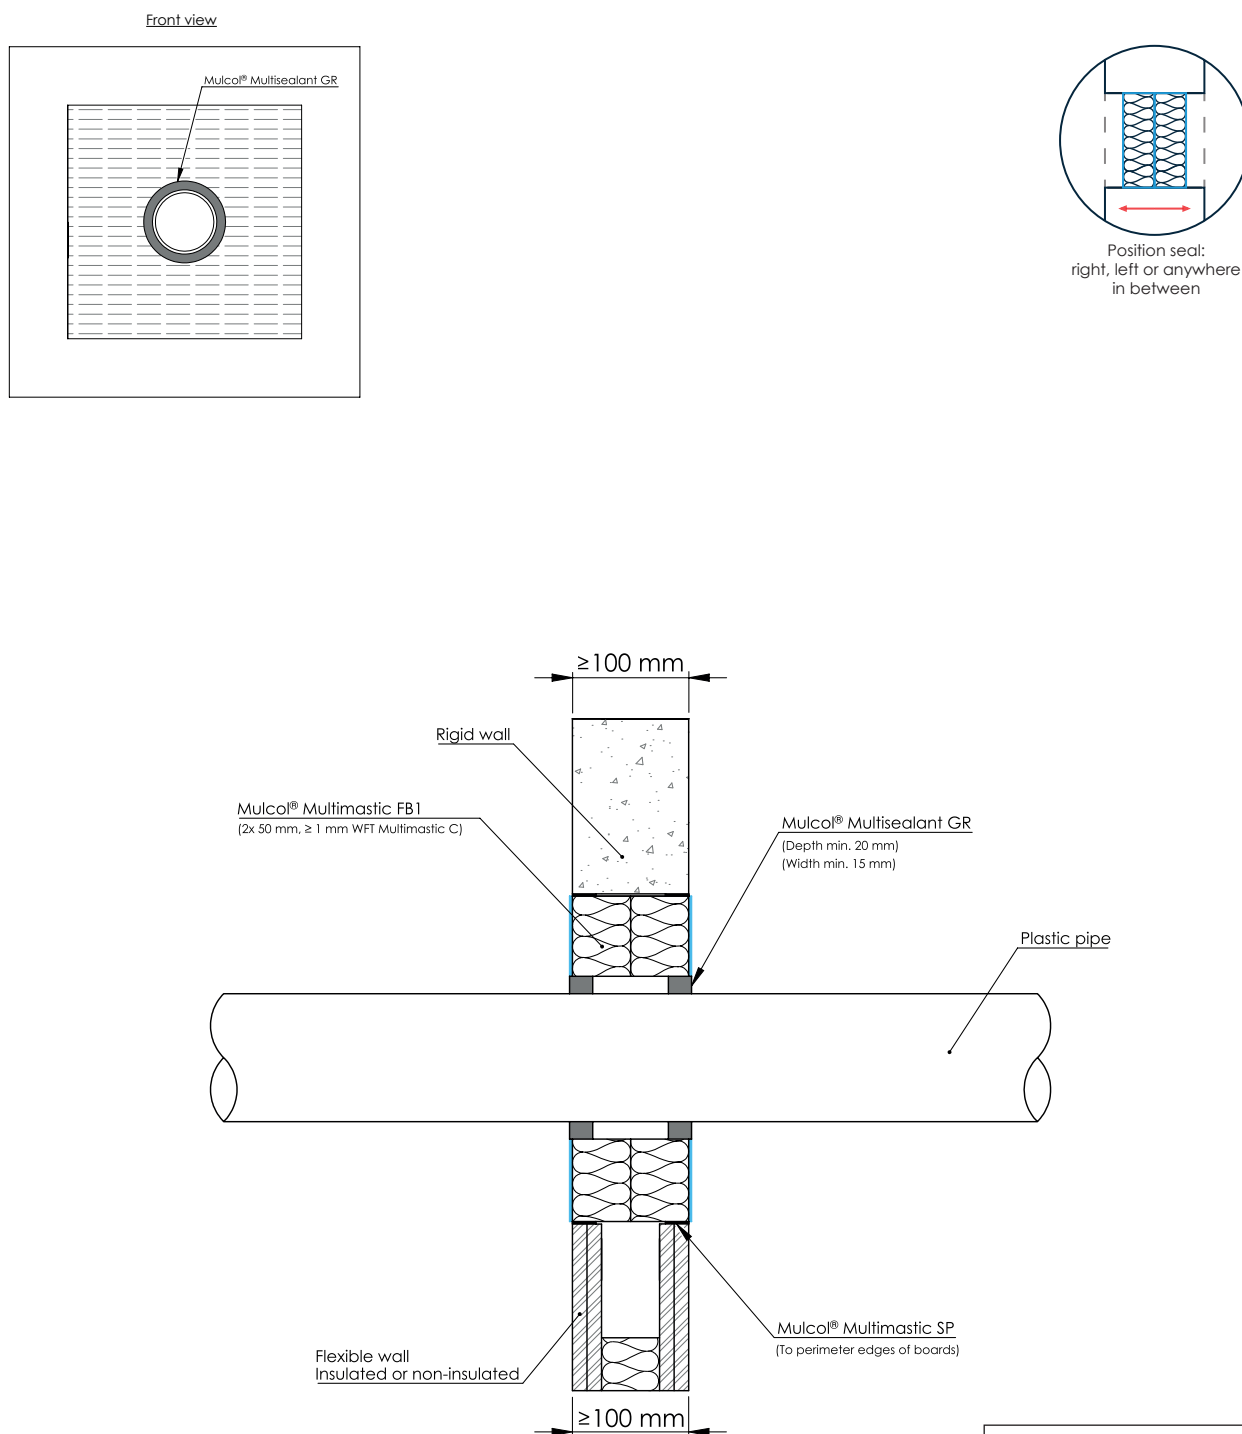


Drawing: PBfw.E-PP-MFB1-G2.4.10

Services	Pipe dimensions (mm)		Sealing (mm)	Classification
	Outer dimension	Wall thickness		
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	2.7 - 10	Multisealant GR ≥ 15 x 20 (wxd)	EI 60 U/C
	≤ Ø 110	10		EI 120 U/C
PP	≤ Ø 110	2.7 - 10		EI 90 U/C, E 120 U/C
	≤ Ø 110	10		EI 120 U/C
PVC(-U/-C)	≤ Ø 32	1.8	Multisealant GR ≥ 10 x 20 (wxd)	EI 120 U/U
	≤ Ø 50	3		EI 60 U/U
	≤ Ø 110	2.7 - 10	Multisealant GR ≥ 15 x 20 (wxd)	EI 60 U/C
	≤ Ø 110	10		EI 120 U/C

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.1.4.7 Plastic pipes (Silent) - Multicollar *Slim*

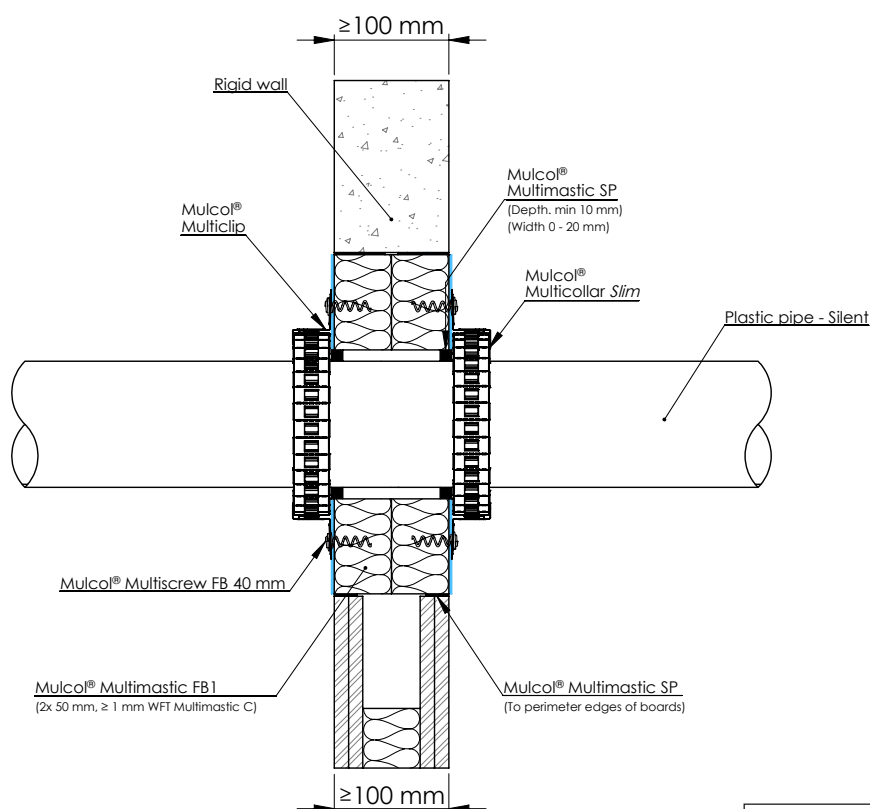


Drawing: PBfw.E-MC30-PPS-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Geberit Silent dB20	≤ Ø 110	6.0	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 60 U/U

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.1.4.8 Plastic pipes (Silent) - Multiwrap

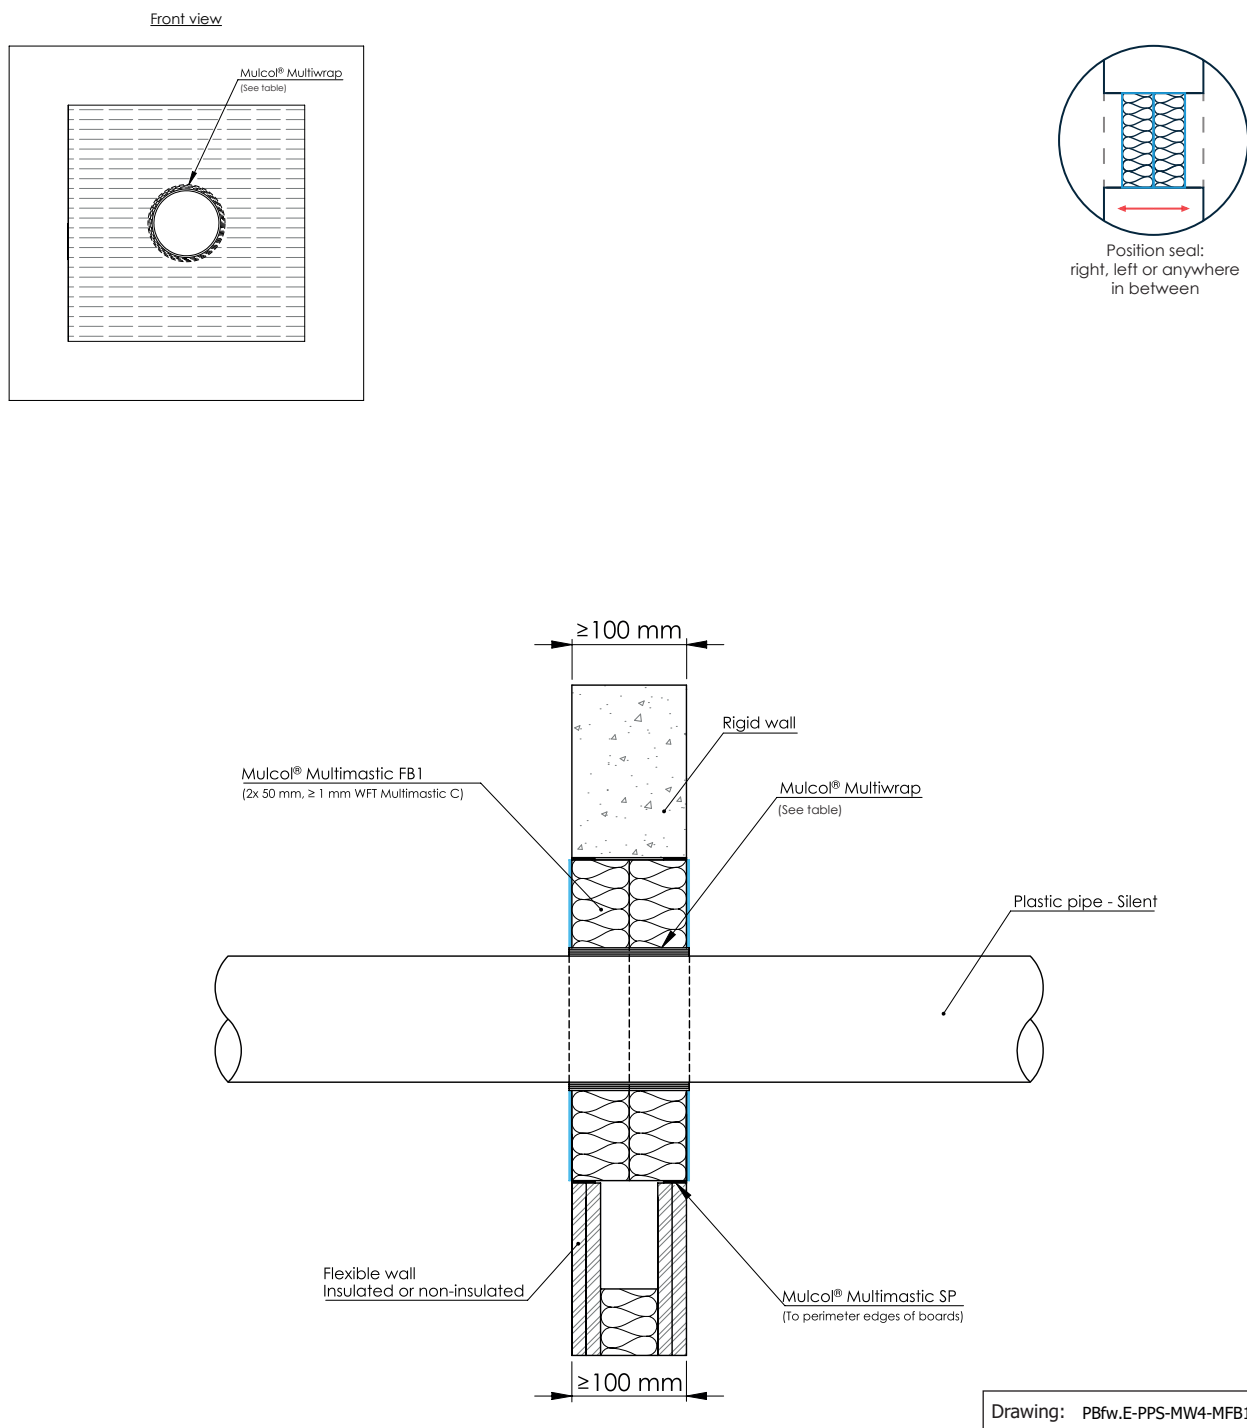

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Raupiano Plus	≤ Ø 50	1.8 - 2.7	Multiwrap (2 layers)	EI 120 U/C
	≤ Ø 110	2.7		
Geberit Silent dB20	≤ Ø 56	3.2 - 6.0		EI 120 U/U
	≤ Ø 110	6.0		
Wavin SiTech+	≤ Ø 40	2.0		EI 120 U/C
	≤ Ø 40	2.0 - 3.4		EI 120 U/U
	≤ Ø 50	1.8		EI 120 U/C
	≤ Ø 110	3.4		EI 120 U/U
Poloplast PoloKal NG	≤ Ø 50	2.0		EI 120 U/C




A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes**A.1.4.8 Plastic pipes (Silent) - Multiwrap**

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Raupiano Plus	$\leq \varnothing 110$	2.7	Multiwrap (4 layers)	EI 120 U/U
	$\leq \varnothing 160$	4.0		EI 90 U/C, E 120 U/C
Poloplast PoloKal NG	$\leq \varnothing 110$	3.4		EI 120 U/C

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Raupiano Plus	$\leq \varnothing 160$	3.9	Multiwrap (6 layers)	EI 120 U/U
Poloplast PoloKal NG	$\leq \varnothing 160$	4.9		EI 90 U/C, E 120 U/C

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.1.4.9 PP-R multilayer pipes - Multicollar *Slim*

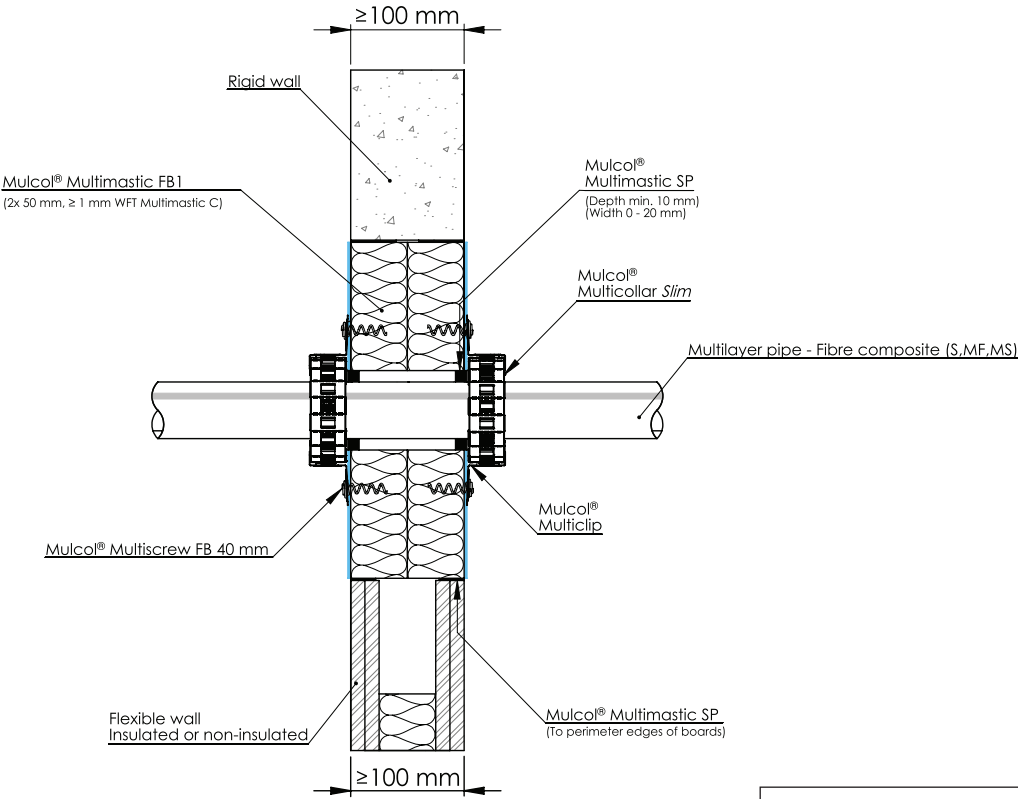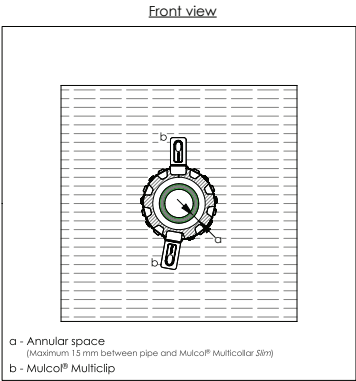


Drawing: PBfw.E-MLF-MC30-10.0.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Aquatherm Green	≤ Ø 50	6.9	Multicollar <i>Slim</i>	Multimastic SP ≥ 0-20 x 10 (wxd)	EI 120 U/C

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes




A.1.4.10 PP-R multilayer pipes - Multiwrap

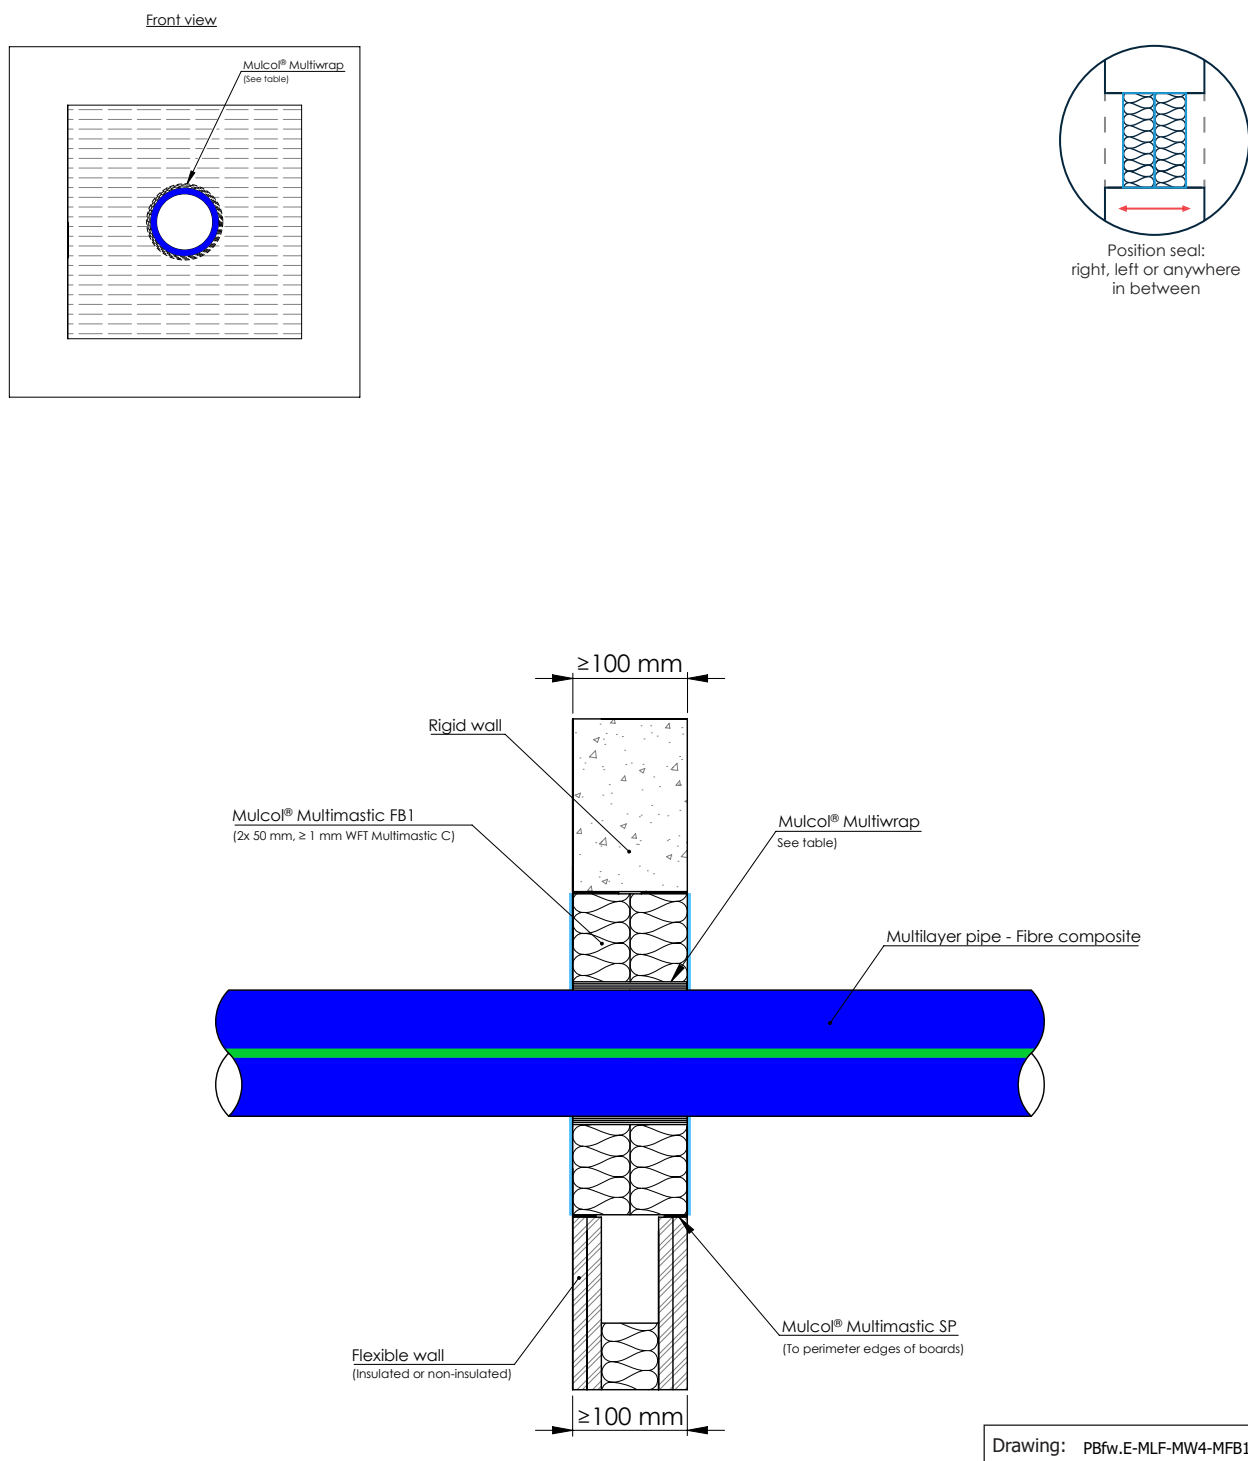

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Aquatherm Blue	≤ Ø 40	3.7	Multiwrap (2 layers)	EI 120 U/C
	≤ Ø 50	4.6		EI 120 U/U
	≤ Ø 110	10	Multiwrap (4 layers)	EI 120 U/C

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.1.4.11 PP-R multilayer pipes - Elastomer LI 300 / CI - Multicollar *Slim*

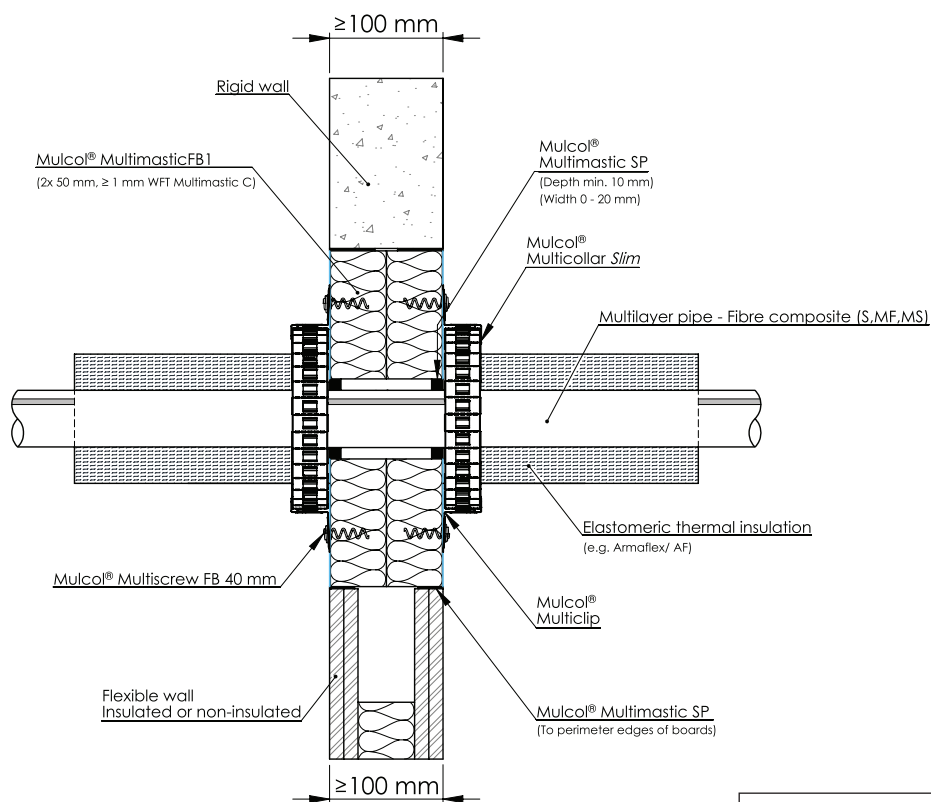


Drawing: PBfw.E-MLF-MC30-10.0.22

Services	Pipe dimensions (mm)		Insulation			Product	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Aquatherm Green	≤ Ø 50	6.9	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	9 - 32	LI 300 / CI	Multicollar <i>Slim</i>	EI 120 U/C

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes




A.1.4.12 PP-R multilayer pipes - With or without Thermoplast Elastomer CS - Multisealant GR

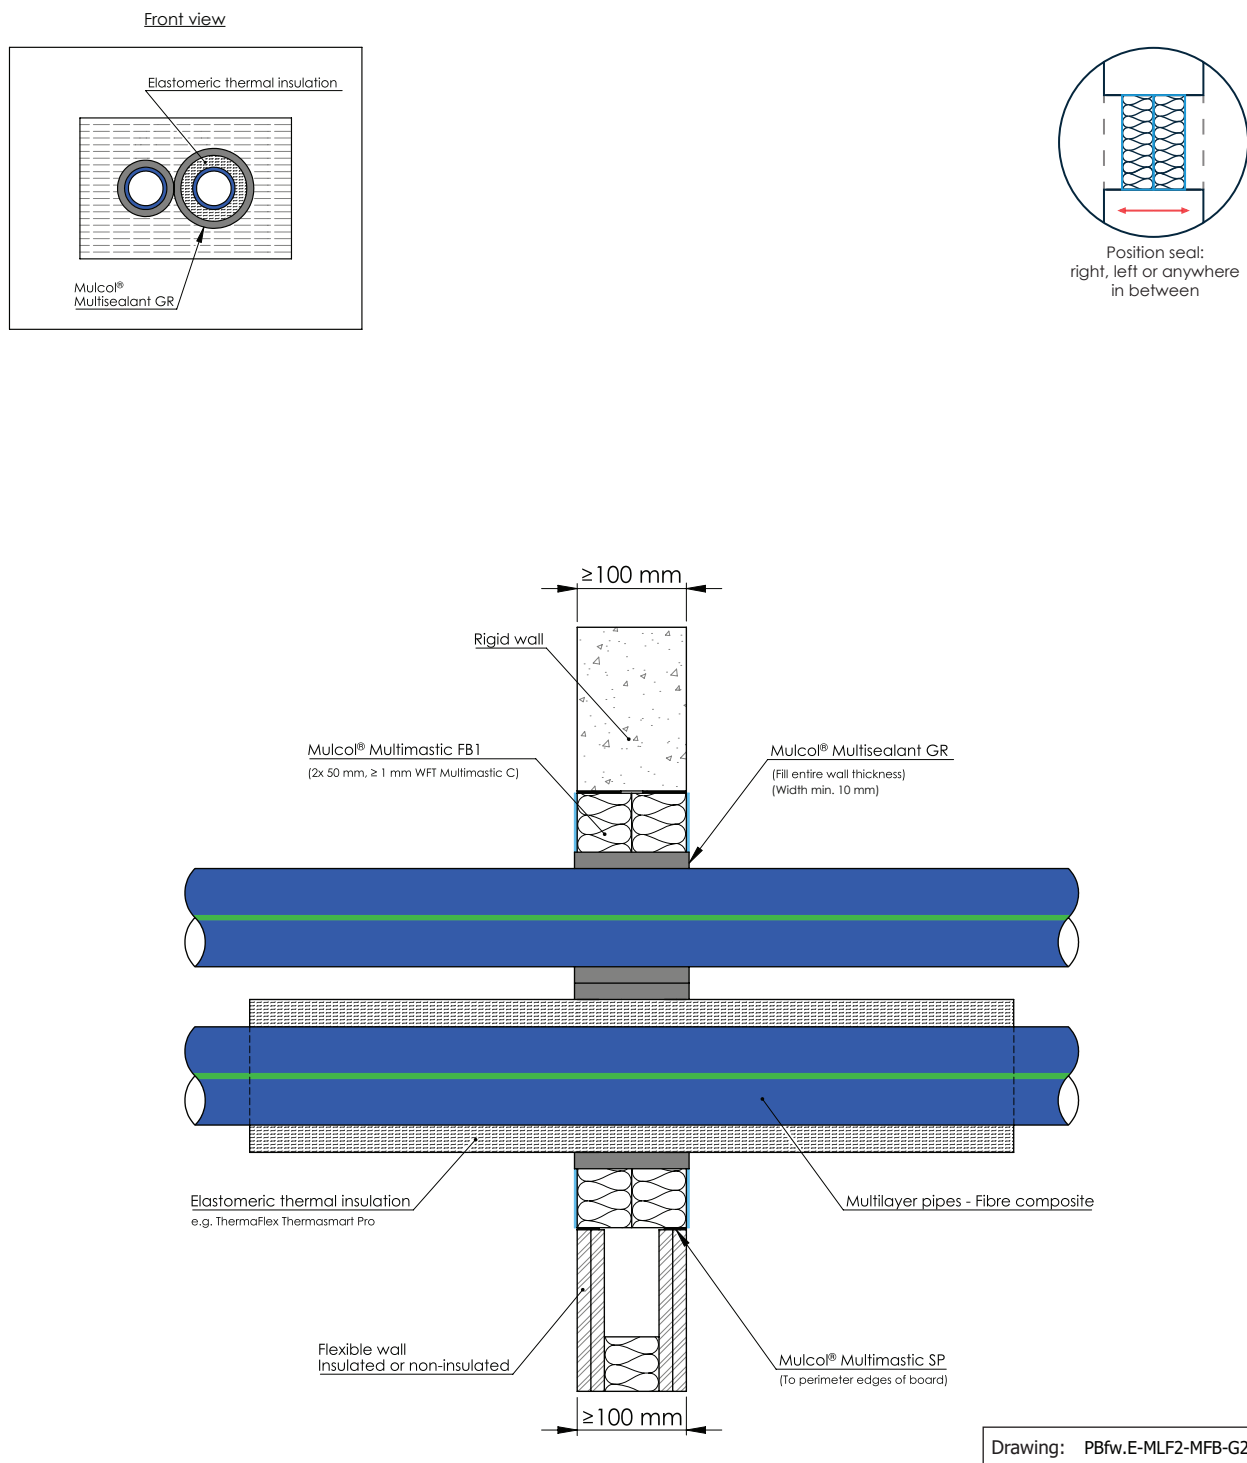

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
PP-R Multilayer pipes	≤ Ø 90	8.2	ThermaFlex (min. class B-s1, d0 B ₁ -s1, d0)	≥ 25	CS	Multisealant GR ≥ 15 x 100 mm (wxd)	EI 60 U/C
	≤ Ø 90	8.2	-	-	-		EI 60 U/C, E 90 U/C

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.1.4.13 Flexible drinking hose - Multisealant GR

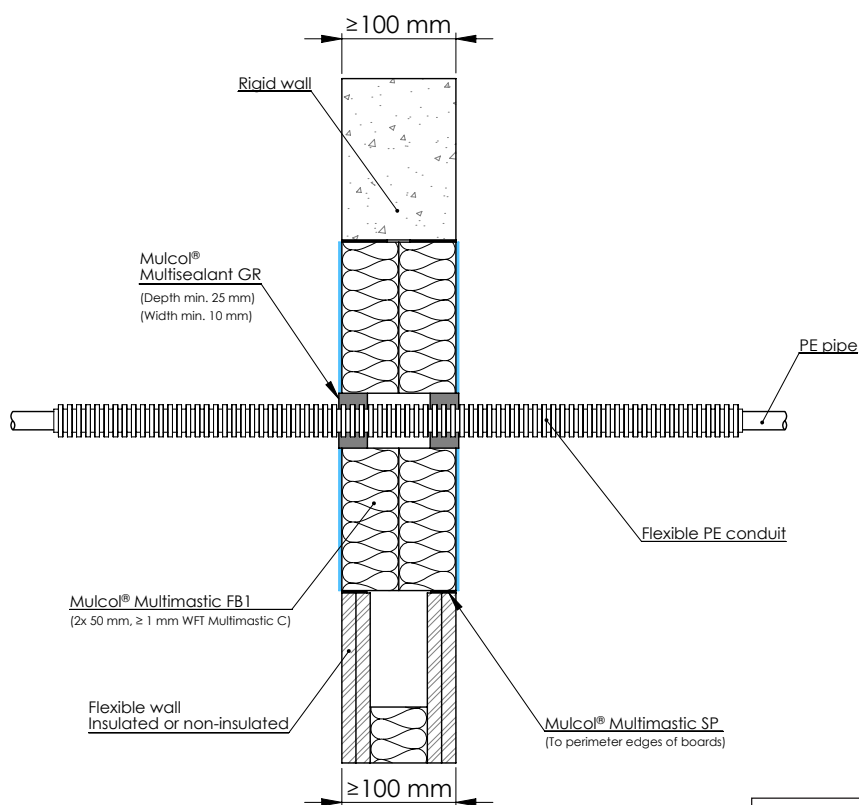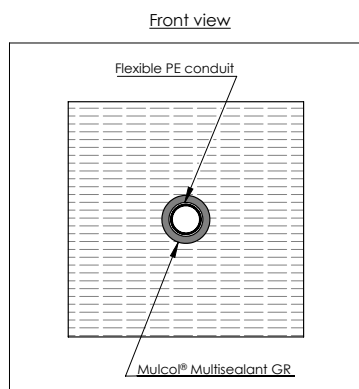


Drawing: PBfw.E-MLA-MFB1.2.30

Services	Pipe dimensions (mm)	Sealing (mm)	Classification
	Outer dimension		
Flexible drinking hose	≤ Ø 20	Multisealant GR ≥ 10 x 25 (wxd)	EI 60 U/C

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes




A.1.4.14 Drinks tubing system - Multicollar *Slim*

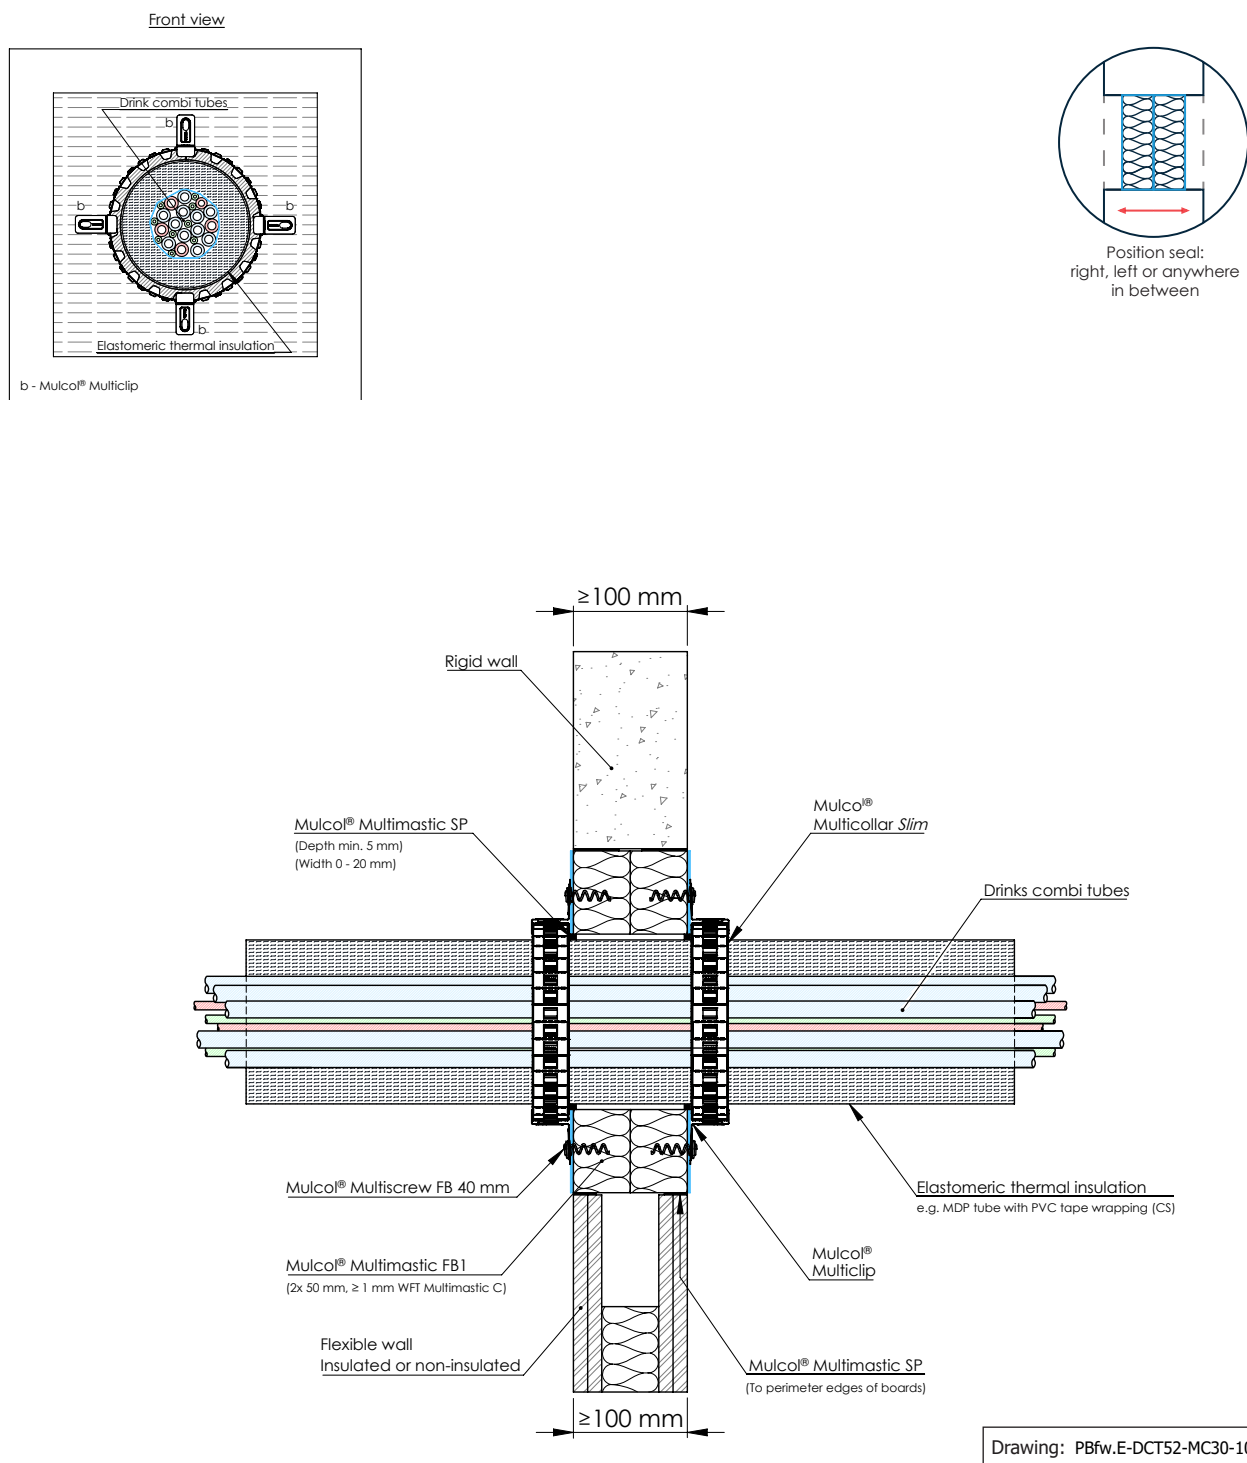

Services	Dimensions (mm)		Insulation			Product	Sealing (mm)	Classification
	Outer dimension	Hoses no.	Type	Thickness (mm)	Configuration			
Drinks tubing system	≤ Ø 47	≤ 3	Elastomeric foam	8 - 35	CS	Multicollar <i>Slim</i>	Multimastic SP ≥ 0-20 x 5 (wx d)	EI 60 U/C
	≤ Ø 145	≤ 52						

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.1.4.15 Rectangular duct - Multicollar *Slim*

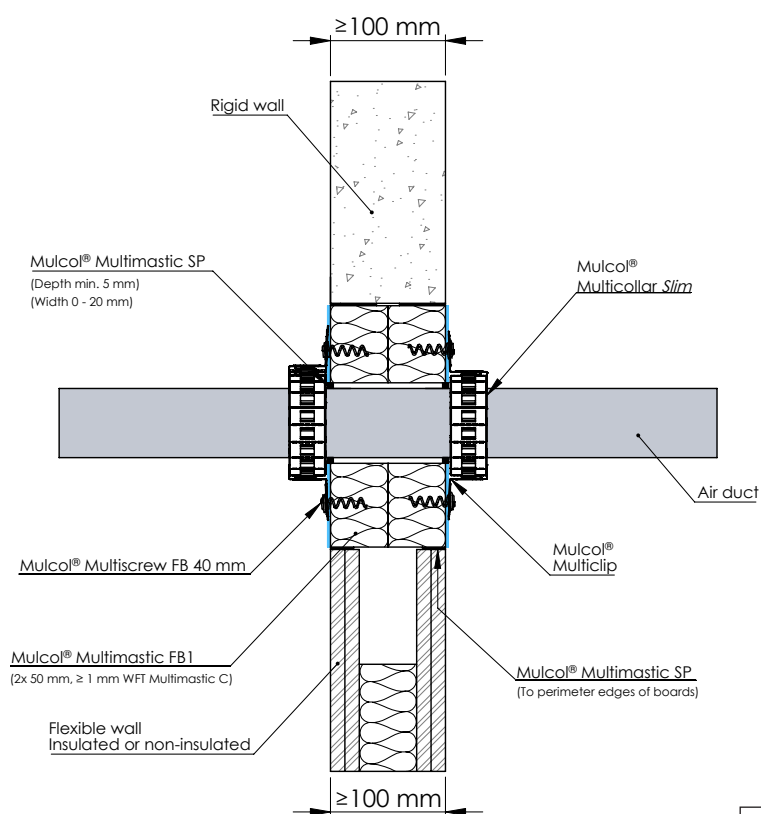

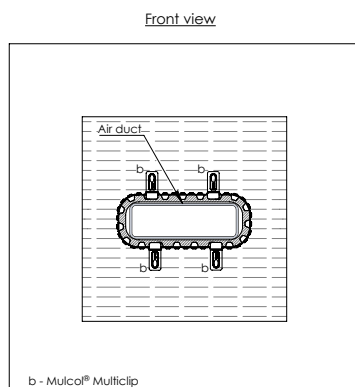


Drawing: PBfw.E-AD-MFB1.2.10

Services	Duct dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Rectangular plastic duct	≤ 220 x 90	1.0	Multicollar <i>Slim</i>	Multimastic SP ≥ 0-20 x 5 (wxd)	EI 45 U/C
		2.0			EI 120 U/C

A.1.4 Multimastic FB1 - 2x 50 mm - Combustible pipes



A.1.4.16 Flexible plastic hoses with cables - Multisealant GR

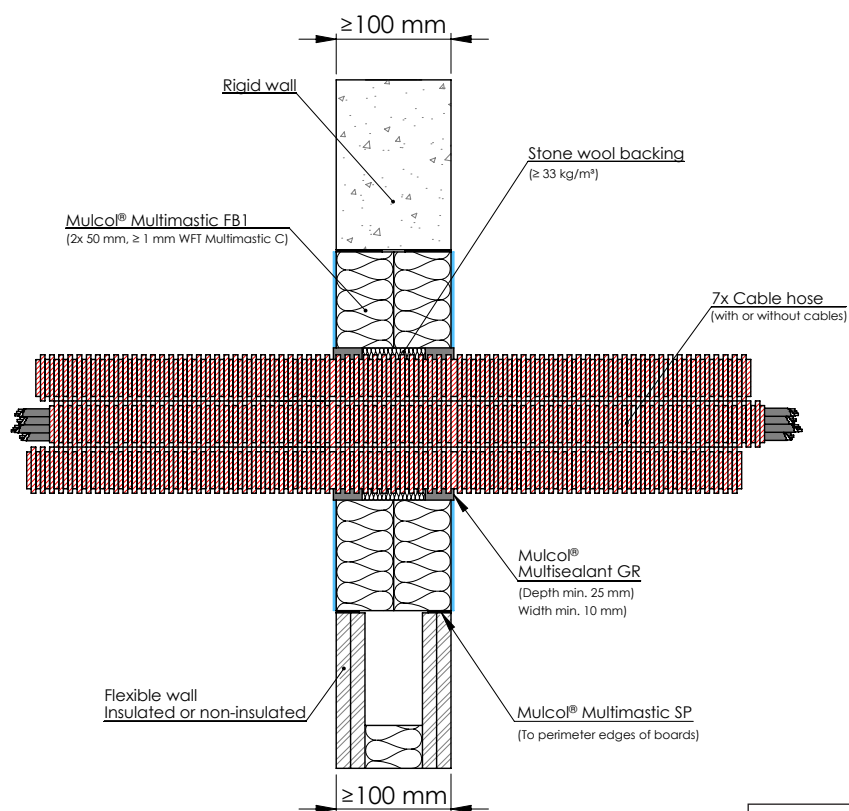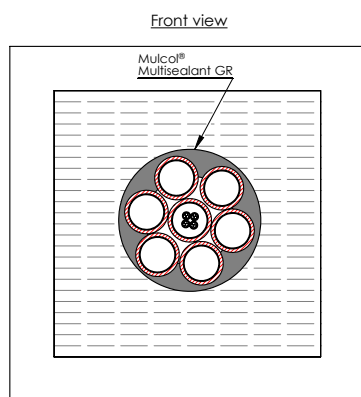

Drawing: PBfw.E-ECH7-MFB1-G2.19.30

Services	Diameter of penetration (mm)	Sealing (mm)	Classification
Ribbed PE-sleeve conduit ≤ Ø 63 mm, with or without cables	≤ 160	Multisealant GR ≥ 10 x 25 (wxd)	EI 60 U/U


A.1.5.1 Plastic pipes - Multicollar *Slim*

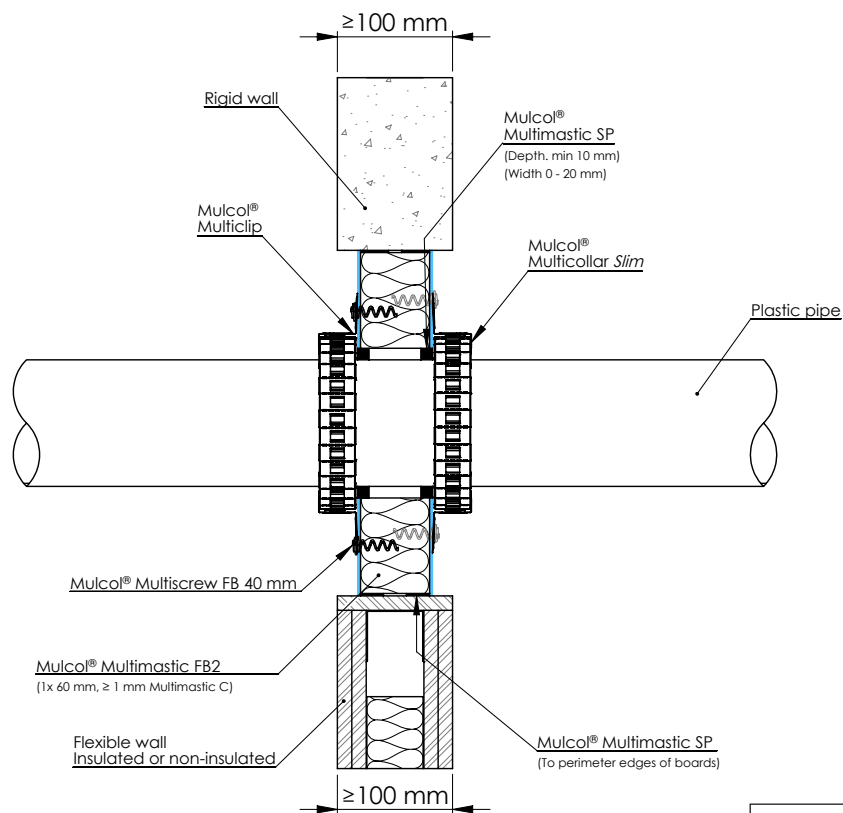

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification		
	Outer dimension	Wall thickness					
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	2.7	Multicollar <i>Slim</i>	Multimastic SP ≥ 0-20 x 10 (wxd)	EI 120 U/U		
PVC(-U/-C)							
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 125	3.9			EI 45 U/U E 60 U/U		
PP					EI 60 U/U		

A.1.5 Multimastic FB2 - 1x 60 mm - Combustible pipes




A.1.5.2 Plastic pipes - Multiwrap

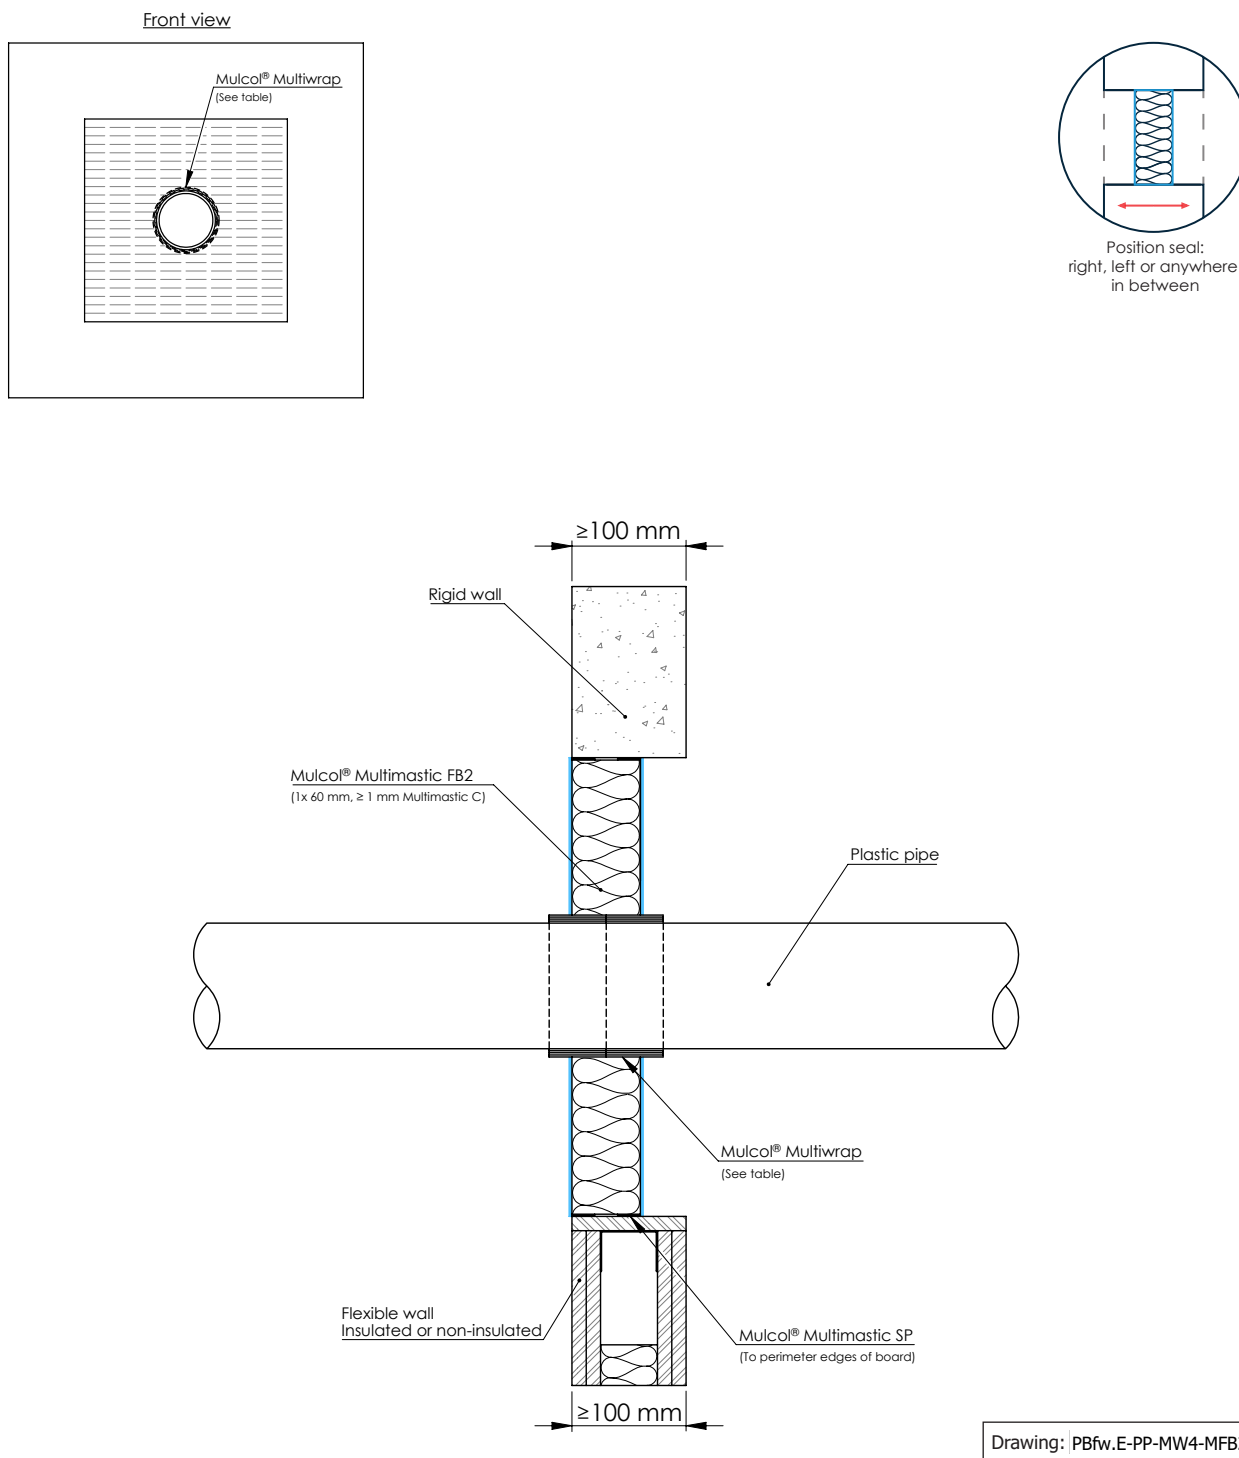

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PP	≤ Ø 40	2.3	Multiwrap (2 layers)	EI 60 U/U
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	10.0	Multiwrap (4 layers)	EI 30 U/U
PVC(-U/-C)		8.1		EI 60 U/U

A.1.5 Multimastic FB2 - 1x 60 mm - Combustible pipes

A.1.5.3 Plastic pipes (Silent) - Multicollar *Slim*

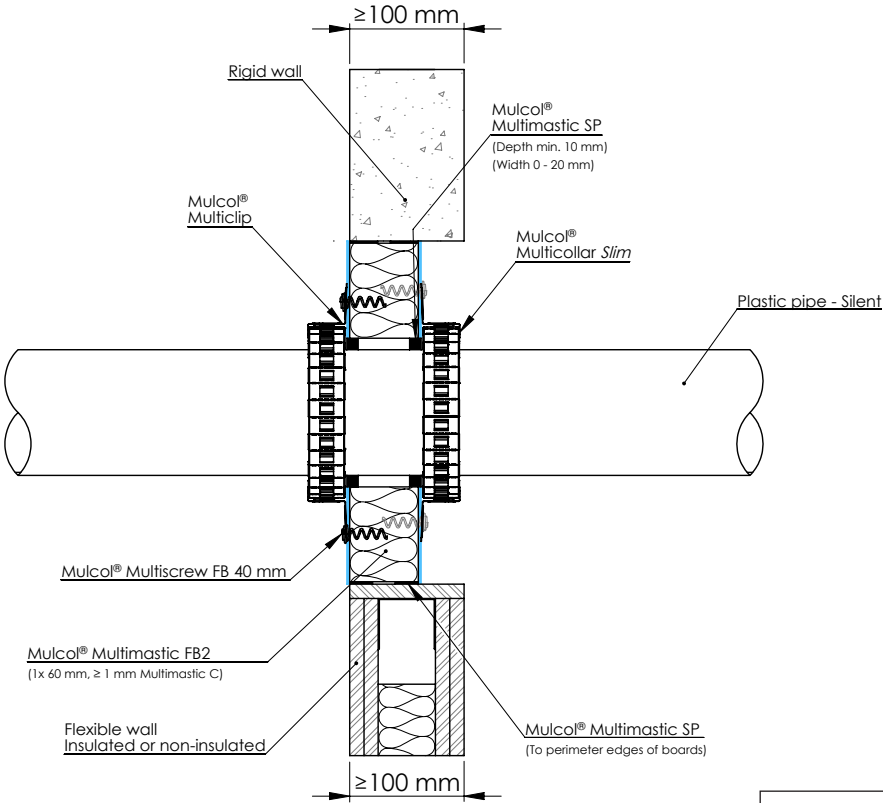

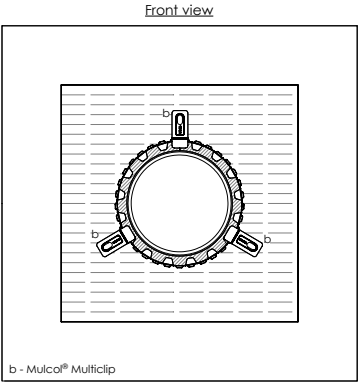


Drawing: PBfw.E-MC30-PPS-MFB2.1.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Geberit Silent dB20	≤ Ø 110	6.0	Multicollar <i>Slim</i>	Multimastic SP ≥ 0-20 x 10 (wxd)	EI 60 U/U

A.1.5 Multimastic FB2 - 1x 60 mm - Combustible pipes

A.1.5.4 Flexible plastic hoses with cables - Multicollar *Slim*

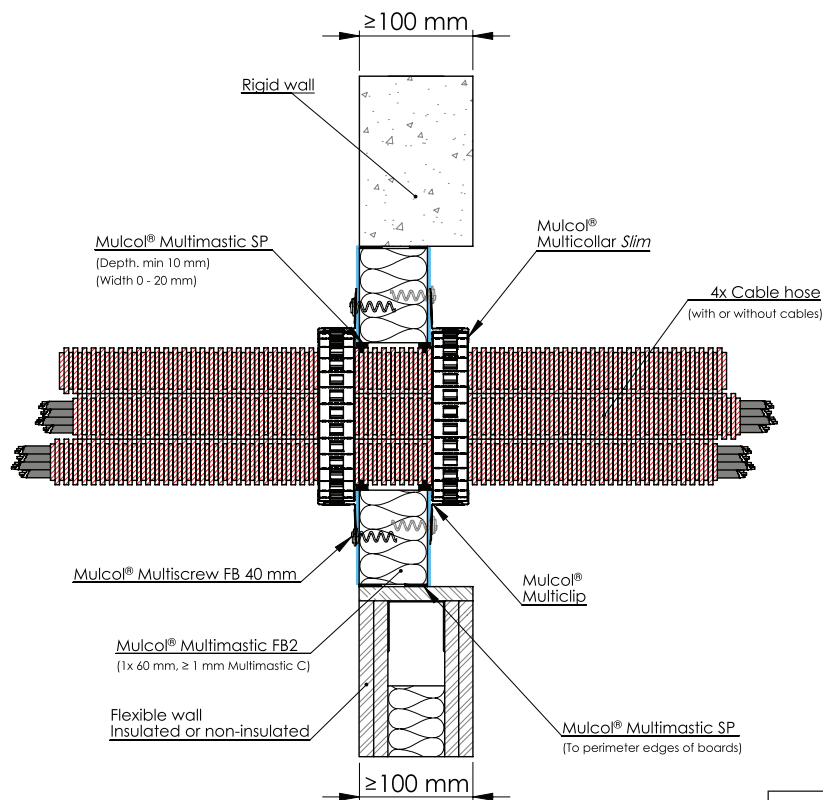




Drawing: PBfw.E-ECH4-MC30-MFB2.1.30

Services	Number of sleeves	Product	Sealing (mm)	Classification
Ribbed PE-sleeve conduit ≤ Ø 63 mm, with or without cables	≤ 4	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 90 U/C, E 120 U/C

A.1.6 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)



A.1.6.1 Multilayer pipes (MLC) - Multicollar *Slim*

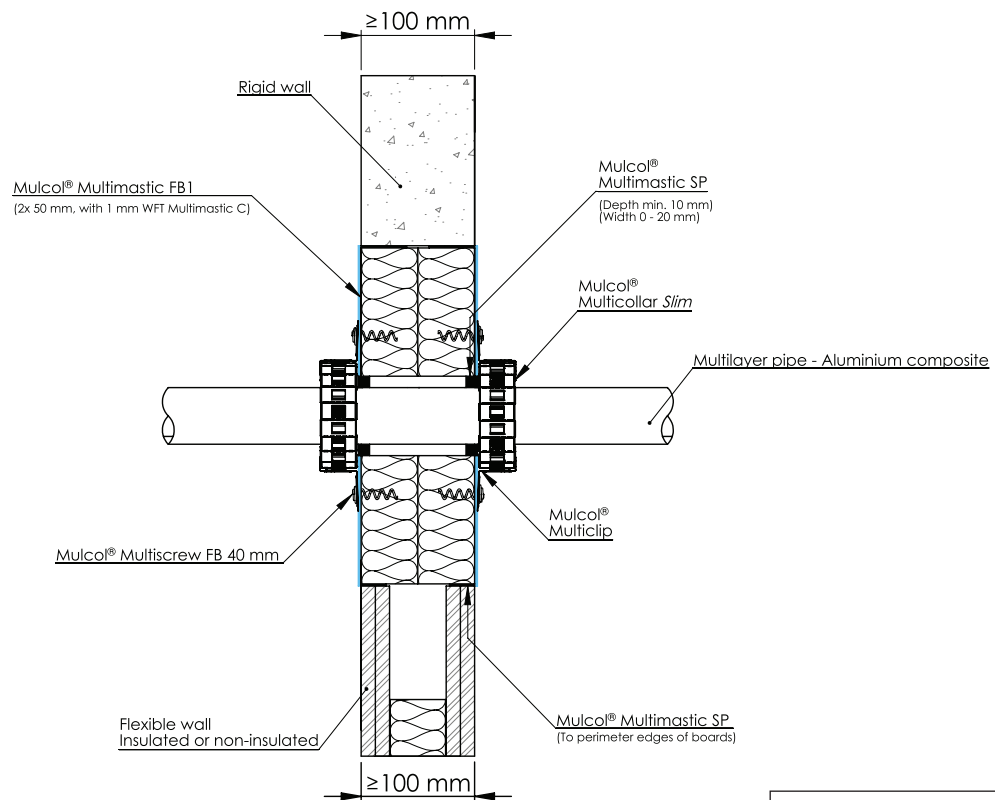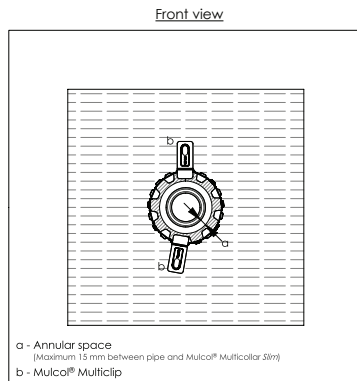

Drawing: PBfw.E-MLA-MC30-MFB1.0.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Multilayer pipes (MLC)	≤ Ø 20	2.0	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 120 U/C
	≤ Ø 25	3.5			
	≤ Ø 32	3.0			
	≤ Ø 40	3.5			
	≤ Ø 40	4.0			
	≤ Ø 50	4.0			
	≤ Ø 63	4.5			EI 90 U/C, E 120 U/C




A.1.6.1 Multilayer pipes (MLC) - Multicollar *Slim*

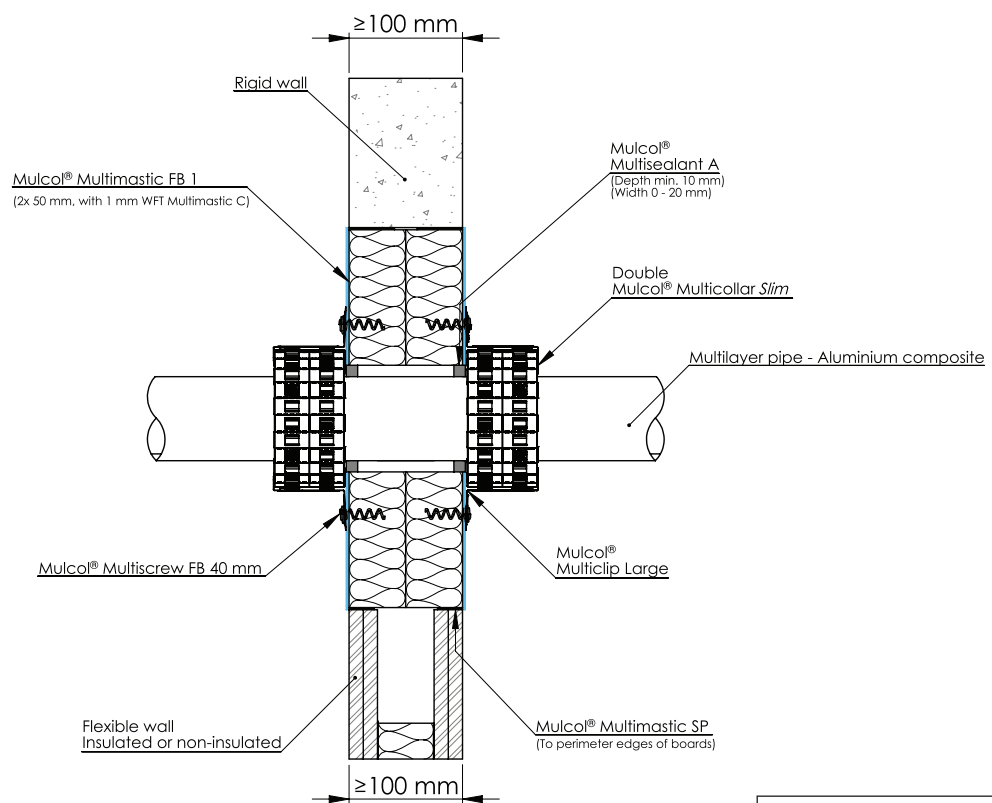

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Multilayer pipes (MLC)	≤ Ø 75	6.0	Multicollar <i>Slim</i> Double	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 90 U/C, E 120 U/C

A.1.6 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)

A.1.6.2 Multilayer pipes (MLC) - Multisealant GR

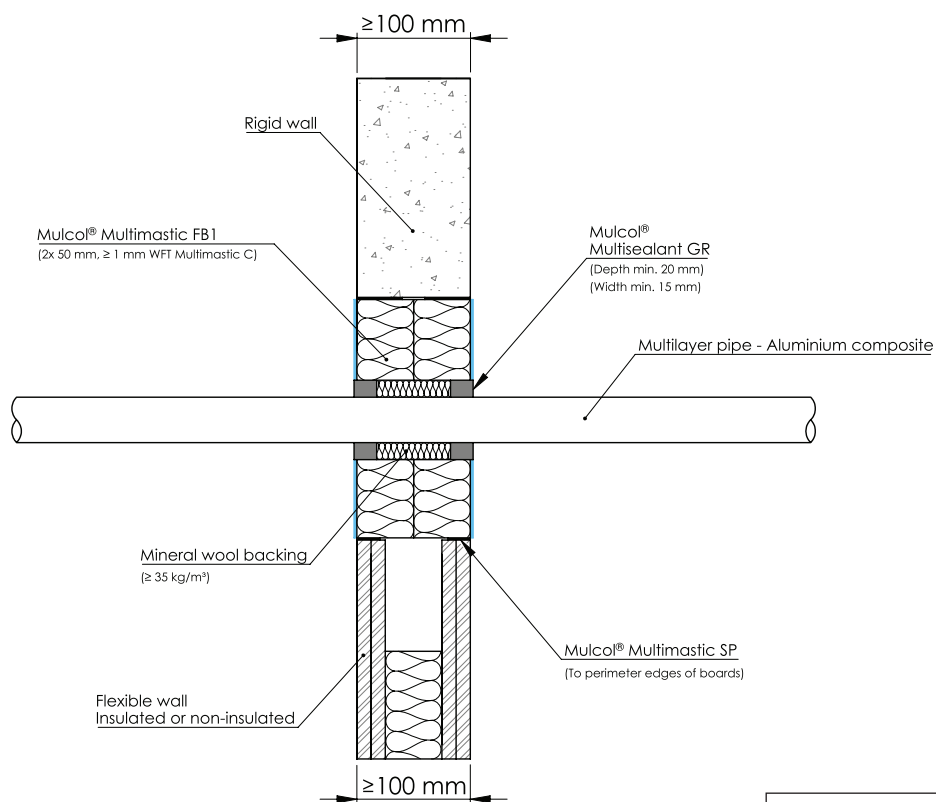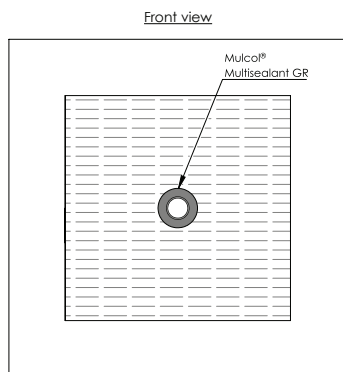


Drawing: PBfw.E-MLA-G2.4.10

Services	Pipe dimensions (mm)		Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness			
Multilayer pipes (MLC)	≤ Ø 20	2.0	Multisealant GR ≥ 15 x 20 (wxd)	Stone wool (≥ 35 kg/m³)	EI 120 U/C
	≤ Ø 32	3.0			
	≤ Ø 40	3.5 - 4.0			

A.1.6 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)


A.1.6.3 Multilayer pipes (MLC) - Conduit - Multisealant GR

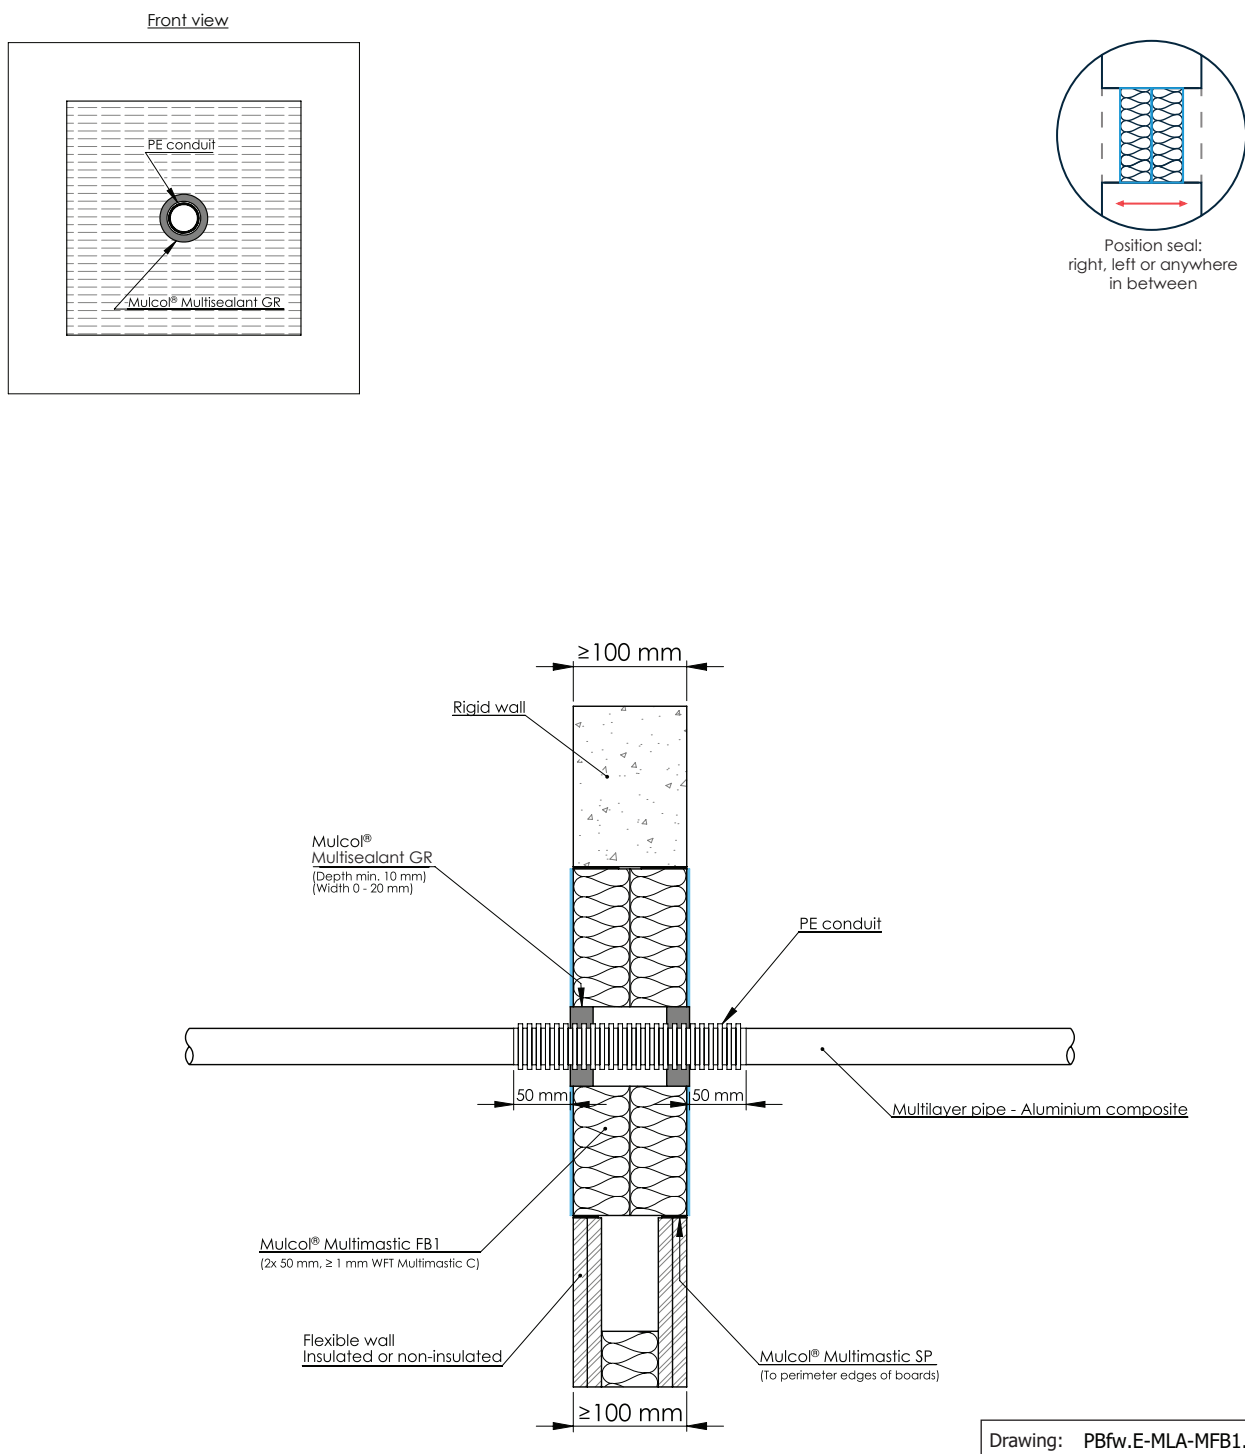

Services	Pipe dimensions (mm)		Conduit			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Outer dimension (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 32	3.0	PE-conduit ribbed	≤ Ø 40	LS 50 / CS	Multisealant GR 0-20 x ≥ 10 (wxd)	EI 60 U/C

A.1.6 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)


A.1.6.4 Multilayer pipes (MLC) - Stone wool LS 400 / CS

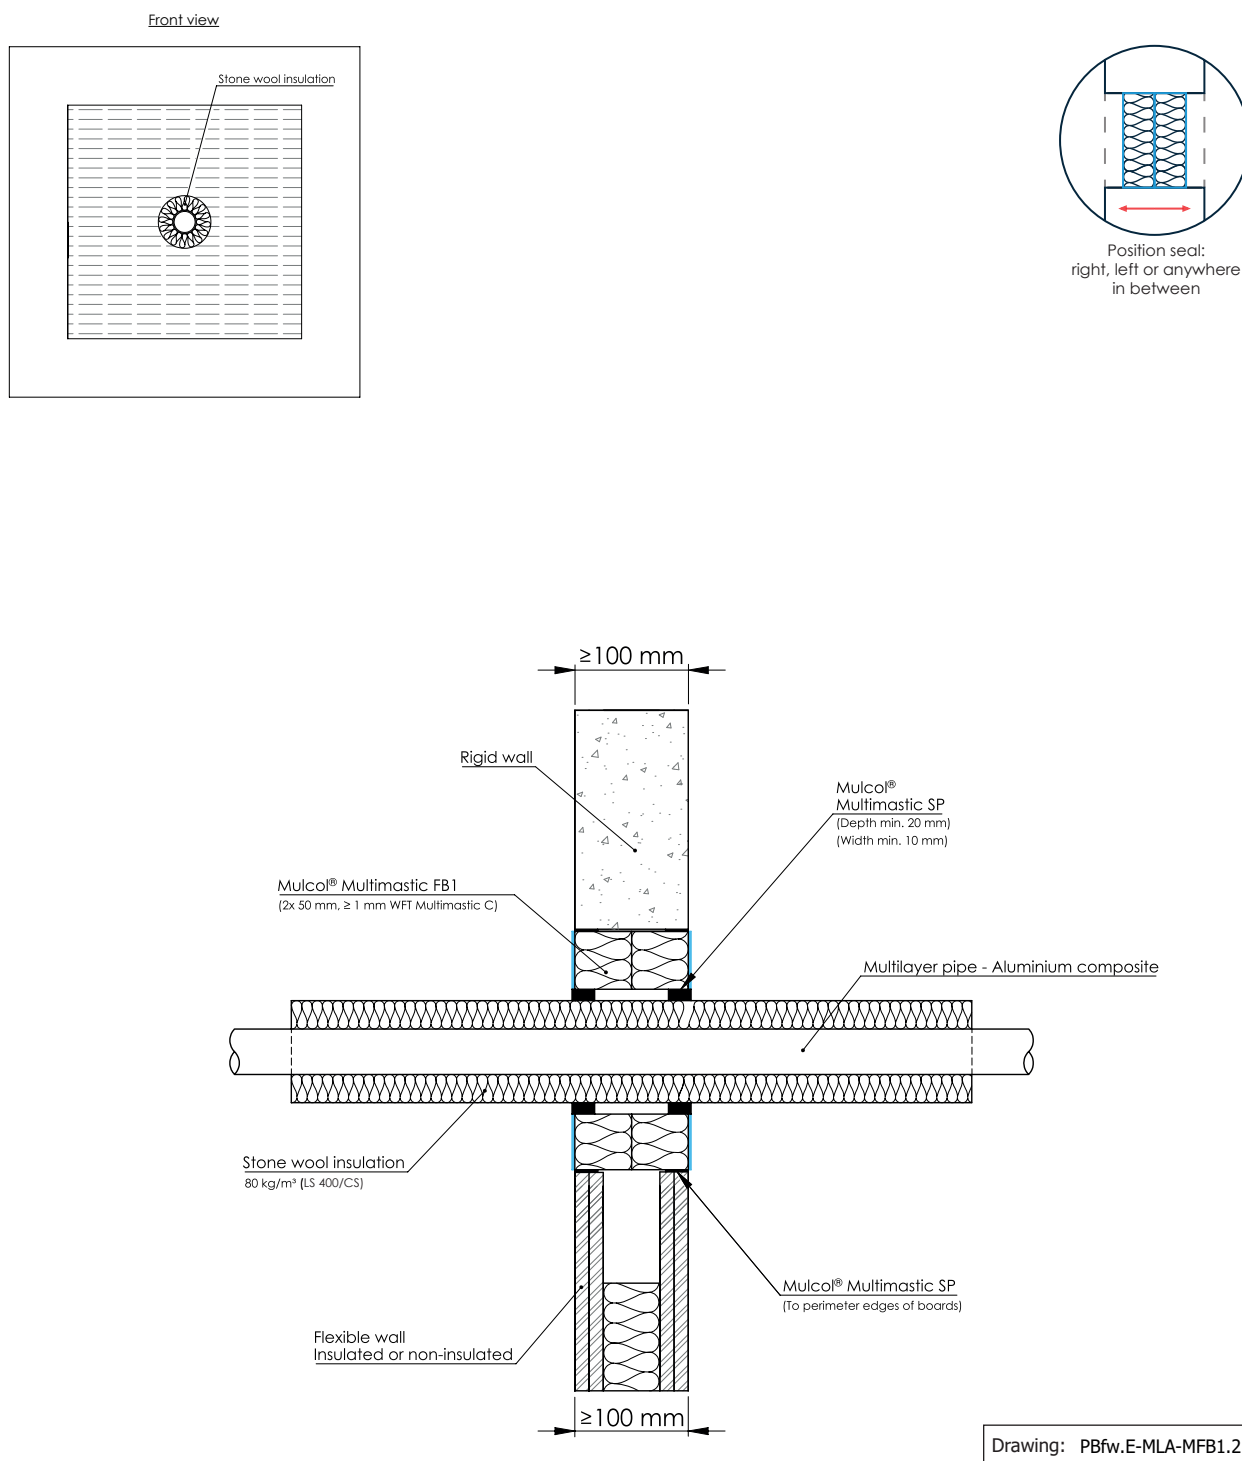

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 32	3.0 to 6.0	Stone wool (≥ 80 kg/m³)	≥ 25	LS 400 / CS	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 60 U/C
	≤ Ø 75	6.0					EI 90 U/C

A.1.6 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)




A.1.6.5 Multilayer pipes (MLC) - Stone wool LI 400 / CI

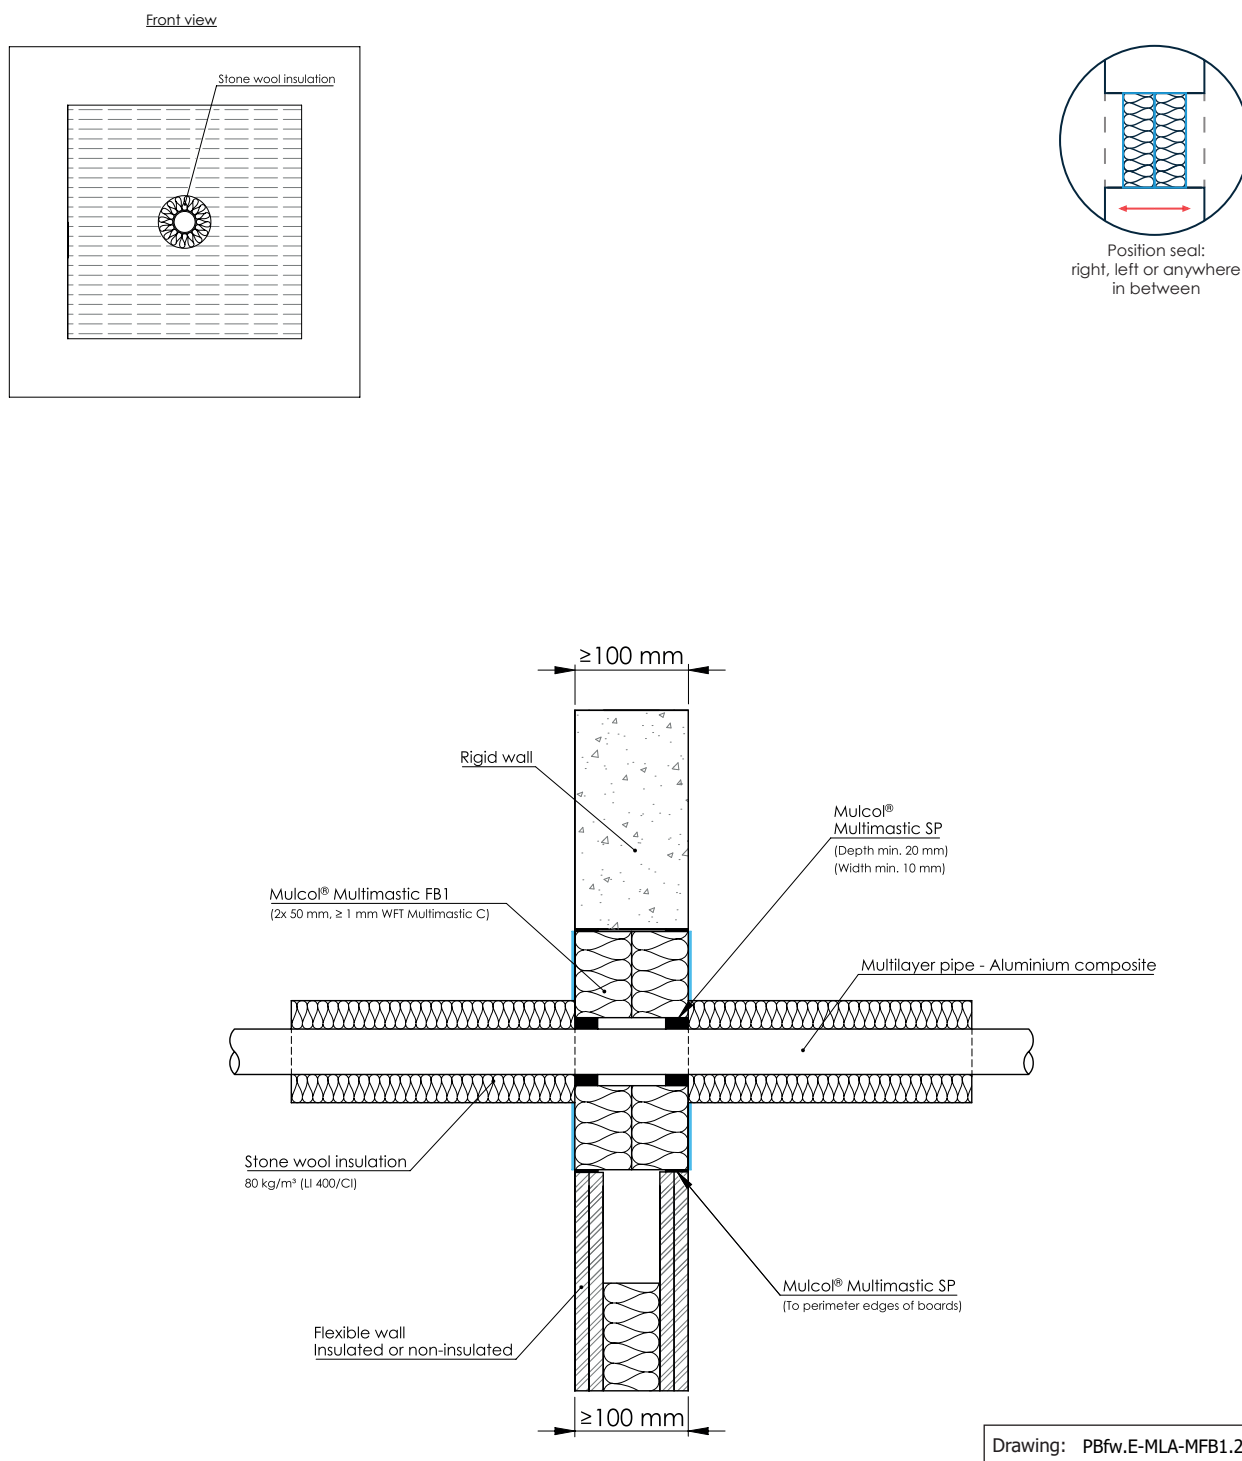

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 40	3.5	Stone wool (≥ 80 kg/m³)	≥ 25	LI 400 / CI	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 90 U/C

A.1.6 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)

A.1.6.6 Multilayer pipes (MLC) - Elastomer LS 300 / CS - Multisealant GR

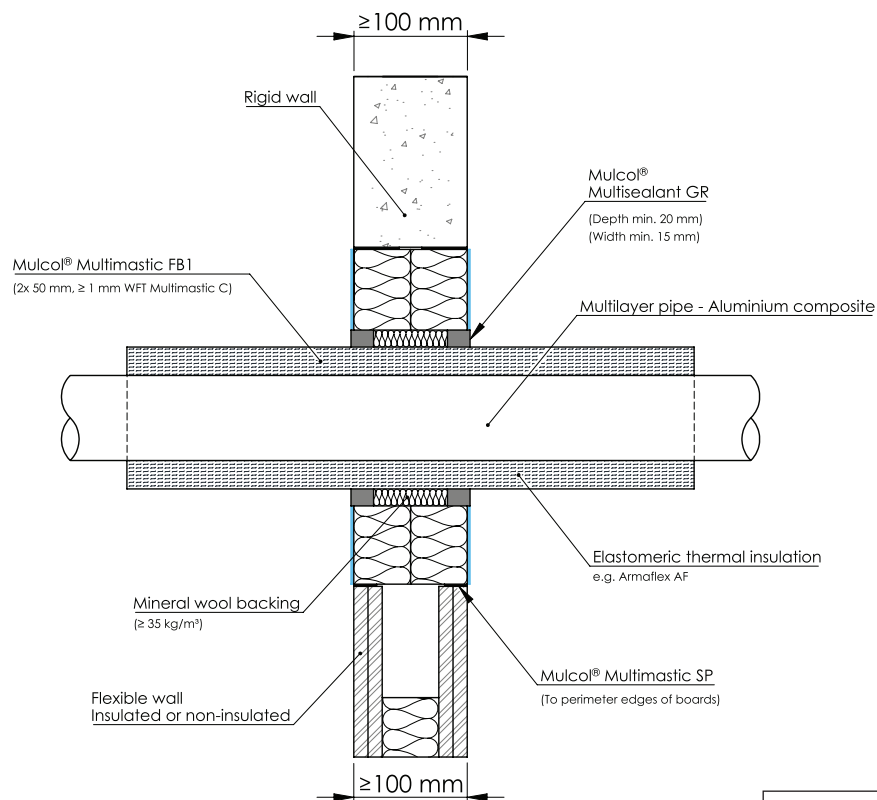

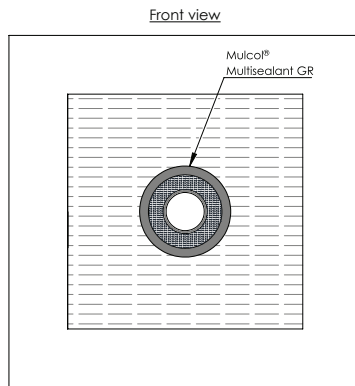


Drawing: PBfw.E-MLA-G2.4.22

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 20	2.0	ArmaFlex AF (min. class B-s3, d0 BL-s3, d0)	9 - 32	LS 300 / CS LI 300 / CI	Multisealant GR ≥ 15 x 20 mm (wxd)	EI 120 U/C
	≤ Ø 32	3.0					EI 90 U/C E 120 U/C
	≤ Ø 40	3.5					
	≤ Ø 50	4.0					
	≤ Ø 63	4.5					
	≤ Ø 75	6.0					

A.1.6 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)

A.1.6.7 Multilayer pipes (MLC) - Elastomer LI 300 / CI - Multicollar *Slim*

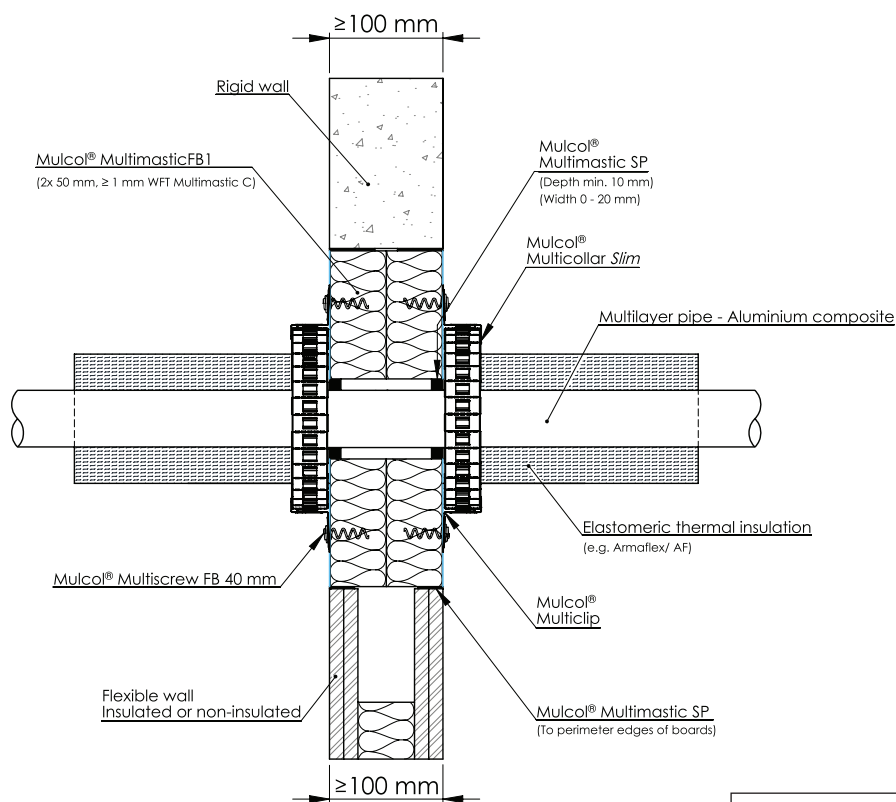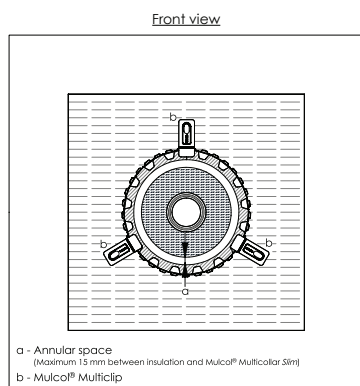




Drawing: PBfw.E-MLA-MC30-10.0.22

Services	Pipe dimensions (mm)		Insulation			Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Multilayer pipes (MLC)	≤ Ø 50	4.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	9 - 32	LI 300 / CI	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 120 U/C

A.1.6 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)

A.1.6.8 Multilayer pipes (MLC) - ArmaFlex Protect LS 400 / CS - Multimastic SP

Front view

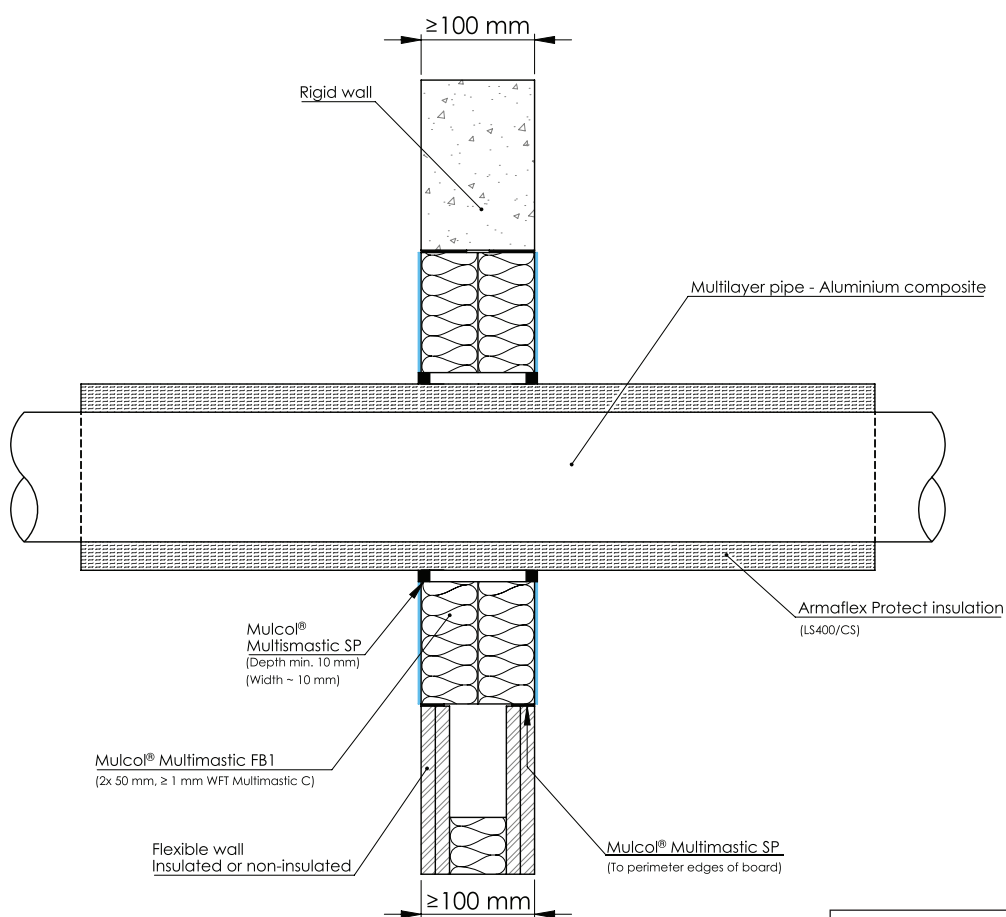

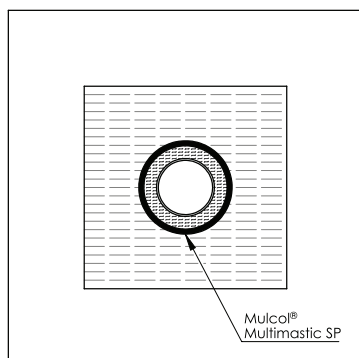


Drawing: PBfw.E-MLA-MFB1.2.10

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 26	3.0	ArmaFlex Protect	20	LS 400 / CS	Multimastic SP 10 x ≥ 10 (wxd)	EI 120 U/C
	≤ Ø 75	5.0		25			

A.1.6 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)

A.1.6.9 Multilayer pipes (MLC) - Phenolic foam LS 400 / CS - Multicollar *Slim*

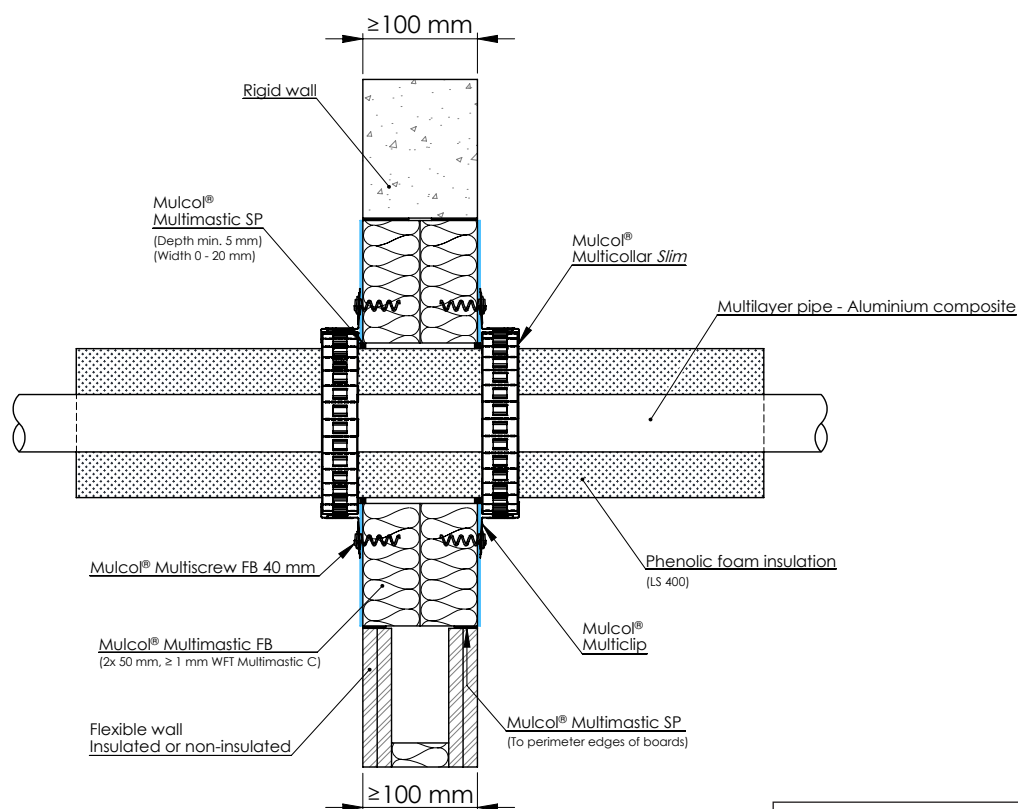




Drawing: PBfw.E-MLA-MC30-MFB1.0.22

Services	Pipe dimensions (mm)		Insulation			Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Multilayer pipes (MLC)	≤ Ø 20	2.0	Kingspan Kooltherm	15 - 40	LS 400 / CS	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 60 U/C
	≤ Ø 40	3.5		20 - 40				
	≤ Ø 63	4.5						

A.1.6 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)

A.1.6.10 Multiple Multilayer pipes (MLC) - PE foam - Multicollar *Slim*

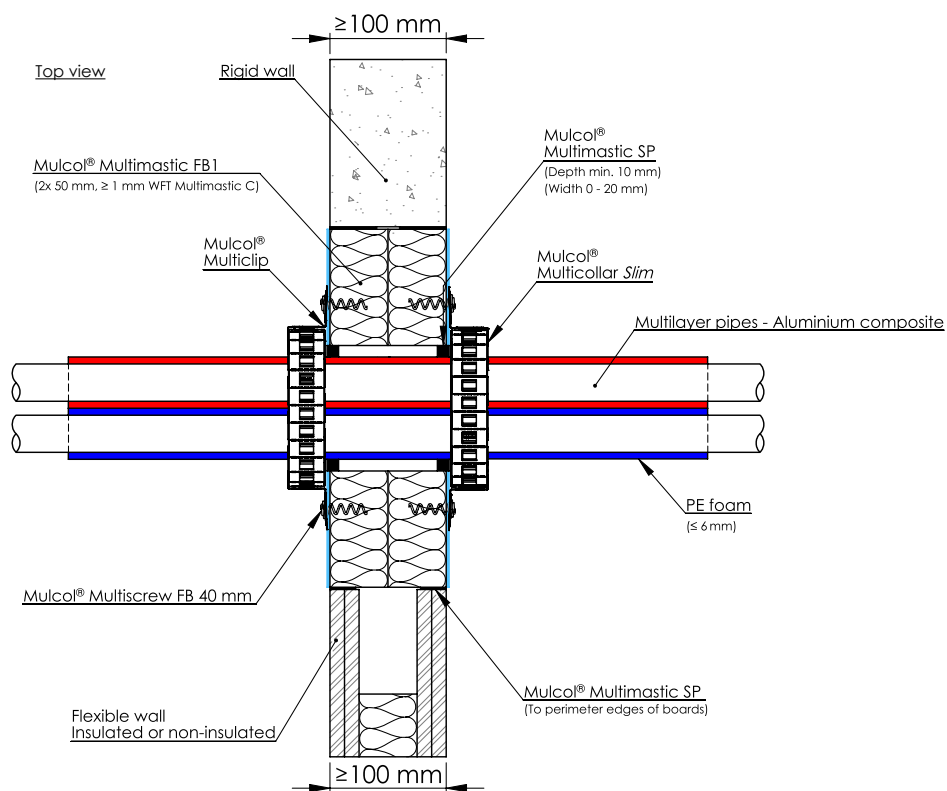

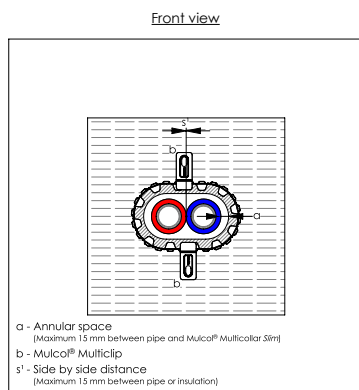


Drawing: PBfw.E-MC30-MLP2-10.0.2

Services	Pipe dimensions (mm)		Number of pipes	Insulation			Product	Sealing	Classification
	Outer dimension	Wall thickness		Type	Thickness (mm)	Configuration			
Multilayer pipes (MLC)	≤ Ø 15	2.0	≤ 12	PE foam	6	LS 400 / CS LI 400 / CI	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 120 U/C

A.1.6 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)

A.1.6.11 Multilayer pipes (MLC) - PE foam - Multisealant GR

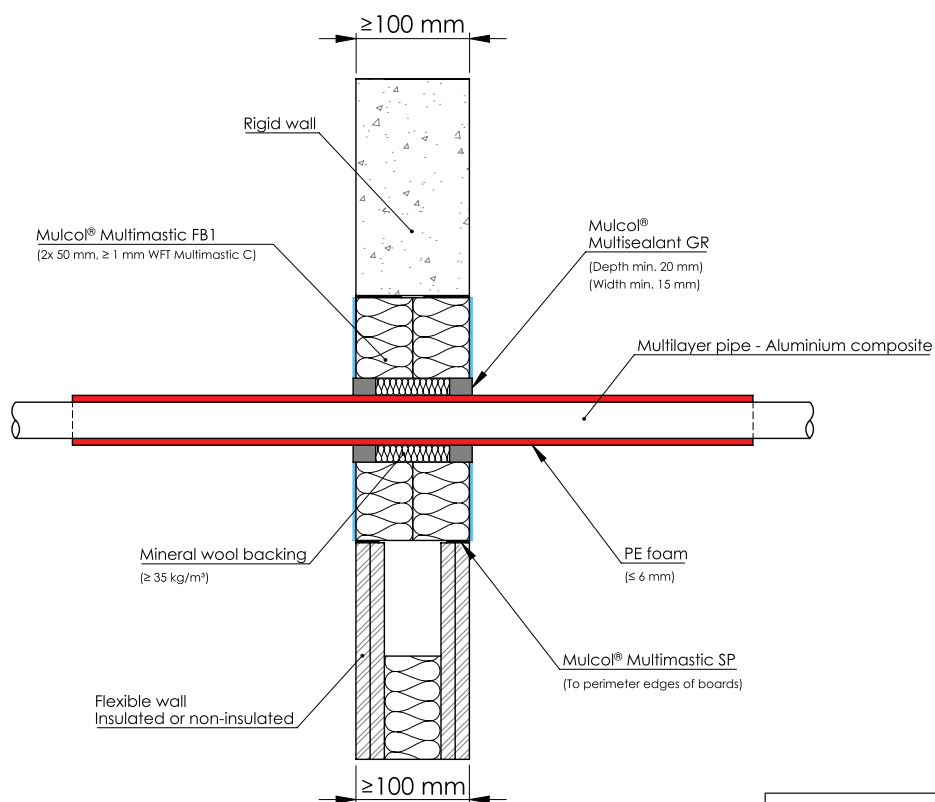

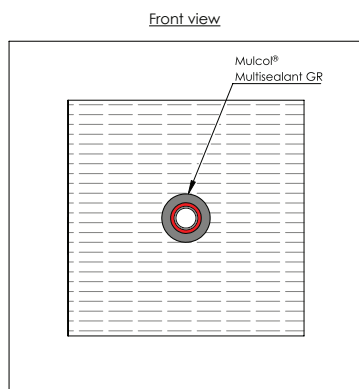


Drawing: PBfw.E-MLA_pr-G2.4.23

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 32	2.0 - 3.0	PE Foam	≤ 6	LS 300 / CS LI 300 / CI	Multisealant GR ≥ 15 x 20 (wxd)	EI 120 U/C

A.1.6 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)

A.1.6.12 Multilayer pipes (MLC) - Multidisc

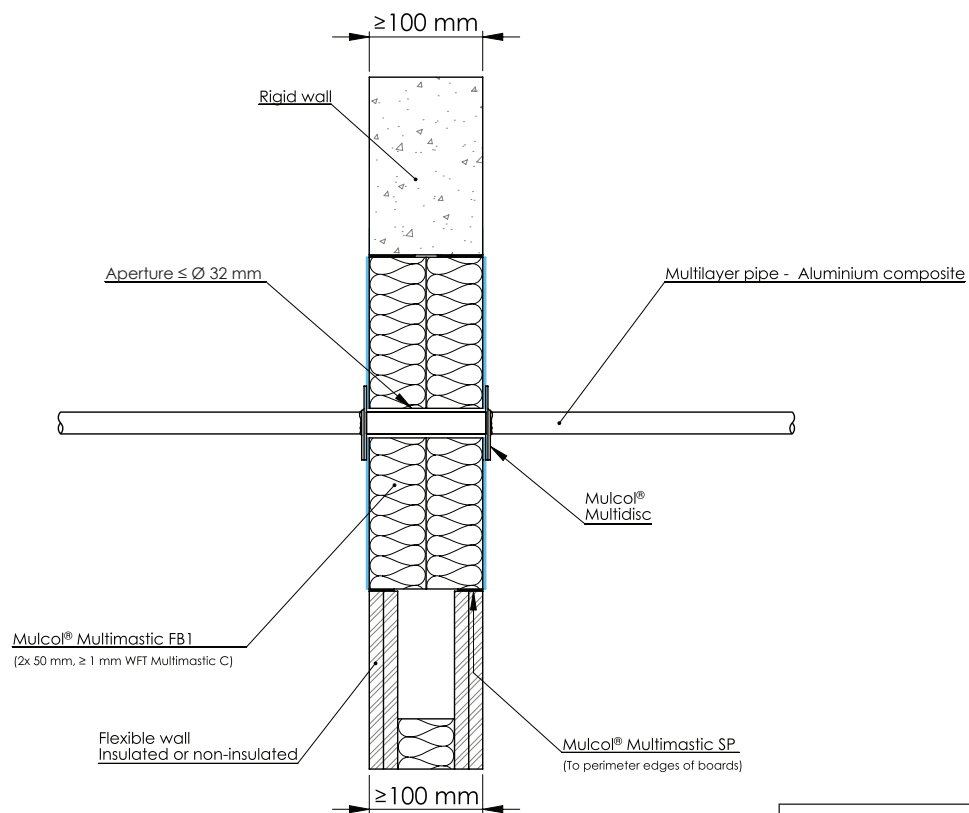

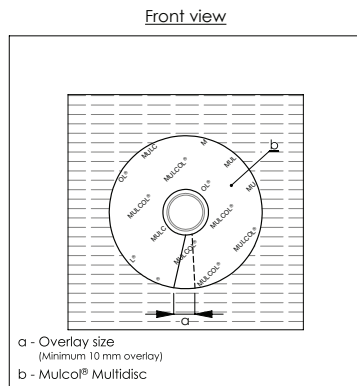


Drawing: PBfw.E-MLA-M2.0.10

Services	Pipe dimensions (mm)		Aperture (mm)	Product	Sealing (mm)	Classification
	Outer diameter	Wall thickness				
Multilayer pipes (MLC)	≤ Ø 16	2.0	≤ Ø 32	Multidisc	Not required	EI 90 U/C E 120 U/C

A.1.6 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)



A.1.6.13 Multilayer pipes (MLC) - Multitherm Bandage

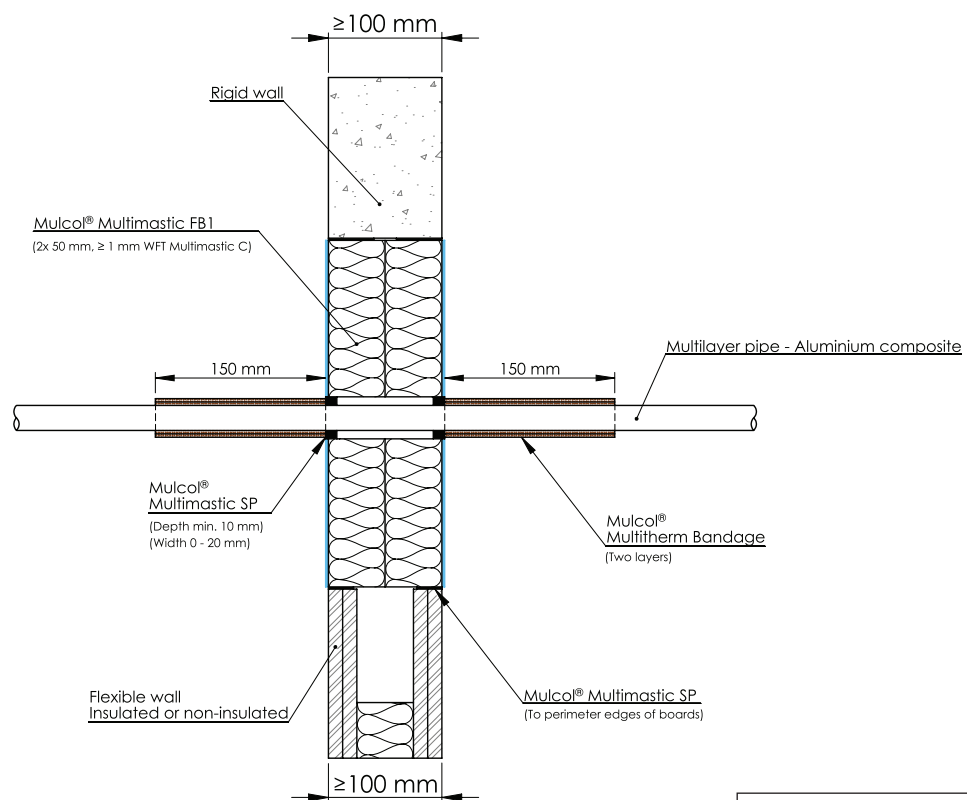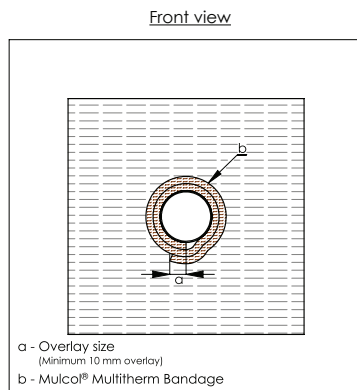

Services	Pipe dimensions (mm)		Sealing (mm)	Multitherm Bandage	Classification
	Outer dimension	Wall thickness			
Multilayer pipes (MLC)	≤ Ø 16	2.0	Multimastic SP 0-20 x ≥ 10 (wxd)	LI 150 two layers	EI 120 U/C
	≤ Ø 25	3.5			
	≤ Ø 26	3.0			

A.1.7 Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Multilayer pipes (MLC)

A.1.7.1 Multilayer pipes (MLC) - Multidisc


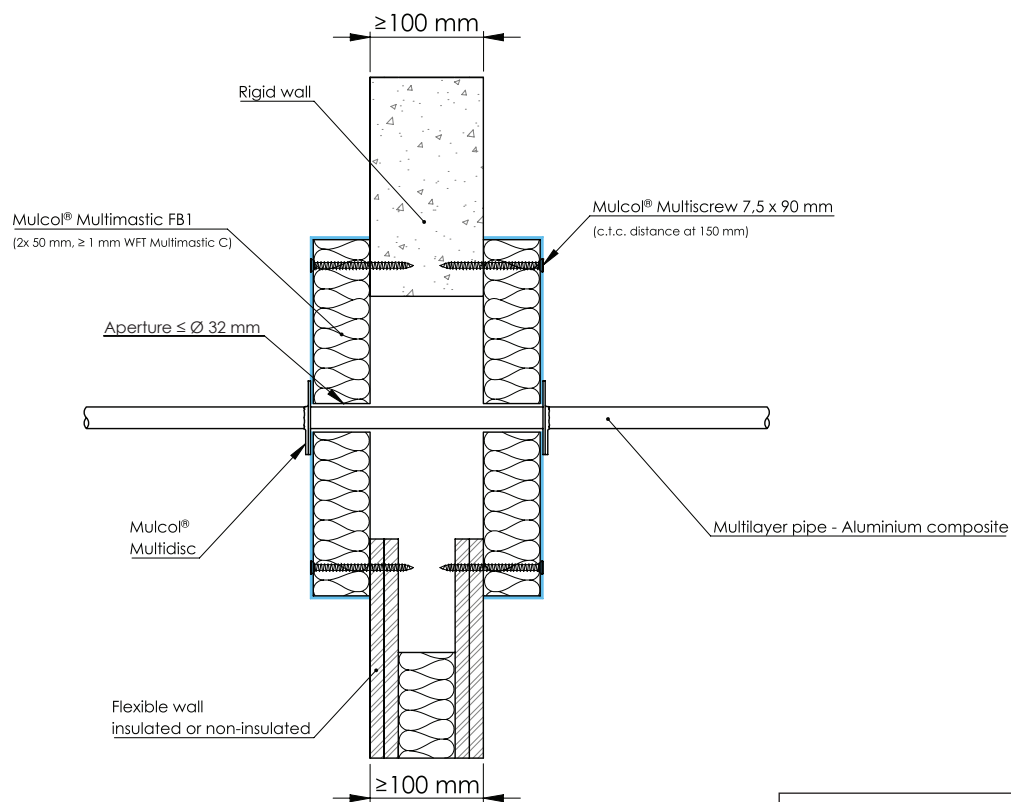
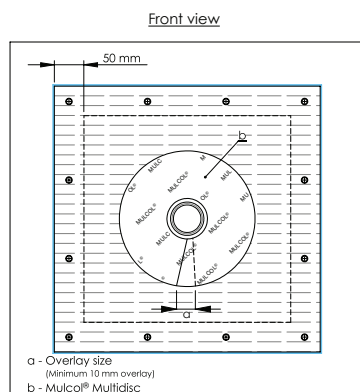


Drawing: PBPfw-MLA-M2.0.10

Services	Pipe dimensions (mm)		Aperture (mm)	Product	Sealing (mm)	Classification
	Outer diameter	Wall thickness				
Multilayer pipes (MLC)	≤ Ø 16	2.0	≤ Ø 32	Multidisc	Not required	EI 60 U/C E 120 U/C

A.1.8 Multimastic FB2 - 1x 60 mm - Multilayer pipes (MLC)

A.1.8.1 Multilayer pipes (MLC) - Multidisc

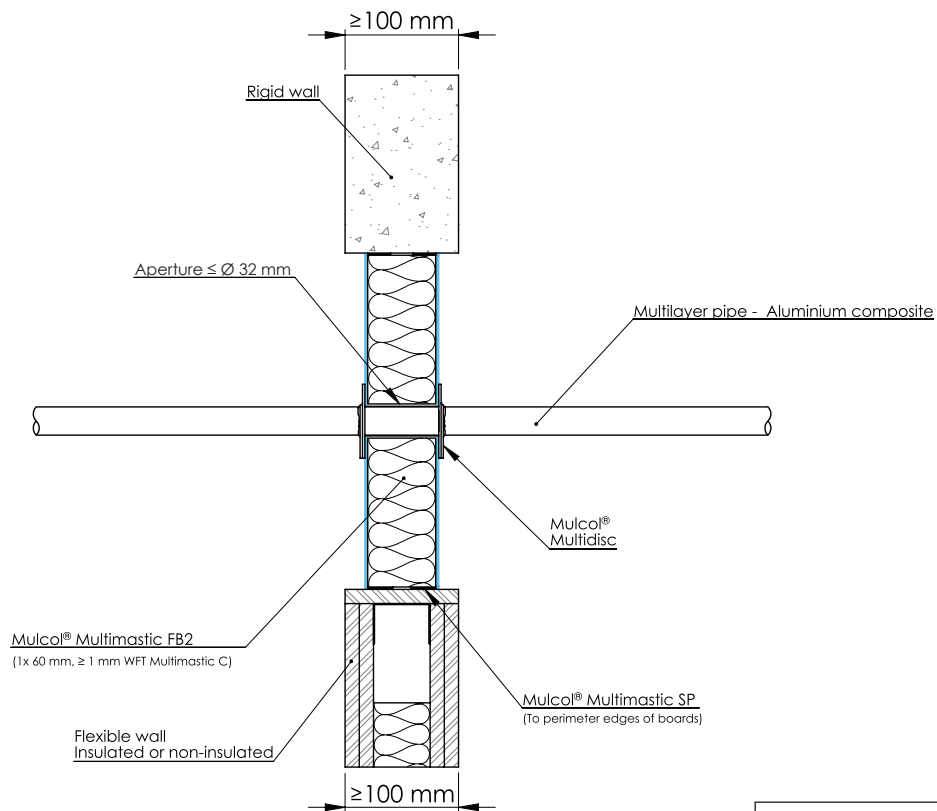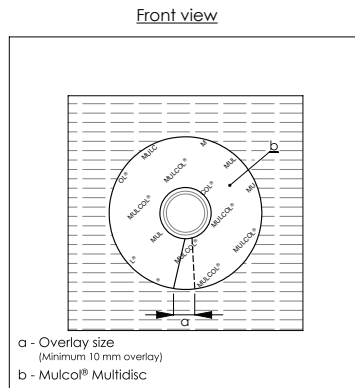


Drawing: PBfw.E-MLA-MFB2.1.10-M2.0.10

Services	Pipe dimensions (mm)		Aperture (mm)	Product	Sealing (mm)	Classification
	Outer diameter	Wall thickness				
Multilayer pipes (MLC)	≤ Ø 16	2.0	≤ Ø 32	Multidisc	Not required	EI 45 U/C E 120 U/C

A.1.8 Multimastic FB2 - 1x 60 mm - Multilayer pipes (MLC)


A.1.8.2 Multilayer pipes (MLC) - Stone wool LI 400 / CI

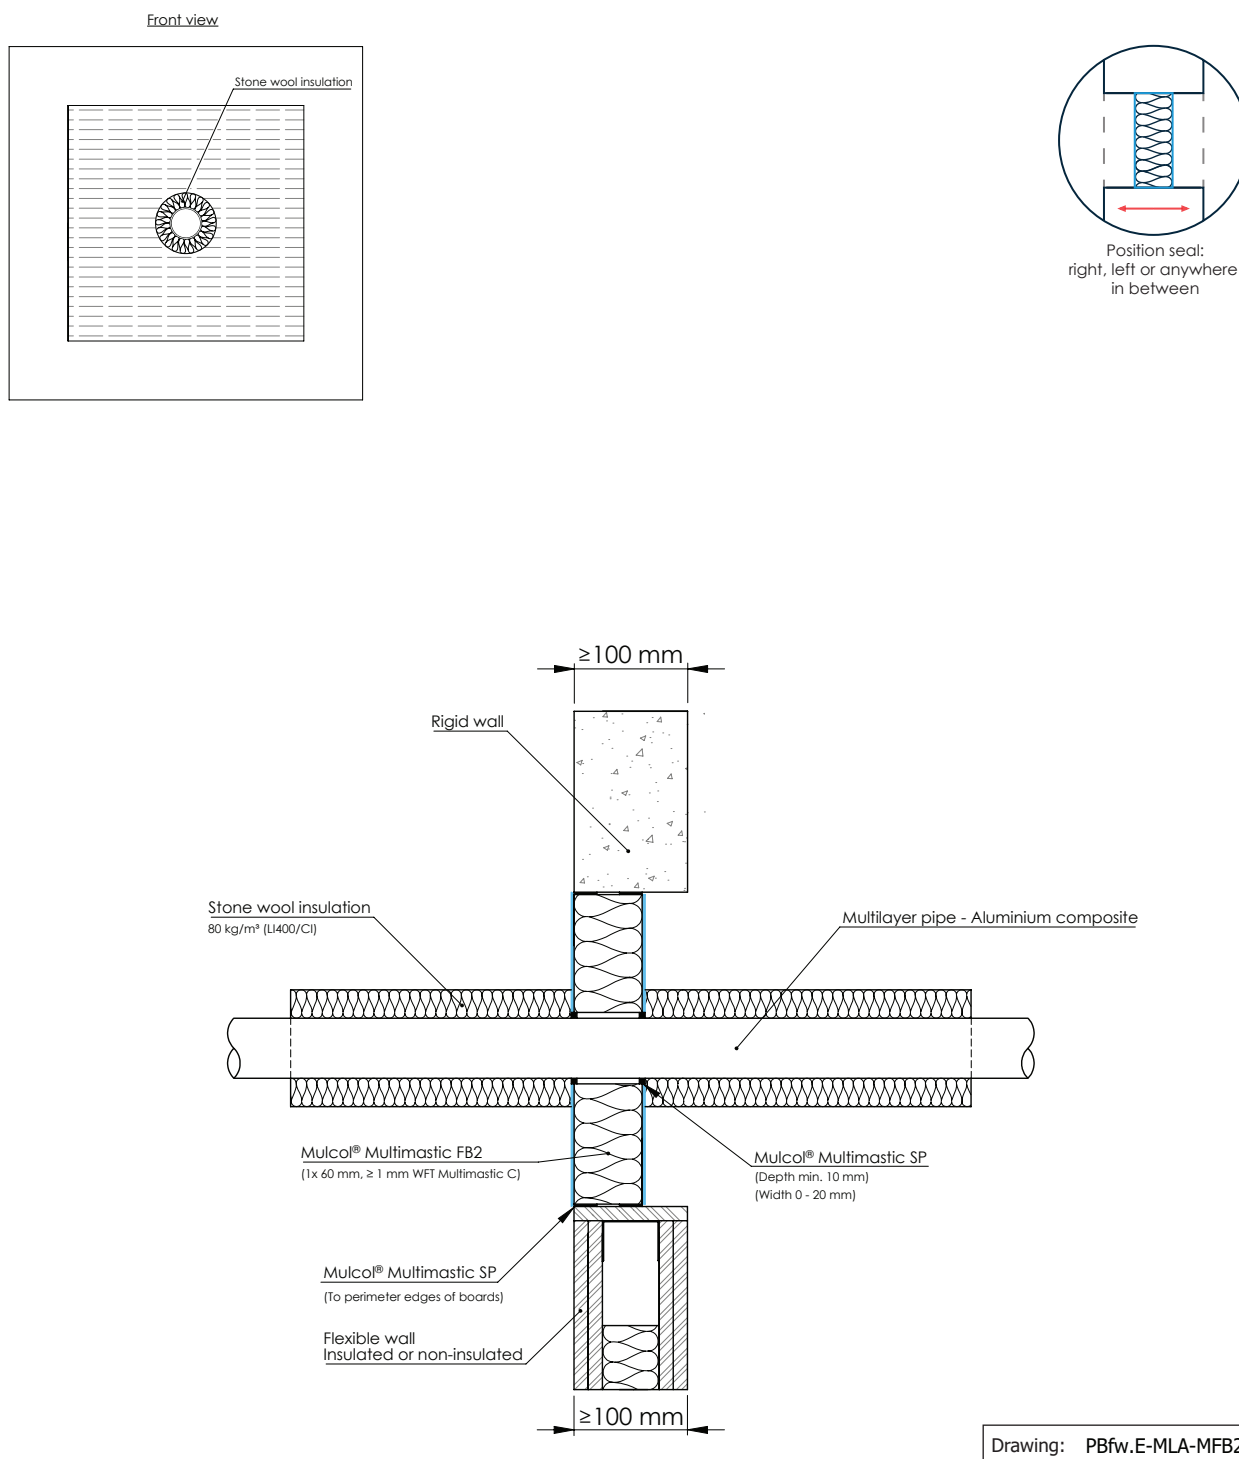

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 40	3.5	Stone wool (≥ 80 kg/m³)	≥ 25	LI 400 / CI	Multimastic SP 0 - 20 x ≥ 10 (wxd)	EI 60 C/U

A.1.9 Multimastic FB1 - 2x 50 mm - Metal pipes insulated mineral wool


A.1.9.1 Copper and steel pipes - Stone wool LS 400 / CS

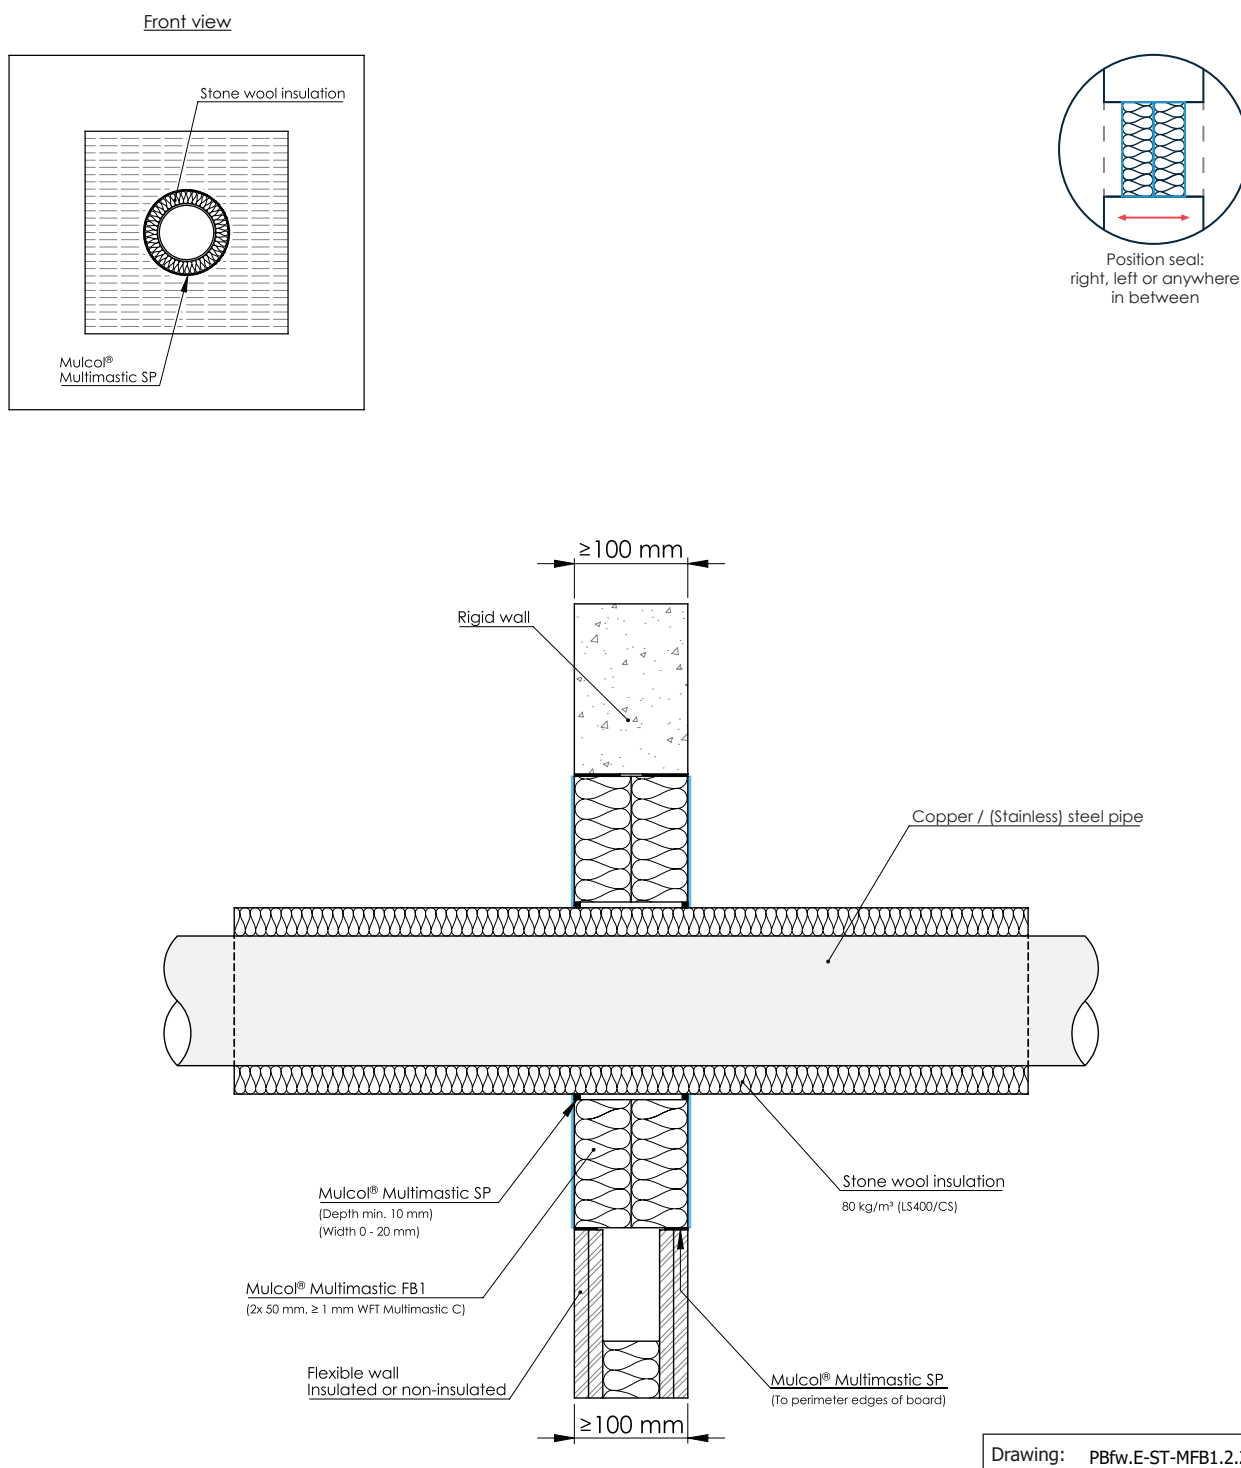

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	25	LS 400 / CS	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 120 C/U
	≤ Ø 54	≥ 1.5					
	≤ Ø 12	≥ 1.5					
	≤ Ø 114.3	≥ 3.6					
	≤ Ø 219.1	≥ 4.0					
(Stainless) Steel / cast iron	≤ Ø 324	≥ 3.7		30	CS		EI 60 C/U
							EI 60 C/U, E 120 C/U
							EI 90 C/U, E 120 C/U

A.1.9 Multimastic FB1 - 2x 50 mm - Metal pipes insulated mineral wool




A.1.9.2 Copper and steel pipes - Stone wool LI 400 / CI

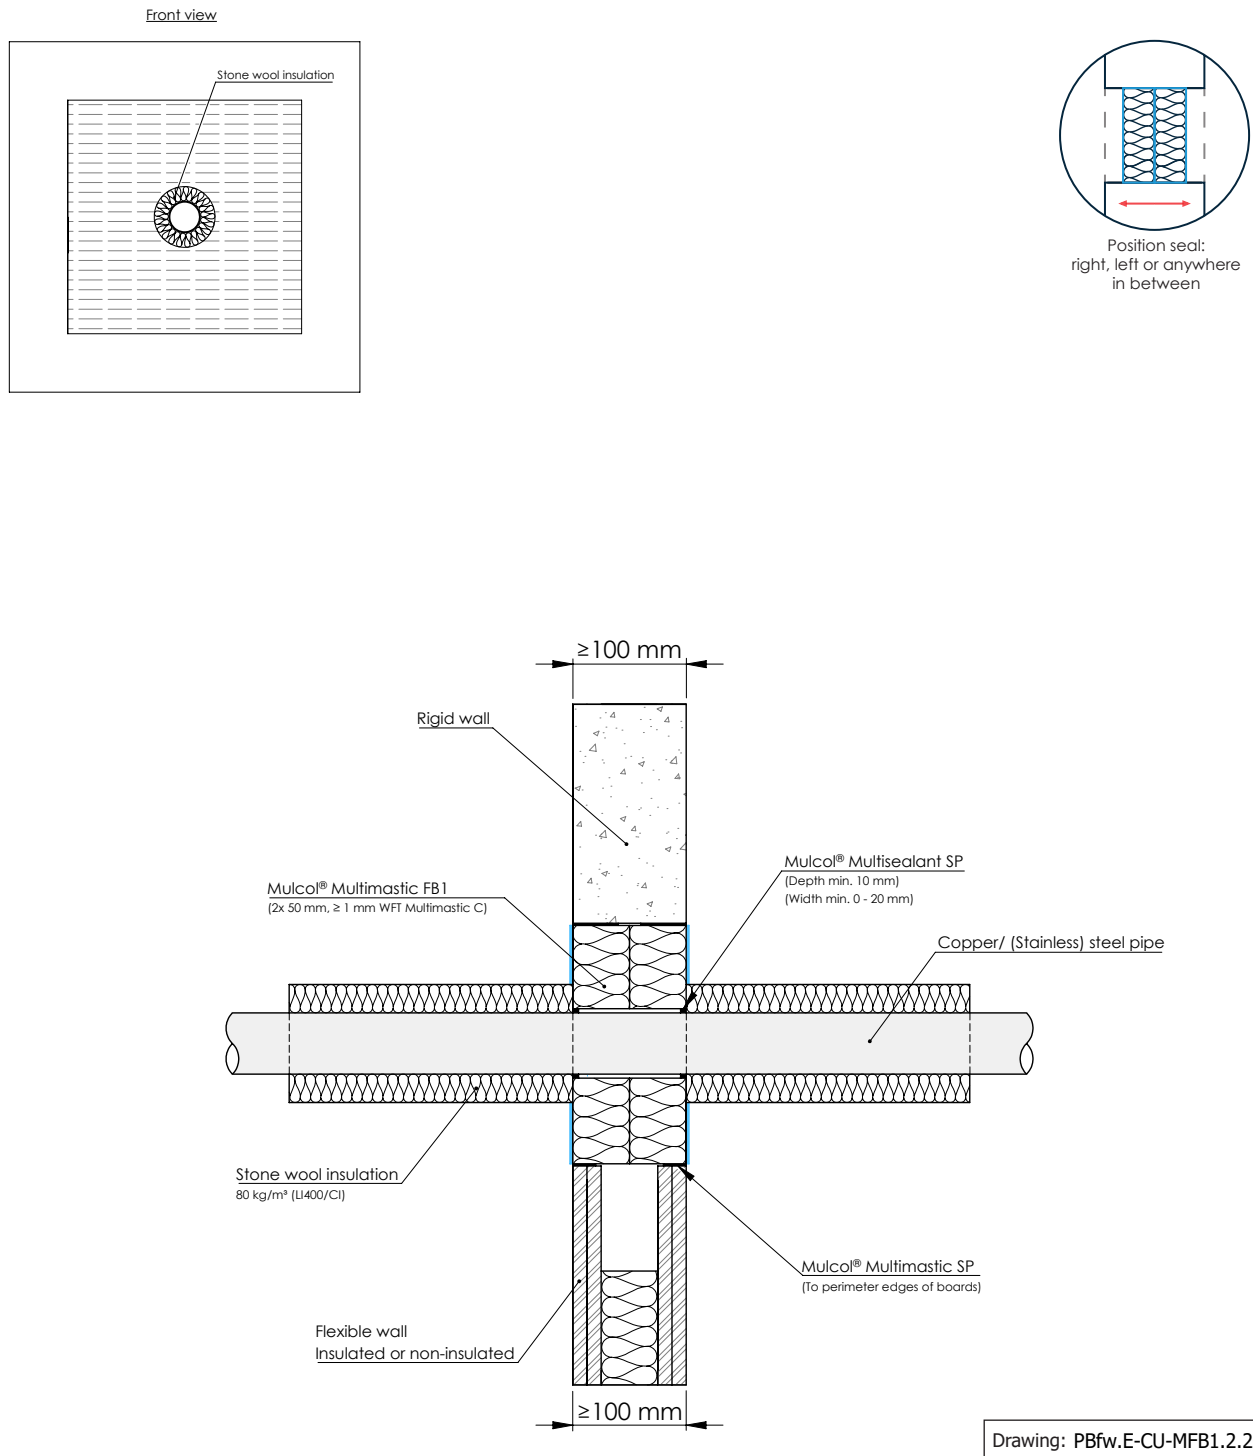

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	≥ 25	LI 400 / CI	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 120 C/U
	≤ Ø 54	≥ 1.5					
(Stainless) Steel / cast iron	≤ Ø 114.3	≥ 3.6					
	≤ Ø 324	≥ 3.7					

A.1.9 Multimastic FB1 - 2x 50 mm - Metal pipes insulated mineral wool

A.1.9.3 Steel pipes - Glass wool LS 400 / CS - Multicollar *Slim*

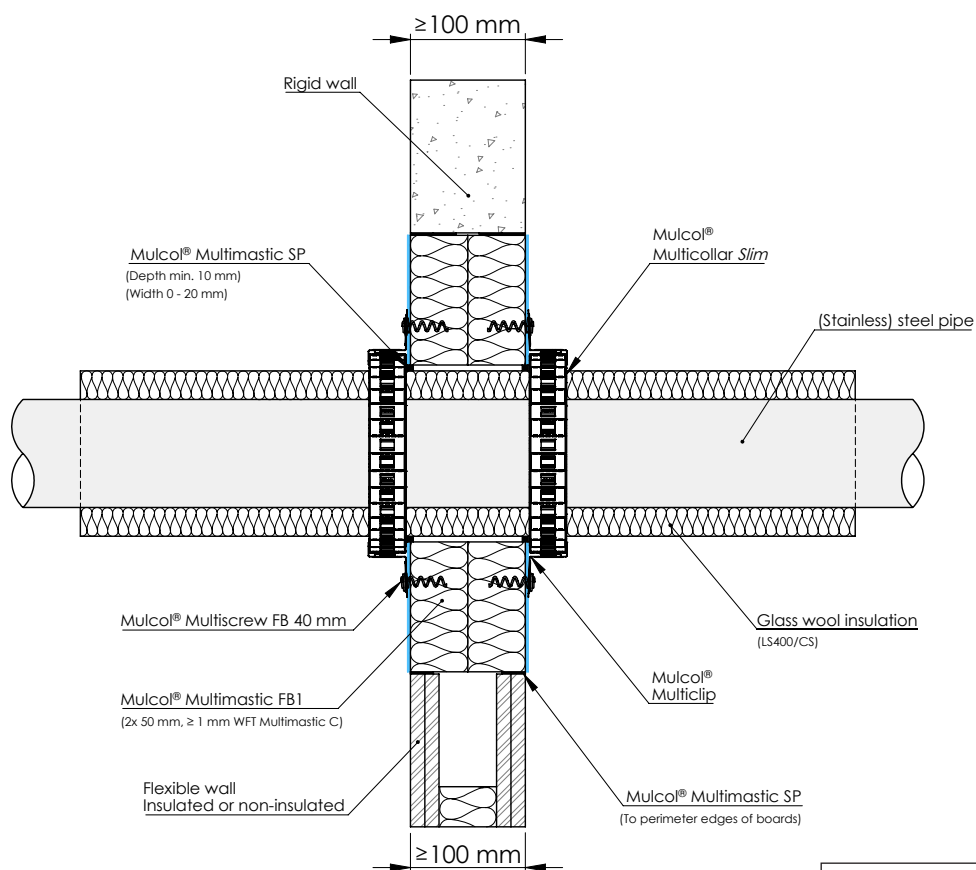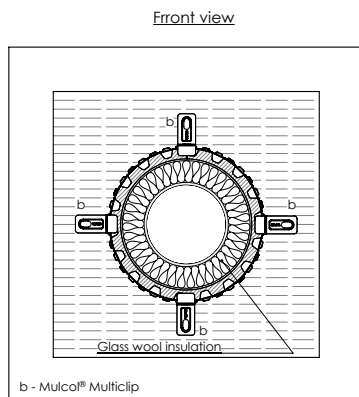

Drawing: PBfw.E-ST-MC30-MFB1.2.20


Services	Pipe dimensions (mm)		Insulation			Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
(Stainless) Steel / cast iron	≤ Ø 76.2	≥ 3.3	Glass wool (≥ 33 kg/m ³)	30	LS 400 / CS	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 90 C/U E 120 C/U
	≤ Ø 139.7	≥ 4.0		50				EI 60 C/U E 90 C/U

A.1.10

Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Metal pipes insulated mineral wool

A.1.10.1

Copper and steel pipes - Stone wool LS 400 / CS

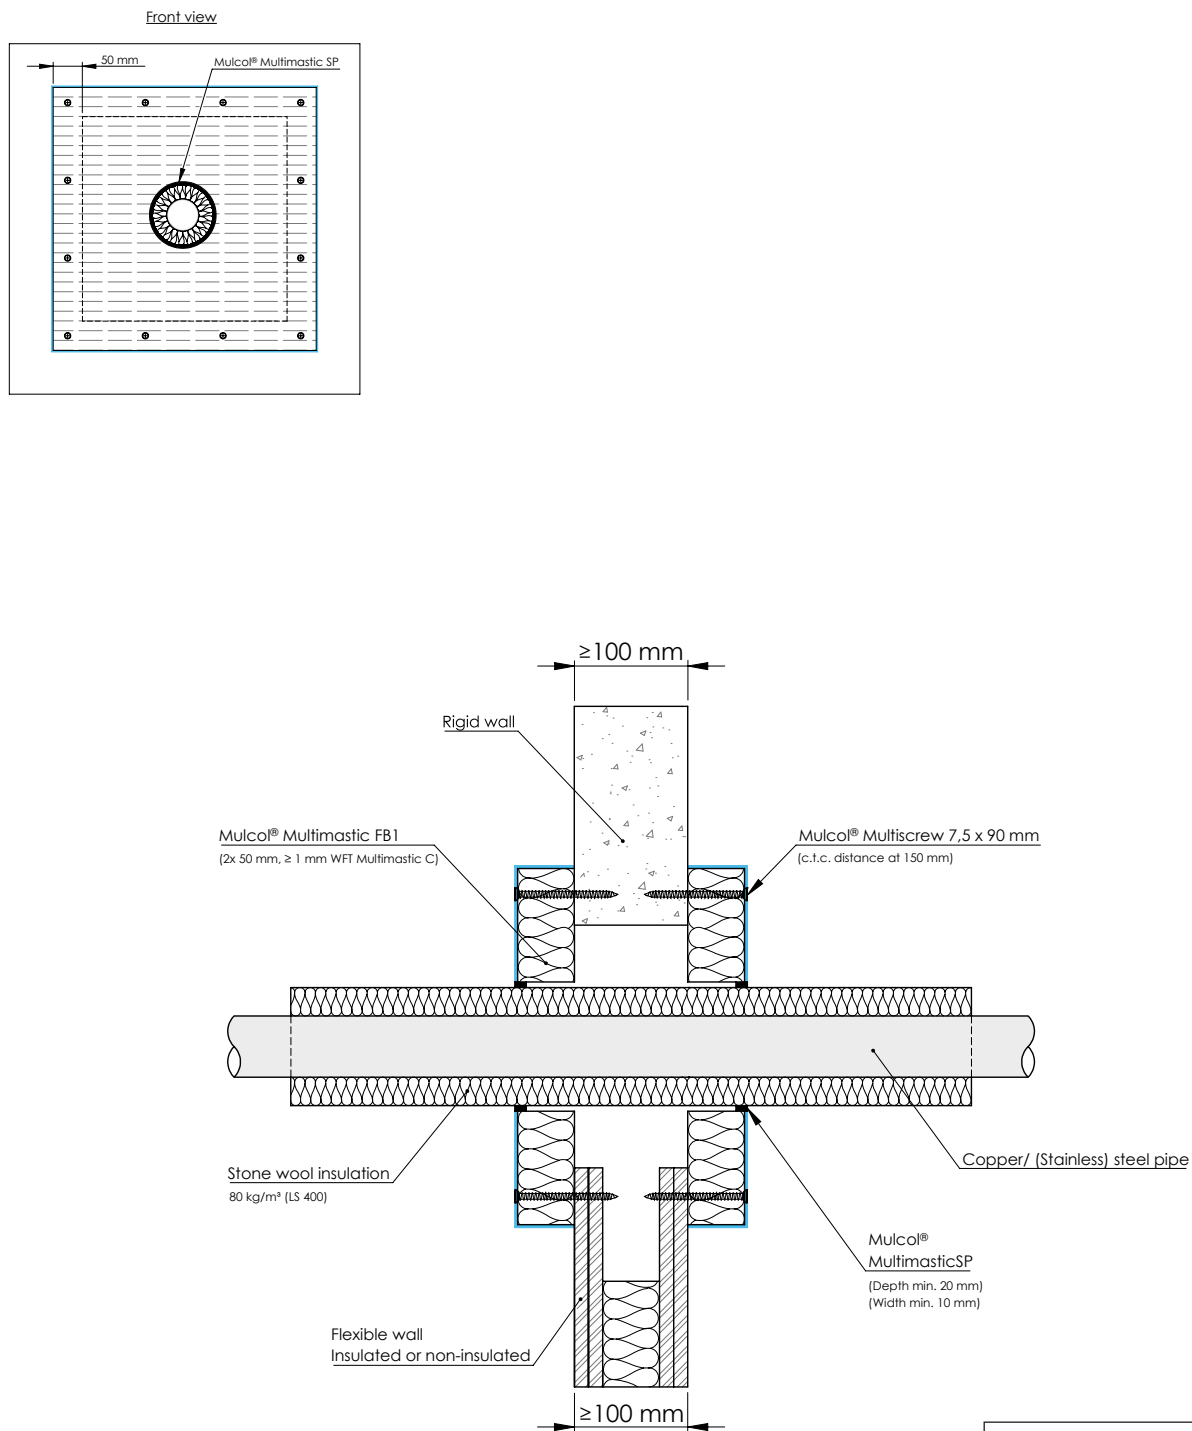

Drawing: PBPfw.E-CU-MFB1.2.20.LS


Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	25	LS 400 / CS	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 120 C/U
	≤ Ø 54	≥ 1.5					
(Stainless) Steel / cast iron	≤ Ø 12	≥ 1.5					EI 60 C/U
	≤ Ø 114.3	≥ 3.6					EI 60 C/U, E 120 C/U
	≤ Ø 219.1	≥ 4.0					EI 90 C/U, E 120 C/U
	≤ Ø 324	≥ 3.7		30	CS		

A.1.10

Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Metal pipes insulated mineral wool

A.1.10.2


Copper and steel pipes - Stone wool LI 400 / CI

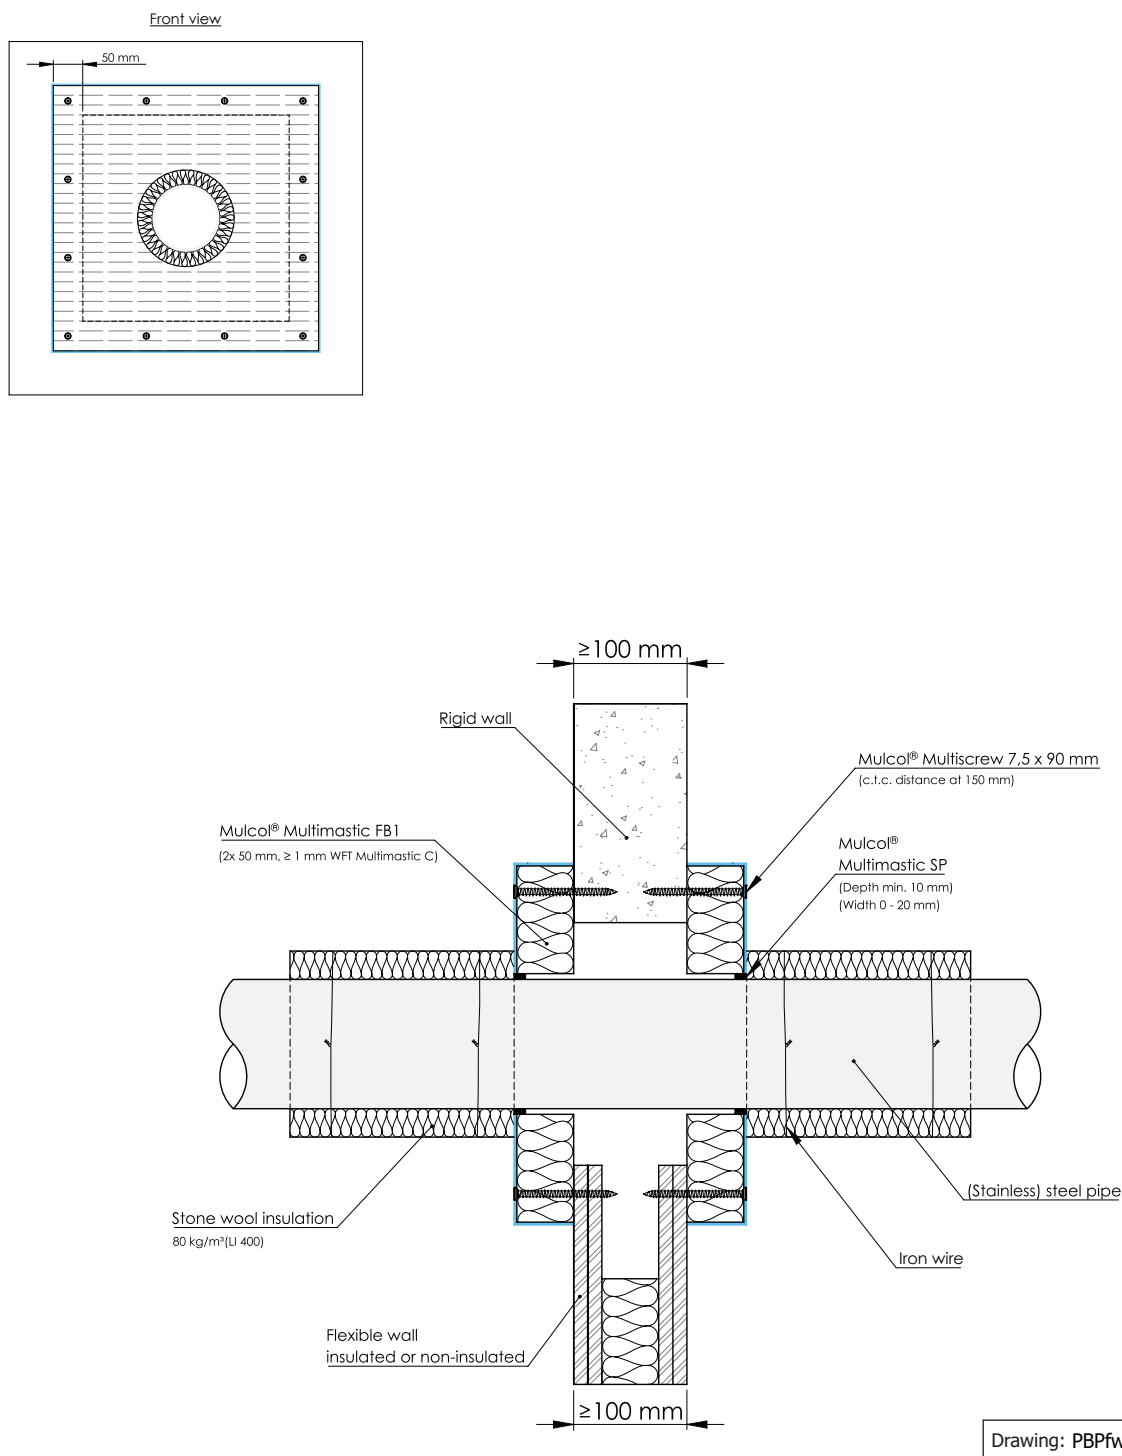

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless)	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	≥ 25	LI 400 / CI	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 120 C/U
steel / cast iron	≤ Ø 54	≥ 1.5					
(Stainless) Steel /	≤ Ø 114.3	≥ 3.6					
cast iron	≤ Ø 324	≥ 3.7					

A.1.11 Multimastic FB2 - 1x 60 mm - Metal pipes insulated mineral wool


A.1.11.1 Copper and steel pipes - Stone wool LS 400 / CS

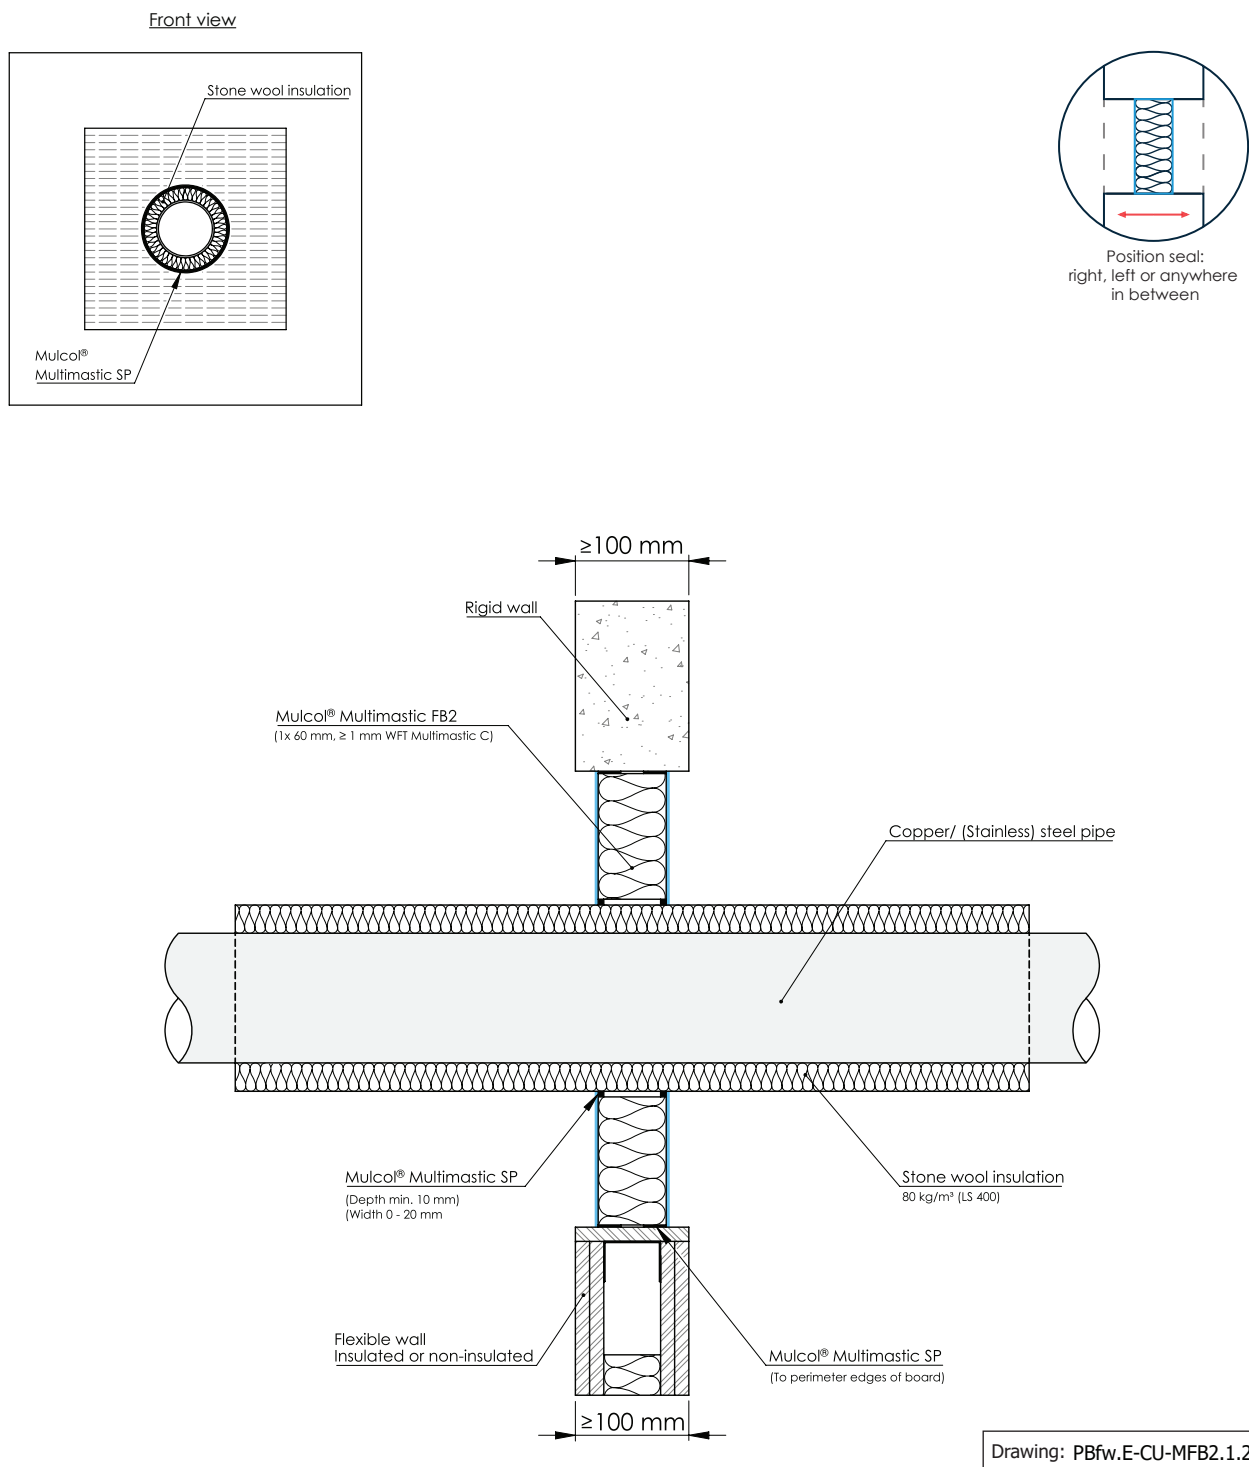

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification	
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	25	LS 400 / CS	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 60 C/U E 90 C/U	
	≤ Ø 54	≥ 1.5						
(Stainless) Steel / cast iron	≤ Ø12	≥ 1.5						EI 90 C/U E 120 C/U
	≤ Ø 114.3	≥ 3.6						
	≤ Ø 324	≥ 3.7		30			EI 60 C/U	

A.1.11 Multimastic FB2 - 1x 60 mm - Metal pipes insulated mineral wool


A.1.11.2 Copper and steel pipes - Stone wool LI 400 / CI

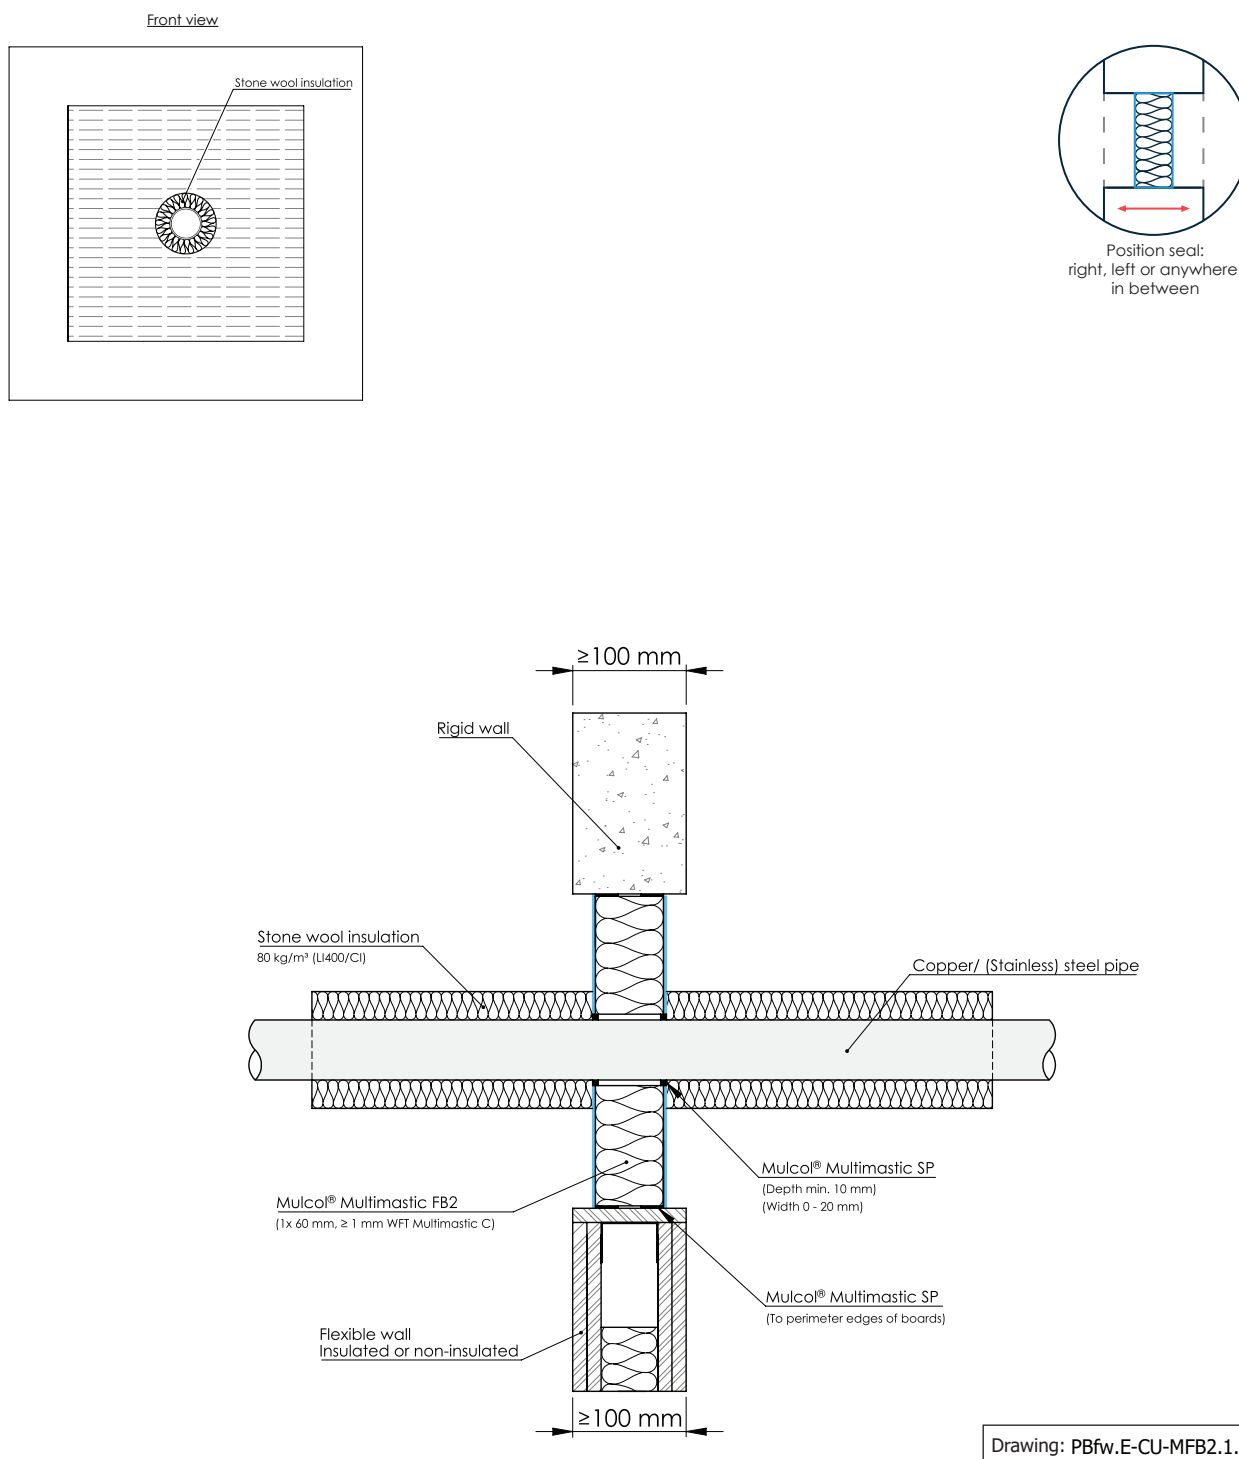

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	≥ 25	LI 400 / CI	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 60 C/U
	≤ Ø 54	≥ 1.5					
(Stainless) Steel / cast iron	≤ Ø 114.3	≥ 3.6					

A.1.12 Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer

A.1.12.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR

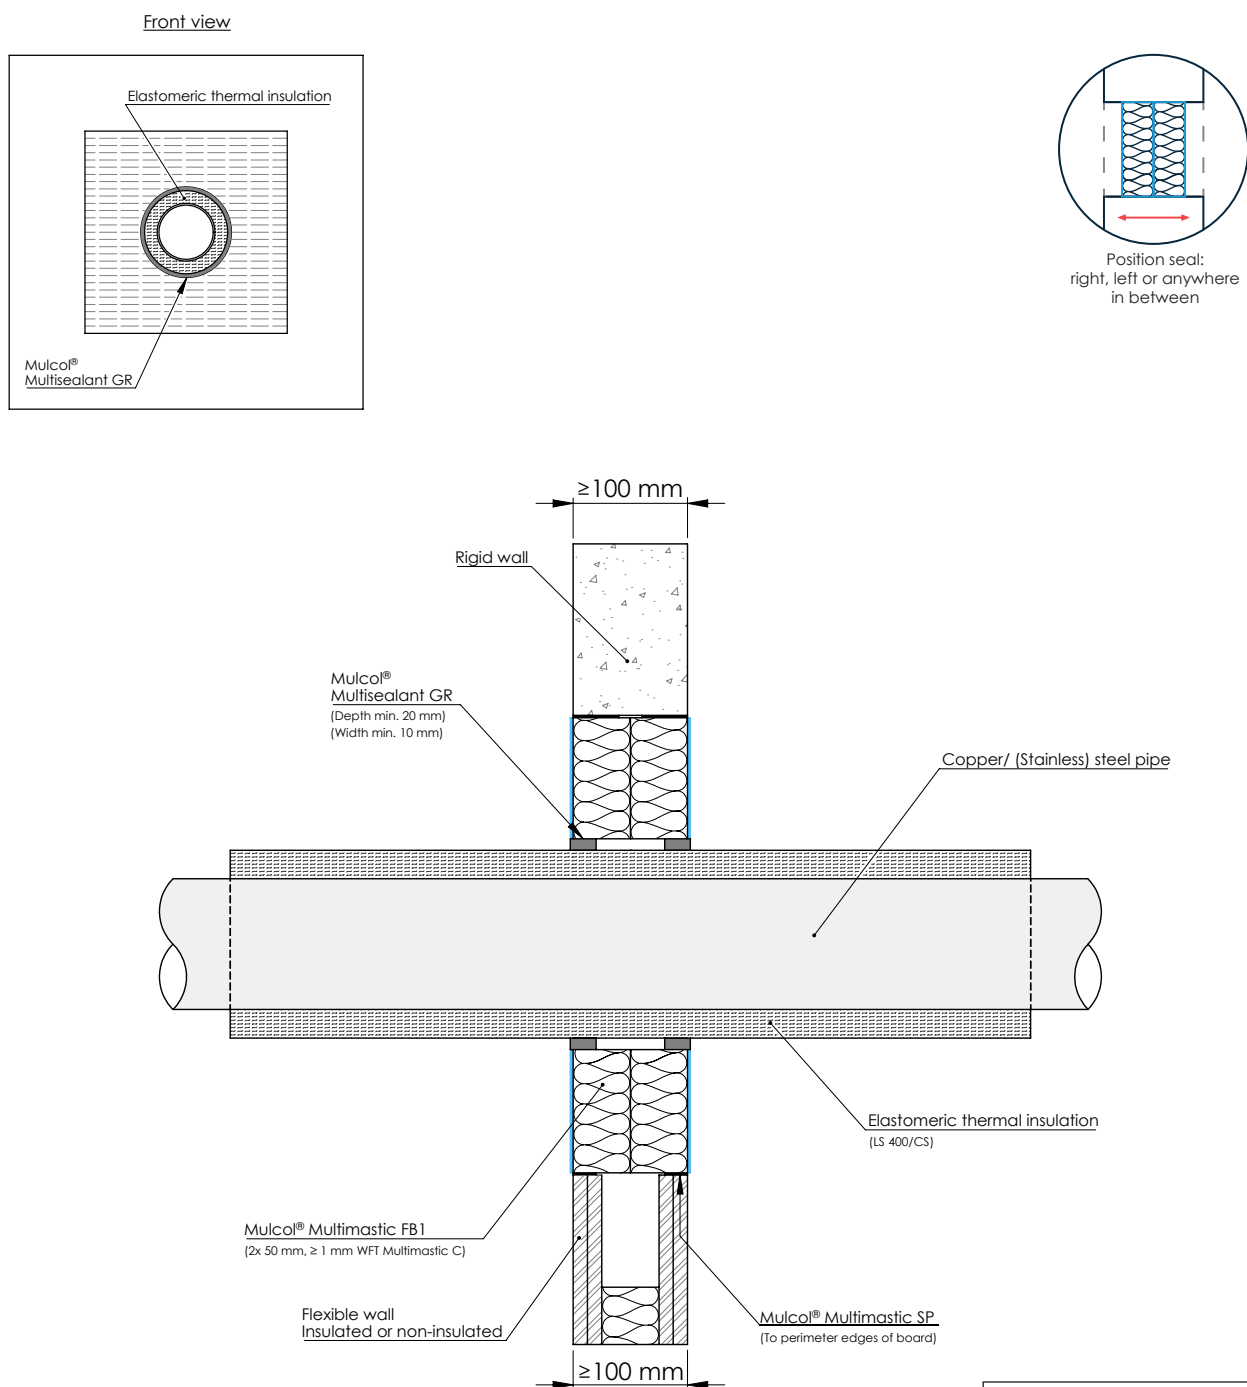

Drawing: PBfw.E-CU-MFB1-G2.4.22

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	8.5	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	EI 90 C/U, E 120 C/U
				8.5 - 38			EI 90 C/U
	13.5 - 38	EI 30 C/U, E 90 C/U					
	≤ Ø 54	≥ 1.5		13.5	CS		EI 90 C/U
				13.5 - 38			EI 60 C/U, E 90 C/U
				38	LS 400 / CS		EI 90 C/U
(Stainless) Steel / cast iron				≤ Ø 26.9			≥ 2.3
	8.5 - 38	EI 90 C/U					
	≤ Ø 114.3	≥ 3.6		15 - 43			EI 45 C/U, E 90 C/U
				43	EI 60 C/U, E 90 C/U		

A.1.12 Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer

A.1.12.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
(Stainless) Steel / cast iron	$\leq \varnothing 26.9$	≥ 2.3	Kaiflex KK Plus (min. class B-s2, d0 B _L -s2, d0)	8.5	LS 400 / CS	Multisealant GR $\geq 10 \times 20$ (wxd)	EI 120 C/U

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex NH (min. class D-s3, d0 D _L -s3, d0)	9	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxwd)	EI 90 C/U
	≤ Ø 54	≥ 1.5		9 - 25			EI 60 C/U
				13			EI 45 C/U, E 90 C/U
				13	EI 60 C/U, E 90 C/U		
	(Stainless) Steel / cast iron	≤ Ø 26.9		≥ 2.3	13 - 25		CS
9			LS 400 / CS		EI 90 C/U, E 120 C/U		
9 - 25					EI 60 C/U, E 90 C/U		
19 - 25					EI 45 C/U		
25					EI 60 C/U, E 90 C/U		

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex Ultima (min. class B-s1, d0 B _L -s1, d0)	9 - 32	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	EI 60 C/U, E 120 C/U
	≤ Ø 54	≥ 1.5		32			EI 90 C/U
				13			EI 60 C/U, E 120 C/U
				13 - 32			EI 60 C/U, E 90 C/U
				32			EI 90 C/U
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		9			EI 120 C/U
	≤ Ø 114.3	≥ 3.6		9 - 32			EI 90 C/U, E 120 C/U
				13			EI 90 C/U
				13 - 32			EI 60 C/U, E 120 C/U




A.1.12

Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer

A.1.12.2

Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR - Multitherm Bandage

Front view

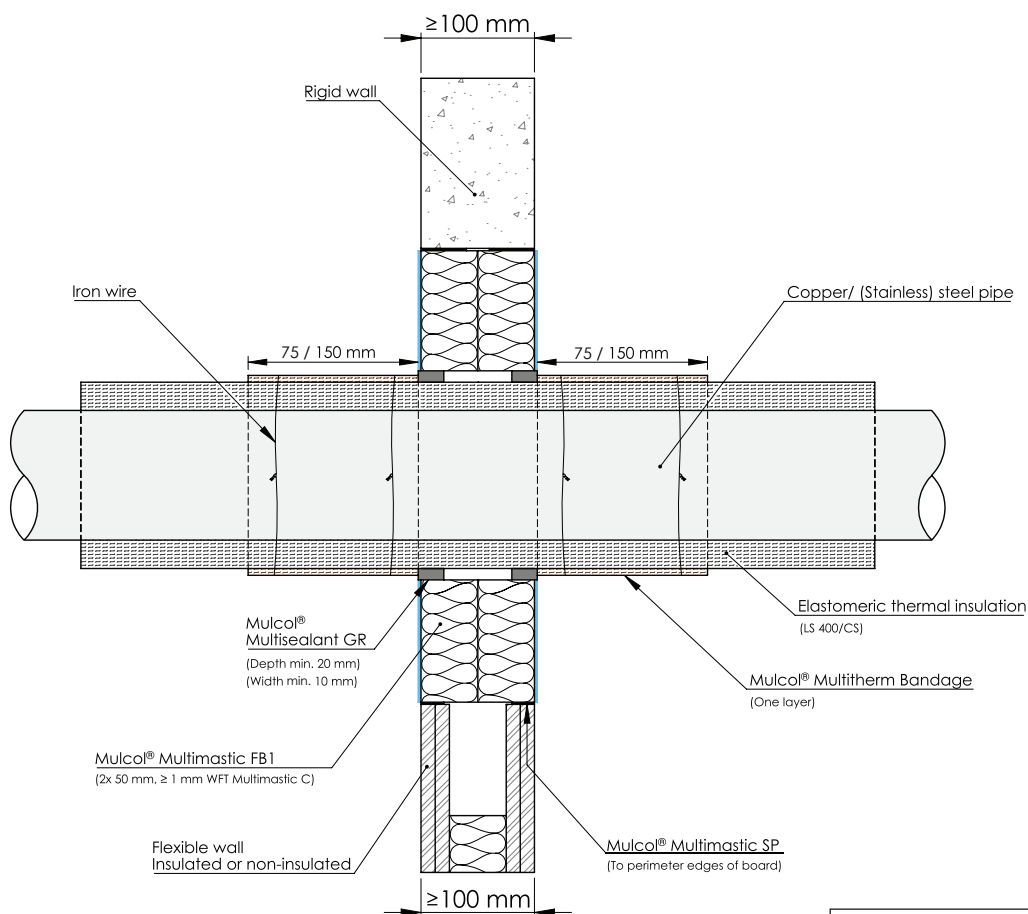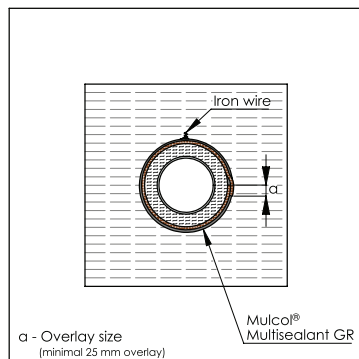

Drawing: PBfw.E-CU-MFB1-G2.4.92

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Multitherm Bandage	Classification			
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration						
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	8.5	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	LI ≥ 75 one layer (one wire)	EI 90 C/U, E 120 C/U			
				8.5 - 38				EI 90 C/U			
	≤ Ø 54	≥ 1.5		13.5 - 38	CS			EI 30 C/U, E 90 C/U			
				13.5 - 38				EI 60 C/U, E 90 C/U			
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		38	LS 400 / CS		LI ≥ 150 one layer (two wires)	EI 90 C/U			
				8.5				EI 90 C/U, E 120 C/U			
	≤ Ø 114.3	≥ 3.6		8.5 - 38				EI 90 C/U			
				18.5				EI 90 C/U, E 120 C/U			
				18.5 - 43				EI 90 C/U			

A.1.12 Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer

A.1.12.2 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR - Multitherm Bandage




Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Multitherm Bandage	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 54	≥ 1.5	Kaiflex KK Plus (min. class B-s2, d0 B _L -s2, d0)	13.5	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	LI ≥ 75 one layer (two wires)	EI 120 C/U
				13.5 - 35.5			LI ≥ 150 one layer (two wires)	EI 90 C/U, E 120 C/U
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		8.5			LI ≥ 75 one layer (two wires)	EI 120 C/U
				8.5 - 35.5			LI ≥ 150 one layer (two wires)	EI 90 C/U, E 120 C/U
	≤ Ø 114.3	≥ 3.6		15 - 35.5			LI ≥ 150 one layer (two wires)	EI 90 C/U, E 120 C/U
				35.5 - 40			LI ≥ 150 one layer (two wires)	EI 120 C/U

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Multitherm Bandage	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex NH (min. class D-s3, d0 D _L -S3, d0)	9	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	LI ≥ 75 one layer (two wires)	EI 90 C/U
				9 - 25				EI 60 C/U
	≤ Ø 54	≥ 1.5		13	CS			EI 45 C/U, E 90 C/U
				13				EI 60 C/U, E 90 C/U
				13 - 25	EI 45 C/U			
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		9	LS 400 / CS			EI 90 C/U, E 120 C/U
				9 - 25				EI 60 C/U, E 90 C/U
	≤ Ø 114.3	≥ 3.6		19 - 25				EI 45 C/U
				25				EI 60 C/U, E 90 C/U

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Multitherm Bandage	Classification		
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration					
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex Ultima (min. class B-s1, d0 B _L -s1, d0)	9 - 32	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	LI ≥ 75 one layer (two wires)	EI 90 C/U, E 120 C/U		
				32			EI 90 C/U			
	≤ Ø 54	≥ 1.5		13			LI ≥ 150 one layer (two wires)	EI 120 C/U		
				13 - 32			EI 90 C/U			
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		9			LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	LI ≥ 75 one layer (two wires)	EI 120 C/U
				9 - 32						EI 90 C/U, E 120 C/U
	≤ Ø 114.3	≥ 3.6		13 - 32					EI 90 C/U	
				32					LI ≥ 150 one layer (two wires)	EI 90 C/U, E 120 C/U

A.1.12 Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer

A.1.12.3 Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap

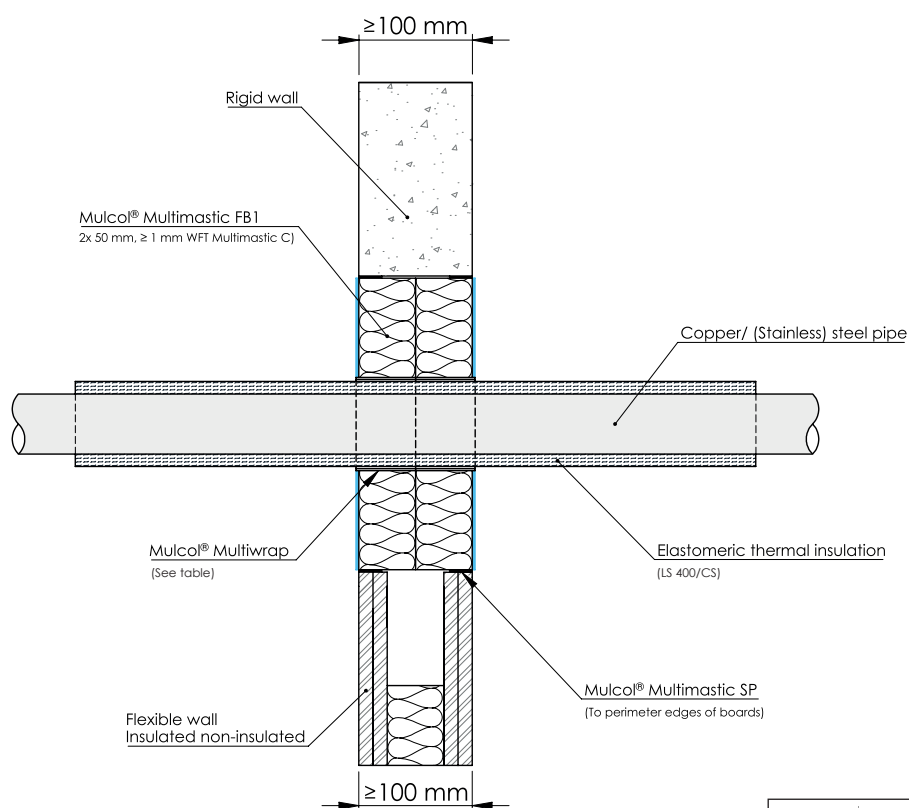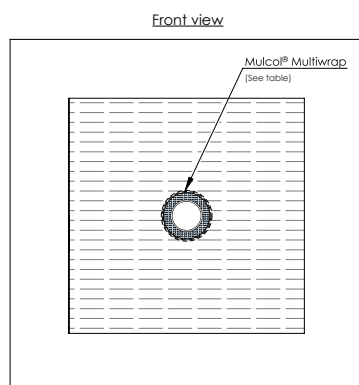

Drawing: PBfw.E-CU-MW2-MFB1.2.22

Services	Pipe dimensions (mm)		Insulation			Product	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 12	≥ 1.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	9	LS 400 / CS	Multiwrap (2 layers)	EI 120 C/U, E 180 C/U
	≤ Ø 35	≥ 1.1		35			EI 90 C/U, E 120 C/U
	≤ Ø 54	≥ 1.5		60		Multiwrap (3 layers)	EI 120 C/U
				38			Multiwrap (2 layers)
(Stainless) Steel / cast iron	≤ Ø 114.3	≥ 3.6		15	CS	EI 60 C/U, E 120 C/U	
	≤ Ø 219.1	≥ 4.0		32		EI 45 C/U, E 120 C/U	
	≤ Ø 324	≥ 3.7			50	LS 400 / CS	
				CS		Multiwrap (3 layers)	EI 60 C/U, E 120 C/U
							EI 45 C/U, E 180 C/U
				EI 90 C/U, E 180 C/U			




A.1.12 Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer**A.1.12.3 Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap**

Services	Pipe dimensions (mm)		Insulation			Product	Classification
	Outer dimension	Wall thick-ness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Kaiflex ST (min. class B-s3, d0 B _L -s3, d0)	9 - 32	LS 400 / CS	Multiwrap (2 layers)	EI 90 C/U, E 120 C/U
				32			EI 120 C/U
	≤ Ø 54	≥ 1.5		13 - 32			EI 30 C/U, E 120 C/U
				32			EI 60 C/U, E 120 C/U
(Stainless) Steel / cast iron	≤ Ø 114.3	≥ 3.6		13			EI 60 C/U, E 120 C/U
	≤ Ø 168.3	≥ 4.5		13 - 32			EI 45 C/U, E 120 C/U
				32			EI 60 C/U, E 120 C/U

A.1.12 Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer

A.1.12.4 Copper and steel pipes - ArmaFlex Protect LS 400 / CS

Front view

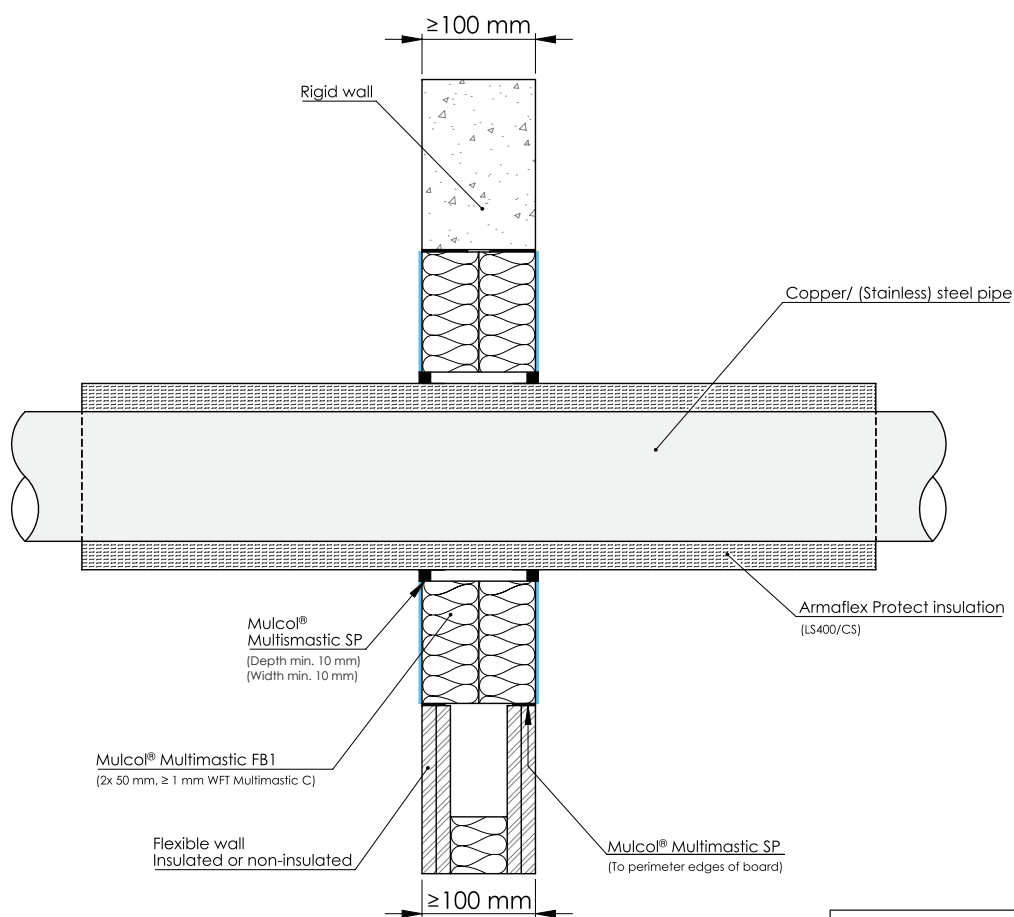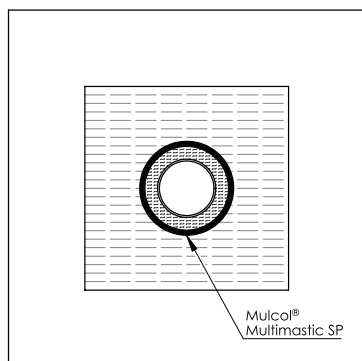

Drawing: PBfw.E-CU-MFB1.2.10



Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex Protect	20 - 25	LS 400 / CS	Multimastic SP 10 x ≥ 10 (wxd)	EI 120 C/U
	≤ Ø 54	≥ 1.5		25			EI 90 C/U, E 120 C/U

A.1.13

Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Metal pipes insulated elastomer

A.1.13.1

Copper and steel pipes - Elastomer LS400 / CS - Multiwrap

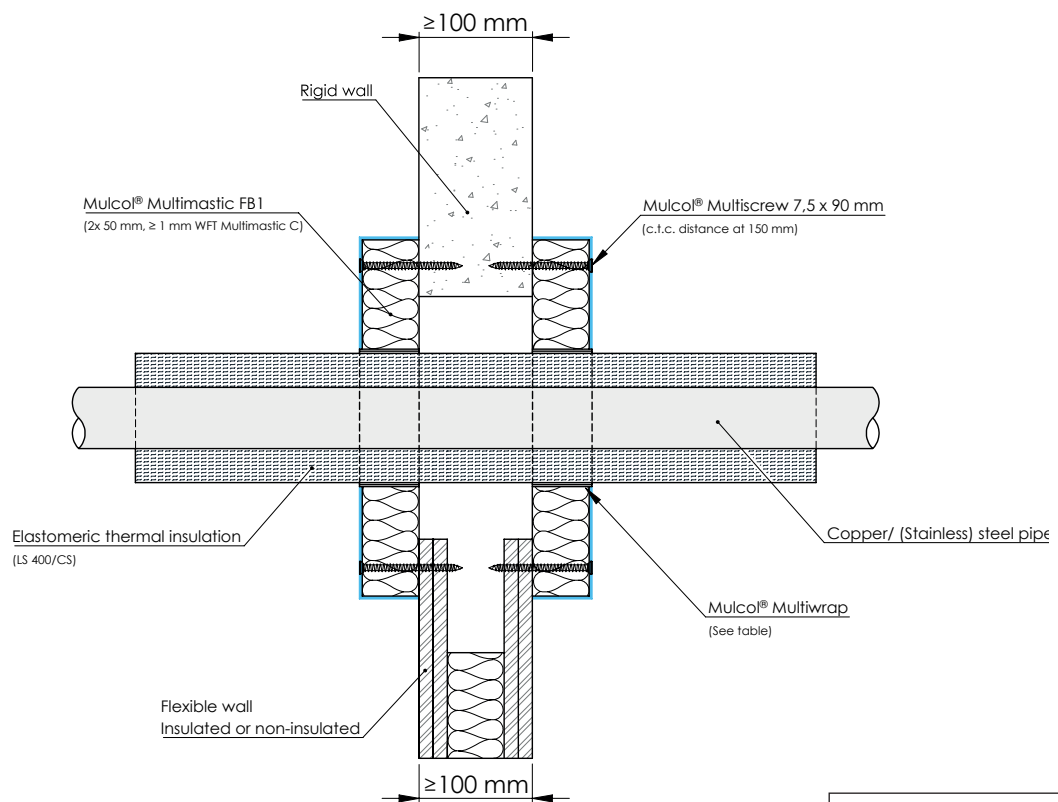
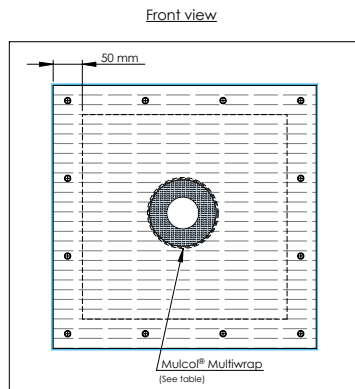


Drawing: PBPfw.E-CU-MW2-MFB1.2.22

Services	Pipe dimensions (mm)		Insulation			Product	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 54	≥ 1.5	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	38	LS 400 / CS	Multiwrap (2 layers)	EI 60 C/U, E 120 C/U

A.1.13 Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Metal pipes insulated elastomer

A.1.13.2 Copper and steel pipes - ArmaFlex Protect LS 400 / CS

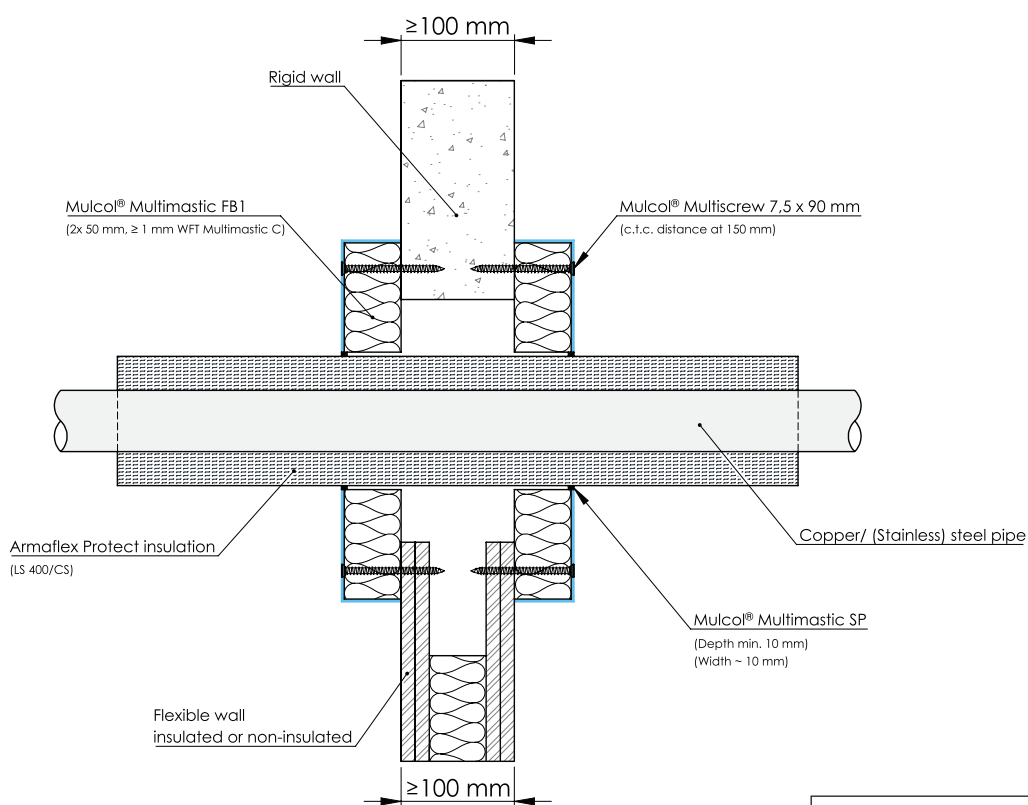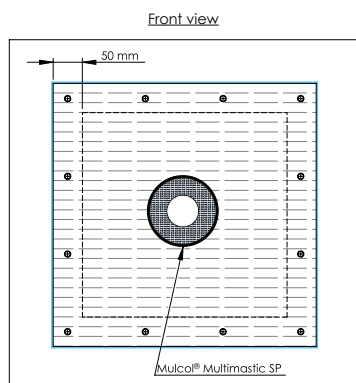


Drawing: PBPfw.E-CU-MFB1.2.22

Services	Pipe dimensions (mm)		Type	Insulation		Sealing (mm)	Classification
	Outer dimension	Wall thickness		Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex Protect	20 - 25	LS 400 / CS	Multimastic SP 10 x ≥ 10 (wxd)	EI 120 U/C
	≤ Ø 54	≥ 1.5		25			EI 90 C/U, E 120 C/U

A.1.14 Multimastic FB2 - 1x 60 mm - Metal pipes insulated elastomer

A.1.14.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR

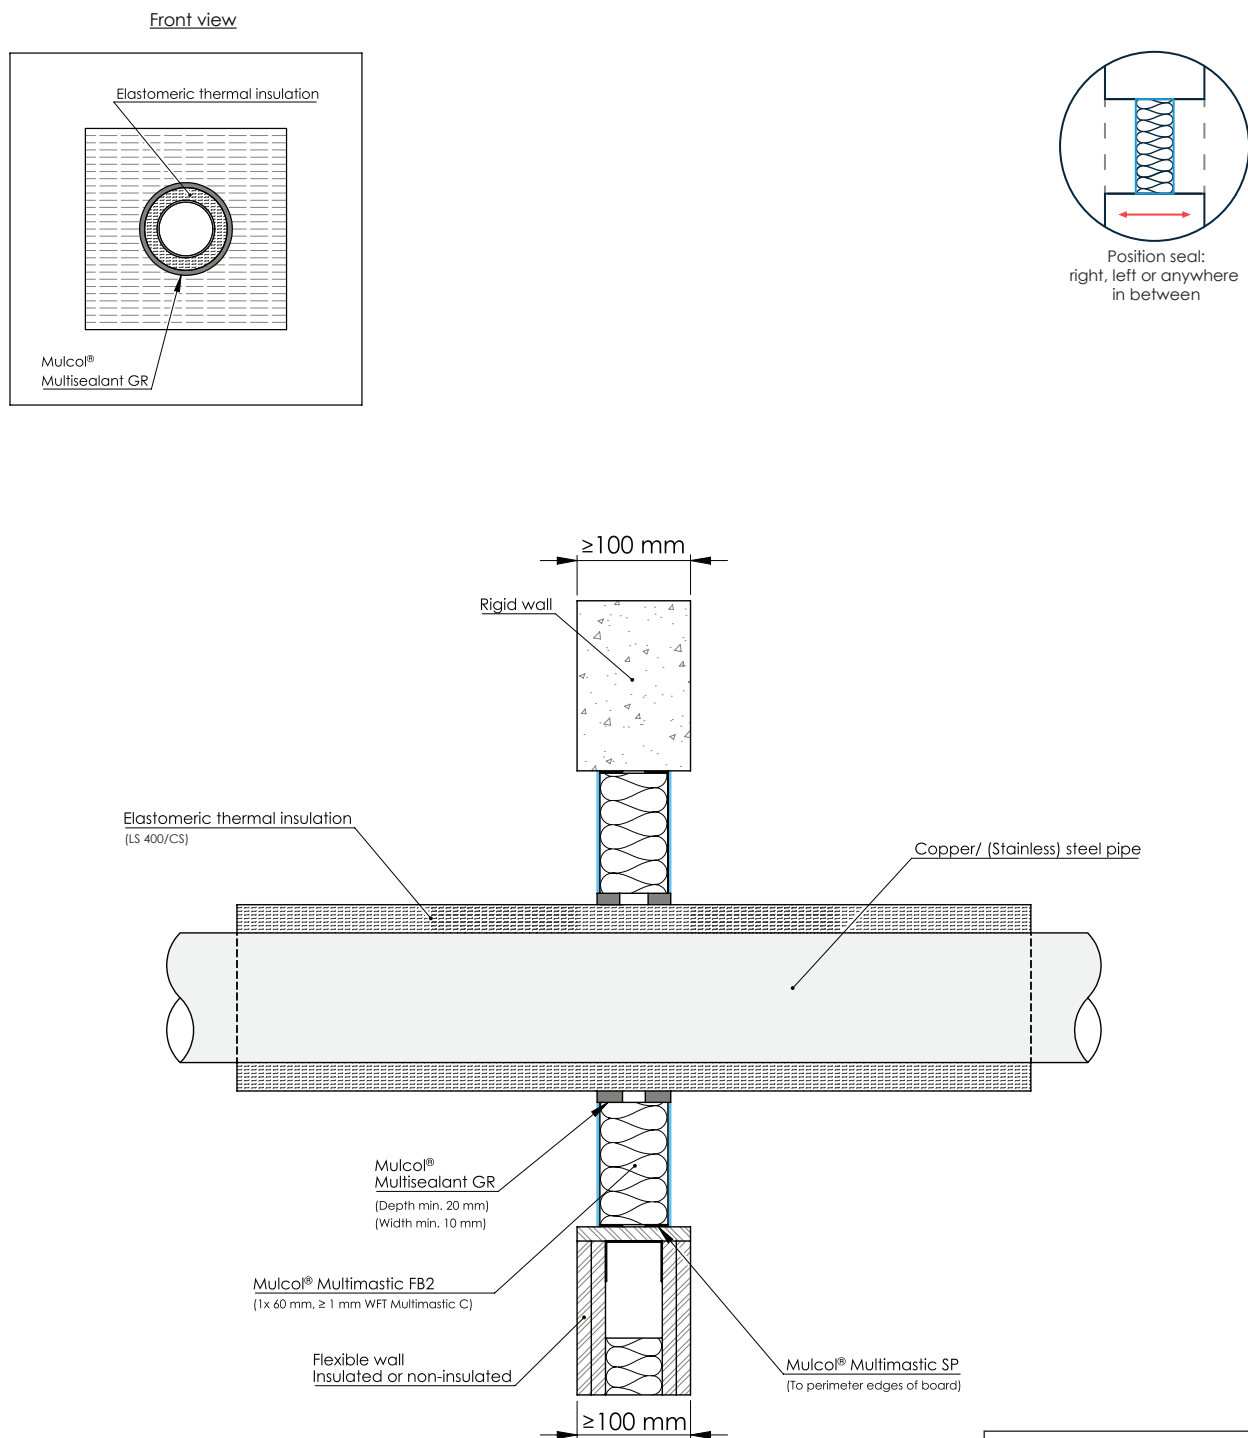

Drawing: PBfw.E-CU-MFB2-G2.4.22

Services	Pipe dimensions (mm)		Insulation			System (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	8.5	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	EI 60 C/U, E 90 C/U
				8.5 - 33.5			EI 60 C/U, E 120 C/U
	≤ Ø 54	≥ 1.5		13.5 - 38			EI 45 C/U, E 60 C/U
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		8.5 - 43	CS		EI 60 C/U
	≤ Ø 114.3	≥ 3.6		15 - 43			EI 45 C/U, E 60 C/U
				15 - 43	EI 60 C/U		
				43	LS 400 / CS		EI 60 C/U

A.1.14 Multimastic FB2 - 1x 60 mm - Metal pipes insulated elastomer

A.1.14.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR


Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Kaiflex KK Plus (min. class B-s2, d0 B _L -s2, d0)	35.5	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	EI 45 C/U / E 90 C/U
	≤ Ø 54	≥ 1.5		35.5			EI 45 C/U / E 90 C/U
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		8.5			EI 90 C/U / E 120 C/U
	≤ Ø 114.3	≥ 3.6		8.5 - 40			EI 45 C/U / E 120 C/U
				15 - 40			EI 45 C/U / E 90 C/U

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex NH (min. class D-s3, d0 D _L -S3, d0)	9 - 25	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	EI 30 C/U, E 60 C/U
				9 - 25	CS		EI 60 C/U
				25	LS 400 / CS		EI 60 C/U
	13	EI 45 C/U, E 120 C/U					
	≤ Ø 54	≥ 1.5		13	CS		EI 60 C/U, E 120 C/U
				13 - 25	LS 400 / CS		EI 45 C/U, E 60 C/U
(Stainless) Steel / cast iron				≤ Ø 26.9			≥ 2.3
	≤ Ø 114.3	≥ 3.6		9 - 25			EI 60 C/U
				13 - 25			EI 60 C/U

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex Ultima (min. class B-s1, d0 B _L -S1, d0)	9 - 25	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	EI 45 C/U, E 120 C/U
				25			EI 60 C/U, E 120 C/U
	≤ Ø 54	≥ 1.5		13 - 32			EI 45 C/U, E 90 C/U
				32			EI 60 C/U, E 90 C/U
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		9 - 32			EI 60 C/U, E 90 C/U
				32			EI 60 C/U, E 120 C/U
	≤ Ø 114.3	≥ 3.6		13 - 32			EI 90 C/U, E 120 C/U

A.1.14 Multimastic FB2 - 1x 60 mm - Metal pipes insulated elastomer

A.1.14.2 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR - Multitherm Bandage

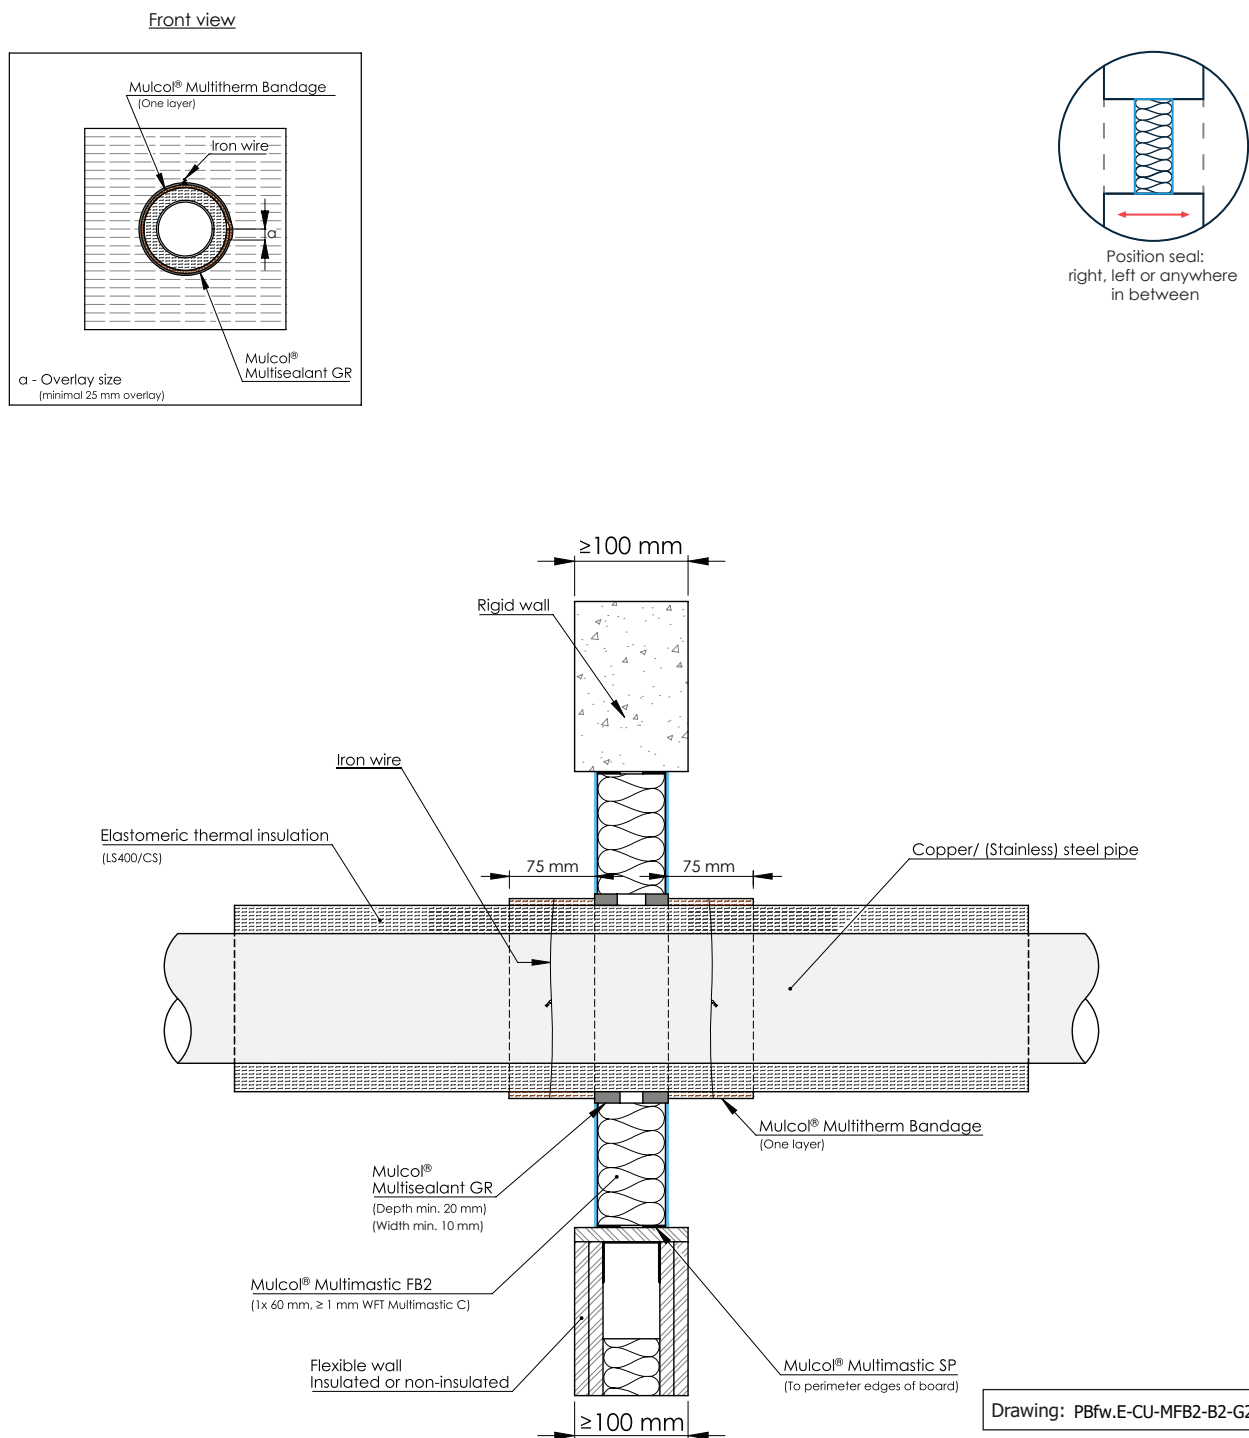

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Multitherm Bandage	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	8.5 - 33.5	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	LI ≥ 75 one layer (one wire)	EI 60 C/U
	≤ Ø 54	≥ 1.5		17 - 43				
(Stainless)	≤ Ø 26.9	≥ 2.3		8.5 - 43				
Steel / cast iron	≤ Ø 114.3	≥ 3.6		15 - 43				

A.1.14 Multimastic FB2 - 1x 60 mm - Metal pipes insulated elastomer**A.1.14.2 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR - Multitherm Bandage**

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Multitherm Bandage	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Kaiflex KK Plus (min. class B-s2, d0 B _L -s2, d0)	9 - 35.5	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	LI ≥ 75 one layer (one wire)	EI 60 C/U
	≤ Ø 54	≥ 1.5		21 - 35.5				
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		8.5 - 35.5				
	≤ Ø 114.3	≥ 3.6		15 - 40				




Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Multitherm Bandage	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex NH (min. class D-s3, d0 D _L -S3, d0)	9 - 25	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	LI ≥ 75 one layer (one wire)	EI 60 C/U
	≤ Ø 54	≥ 1.5		13 - 25				
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		9 - 25				
	≤ Ø 114.3	≥ 3.6		13 - 25				

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Multitherm Bandage	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex Ultima (min. class B-s1, d0 B _L -S1, d0)	13 - 32	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	LI ≥ 75 one layer (one wire)	EI 60 C/U
	≤ Ø 54	≥ 1.5		13 - 32				
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		9 - 32				
	≤ Ø 114.3	≥ 3.6		13 - 32				

A.1.14 Multimastic FB2 - 1x 60 mm - Metal pipes insulated elastomer

A.1.14.3 Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap

Front view

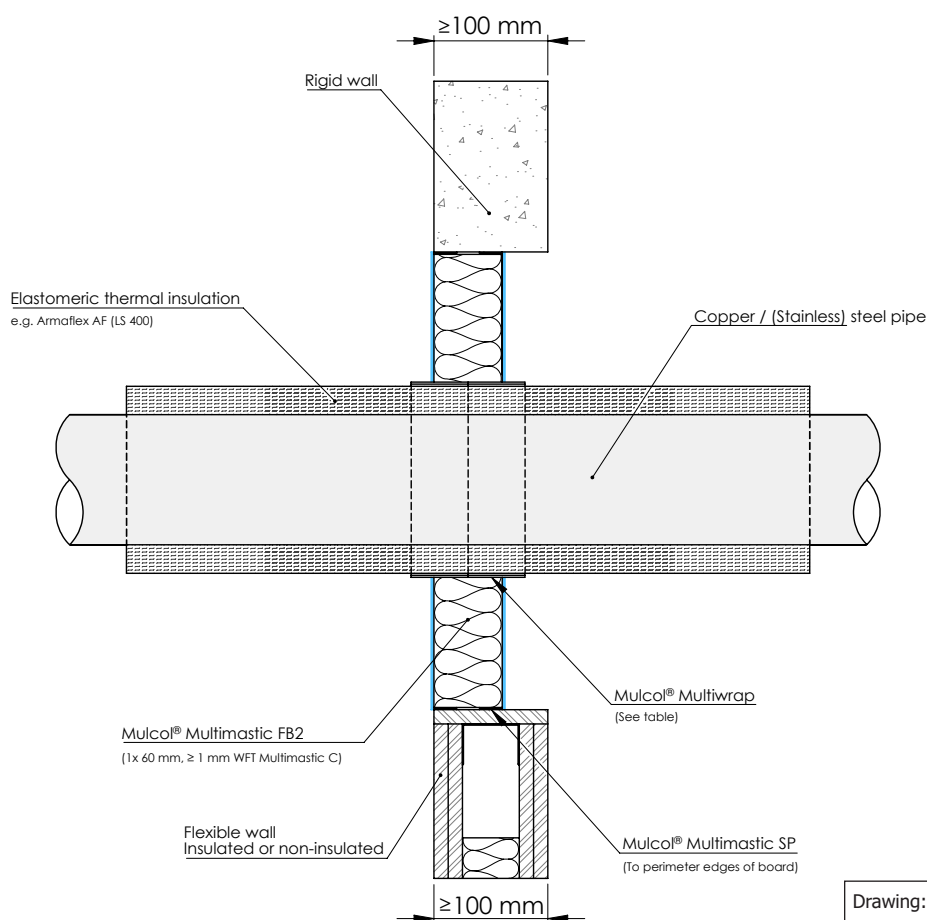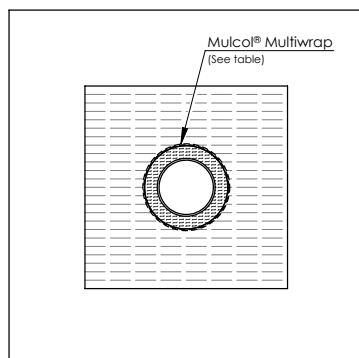


Drawing: PBfw.E-ST-MW2-MFB2.1.22

Services	Pipe dimensions (mm)		Insulation			Product	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.1	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	12 - 33.5	LS 400 / CS	Multiwrap (2 layers)	EI 60 C/U
	≤ Ø 54	≥ 1.5		13.5 - 38			EI 45 C/U, E 60 C/U
				38			EI 60 C/U
(Stainless) Steel / cast iron				≤ Ø 114.3			≥ 3.6
	32	EI 60 C/U					

A.1.14 Multimastic FB2 - 1x 60 mm - Metal pipes insulated elastomer




A.1.14.4 Steel pipes - ArmaFlex Protect LS 400 / CS

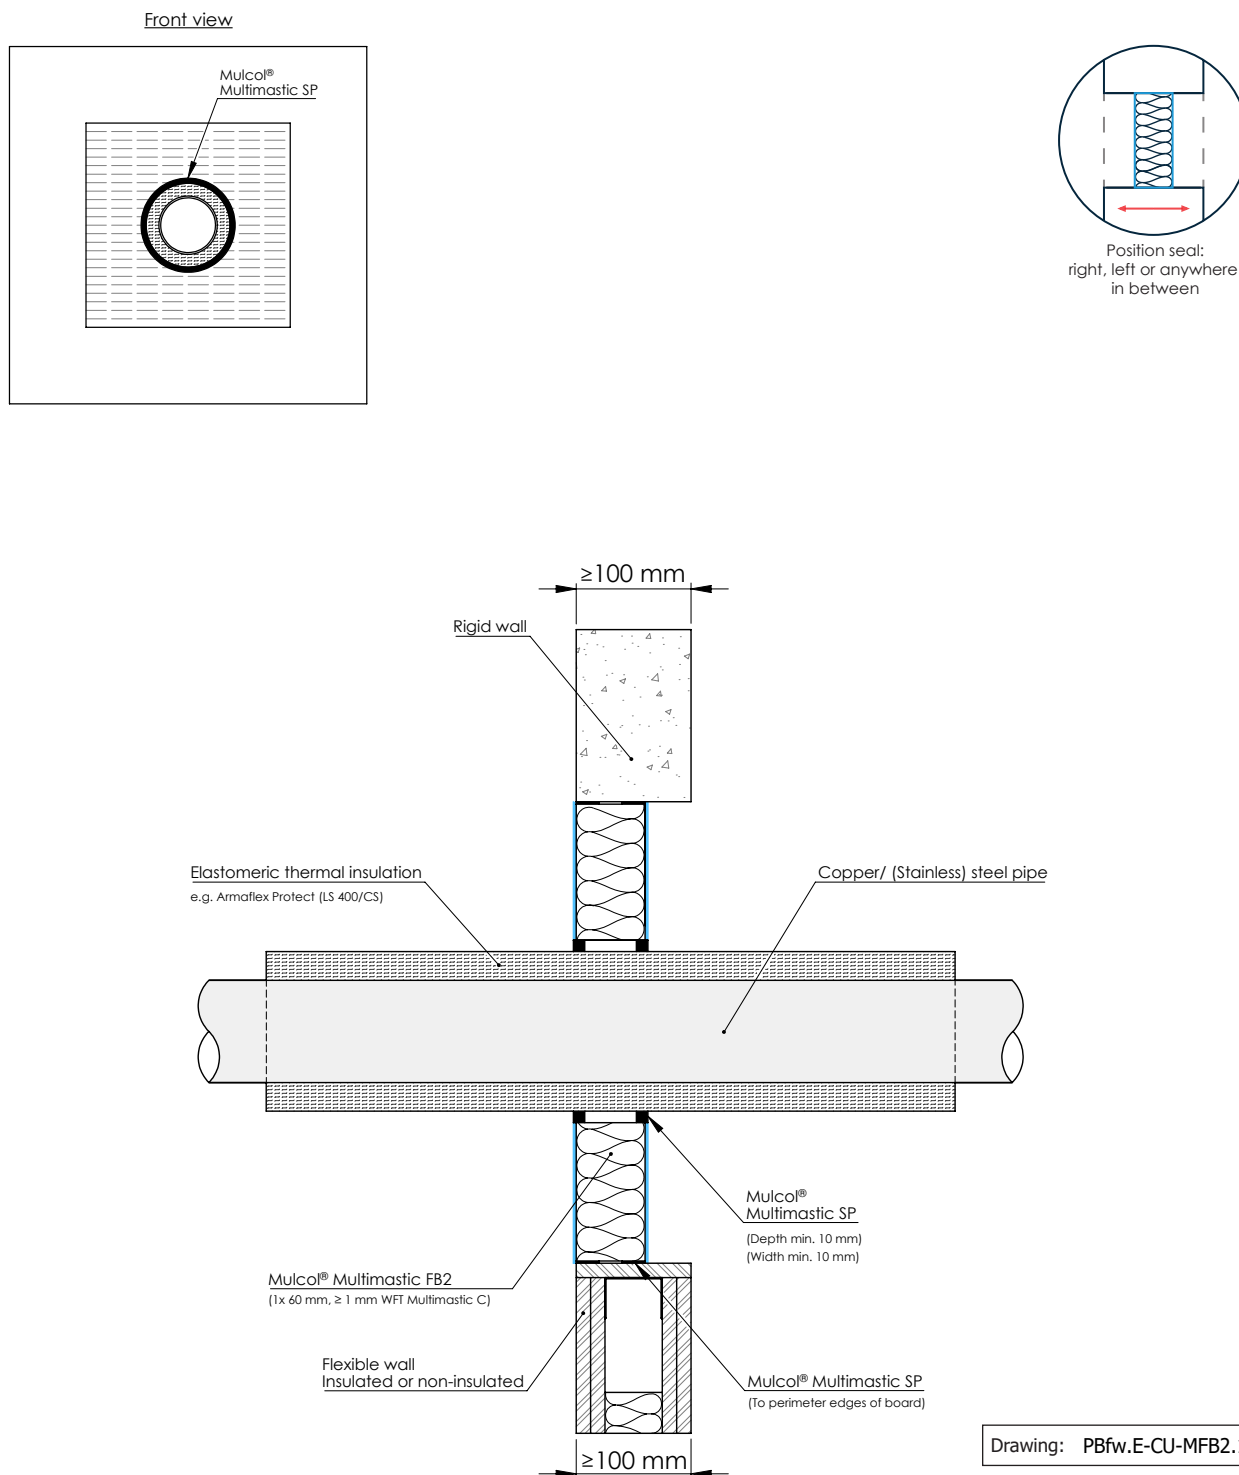

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
(Stainless) steel / cast iron	≤ Ø 88.9	≥ 2.0	ArmaFlex Protect	25	LS 400 / CS	Multimastic SP 10 x ≥ 20 (wxd)	EI 60 C/U

A.1.15 Multimastic FB1 - 2x 50 mm - Metal pipes insulated phenolic foam

A.1.15.1 Steel pipes - Phenolic foam LS 400 / CS - Multisealant GR

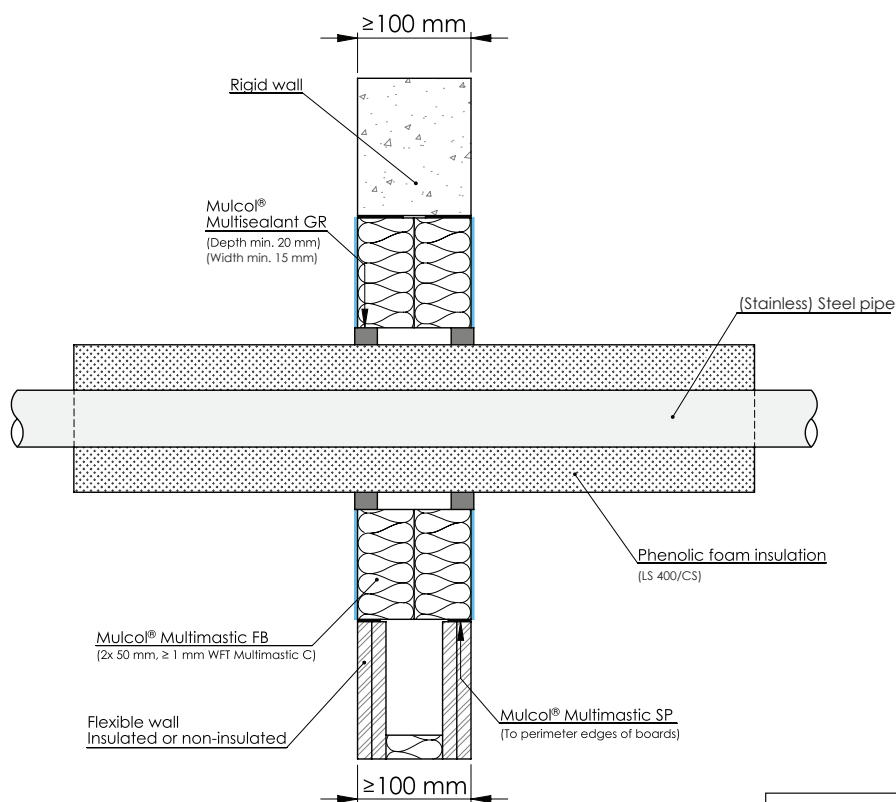

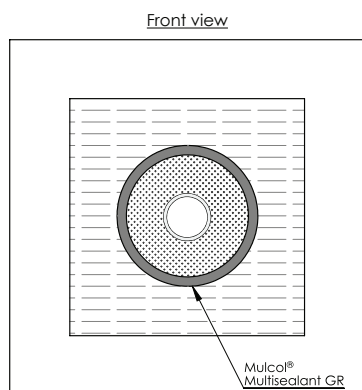


Drawing: PBfw.E-ST-MFB1-G2.4.27

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3	Kingspan Kooltherm	15 - 45	LS 400 / CS	Multisealant GR ≥ 15 x 20 (wxd)	EI 60 C/U
	≤ Ø 114.3	≥ 3.6		20 - 45			

A.1.16 Multimastic FB1 - 2x 50 mm - Metal pipes insulated PIR foam

A.1.16.1 Copper and steel pipes - PIR foam LS 400 / CS - Multisealant GR

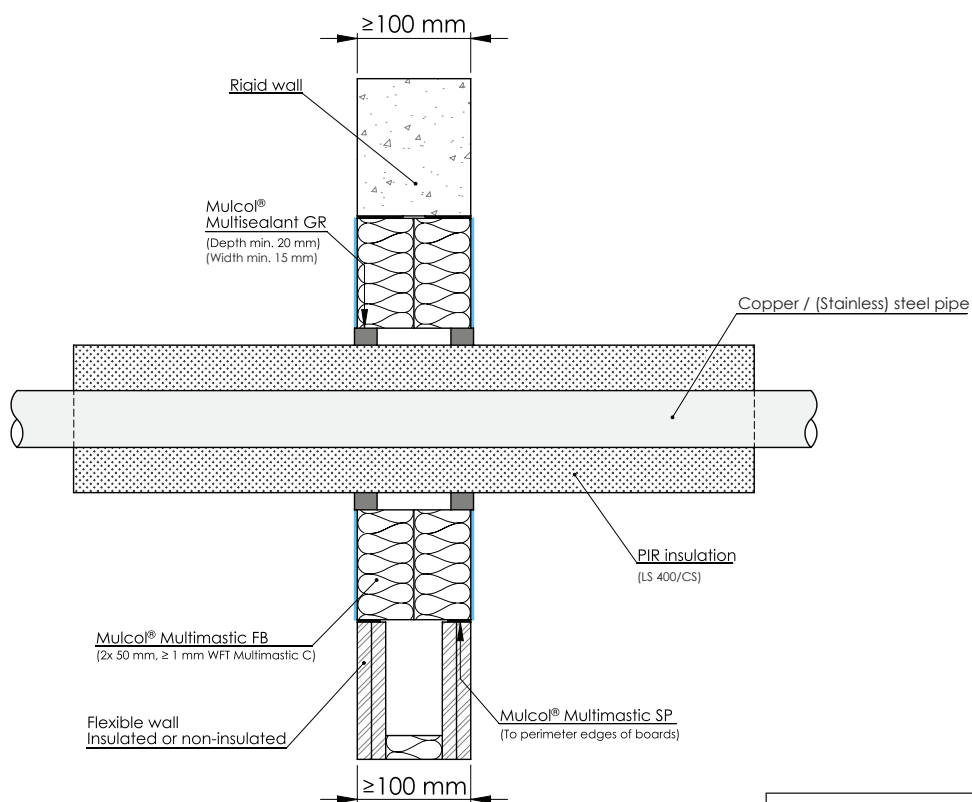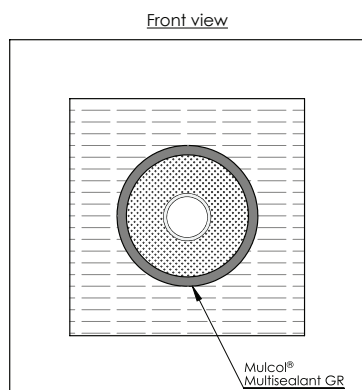

Drawing: PBfw.E-CU-MFB1-G2.4.28

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classifica- tion
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	PIR (min. class E)	20 - 40	LS 400 / CS	Multisealant GR ≥ 15 x 20 (wxd)	EI 60 C/U
	≤ Ø 54	≥ 1.5		25 - 40			
(Stainless) Steel / cast iron	≤ Ø 114.3	≥ 3.6					



A.1.17

Multimastic FB2 - 1x 60 mm - Metal pipes insulated PIR foam


A.1.17.1

Copper and steel pipes - PIR foam LS 400 / CS - Multiwrap

Front view

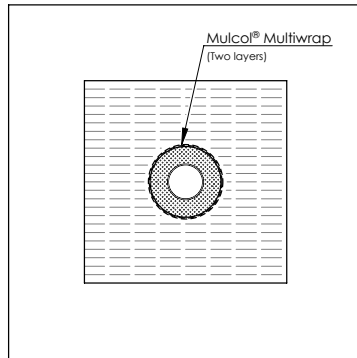

Position seal:
right, left or anywhere
in between

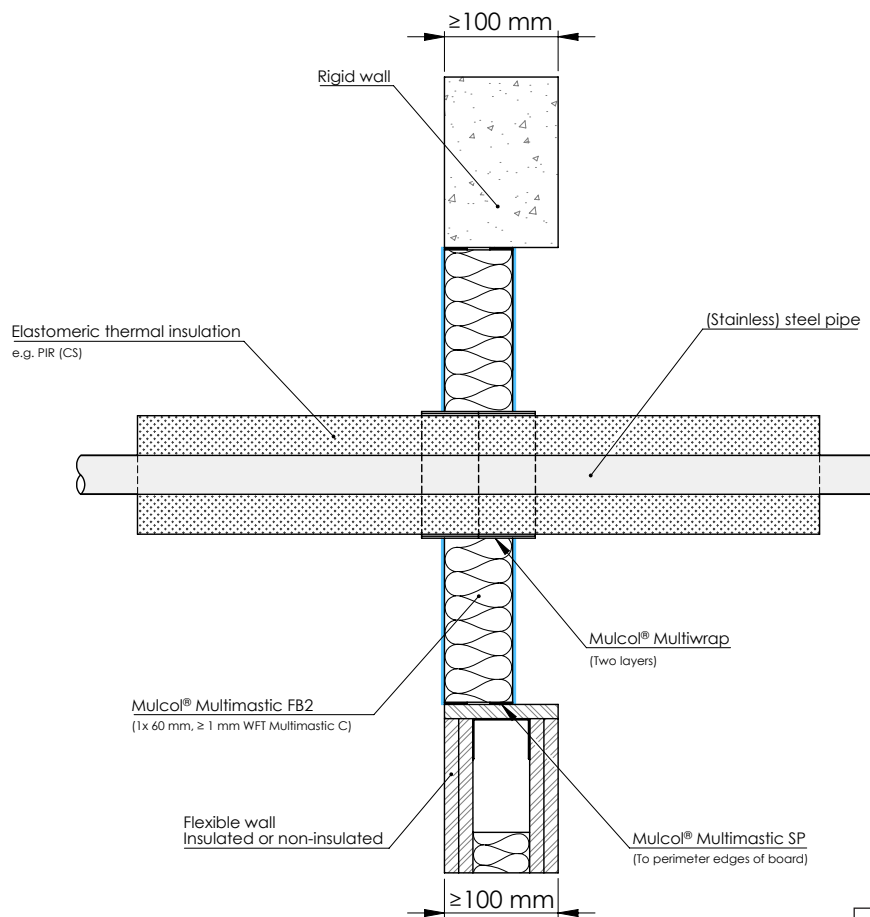




Drawing: PBfw.E-ST-MW2-MFB2.1.22

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classifica- tion
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
(Stainless) Steel / cast iron	≤ Ø 35	≥ 2.0	PIR (min. class E)	20 - 40	LS 400 / CS	Multiwrap (2 layers)	EI 60 C/U

A.1.18 Multimastic FB1 - 2x 50 mm - Metal pipes uninsulated

A.1.18.1 Copper and steel pipes - Multimastic SP

Front view

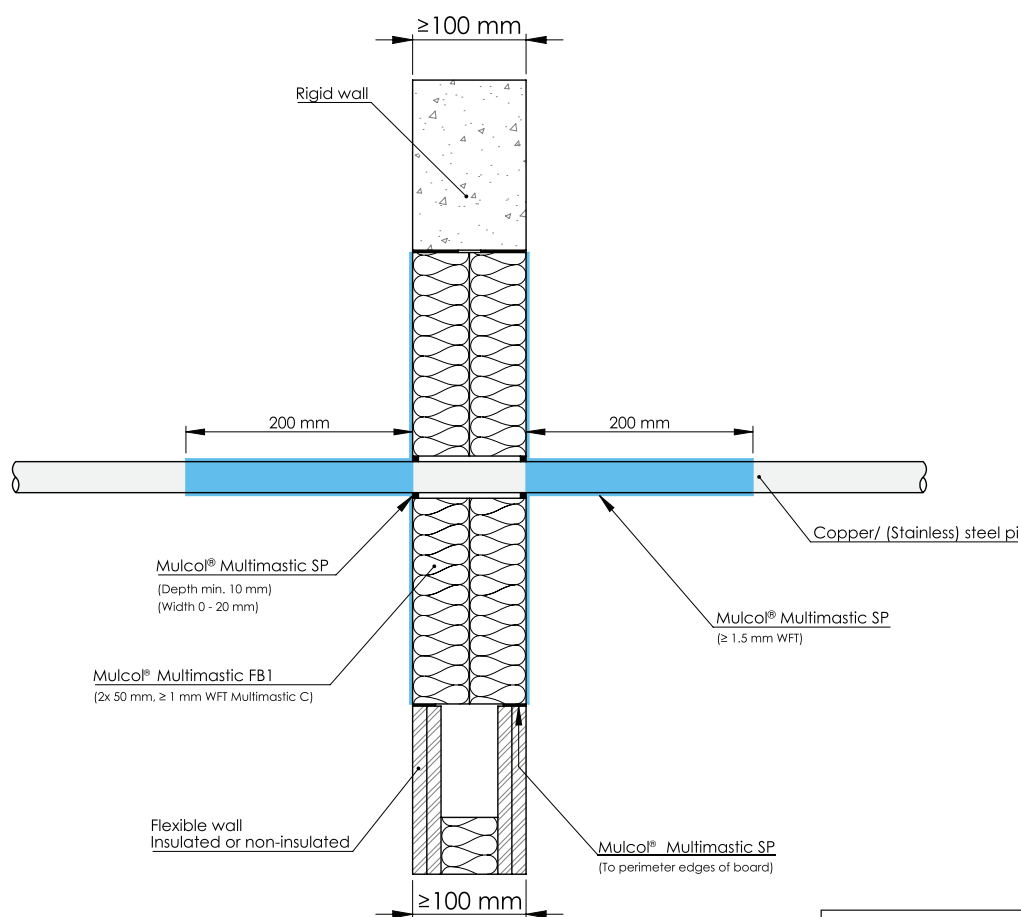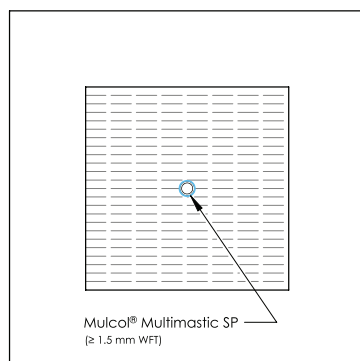




Drawing: PBfw.E-CU-MFB1-SPC.1.10

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 15	≥ 1.0	Multimastic SP	1.5 WFT	LI 200	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 60 C/U E 120 C/U
(Stainless) Steel / cast iron	≤ Ø 16	≥ 1.0					EI 90 C/U
	≤ Ø 26.9	≥ 2.6					EI 90 C/U E 120 C/U
	≤ Ø 42.4	≥ 3.2					EI 60 C/U E 120 C/U
	≤ Ø 60.3	≥ 3.6					

A.1.18 Multimastic FB1 - 2x 50 mm - Metal pipes uninsulated

A.1.18.2 Steel pipes - Multisealant GR

Front view

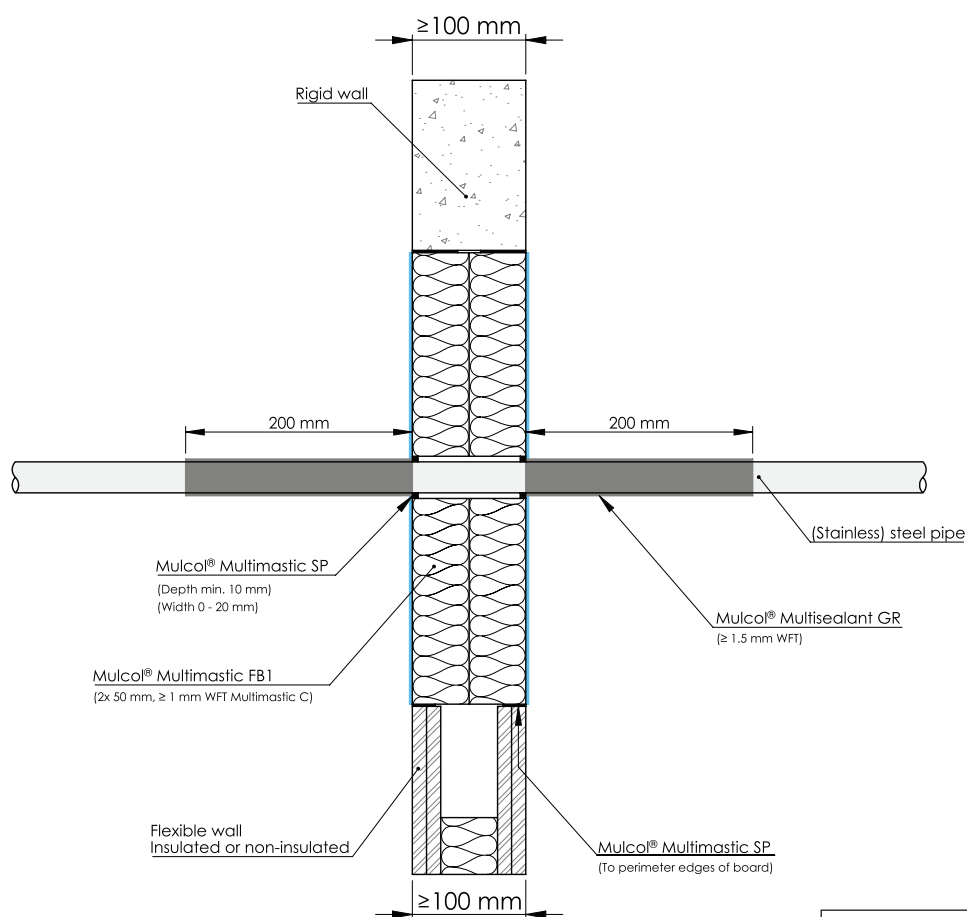

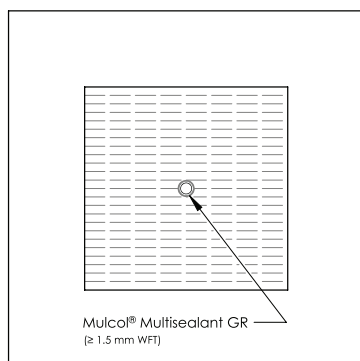


Drawing: PBfw.E-ST-MFB1-GRC.1.10

Services	Pipe dimensions (mm)		Coating	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
(Stainless) Steel / cast iron	$\leq \varnothing 26.9$	≥ 2.6	Coat back 200 mm ≥ 1.5 mm WFT Multisealant GR	Multisealant GR 0-20 x ≥ 10 (wxd)	EI 90 C/U, E 120 C/U
	$\leq \varnothing 60.3$	≥ 3.6			

A.1.18 Multimastic FB1 - 2x 50 mm - Metal pipes uninsulated

A.1.18.3 Copper and steel pipes - Multidisc

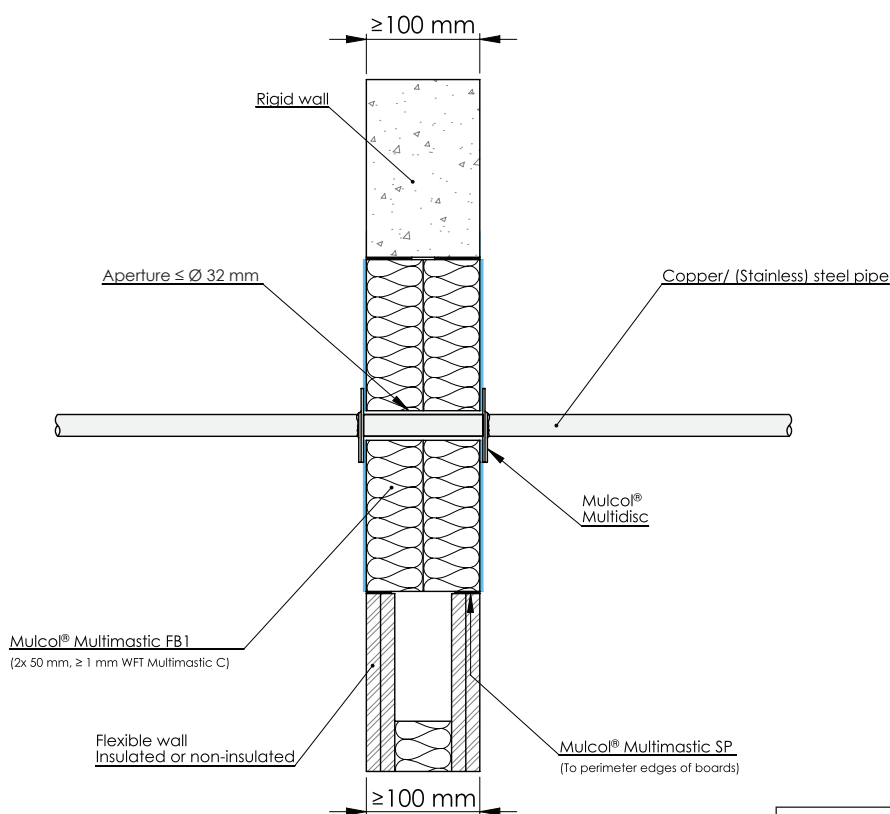




Drawing: PBfw.E-MLA-M2.0.10

Services	Pipe dimensions (mm)		Product	Aperture (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness				
Copper / (stainless) steel / cast iron	≤ Ø 15	≥ 1.0	Multidisc	≤ Ø 32	Not required	EI 45 C/U, E 120 C/U
(Stainless) Steel / cast iron	≤ Ø 17.2					EI 90 C/U

A.1.18 Multimastic FB1 - 2x 50 mm - Metal pipes uninsulated

A.1.18.4 Copper and steel pipes - Multitherm Bandage

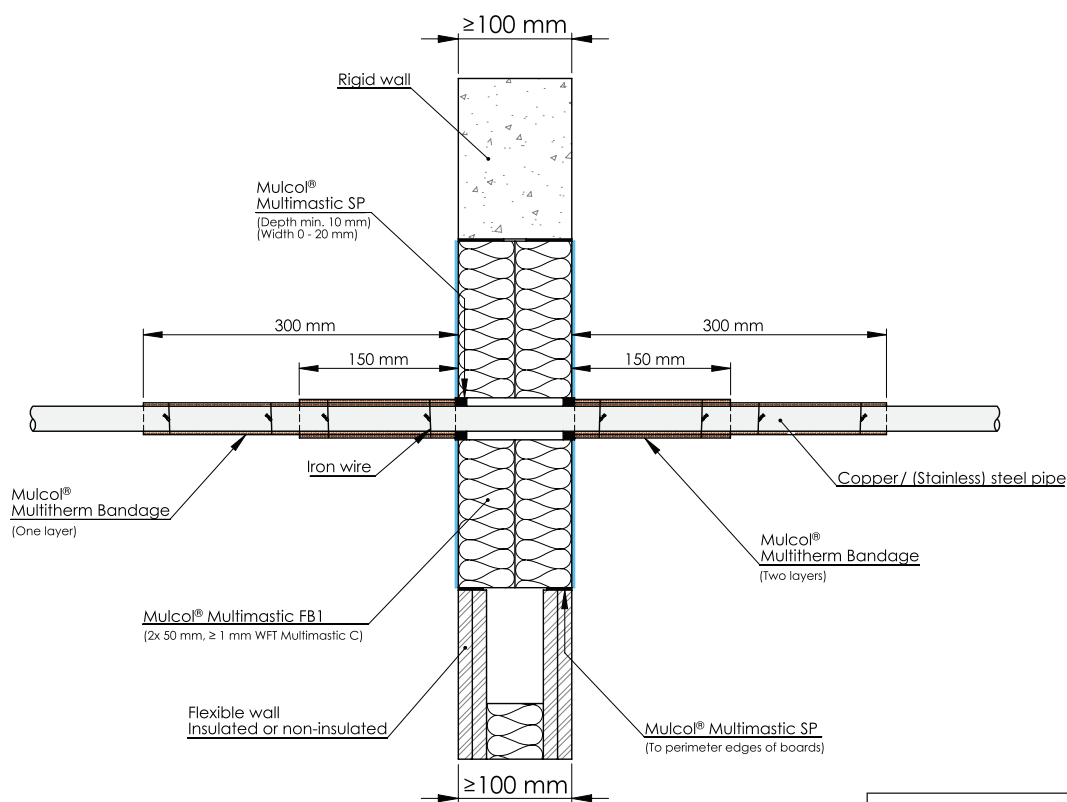
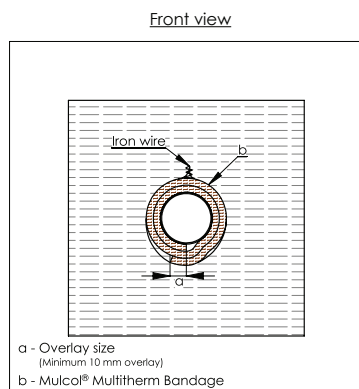


Drawing: PBfw.E-CU-MFB1-B2.3.21

Services	Pipe dimensions (mm)		Sealing (mm)	Multitherm Bandage	Classification
	Outer dimension	Wall thickness			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Multimastic SP 0-20 x ≥ 10 (wxd)	LI 150 two layers (two wires)	EI 30 C/U, E 120 C/U
	≤ Ø 15	≥ 1.0		LI 150 two layers (two wires) + LI 300 one layer (two wires)	EI 60 C/U, E 120 C/U
	≤ Ø 54	≥ 1.5			EI 45 C/U, E 120 C/U
	≤ Ø 88.9	≥ 2.0			EI 30 C/U, E 120 C/U

A.1.19 Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Metal pipes uninsulated

A.1.19.1 Copper and steel pipes - Multidisc

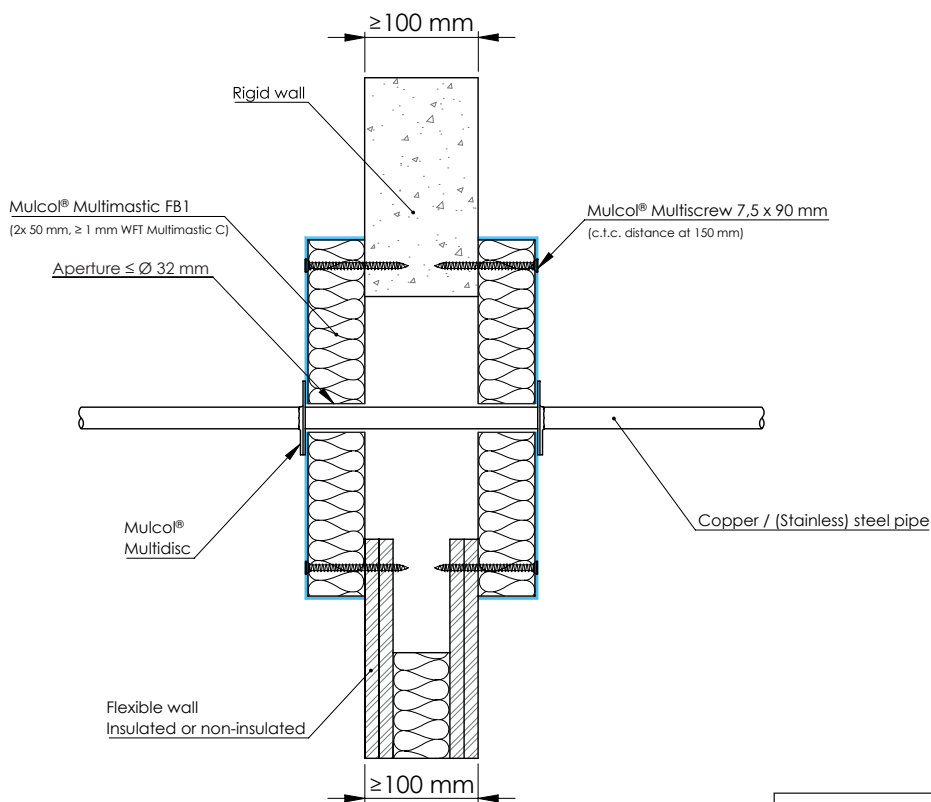
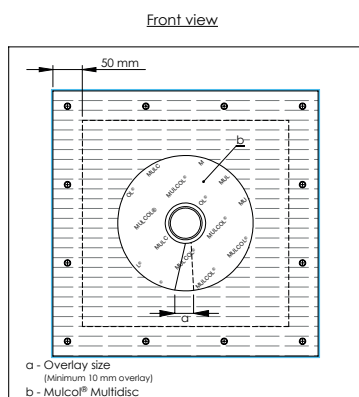


Drawing: PBPfw.E-CU-M2.0.10

Services	Pipe dimensions (mm)		Product	Aperture (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness				
Copper / (stainless) steel / cast iron	≤ Ø 15	≥ 1.0	Multidisc	≤ Ø 32	Not required	EI 45 C/U, E 120 C/U
(Stainless) Steel / cast iron	≤ Ø 17.2					EI 90 C/U

A.1.19 Multimastic FB1 Pattress fixed to wall - 2x 50 mm - Metal pipes uninsulated

A.1.19.2 Copper and steel pipes - Multitherm Bandage

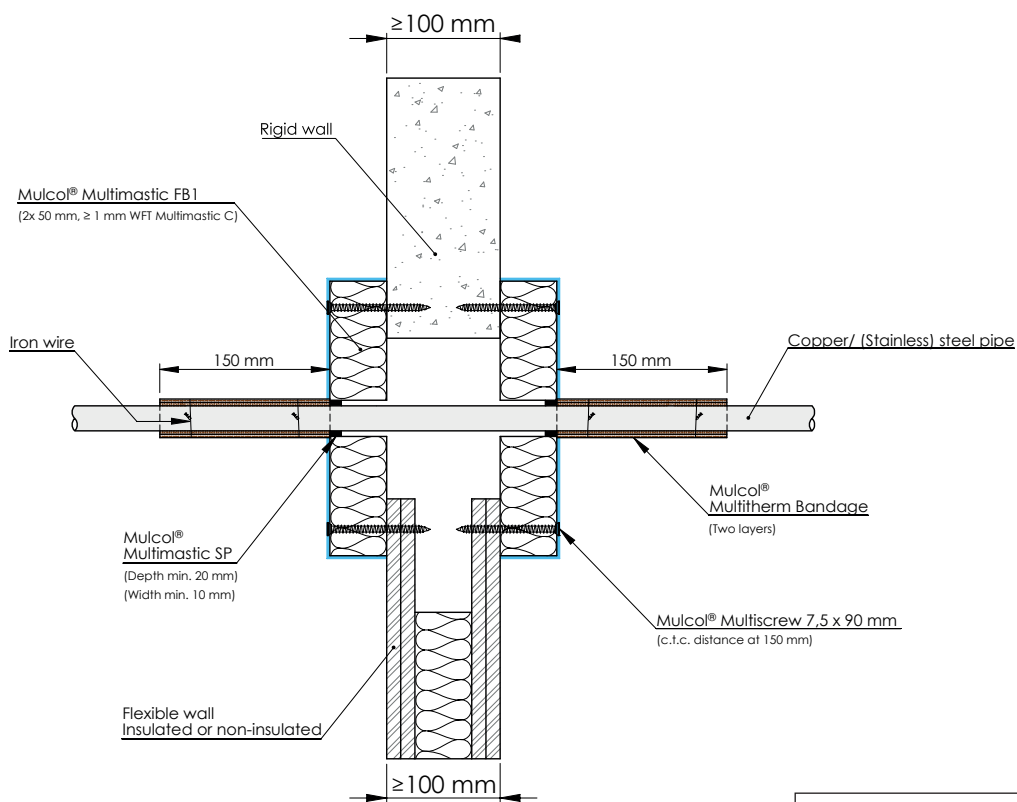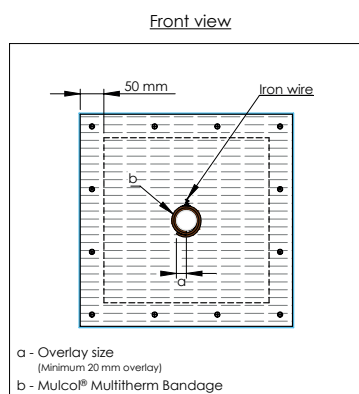


Drawing: PBfw.E-CU-MFB1-B2.1.20

Services	Pipe dimensions (mm)		Sealing (mm)	Multitherm Bandage	Classification
	Outer dimension	Wall thickness			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Multimastic SP 0-20 x ≥ 10 (wxd)	LI 150 two layers (two wires)	EI 120 C/U
	≤ Ø 15	≥ 1.5		LI 150 two layers (two wires) + LI 300 one layer (two wires)	EI 45 C/U, E 120 C/U
	≤ Ø 54	≥ 2.0			EI 30 C/U, E 120 C/U

A.1.20 Multimastic FB2 - 1x 60 mm - Metal pipes uninsulated

A.1.20.1 Copper and steel pipes - Multimastic SP



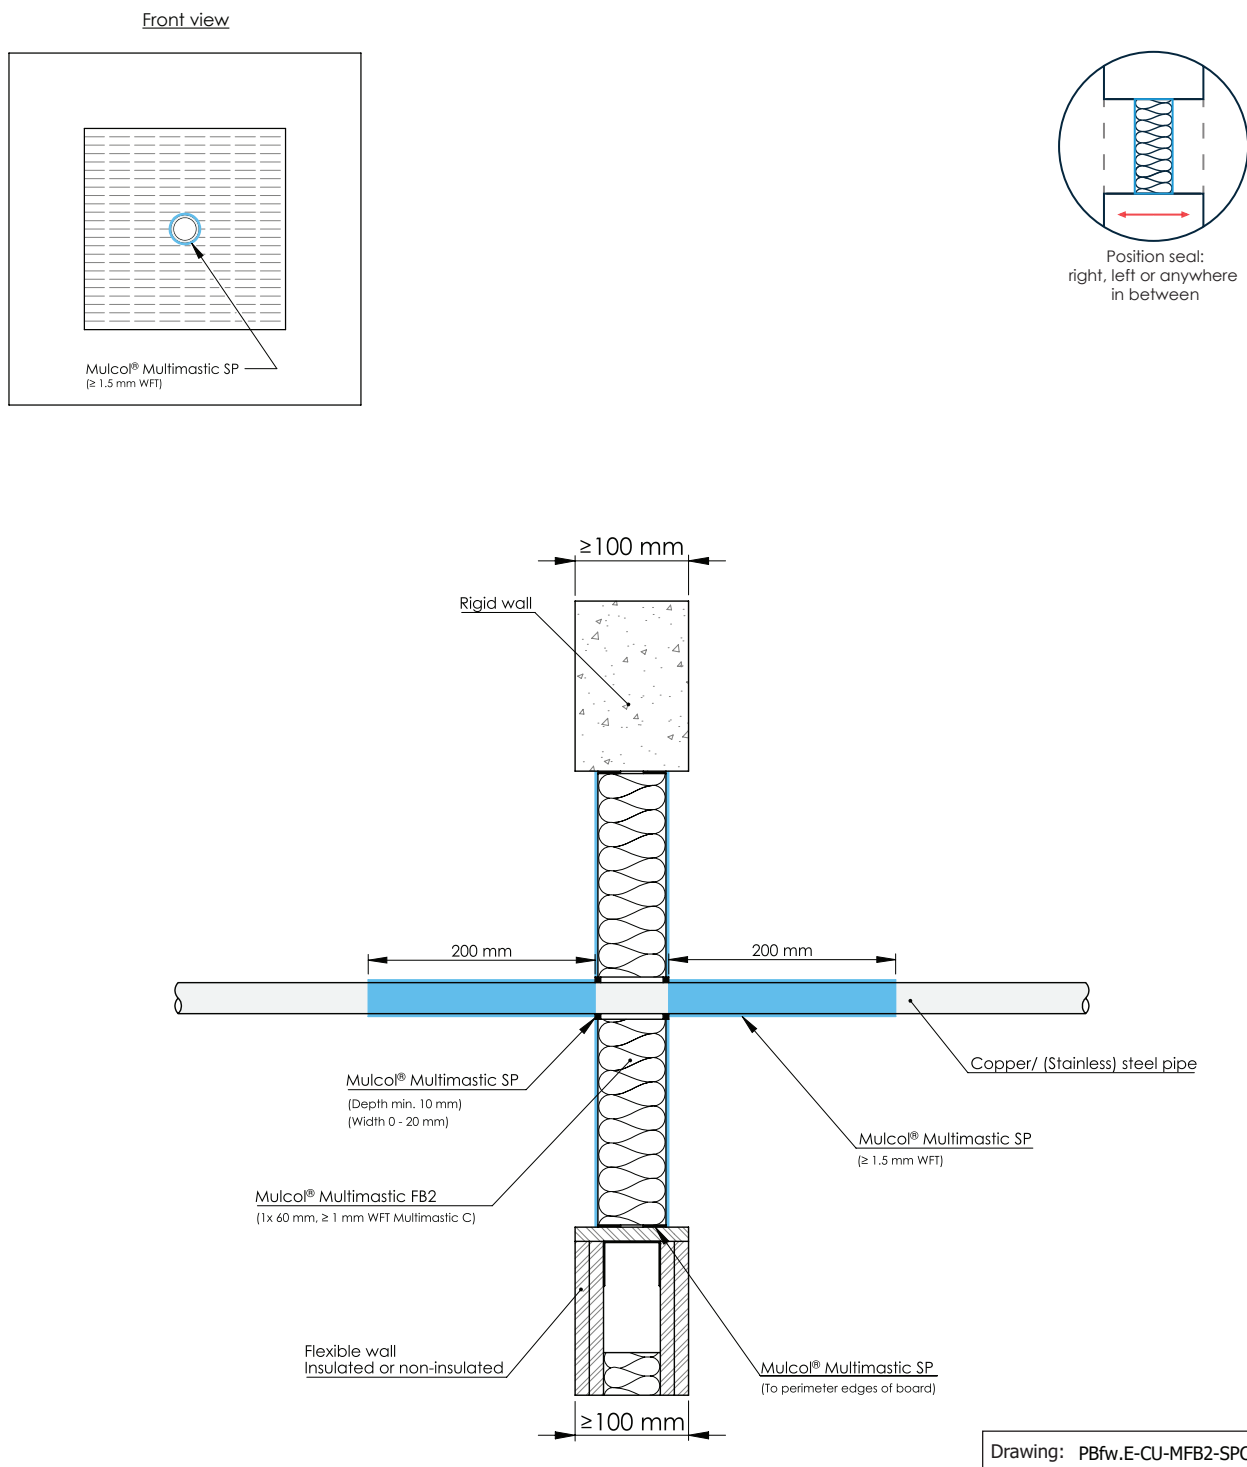


Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 15	≥ 1.0	Multimastic SP	1.5 WFT	LI 200	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 30 C/U E 120 C/U
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.6					EI 60 C/U E 120 C/U
	≤ Ø 42.4	≥ 3.2					
	≤ Ø 60.3	≥ 3.6					

A.1.20 Multimastic FB2 - 1x 60 mm - Metal pipes uninsulated

A.1.20.2 Steel pipes - Multisealant GR

Front view

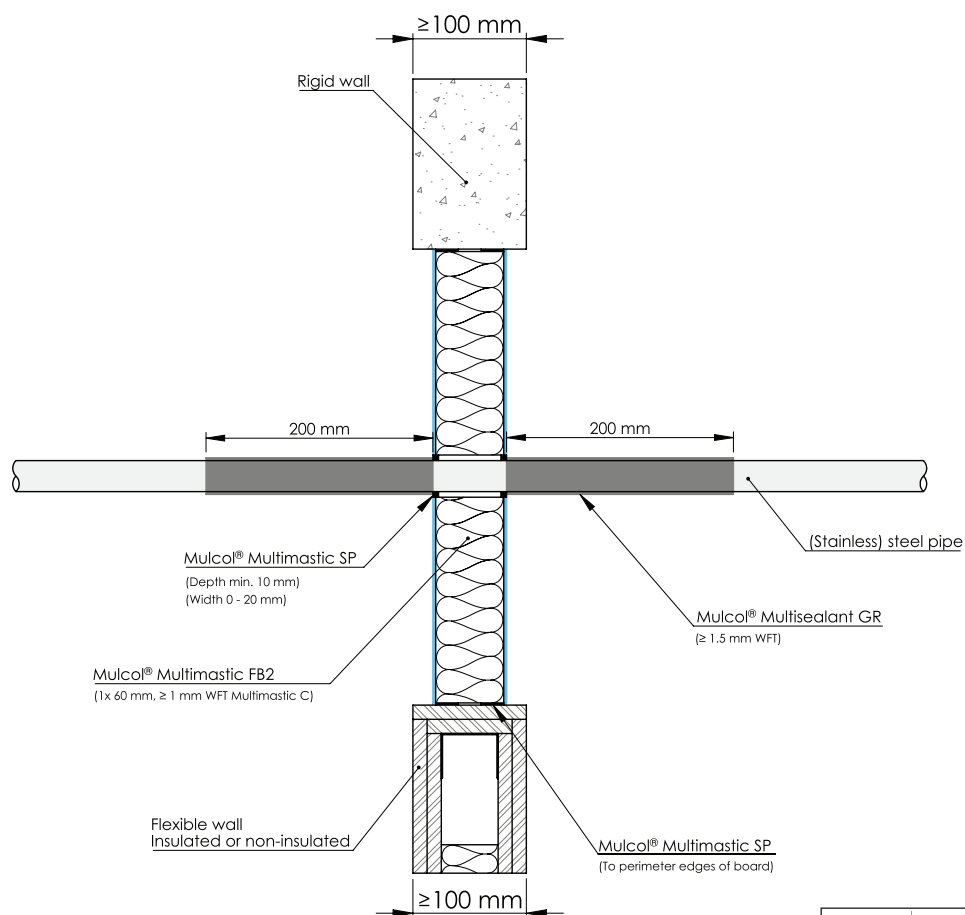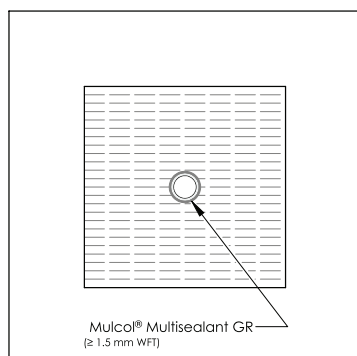


Drawing: PBfw.E-ST-MFB2-GRC.1.10


Services	Pipe dimensions (mm)		Coating	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.6	Coat back 200 mm ≥ 1.5 mm WFT Multisealant GR	Multisealant GR 0-20 x ≥ 10 (wxd)	EI 60 C/U, E 120 C/U
	≤ Ø 60.3	≥ 3.6			

A.1.21 Multimastic FB1 - 2x 50 mm - Busbars

A.1.21.1 Single busbar - LI 300



Side view

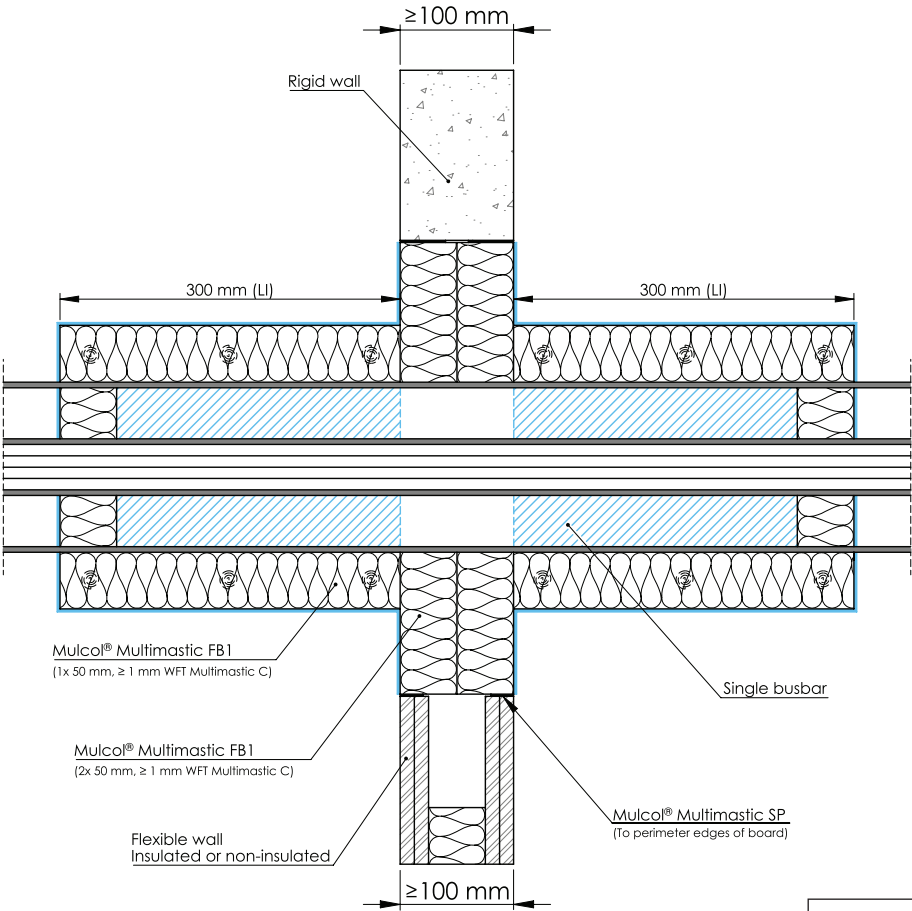


Drawing: PBfw.E-1BB-MFB1.2.10

Services	Service dimensions		Insulation			Classification
	Outside	Conductor	Type	Thickness (mm)	Configuration	
Single busbar	≤ 150 x 250 mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 300 / CI	EI 60


A.1.21 Multimastic FB1 - 2x 50 mm - Busbars

A.1.21.1 Single busbar - LI 300



Position seal:
right, left or anywhere
in between



Front view

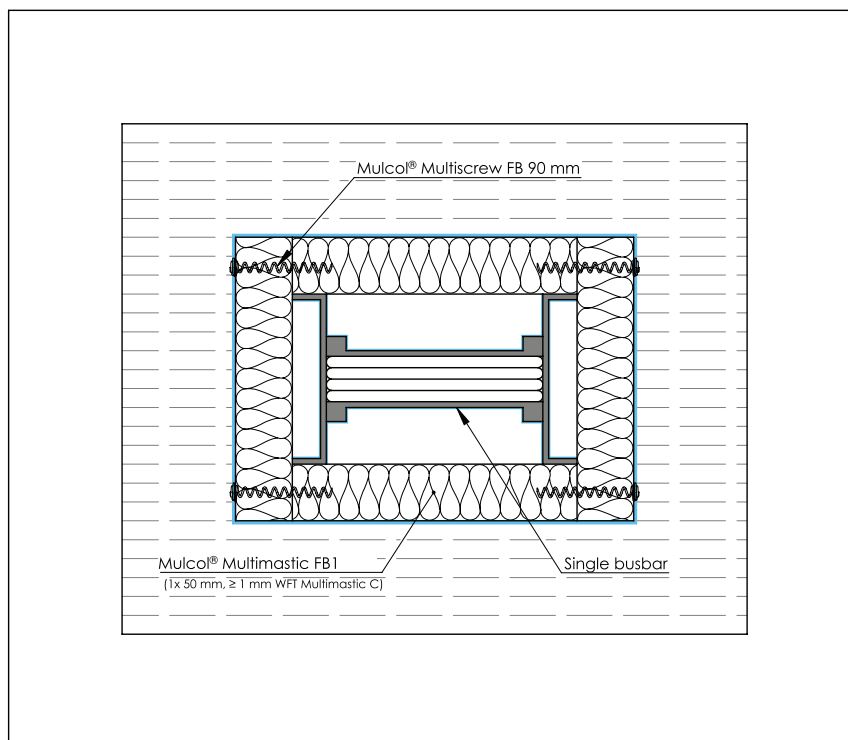

Drawing: PBfw.E-1BB-MFB1.2.10

A.1.21 Multimastic FB1 - 2x 50 mm - Busbars

A.1.21.2 Single busbar - LI 400

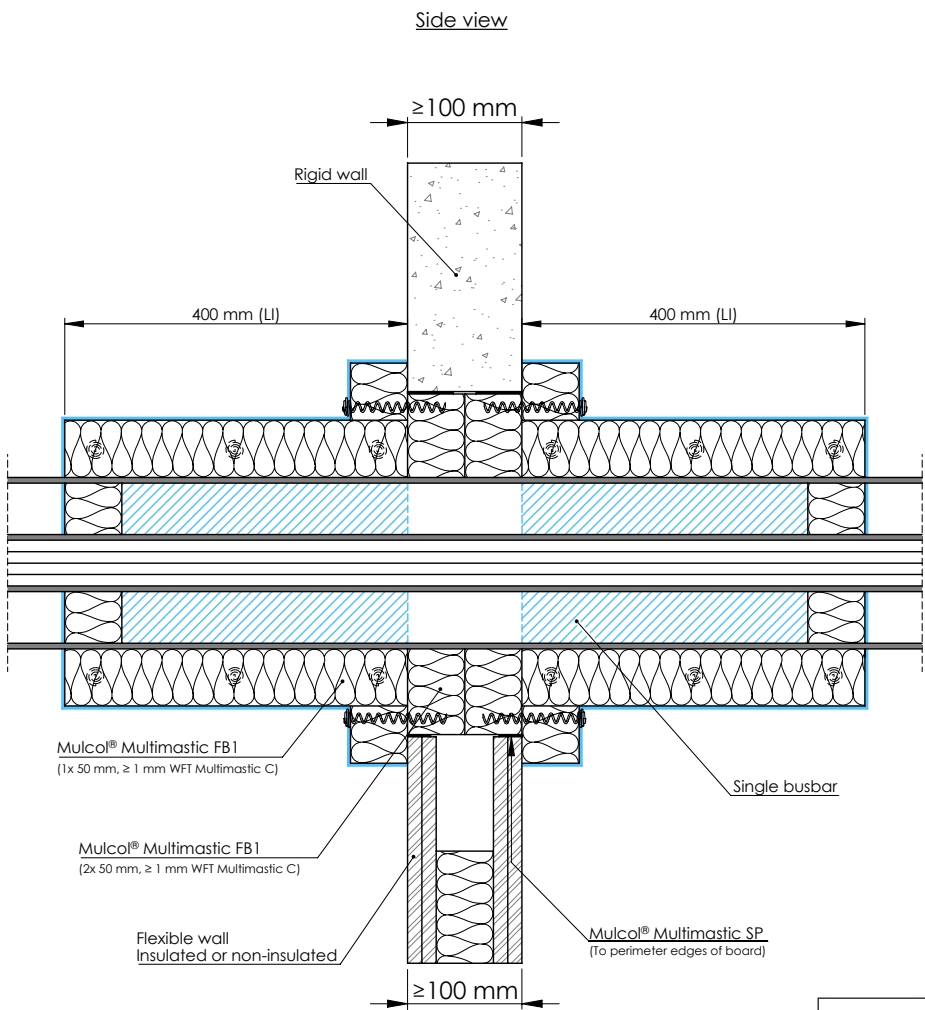


Drawing: PBfw.E-1BB-MFB1.2.10

Services	Service dimensions		Insulation			Classification
	Outside dimension	Conductor	Type	Thickness (mm)	Configuration	
Single busbar	≤ 150 x 250 mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 400 / CI	EI 120


A.1.21 Multimastic FB1 - 2x 50 mm - Busbars

A.1.21.2 Single busbar - LI 400



Position seal:
right, left or anywhere
in between


Front view

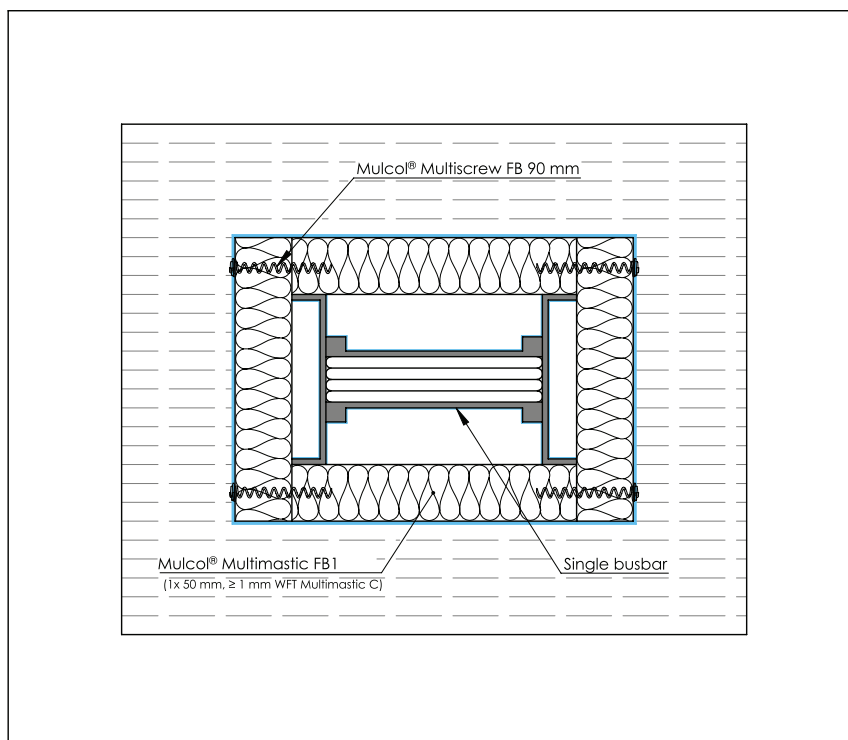

Drawing: PBfw.E-1BB-MFB1.2.10

A.1.21 Multimastic FB1 - 2x 50 mm - Busbars

A.1.21.3 Multiple busbars - LI 300


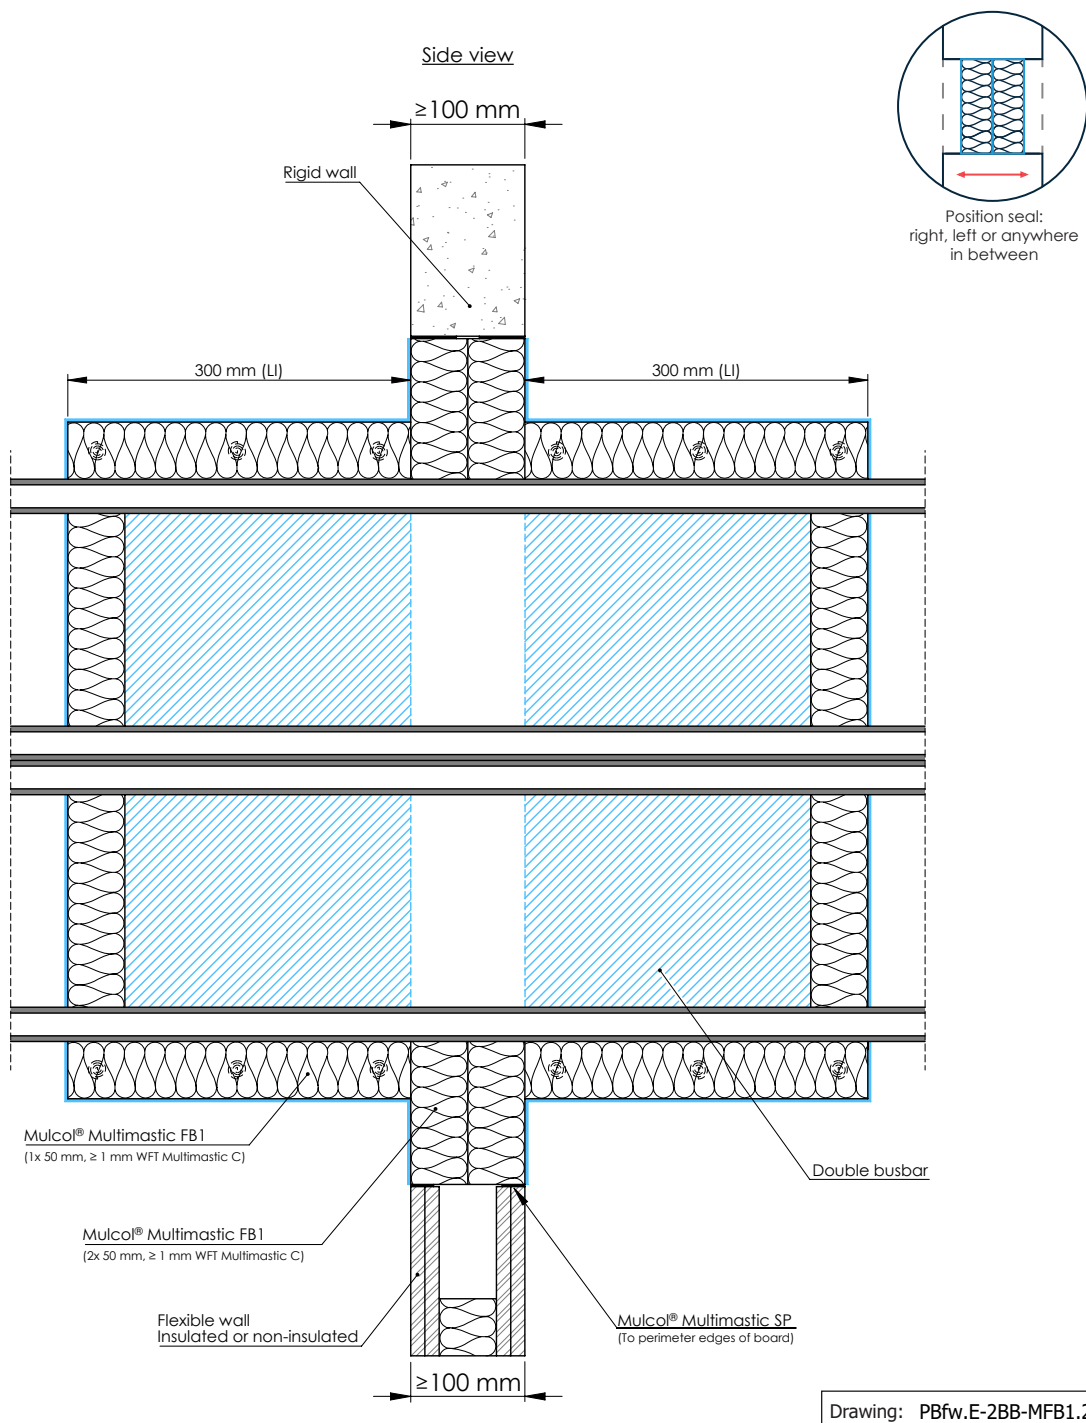


Services	Service dimensions		Insulation			Classification
	Outside dimension	Conductor	Type	Thickness (mm)	Configuration	
Double busbar	$\leq 150 \times 500$ mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 300 / CI	EI 60

A.1.21 Multimastic FB1 - 2x 50 mm - Busbars

A.1.21.3 Multiple busbars - LI 300

Front view

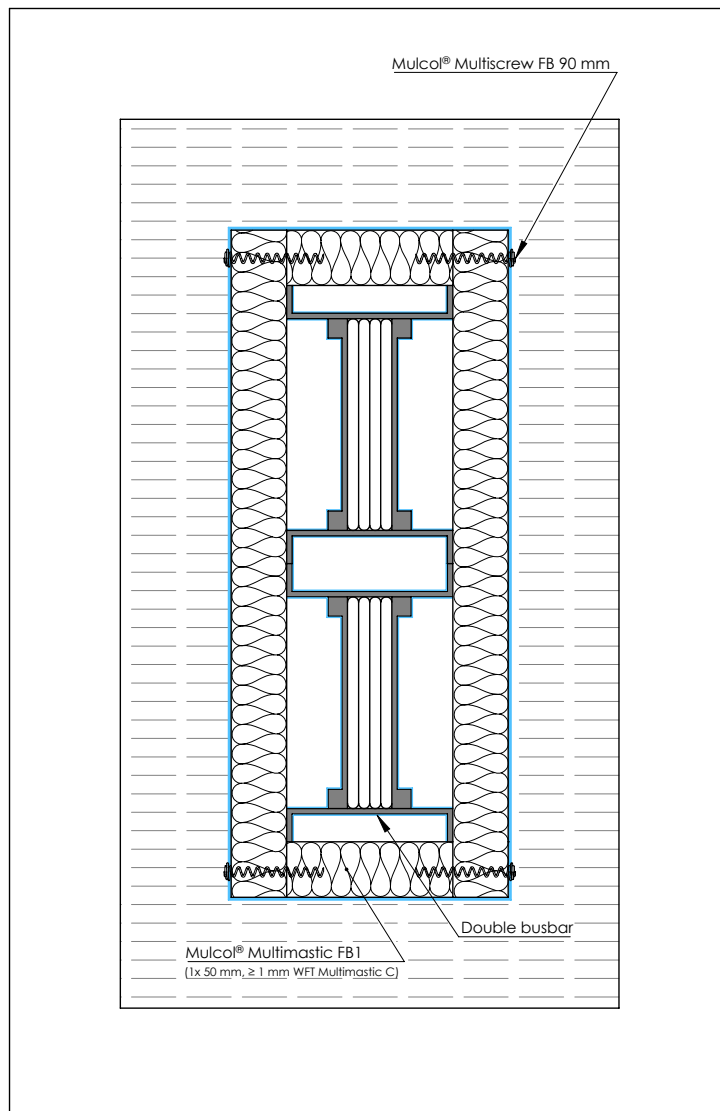


Position seal:
right, left or anywhere
in between

Drawing: PBfw.E-2BB-MFB1.2.10

A.1.21 Multimastic FB1 - 2x 50 mm - Busbars

A.1.21.4 Multiple busbars - LI 400


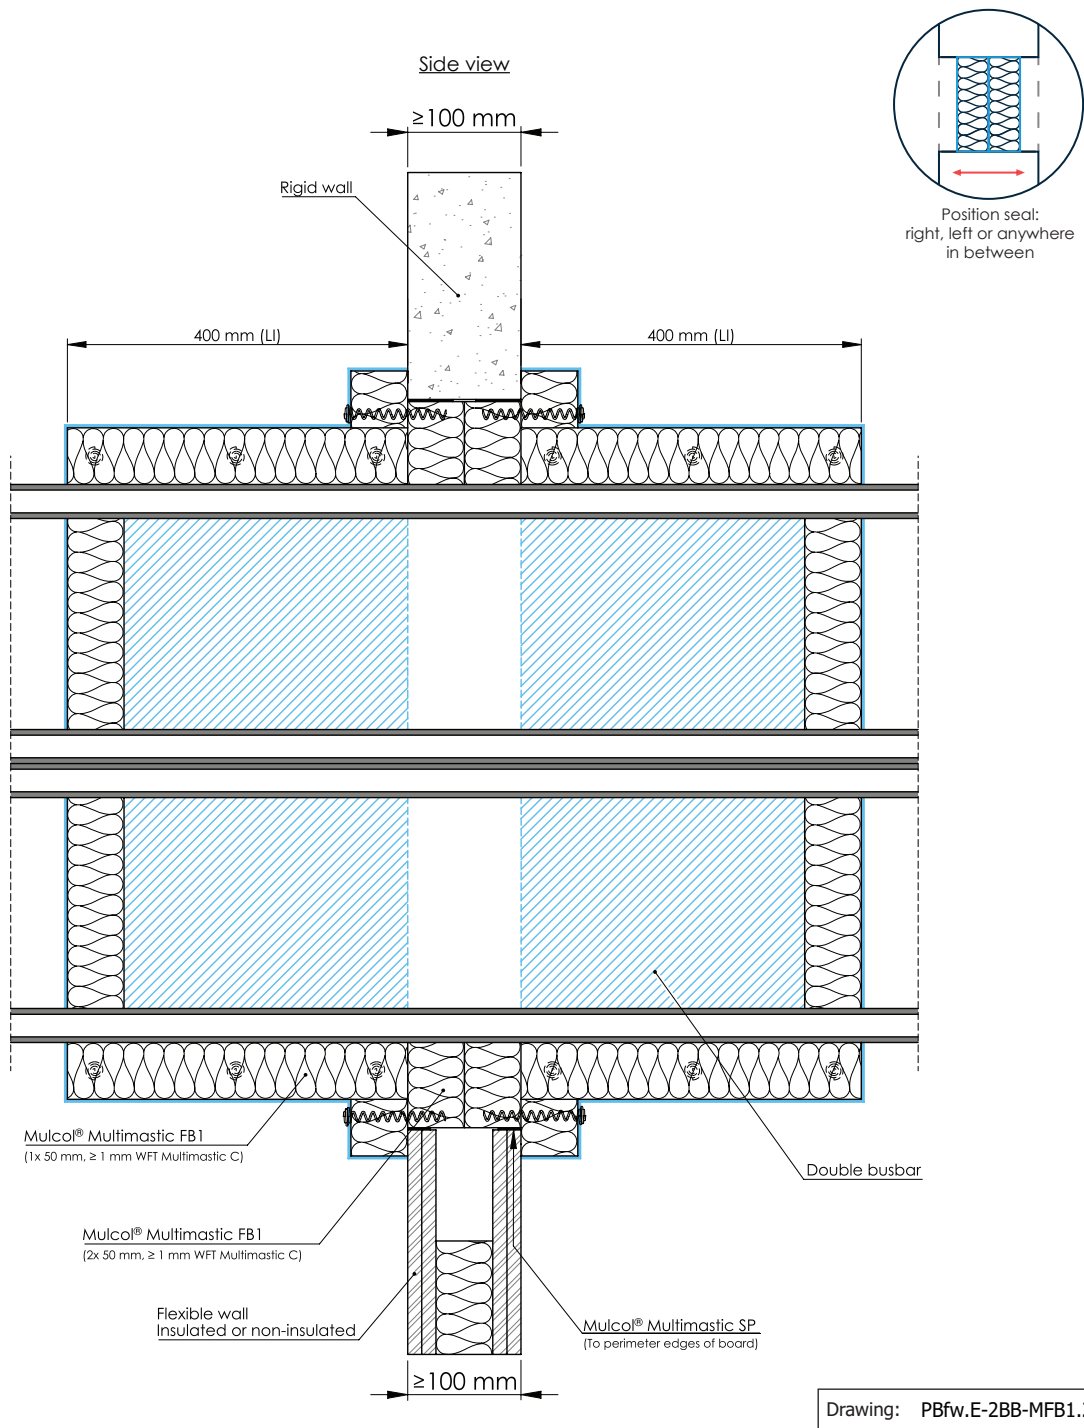


Services	Service dimensions		Insulation			Classification
	Outside dimension	Conductor	Type	Thickness (mm)	Configuration	
Double busbar	≤ 150 x 500 mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 400 / CI	EI 120

A.1.21 Multimastic FB1 - 2x 50 mm - Busbars

A.1.21.4 Multiple busbars - LI 400




Front view

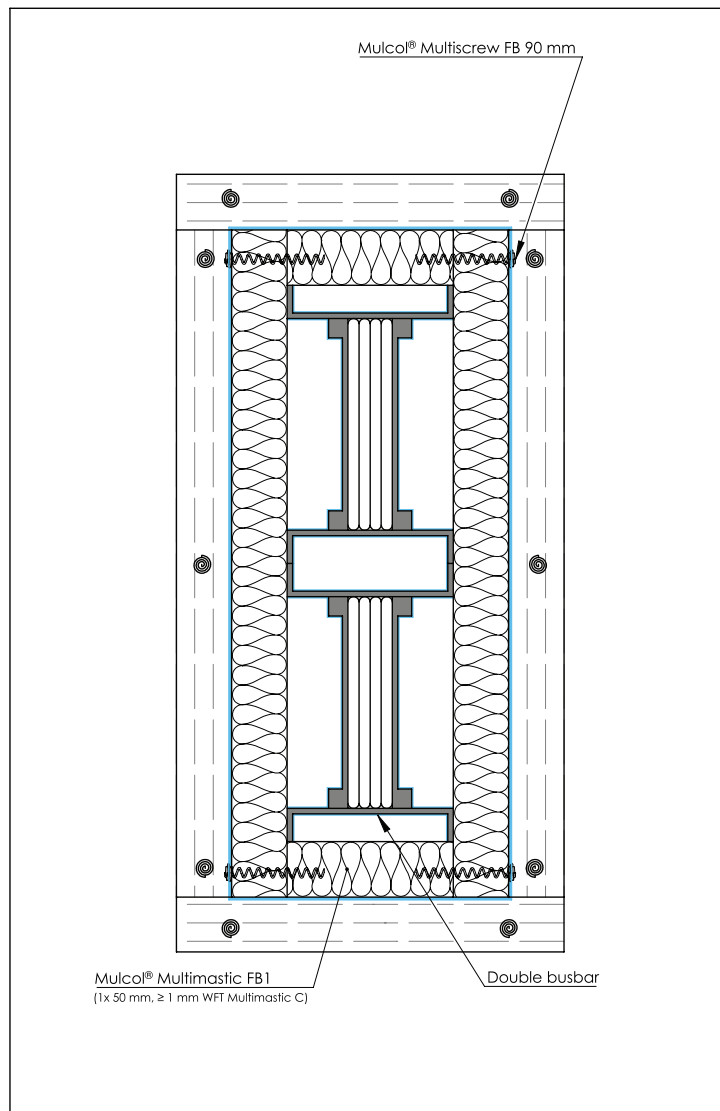

Drawing: PBfw.E-2BB-MFB1.2.10

A.1.22 Multimastic FB1 - 2x 50 mm - Multiple services

A.1.22.1 Airconditioning set - Multicollar *Slim*

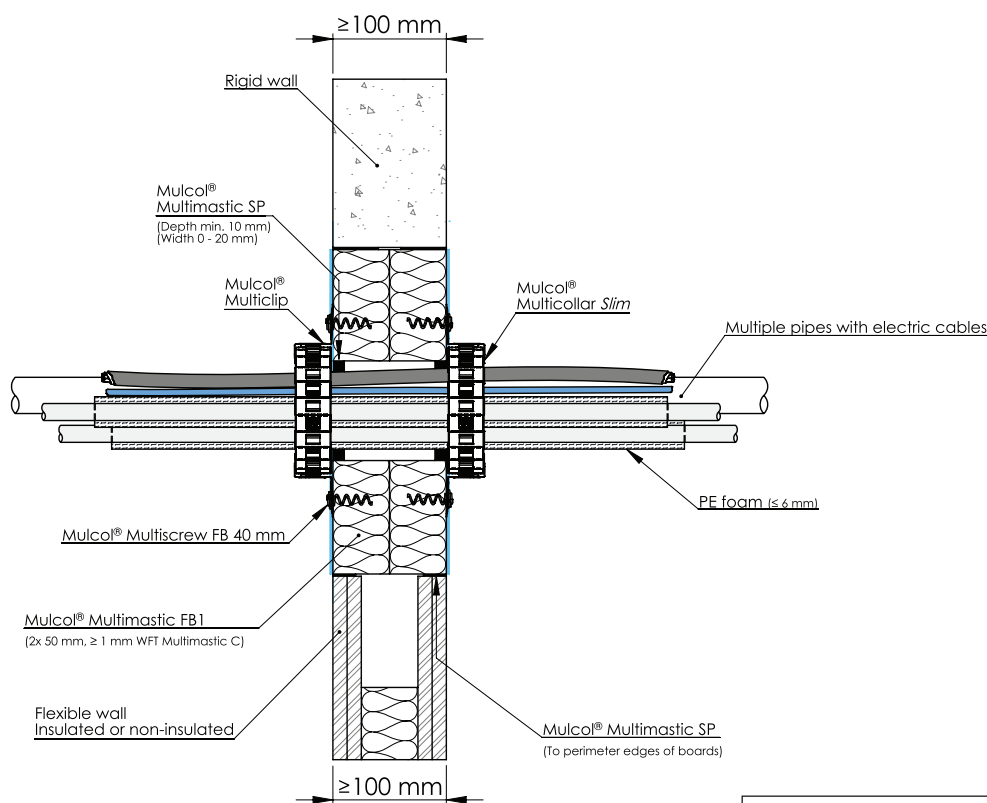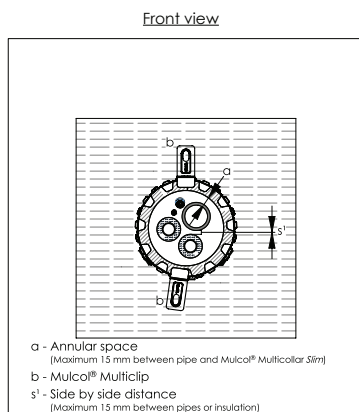

Drawing: PBfw.E-MLP5-MFB1.2.40

Services	Pipe dimensions (mm)		Insulation			Product	Classification
	Outer diameter	Wall thickness	Type	Thickness (mm)	Configuration		
Set of airconditioning pipes	$2x \leq \varnothing 15$	1.5	PE foam	≥ 6	LS 400 / CS LI 400 / CI	Multicollar <i>Slim</i>	EI 60 C/U E 120 C/U
PVC-U / PVC-C	$\leq \varnothing 40$	3.0	-	-	-		EI 60 U/U E 120 U/U
Telecommunication cable	UTP Cat 5/6	-	-	-	-		
Sheathed cable	$\leq 5 \times 2.5$ mm ²	-	-	-	-		EI 60 E 120



A.1.23.1 Airconditioning set - Multicollar *Slim*

The diagram shows a top-down view of a circular Mulco® Multiclip. The clip has a central body with two circular openings and two side flaps, each labeled 'b'. The distance between the two side flaps is labeled 'a'. The distance between the two circular openings is labeled 's¹'. The clip is shown against a background of horizontal lines.

a - Annular space
(Maximum 15 mm between pipe and Mulco® Multicollar Slim)

b - Mulco® Multiclip




s¹ - Side by side distance
(Maximum 15 mm between pipes or insulation)

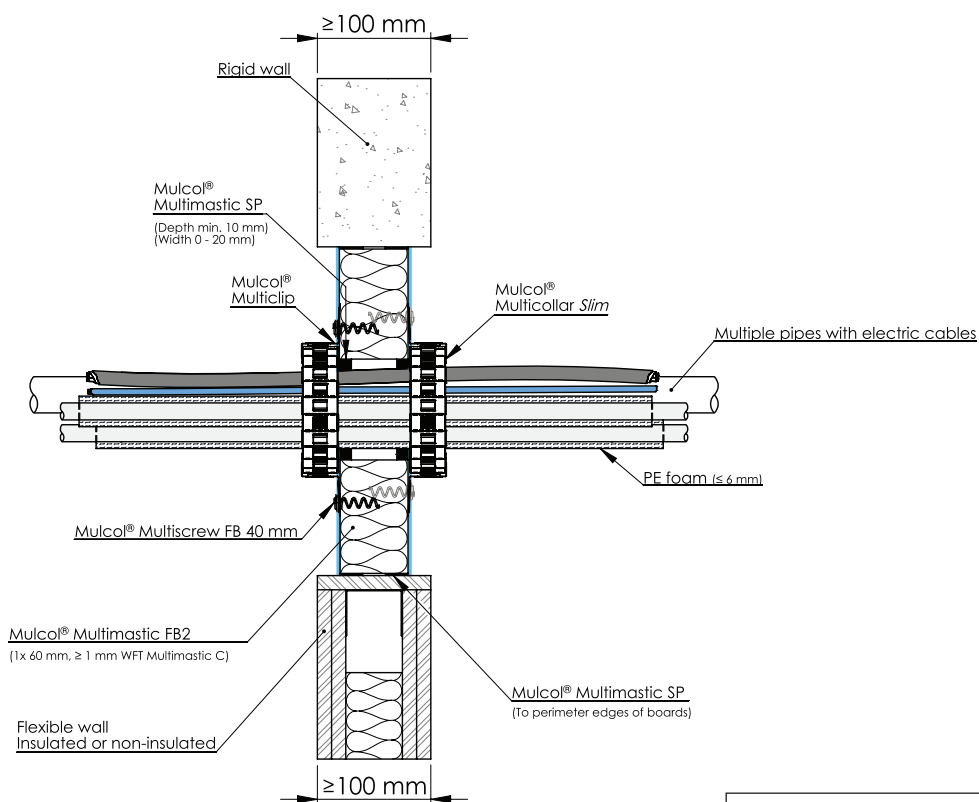

Services	Pipe dimensions (mm)		Insulation			Product	Classification
	Outer diameter	Wall thickness	Type	Thickness (mm)	Configuration		
Set of airconditioning pipes	2x ≤ Ø 15	1.5	PE foam	≥ 6	LS 400 / CS LI 400 / CI	Multicollar <i>Slim</i>	EI 60 C/U E 120 C/U
PVC-U / PVC-C	≤ Ø 40	3.0	-	-	-		EI 60 U/U E 120 U/U
Telecommunication cable	UTP Cat 5/6	-	-	-	-		EI 60 E 120
Sheathed cable	≤ 5 x 2.5 mm ²	-	-	-	-		

A.1.24 Multimastic FB1 - 2x 50 mm - Gas pipes

A.1.24.1 Corrugated stainless steel tube gas (CSST) pipes

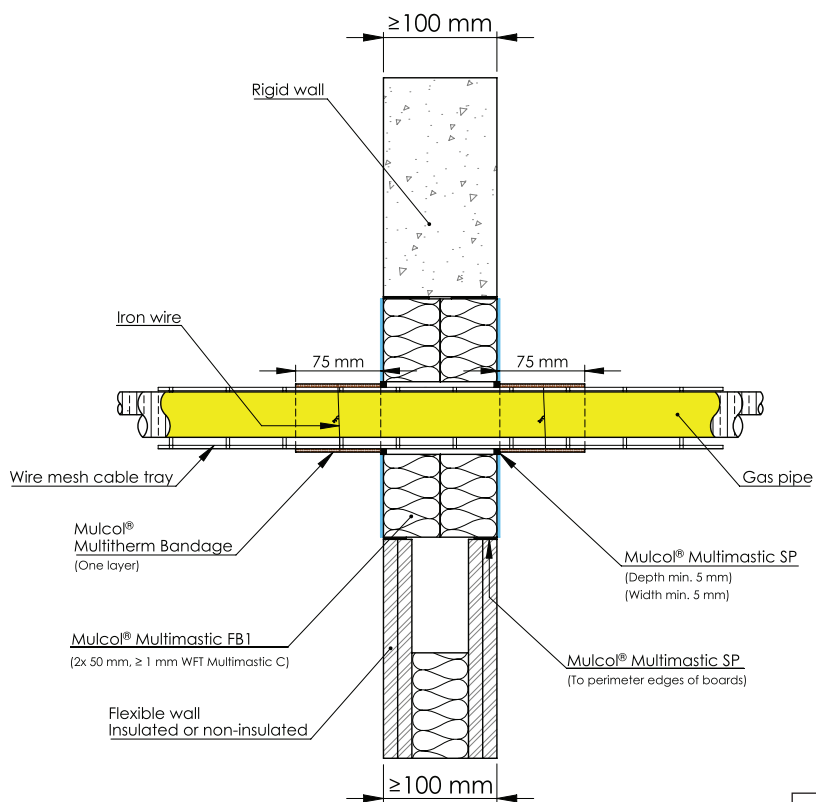

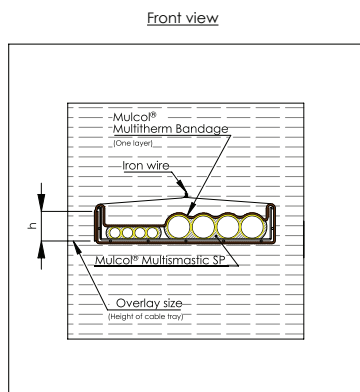


Drawing: PBfw.E-CT-MFB1.2.10

Services	Service dimensions (mm)		Sealing (mm)	Multitherm Bandage	Classification
	Outer dimension	Number of pipes			
Corrugated stainless steel tube (CSST) gas pipes in wire mesh cable tray	≤ Ø 19.9	≤ 3	Multimastic SP ≥ 5 x 5 (wxd)	LI 75 one layer (one wire)	EI 60 U/C
	≤ Ø 40.8	≤ 3			
	≤ Ø 60.3	≤ 1			

A.1.24 Multimastic FB1 - 2x 50 mm - Gas pipes

A.1.24.2 Corrugated stainless steel tube gas (CSST) pipes - Multisealant GR - Multitherm Bandage

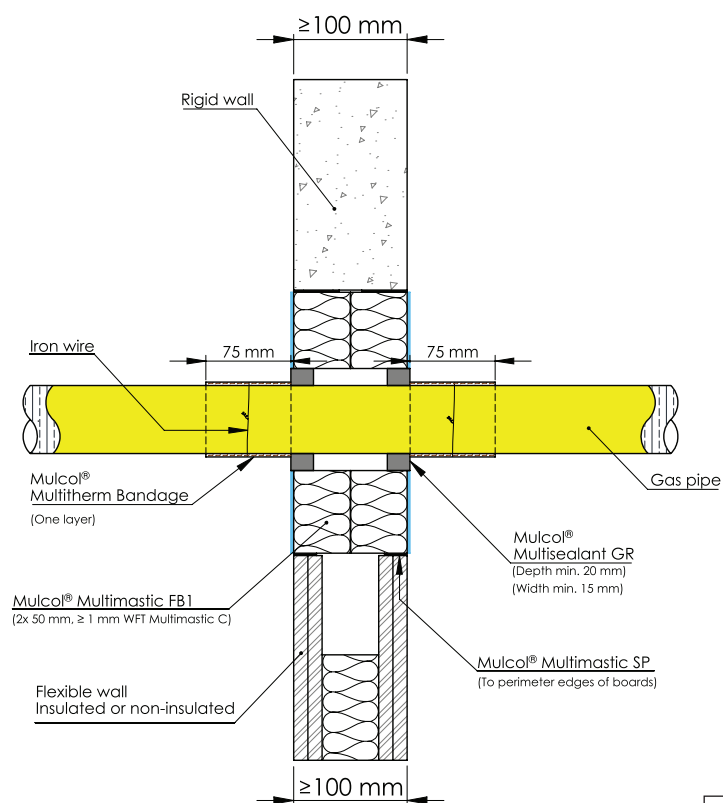
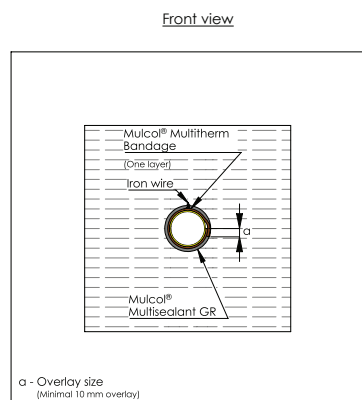


Drawing: PBfw.E-GFS-MFB1.2.10

Services	Service dimensions (mm)		Sealing (mm)	Multitherm Bandage	Classification
	Outer dimension	Number of pipes			
Corrugated stainless steel tube (CSST) gas pipes	≤ Ø 19.9	≤ 2	Multisealant GR ≥ 15 x 20 (wxd)	LI 75 one layer (one wire)	EI 60 U/C
	≤ Ø 40.8	≤ 1			
	≤ Ø 60.3	≤ 1			

A.1.25 Directly through wall - Cables, trays and conduits

A.1.25.1 Cables, trays and conduits - Multimastic C - 50 mm

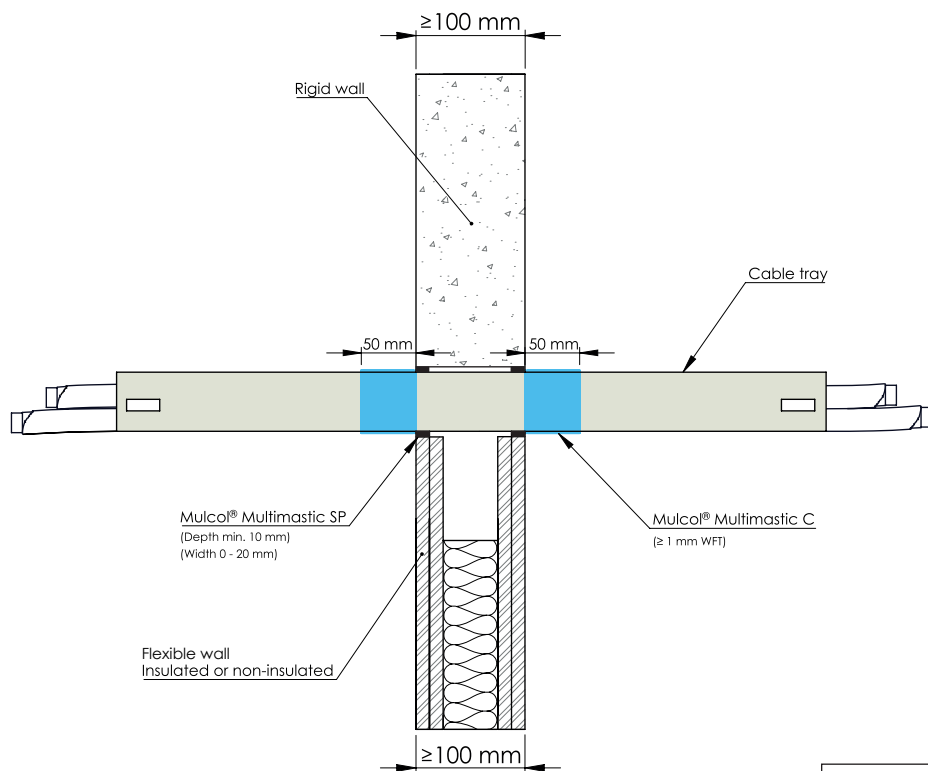
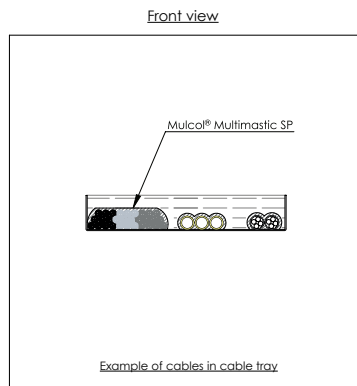


Drawing: FW.E-PB-CT-0.10_50

Services	Coating	Classification
Metal cable ladders	Coat back 50 mm ≥ 1 mm WFT	EI 60, E 90
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 80 mm		
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 45, E 90
Non sheathed cables ≤ Ø 24 mm		EI 60 U/C, E 90 U/C
Plastic conduits ≤ Ø 16 mm		EI 45 C/U, E 60 C/U
Copper conduits ≤ Ø 16 mm		EI 60 C/U
Steel conduits ≤ Ø 16 mm		

A.1.25 Directly through wall - Cables, trays and conduits

A.1.25.2 Cables, trays and conduits - Multimastic C - 150 mm

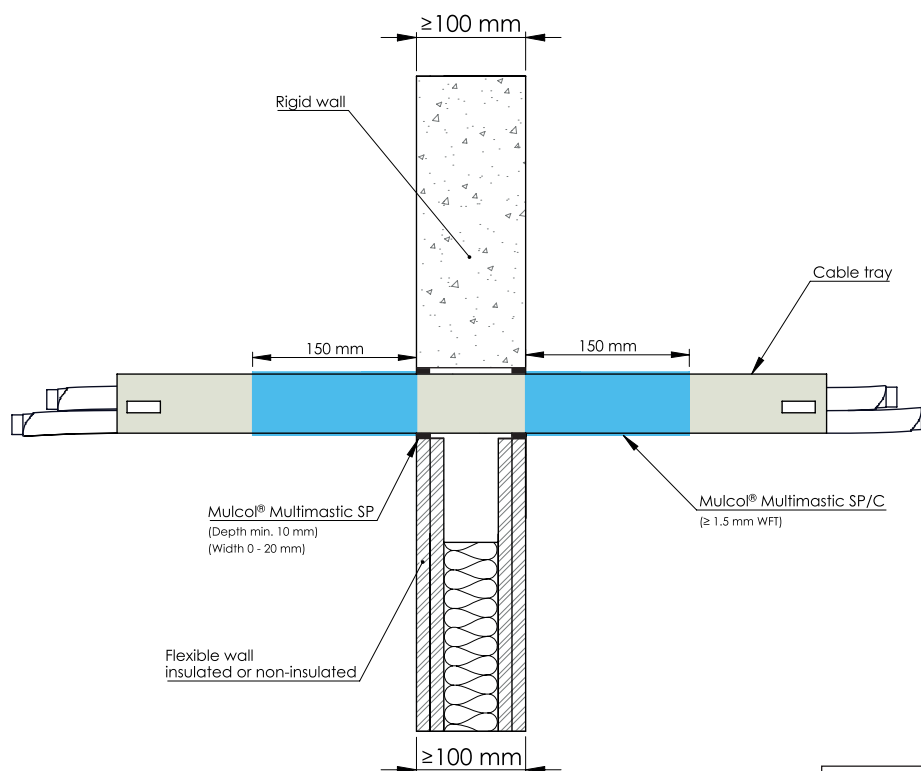
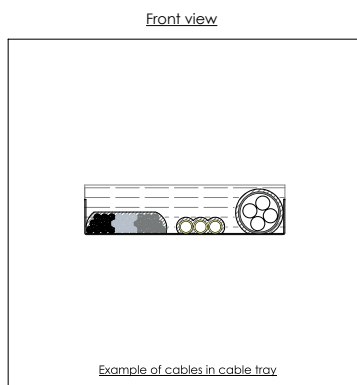


Drawing: FW.E-PB-CT-0.10_150

Services	Coating	Classification
Metal cable ladders	Coat back 150 mm ≥ 1.5 mm WFT	EI 90, E 120
Metal (non-)perforated cable trays		EI 120
Steel wire mesh cable trays (baskets)		EI 90, E 120
Cables ≤ Ø 80 mm		EI 60, E 120
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 120 U/C
Non sheathed cables ≤ Ø 24 mm		EI 45 C/U, E 90 C/U
Plastic conduits ≤ Ø 16 mm		EI 90 C/U
Copper conduits ≤ Ø 16 mm		
Steel conduits ≤ Ø 16 mm		

A.1.25 Directly through wall - Cables, trays and conduits

A.1.25.3 Cables, trays and conduits - Multitherm Bandage

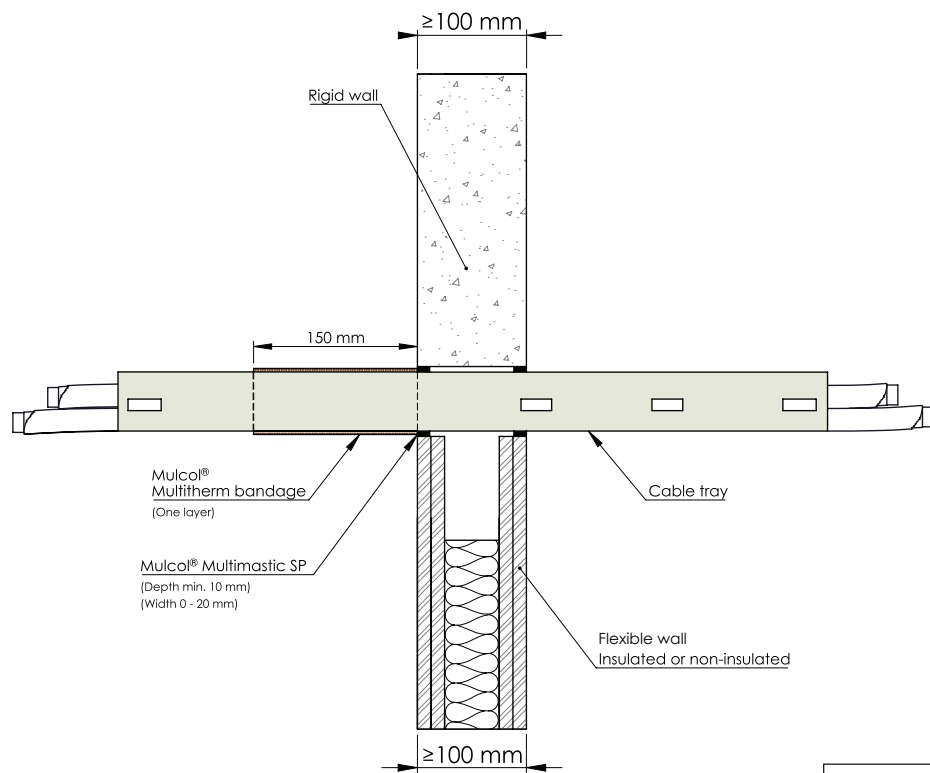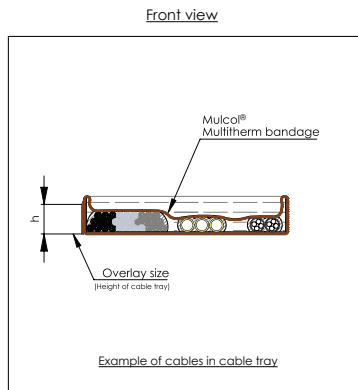


Drawing: FW.E-PB-CT-B1.3.10

Services	Insulation (mm)	Classification
Metal (non-)perforated cable trays	LI 150 - Multitherm Bandage either side	EI 120
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 21 mm		

A.1.26 Directly through wall - Busbars

A.1.26.1 Single busbar - LI 300

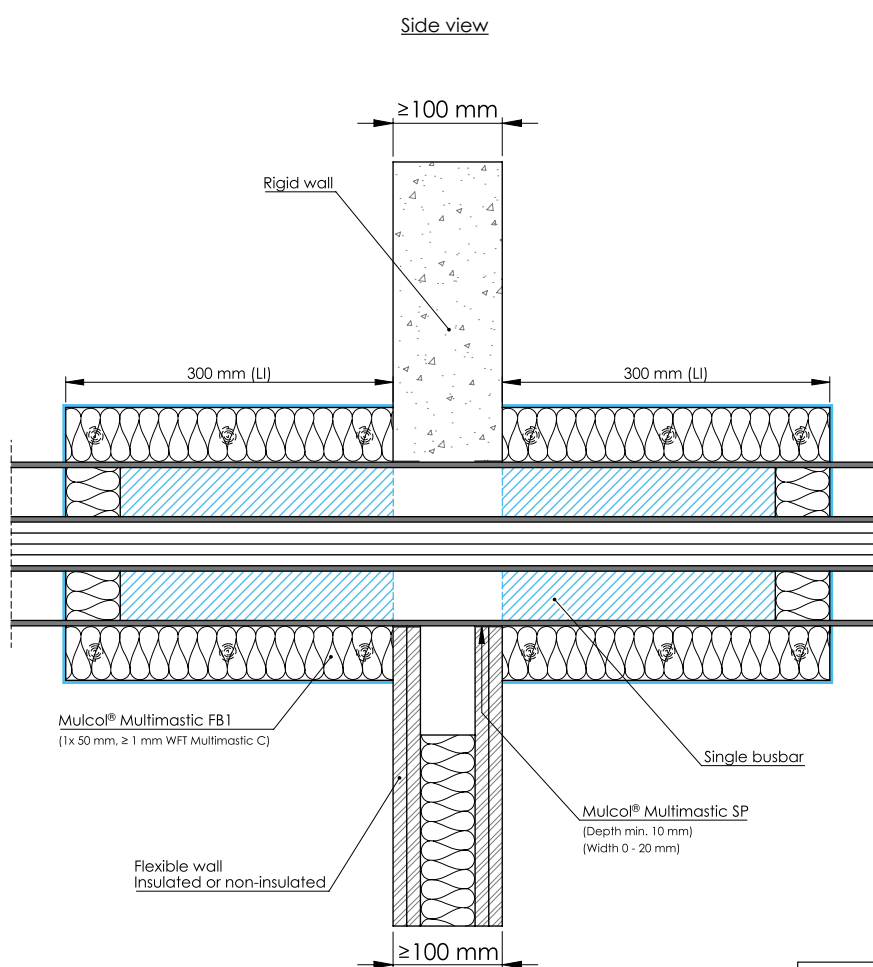


Drawing: FW.E-1BB-0.10.LI300

Services	Service dimensions		Insulation			Classification
	Outside	Conductor	Type	Thickness (mm)	Configuration	
Single busbar	≤ 150 x 250 mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 300 / CI	EI 60

A.1.26 Directly through wall - Busbars

A.1.26.1 Single busbar - LI 300


Front view

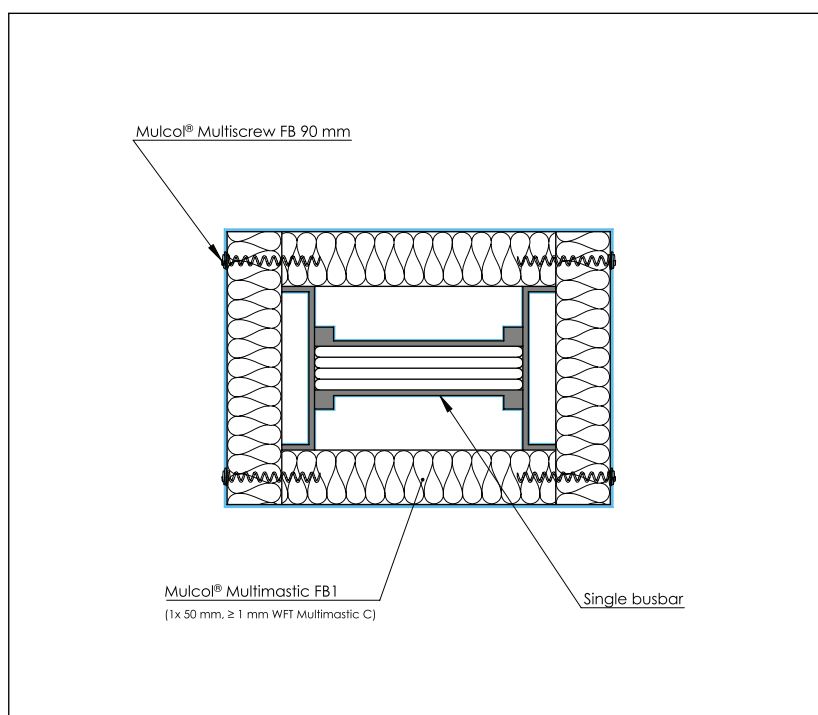

Drawing: FW.E-1BB-0.10.LI300

A.1.26 Directly through wall - Busbars

A.1.26.2 Single busbar - LI 400

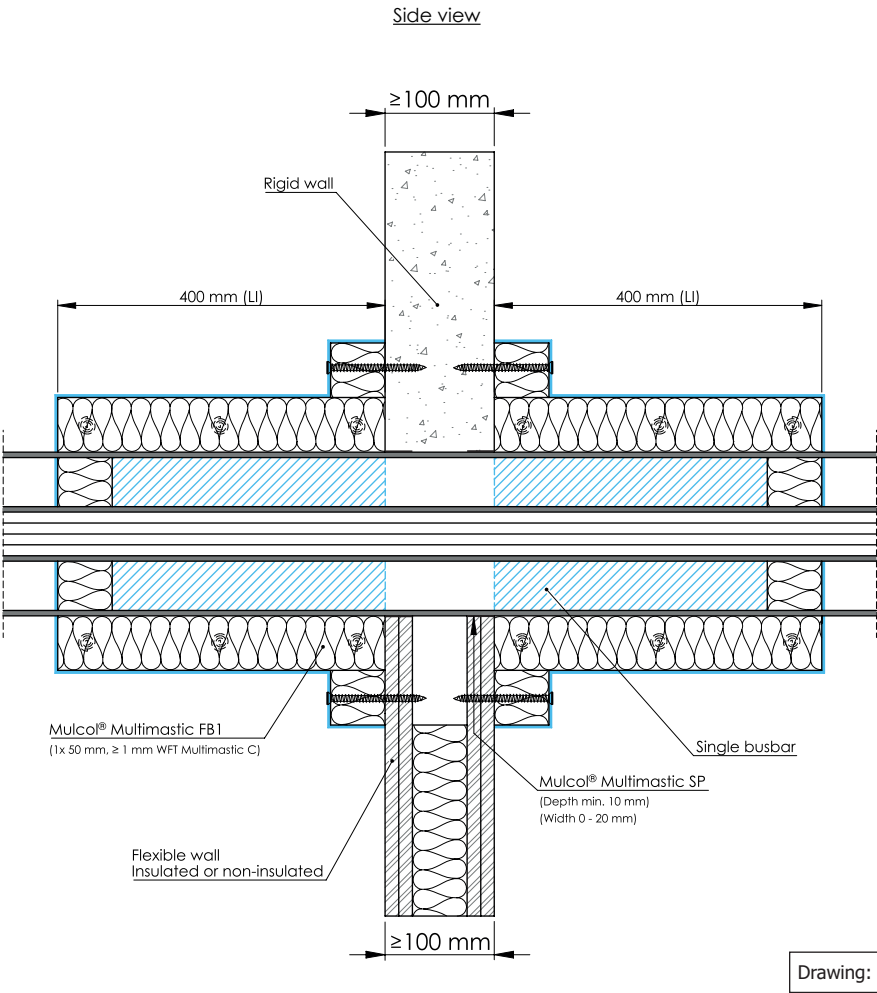


Services	Service dimensions		Insulation			Classification
	Outside	Conductor	Type	Thickness (mm)	Configuration	
Single busbar	$\leq 150 \times 250 \text{ mm}$	max. $4 \times \leq 200 \text{ mm}$ width (per busbar)	Multimastic FB1	50	LI 400 / CI	EI 120

A.1.26 Directly through wall - Busbars

A.1.26.2 Single busbar - LI 400


Front view

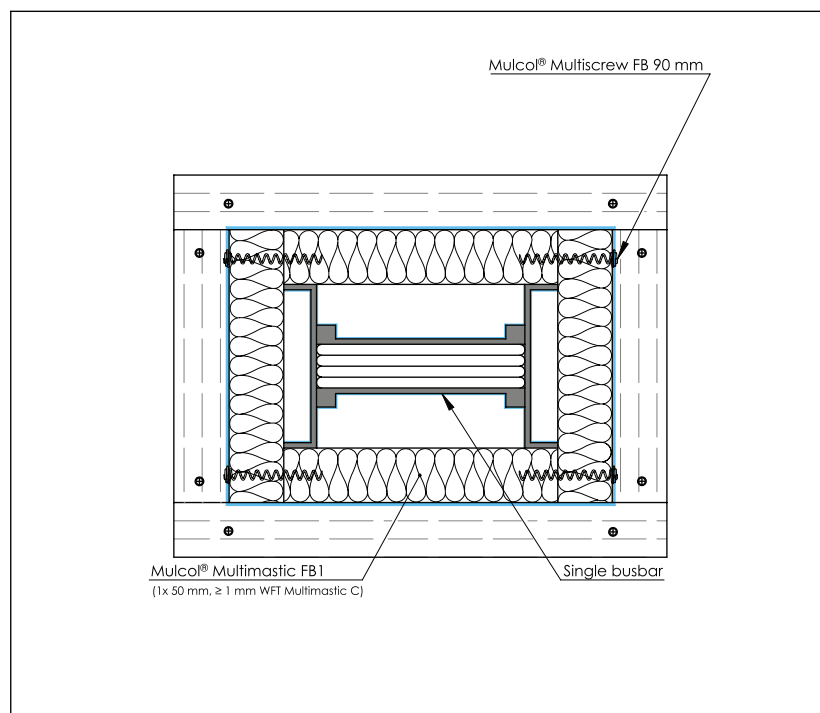

Drawing: FW.E-1BB-0.10.LI400

A.1.26 Directly through wall - Busbars

A.1.26.3 Multiple busbars - LI 300

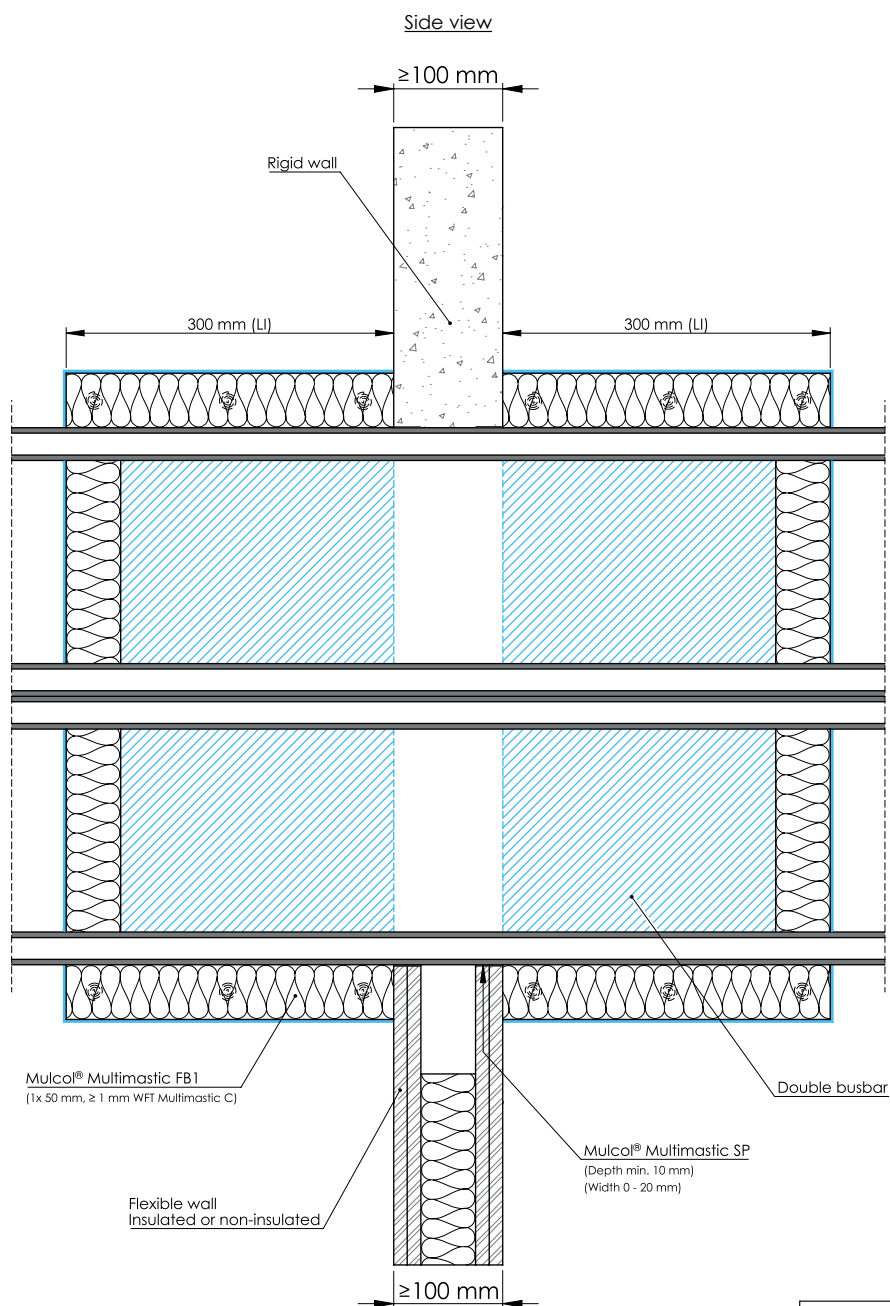


Drawing: FW.E-2BB-0.10.LI300

Services	Service dimensions		Insulation			Classification
	Outside dimension	Conductor	Type	Thickness (mm)	Configuration	
Double busbar	≤ 150 x 500 mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 300 / CI	EI 60

A.1.26 Directly through wall - Busbars

A.1.26.3 Multiple busbars - LI 300


Front view

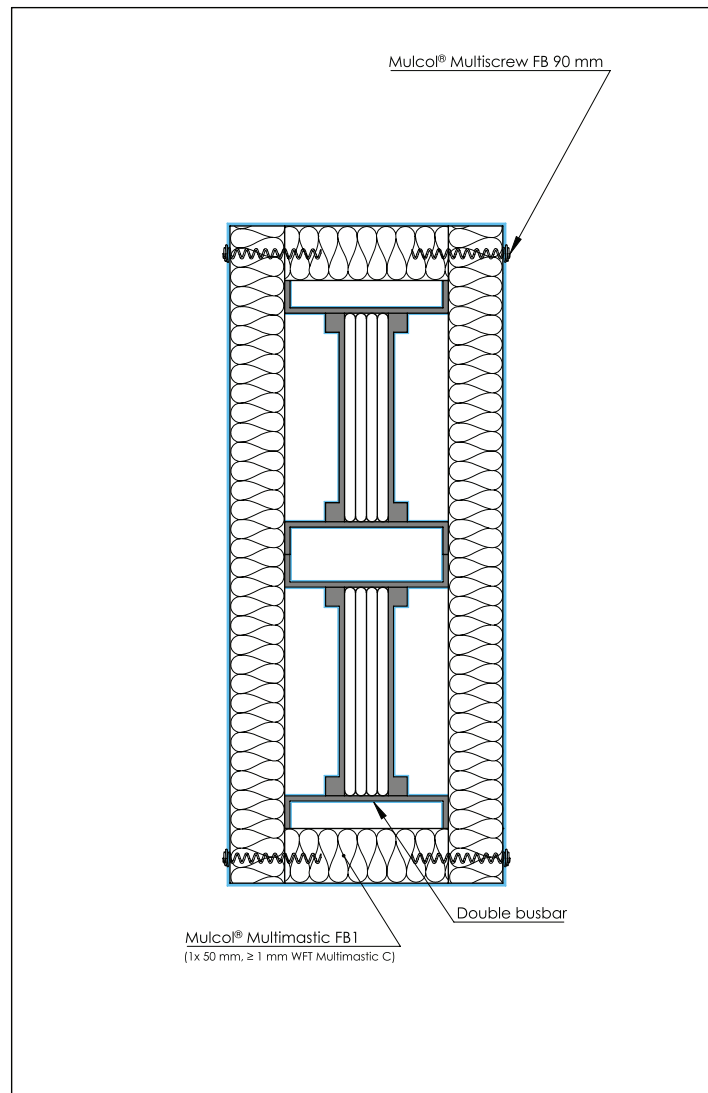

Drawing: FW.E-2BB-0.10.LI300

A.1.26 Directly through wall - Busbars

A.1.26.4 Multiple busbars - LI 400

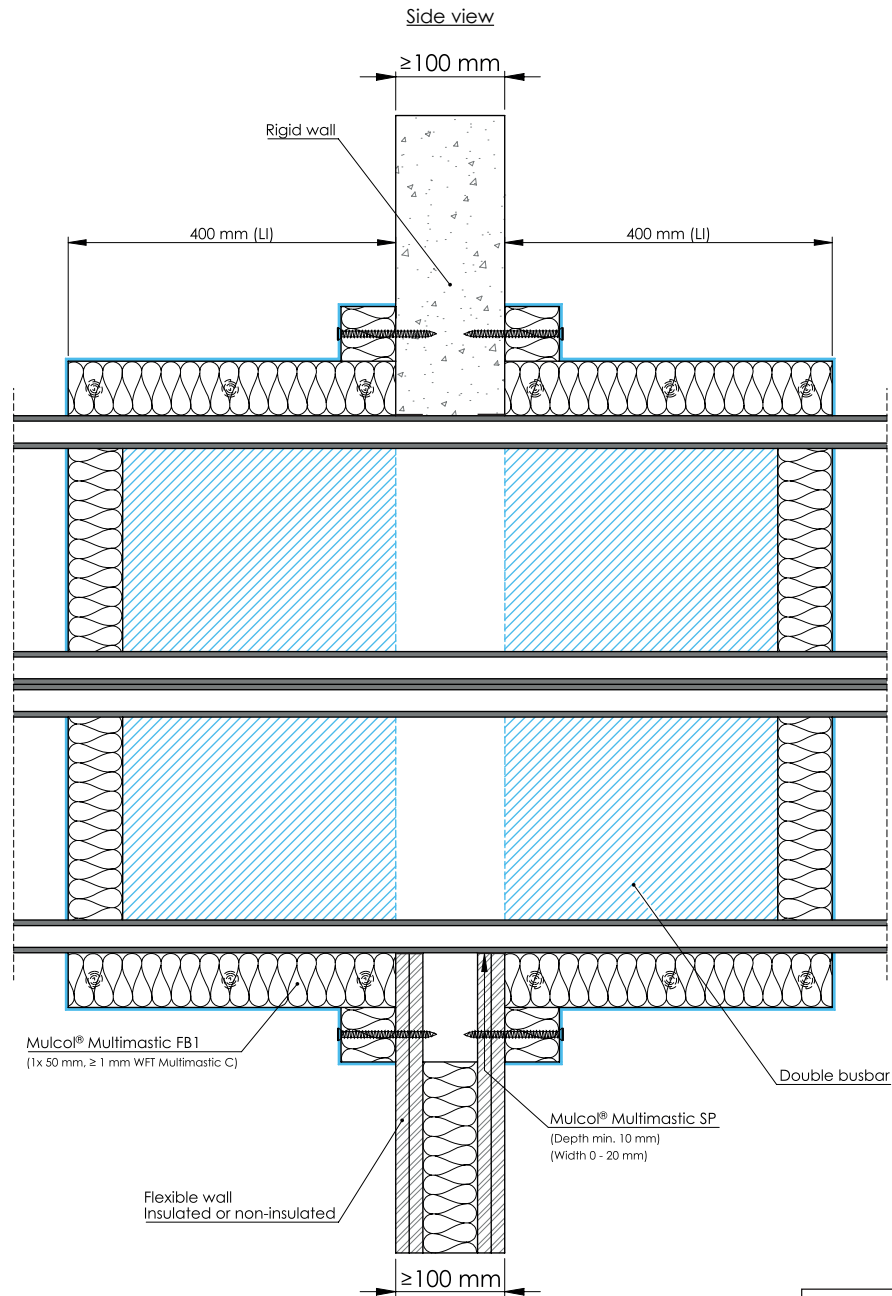


Drawing: FW.E-2BB-0.10.LI400

Services	Service dimensions		Insulation			Classification
	Outside dimension	Conductor	Type	Thickness (mm)	Configuration	
Double busbar	≤ 150 x 500 mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 400 / CI	EI 120

A.1.26 Directly through wall - Busbars

A.1.26.4 Multiple busbars - LI 400




Front view

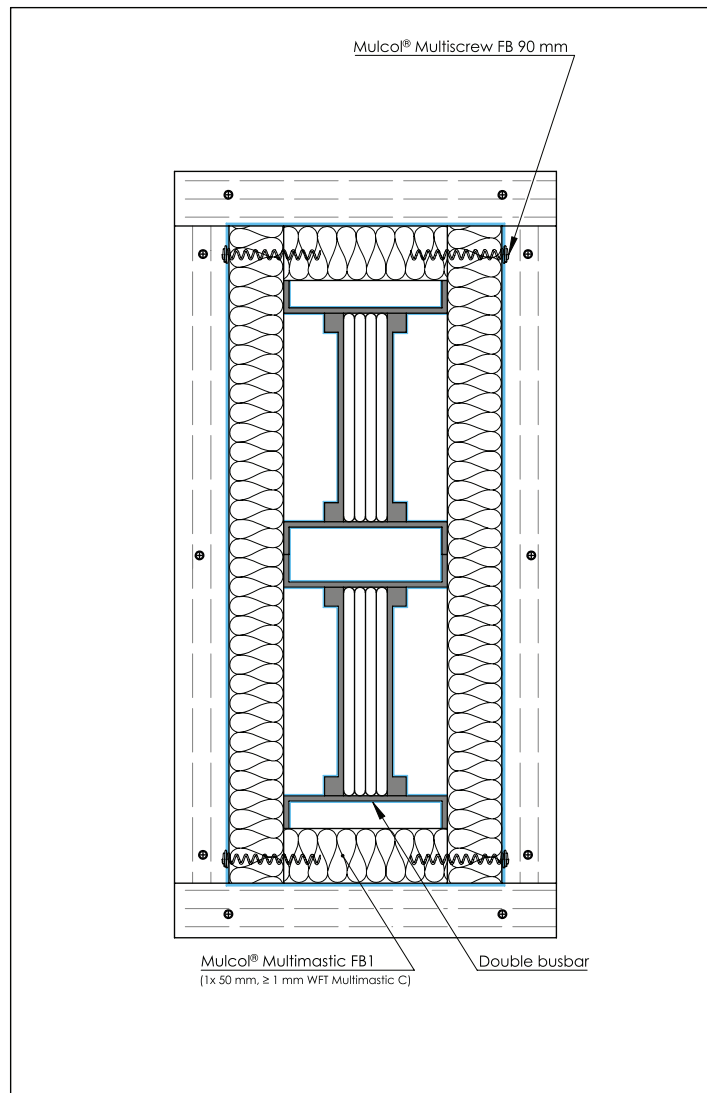

Drawing: FW.E-2BB-0.10.LI400

A.2.1 Multimastic FB2 - 2x 60 mm - Cables, trays and conduits

A.2.1.1 Cables and trays - Multimastic C

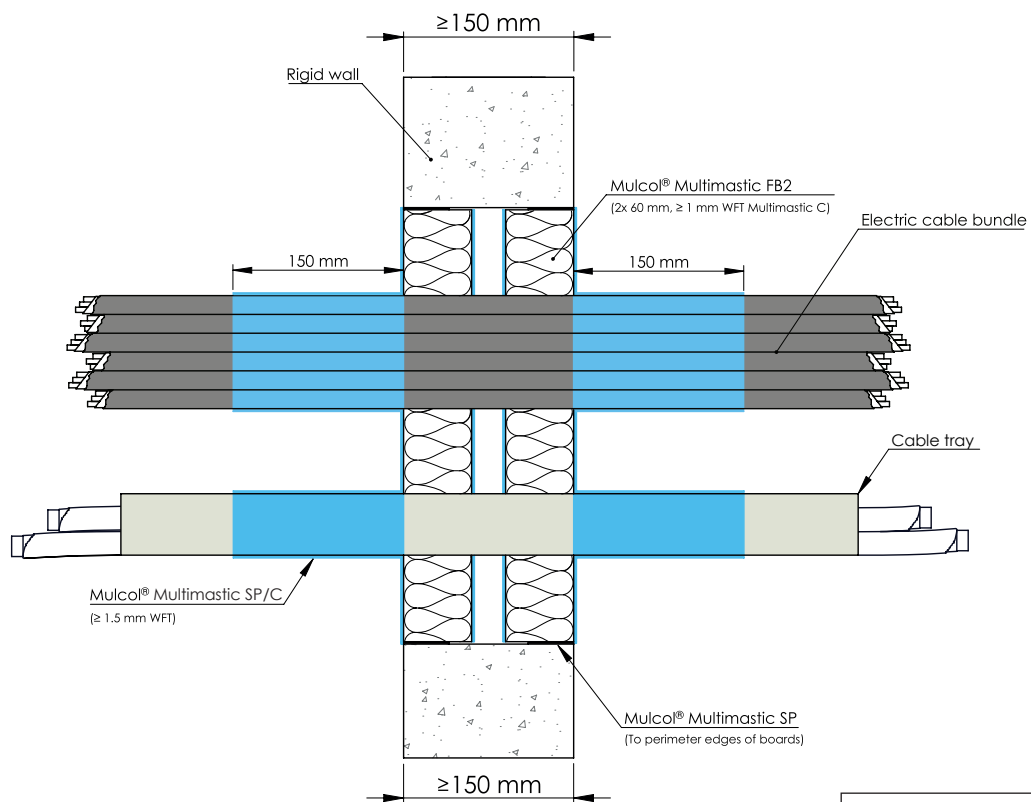
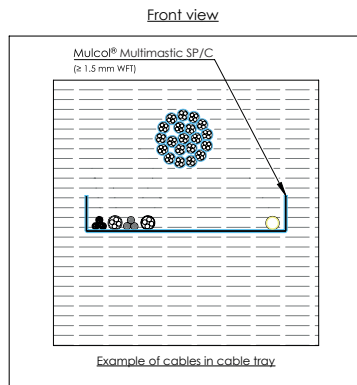


Drawing: RW150.E-CT-ECB-MFB2.2.10

Services	Coating	Classification
Metal cable ladders	Coat back 150 mm ≥ 1.5 mm WFT Multimastic C	EI 240
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		EI 120
Cables ≤ Ø 21 mm		EI 180 U/C
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		
Plastic conduits ≤ Ø 16 mm		

A.2.2 Multimastic FB2 Pattress - 2x 60 mm - Cables, trays and conduits

A.2.2.1 Cables and trays - Multimastic C

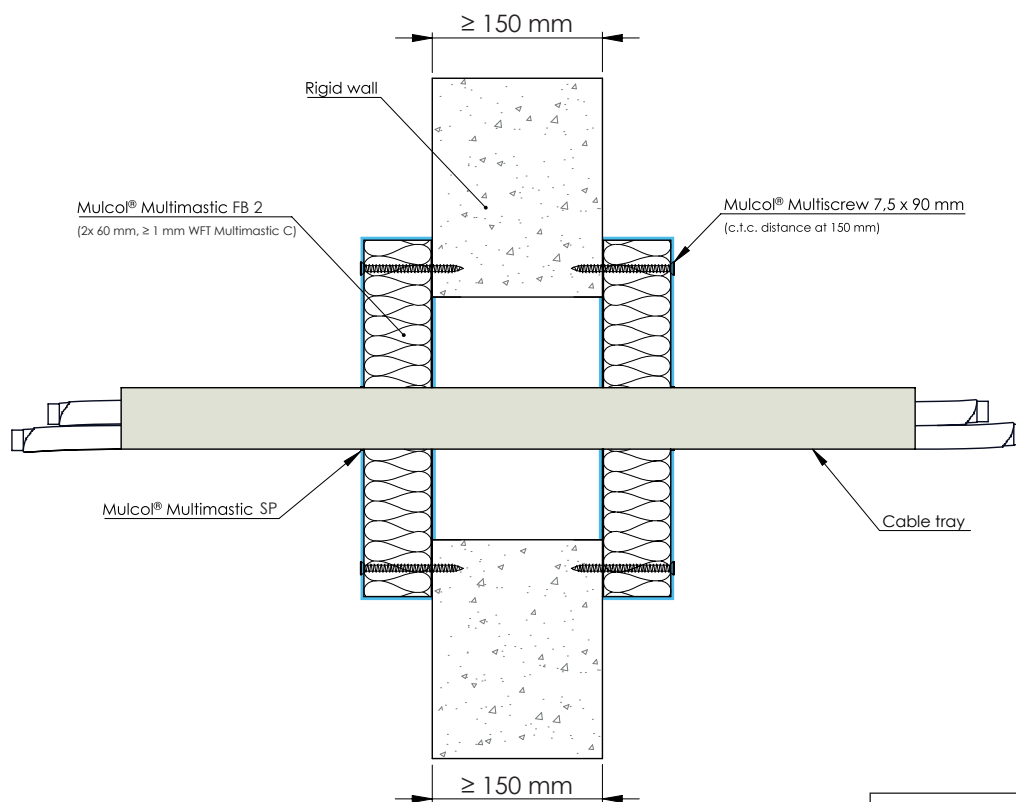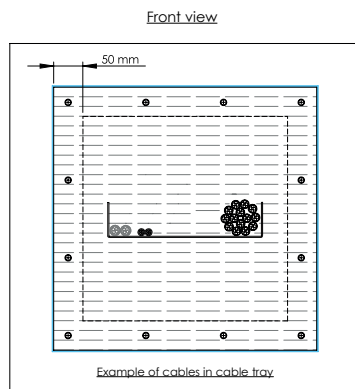




Drawing: RW150-P-CT-MFB2.2.10

Services	Coating	Classification
Metal cable ladders	Not required	EI 240
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		EI 180, E 240
Cables ≤ Ø 21 mm		EI 240
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 90, E 240
Non sheathed cables ≤ Ø 24 mm		

A.2.3 Multimastic FB2 - 2x 60 mm - Combustible pipes

A.2.3.1 Plastic pipes - Multiwrap

Front view

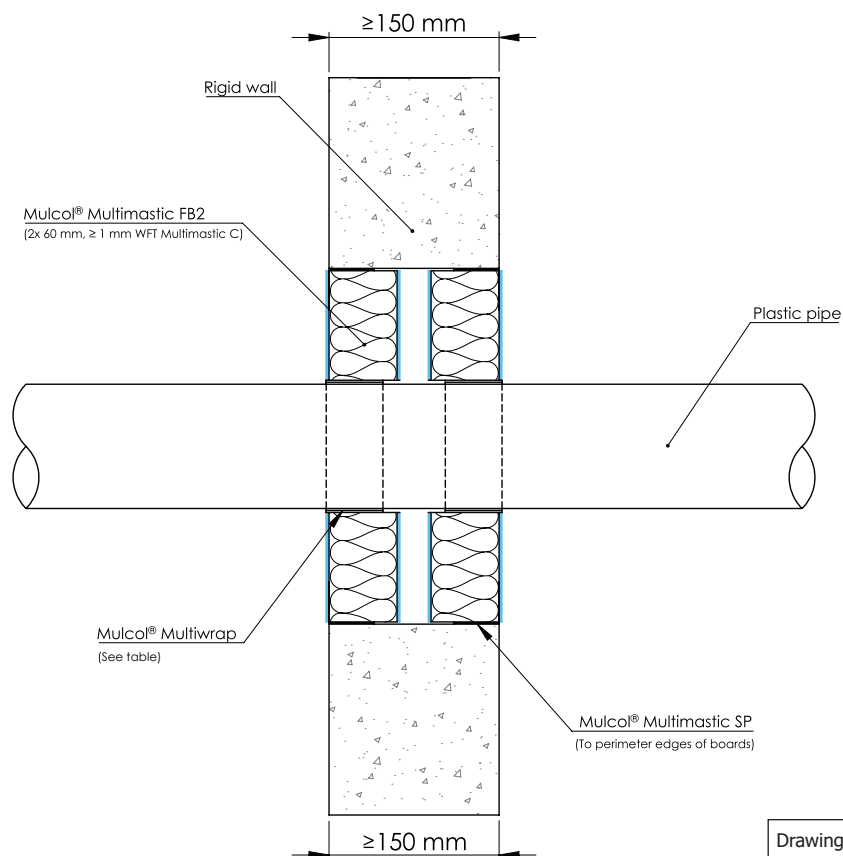

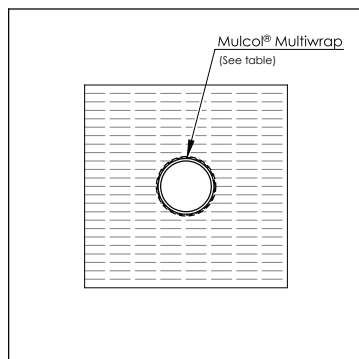


Drawing: RW150-PP-MW2-MFB2.2.10

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 40	2.0 to 5.5	Multiwrap (1 layer)	EI 240 U/C
	≤ Ø 110	3.4	Multiwrap (2 layers)	
		3.4 to 10		
	≤ Ø 160	4.0 to 9.5	Multiwrap (6 layers)	EI 180 U/C, E 240 U/C
		9.5		
PP	≤ Ø 40	1.8 to 5.5	Multiwrap (1 layer)	EI 240 U/C
PVC(-U/-C)	≤ Ø 40	2.0 to 5.5		
	≤ Ø 110	2.7 to 8.6	Multiwrap (2 layers)	EI 180 U/C, E 240 U/C
	≤ Ø 160	4.0 to 11.8	Multiwrap (6 layers)	

A.2.4 Multimastic FB2 - 2x 60 mm - Multilayer pipes (MLC)

A.2.4.1 Multilayer pipes (MLC) - Stone wool LI 600 / CI

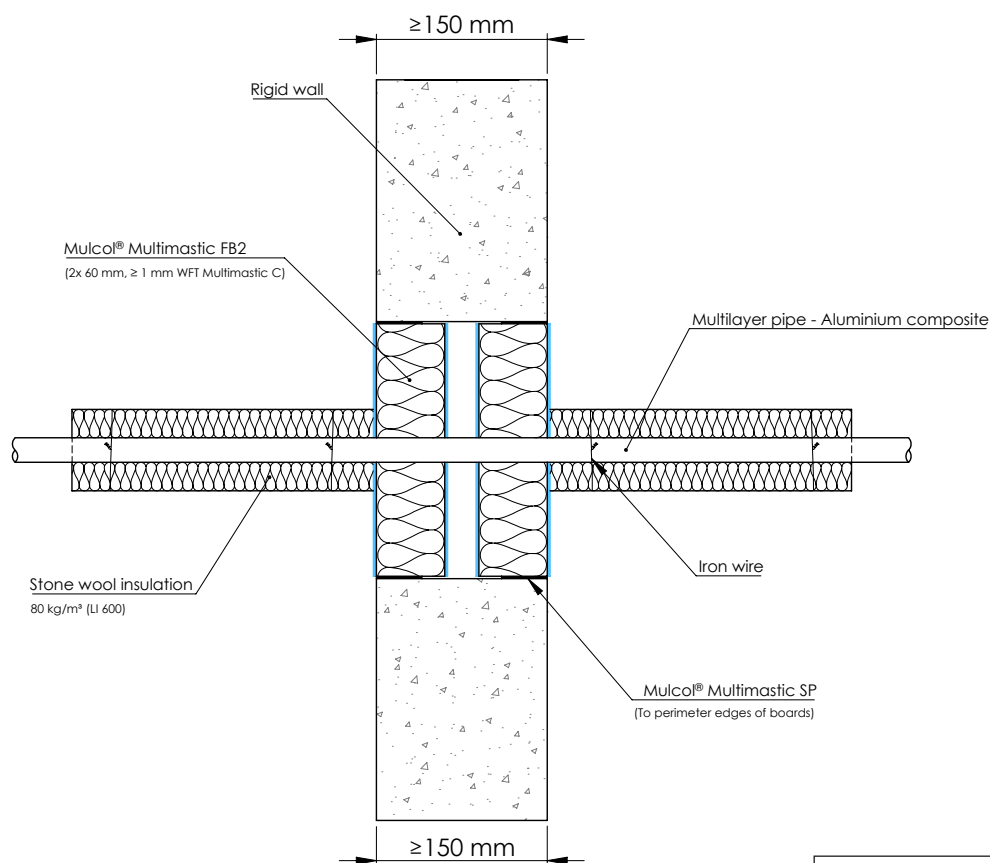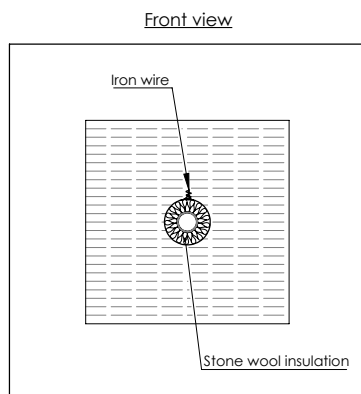



Drawing: RW150-MLA-MFB2.2.20

Services	Pipe dimensions (mm)		Insulation			Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration	
Multilayer pipes (MLC)	≤ Ø 20	2.0	Stone wool (≥ 80 kg/m³)	≥ 25	LI 600 / CI	EI 240 C/U


A.2.5 Multimastic FB2 - 2x 60 mm - Metal pipes insulated mineral wool

A.2.5.1 Steel pipes - Stone wool LS 400 / CS

Front view

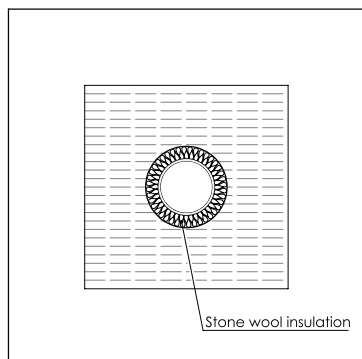

Position seal:
right, left or any in between



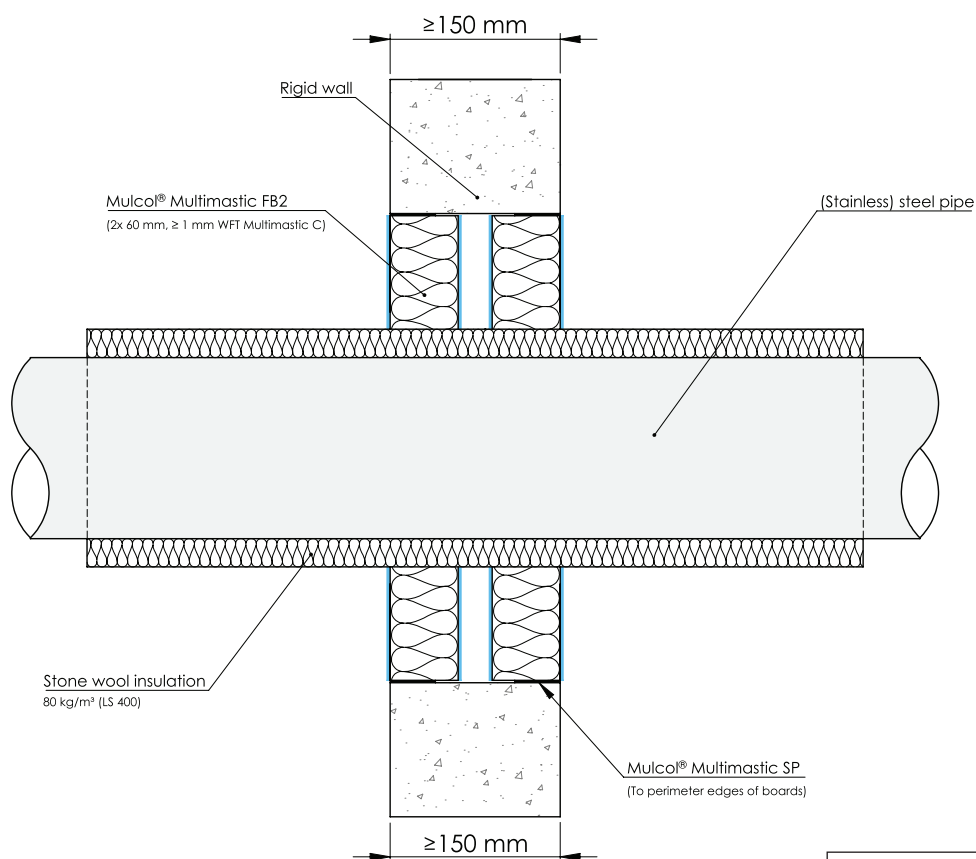


Drawing: RW150.E-ST-MFB2.2.20

Services	Pipe dimensions (mm)		Insulation			Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration	
(Stainless) Steel / cast iron	≤ Ø 40	≥ 1.0	Stone wool (≥ 80 kg/m³)	30	LS 400 / CS	EI 90 C/U E 180 C/U
	≤ Ø 324	≥ 3.7				EI 90 C/U E 180 C/U

A.2.5 Multimastic FB2 - 2x 60 mm - Metal pipes insulated mineral wool

A.2.5.2 Copper and steel pipes - Stone wool LI / CI

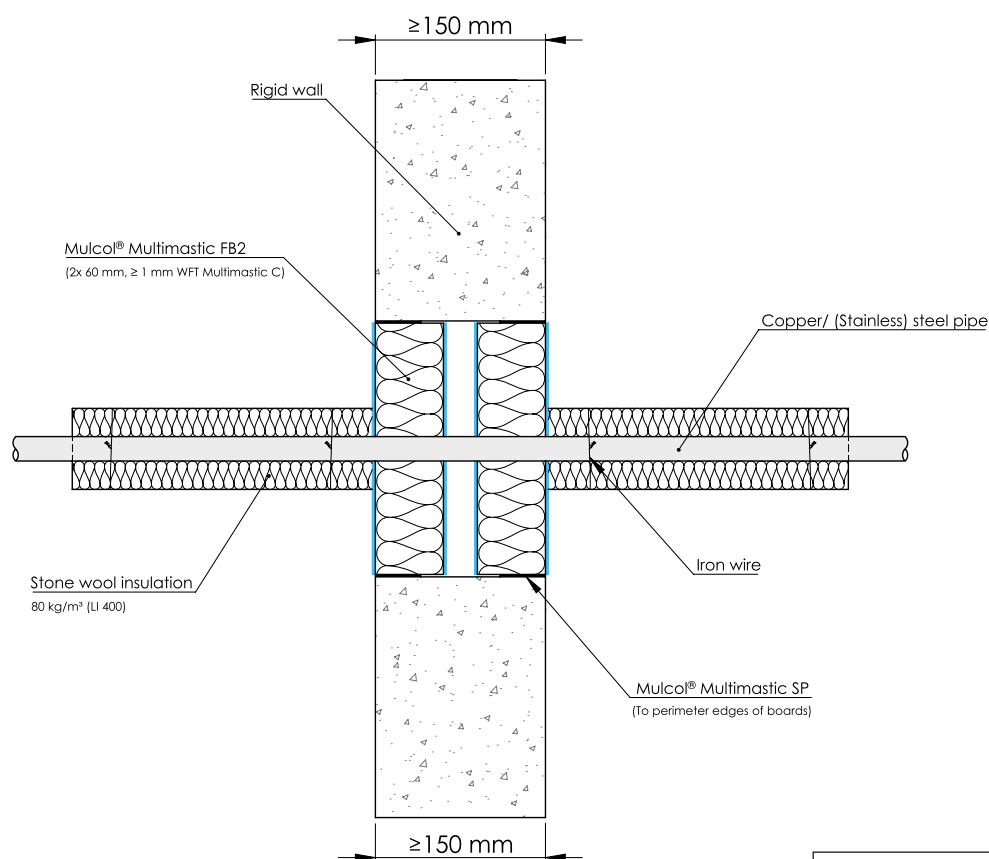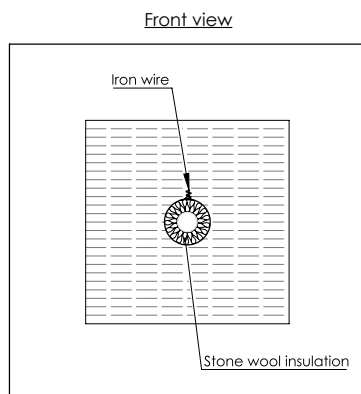


Drawing: RW150.E-CU-MFB2.2.20

Services	Pipe dimensions (mm)		Insulation			Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration	
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	≥ 25	LI 400 / CI	EI 90 C/U, E 240 C/U
	≤ Ø 54	≥ 1.5			CI	EI 120 C/U, E 240 C/U
					LI 400 / CI	EI 120 C/U
					LI 500 / CI	EI 90 C/U, E 240 C/U
					CI	EI 120 C/U, E 240 C/U
(Stainless) Steel / cast iron	≤ Ø 40	≥ 1.0		≥ 25	LI 400 / CI	EI 180 C/U
	≤ Ø 114.3	≥ 3.6			LI 600 / CI	EI 240 C/U
	≤ Ø 219	≥ 4.0			LI 400 / CI	EI 120 C/U
					LI 600 / CI	EI 120 C/U, E 240 C/U
	≤ Ø 324	≥ 3.7 ≥ 6.3			≥ 30	CI
				LI 400 / CI		EI 120 C/U
				LI 500 / CI		EI 180 C/U, E 240 C/U

A.2.6 Multimastic FB2 - 1x 60 mm - Cables, trays and conduits




A.2.6.1 Cables - Multimastic C

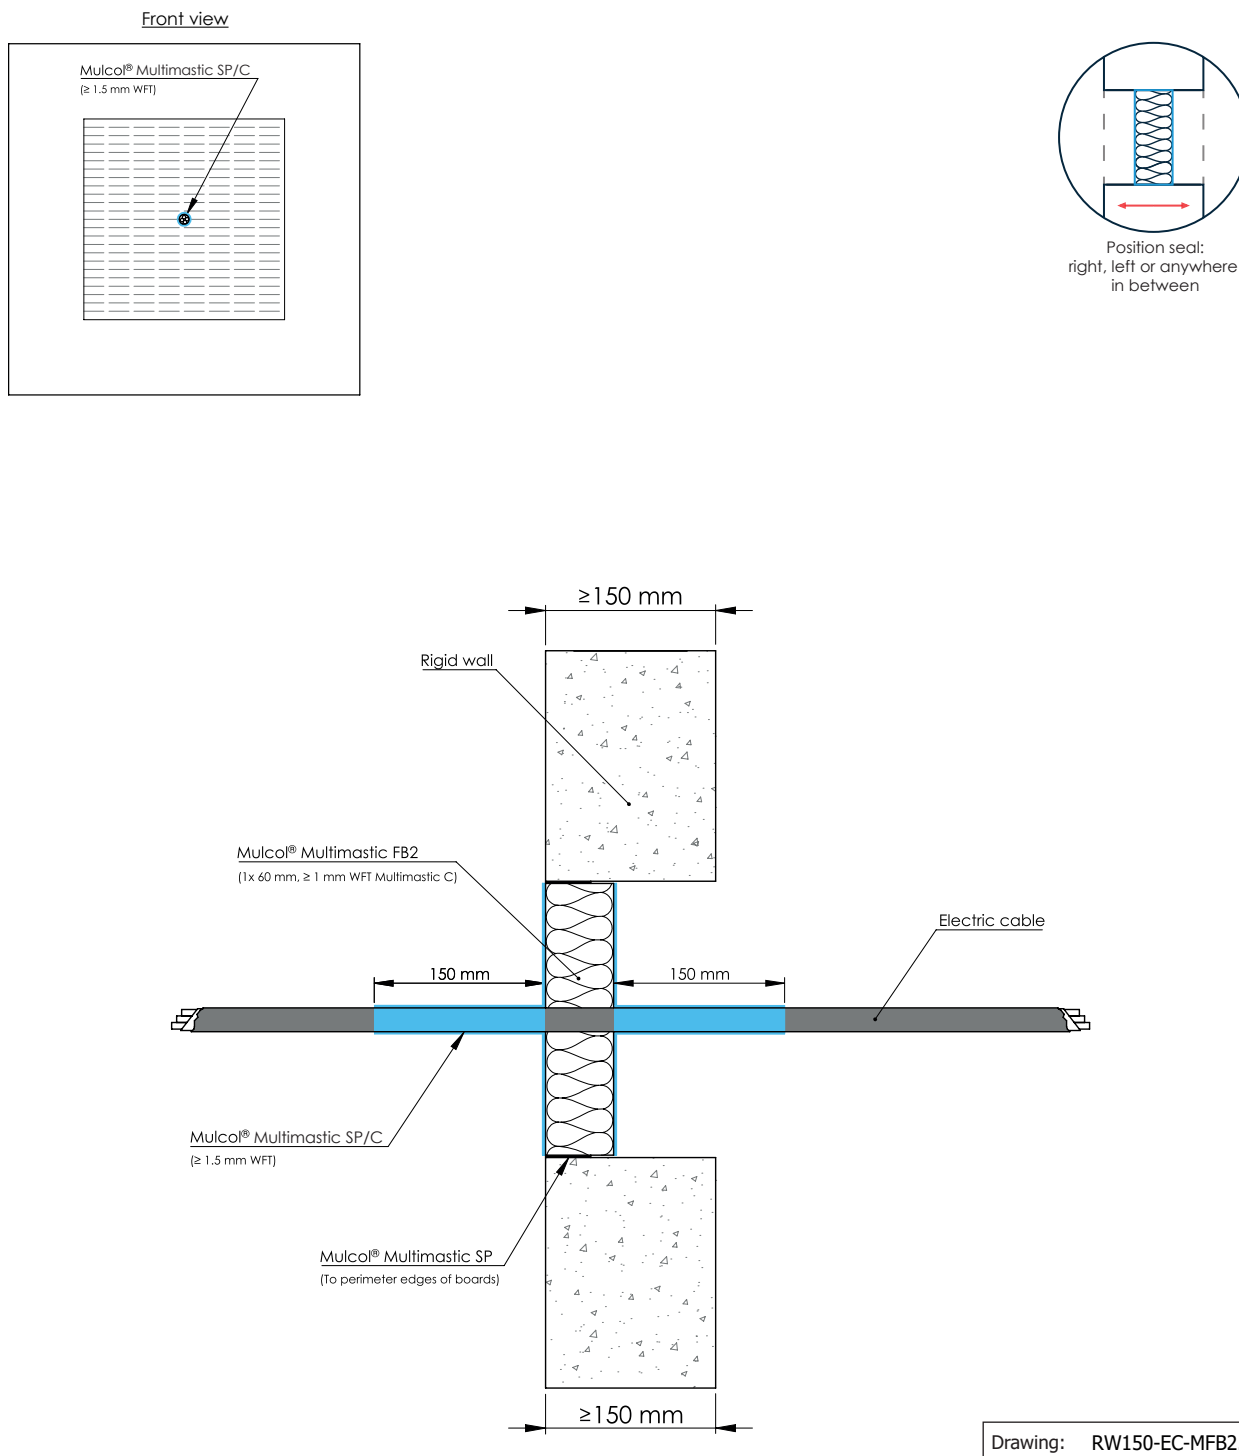

Services	Coating	Classification
Cables ≤ Ø 21 mm (single)	Coat back 150 mm, ≥ 1 mm WFT	EI 45, E 240

A.2.7 Multimastic FB2 - 1x 60 mm - Metal pipes insulated mineral wool

A.2.7.1 Copper and steel pipes - Stone wool LI / CI

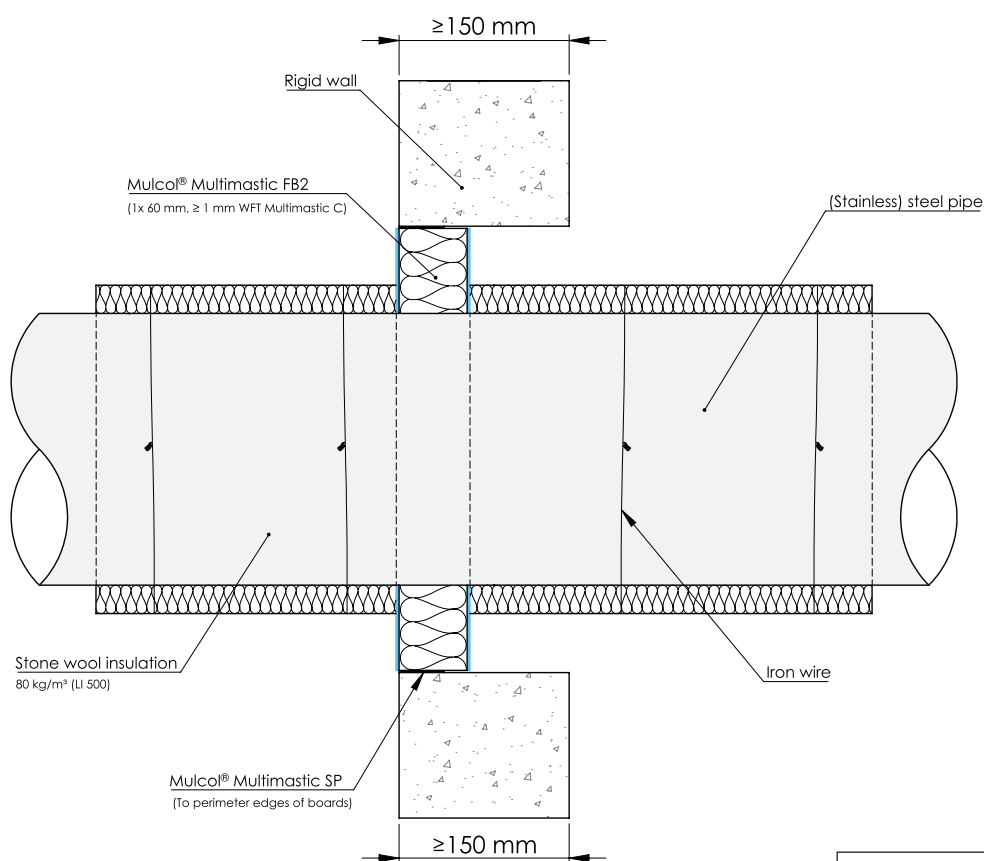
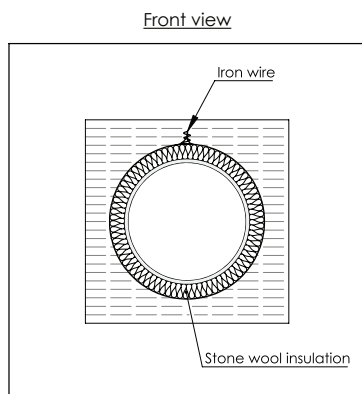


Drawing: RW150.E-ST-MFB2.1.20

Services	Pipe dimensions (mm)		Insulation			Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration	
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	≥ 25	LI 500 / CI	EI 90 C/U, E 240 C/U
					CI	EI 120 C/U, E 240 C/U
	≤ Ø 54	≥ 1.5			LI 500 / CI	EI 90 C/U, E 240 C/U
					CI	EI 120 C/U, E 240 C/U
(Stainless) Steel / cast iron	≤ Ø 40	≥ 1.0		≥ 30	LI 600 / CI	EI 240 C/U
	≤ Ø 219	≥ 4.0				EI 120 C/U, E 240 C/U
			CI		EI 180 C/U, E 240 C/U	

A.2.8 Directly through wall - Cables, trays and conduits

A.2.8.1 Cables, trays and conduits - Multimastic C - 150 mm

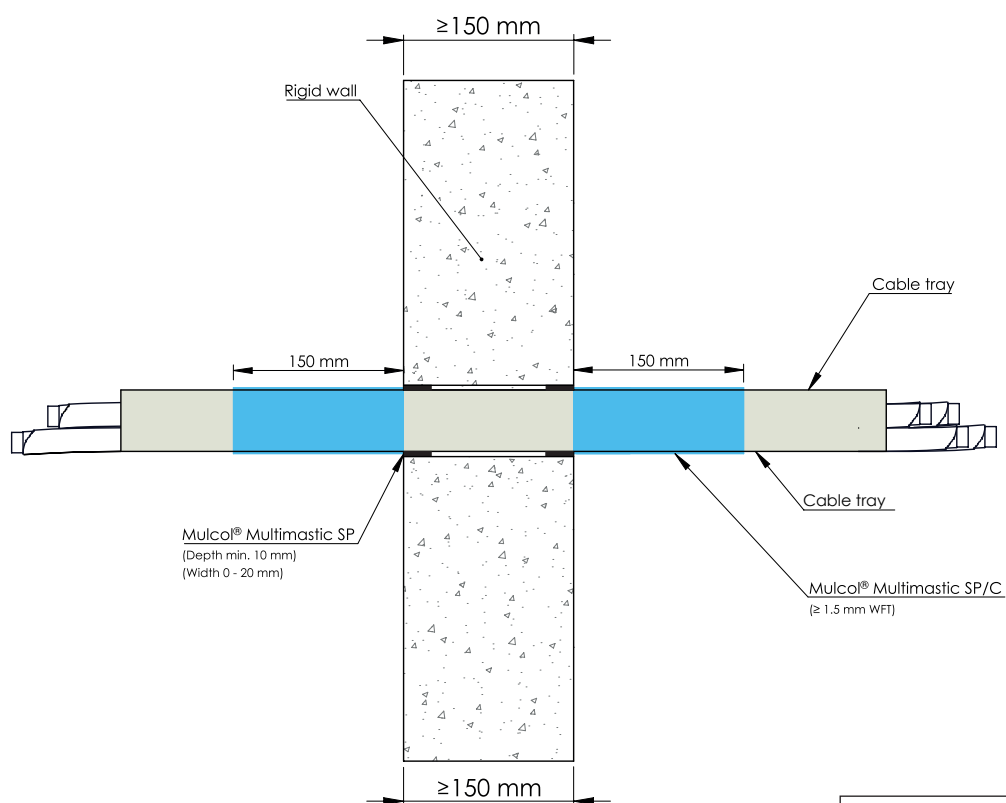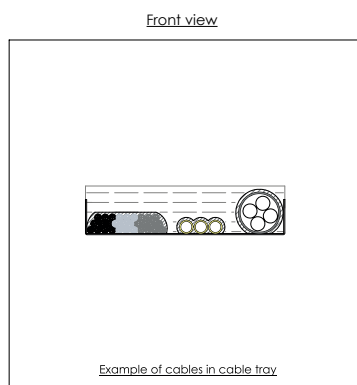


Drawing: RW150.E-PB-CT-0.10

Services	Coating	Classification
Metal cable ladders	Coat back 150 mm ≥ 1.5 mm WFT Multimastic SP/C	EI 240
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 21 mm		
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 120, E 180
Plastic conduits ≤ Ø 16 mm		EI 180 U/C

A.3.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits


A.3.1.1 Cables, trays and conduits - Multimastic C - 50 mm

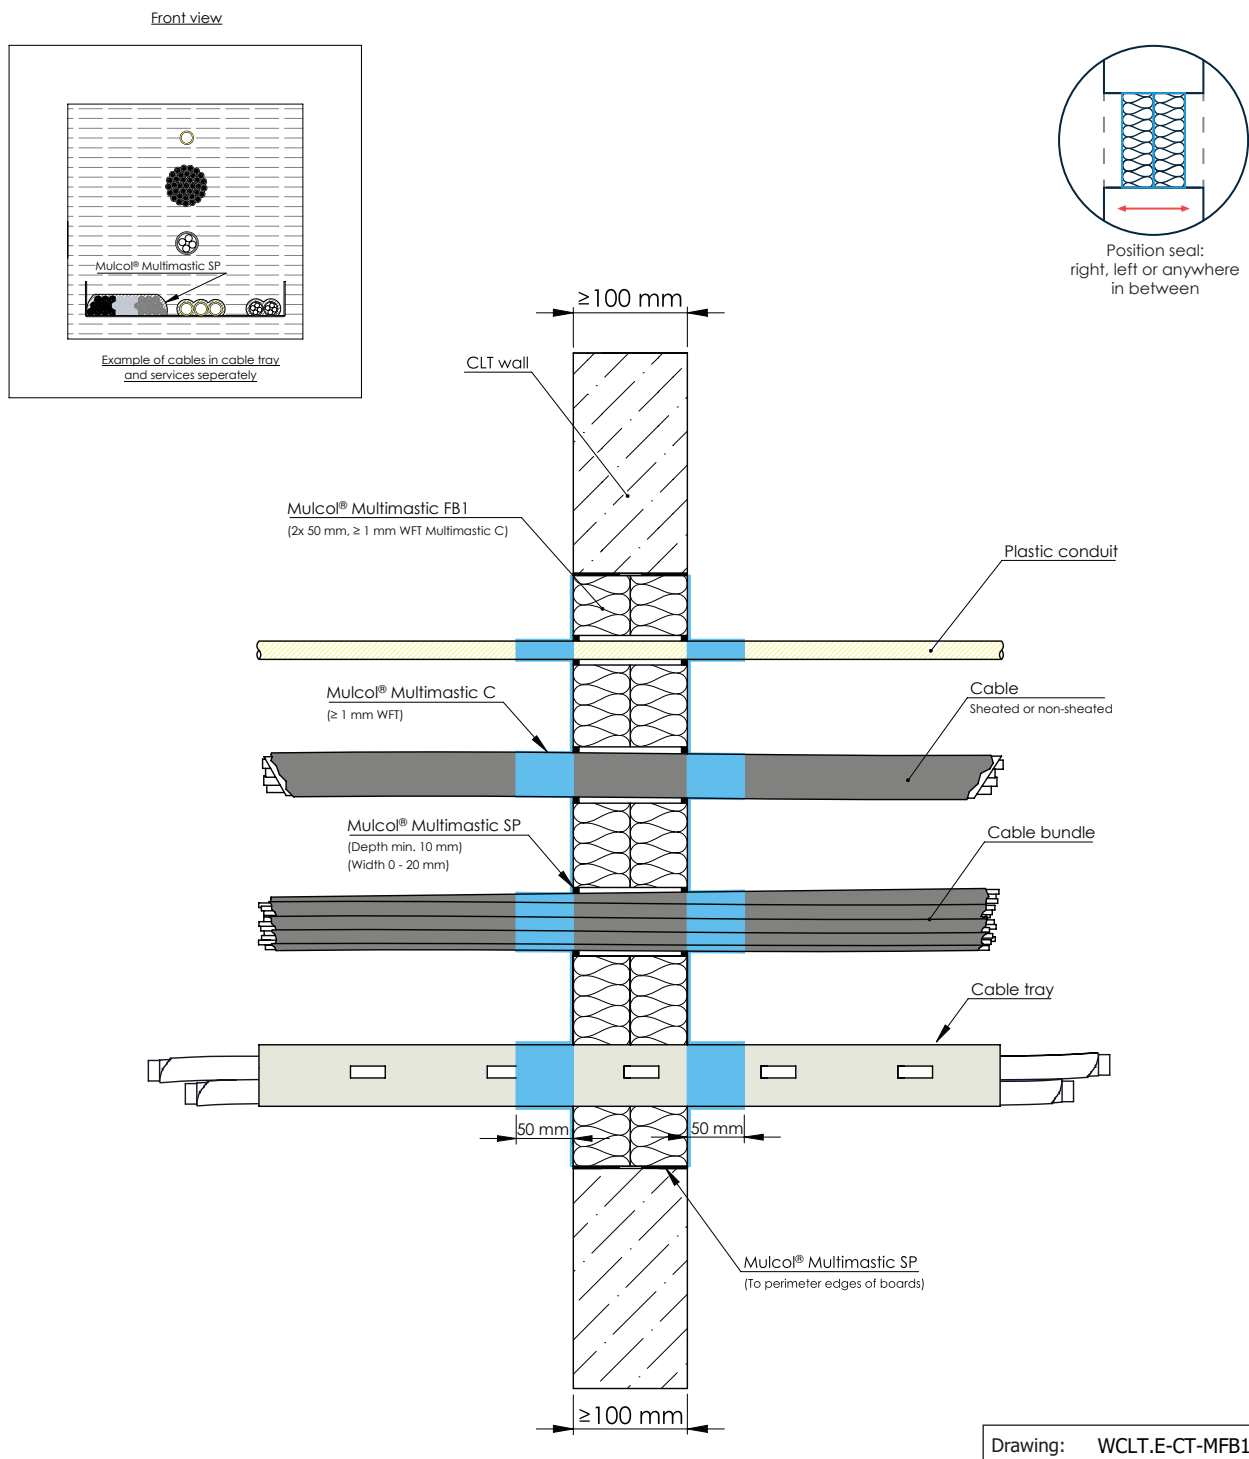

Services	Coating	Classification
Metal cable ladders	Coat back 50 mm ≥ 1 mm WFT Multimastic C	EI 60, E 90
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 80 mm		
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 45, E 90
Non sheathed cables ≤ Ø 24 mm		EI 60 U/C, E 90 U/C
Plastic conduits ≤ Ø 16 mm		EI 45 C/U, E 60 C/U
Copper conduits ≤ Ø 16 mm		EI 60 C/U
Steel conduits ≤ Ø 16 mm		

A.3.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits




A.3.1.2 Cables, trays and conduits - Multimastic C - 150 mm

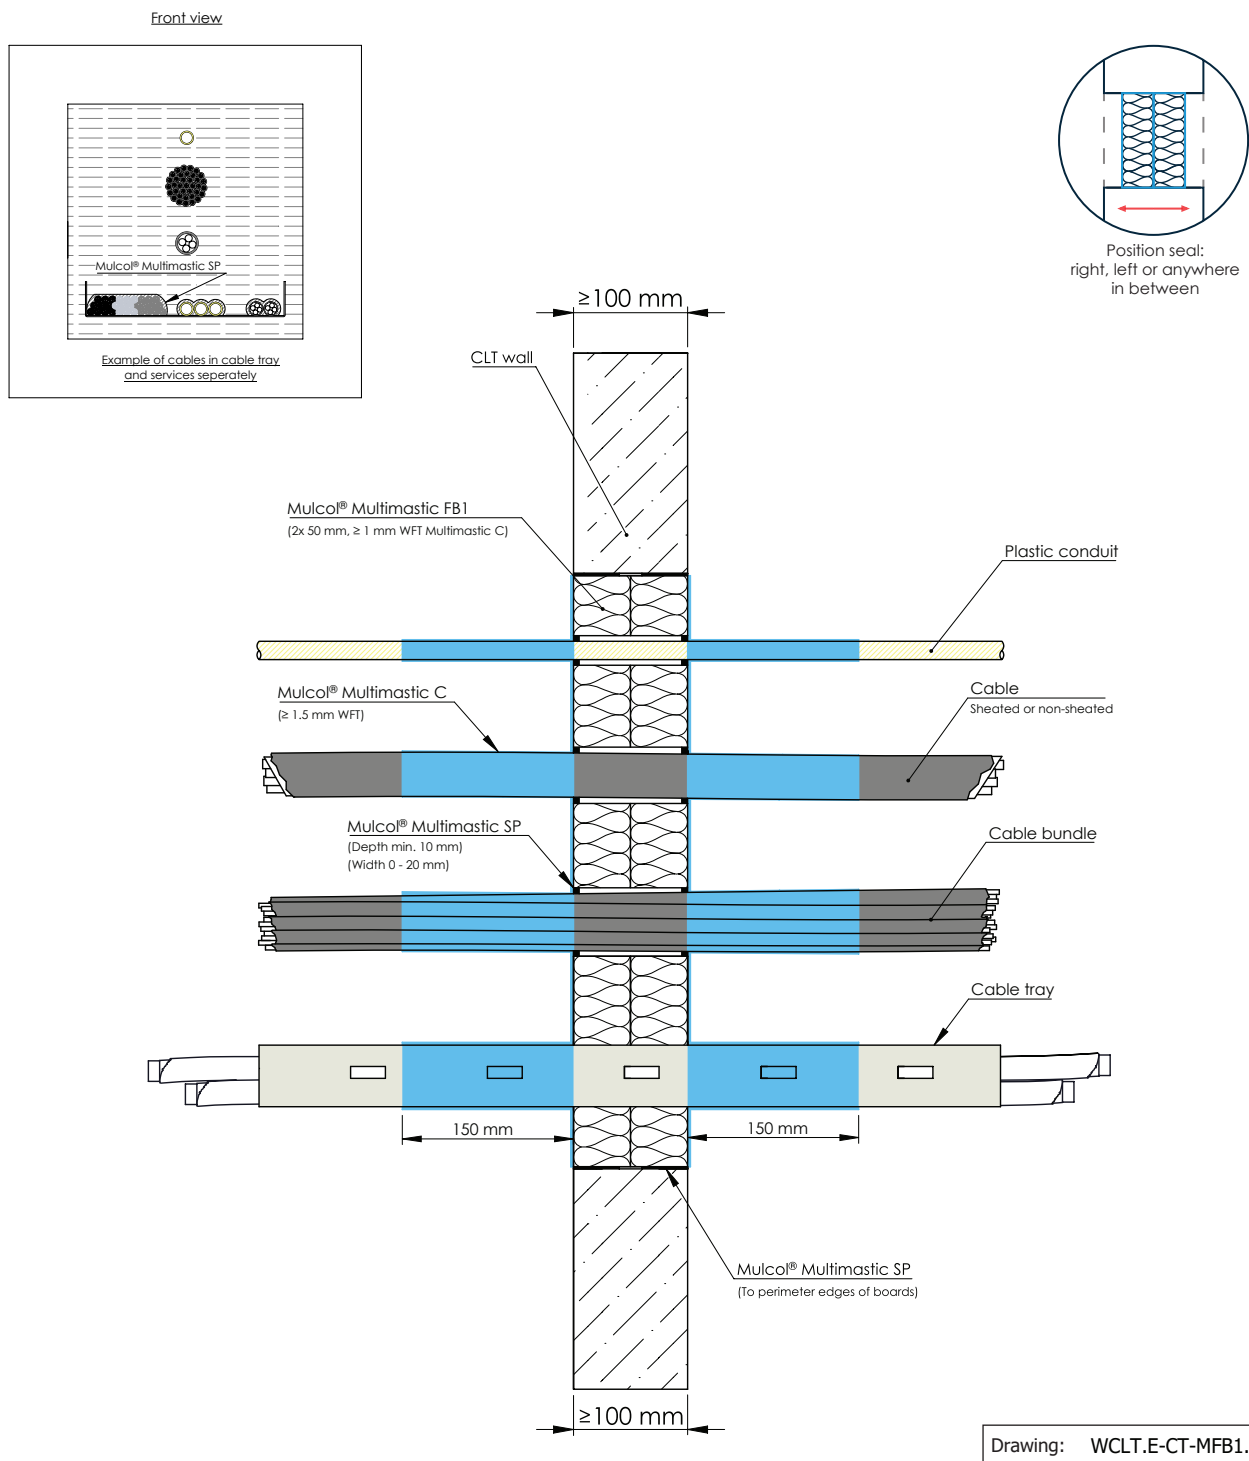

Services	Coating	Classification
Metal cable ladders	Coat back 150 mm ≥ 1.5 mm WFT Multimastic C	EI 90
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		EI 60, E 90
Cables ≤ Ø 80 mm		
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 90 U/C
Non sheathed cables ≤ Ø 24 mm		
Plastic conduits ≤ Ø 16 mm		EI 45 C/U, E 90 C/U
Copper conduits ≤ Ø 16 mm		EI 90 C/U
Steel conduits ≤ Ø 16 mm		

A.3.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits

A.3.1.3 Single plastic conduits - Multidisc

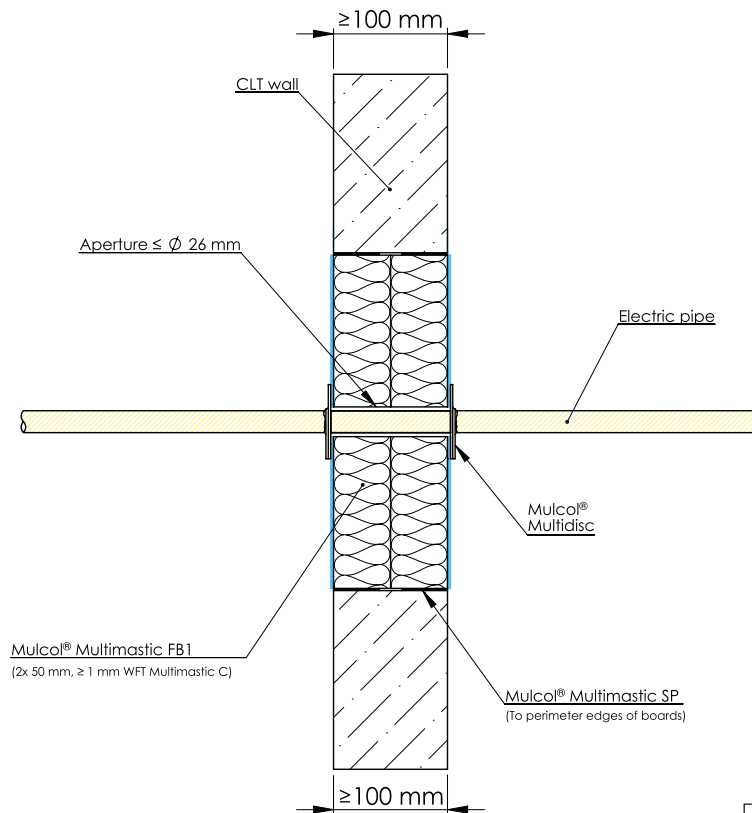

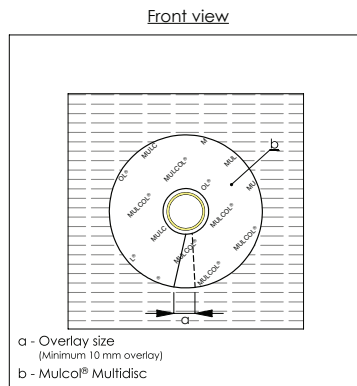


Drawing: WCLT.E-EP-MFB1-M2.0.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Plastic conduits $\leq \varnothing 25 \text{ mm}$, with or without cables	Multidisc	$\leq \varnothing 32$	Not required	EI 90 U/U

A.3.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits

A.3.1.4 Multiple cables - Multidisc

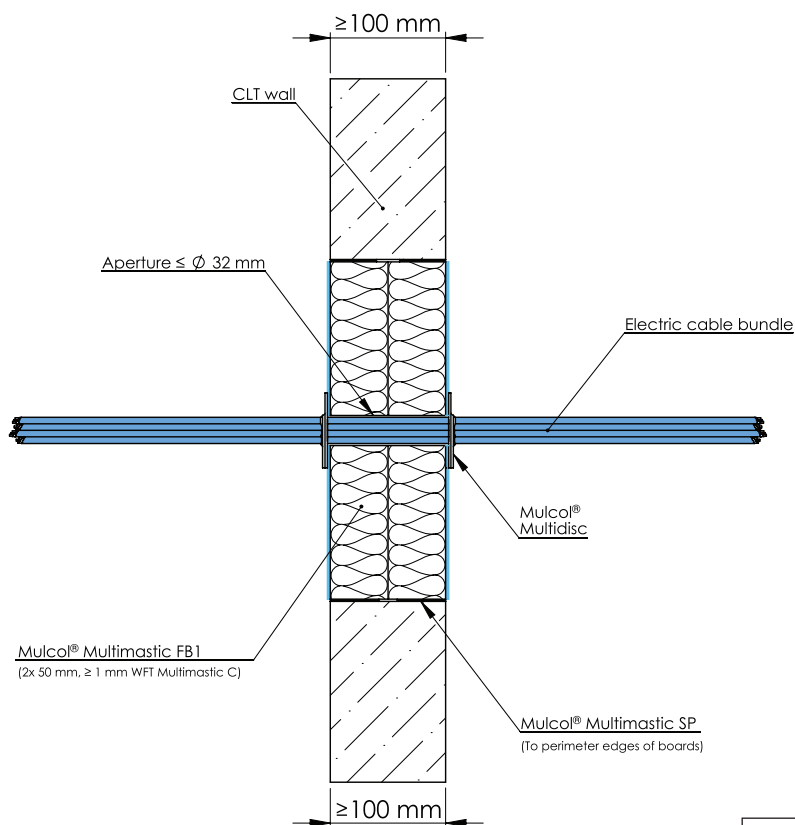

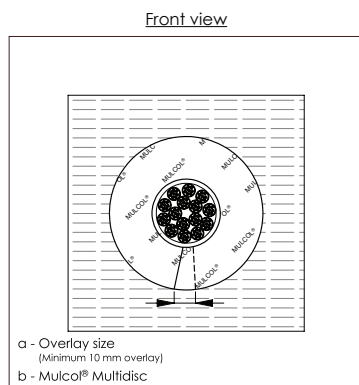


Drawing: WCLT.E-ECB-MFB1-M2.0.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Multiple electrical / telecommunication cables max. 15 pcs., max. ≤ Ø 25	Multidisc	≤ Ø 32	Not required	EI 60, E 90

A.3.2 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.3.2.1 Plastic pipes - Multicollar *Slim*

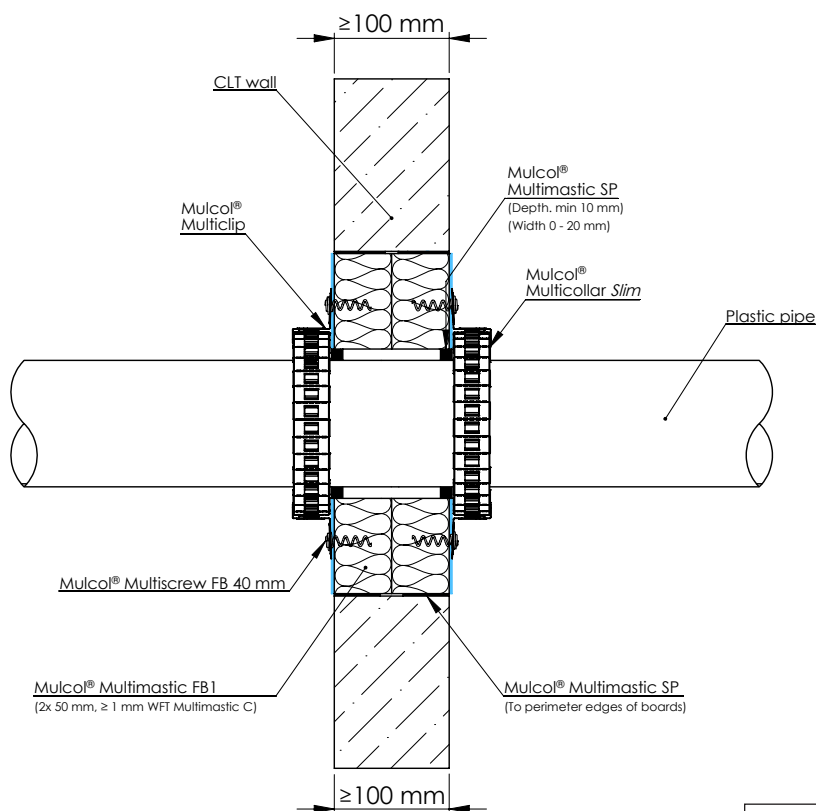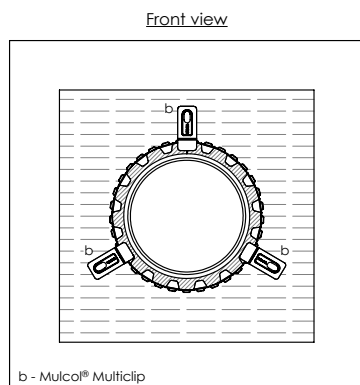

Drawing: WCLT.E-MC30-PP-MFB1.2.10



Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	2.7 - 6.6	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 90 U/U
PP		2.7			
PVC(-U/-C)					

A.3.2 Multimastic FB1 - 2x 50 mm - Combustible pipes


A.3.2.2 Plastic pipes perpendicular to 45° - Multicollar *Slim*

Front view

a - Annular space
(Maximum 15 mm between pipe and Mulcol® Multicollar *Slim*)
b - Mulcol® Multiclip

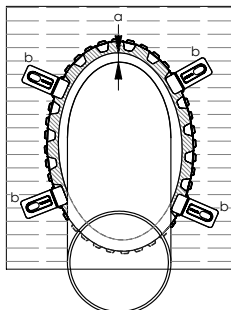

Position seal:
right, left or anywhere
in between

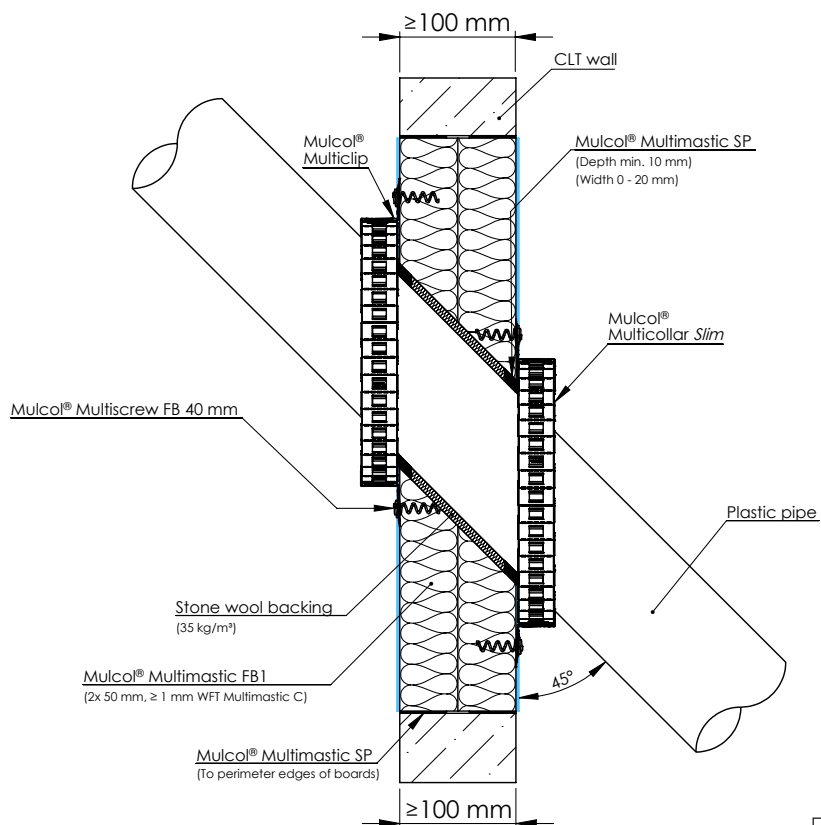

Drawing: WCLT.E-MC30-PP-MFB1-10.1.10



Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	2.7	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 90 U/C
PP					
PVC(-U/-C)					

A.3.2 Multimastic FB1 - 2x 50 mm - Combustible pipes


A.3.2.3 Plastic pipes perpendicular to 45° - Multicollar *Slim*

Front view

- a - Annular space
(Maximum 15 mm between pipe and Mulcol® Multicollar *Slim*)
b - Mulcol® Multiclip
c - Mulcol® Multiclip Large

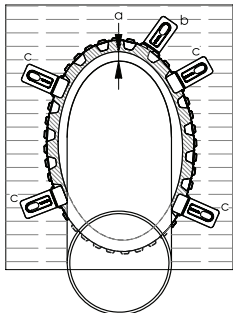

Position seal:
right, left or anywhere
in between



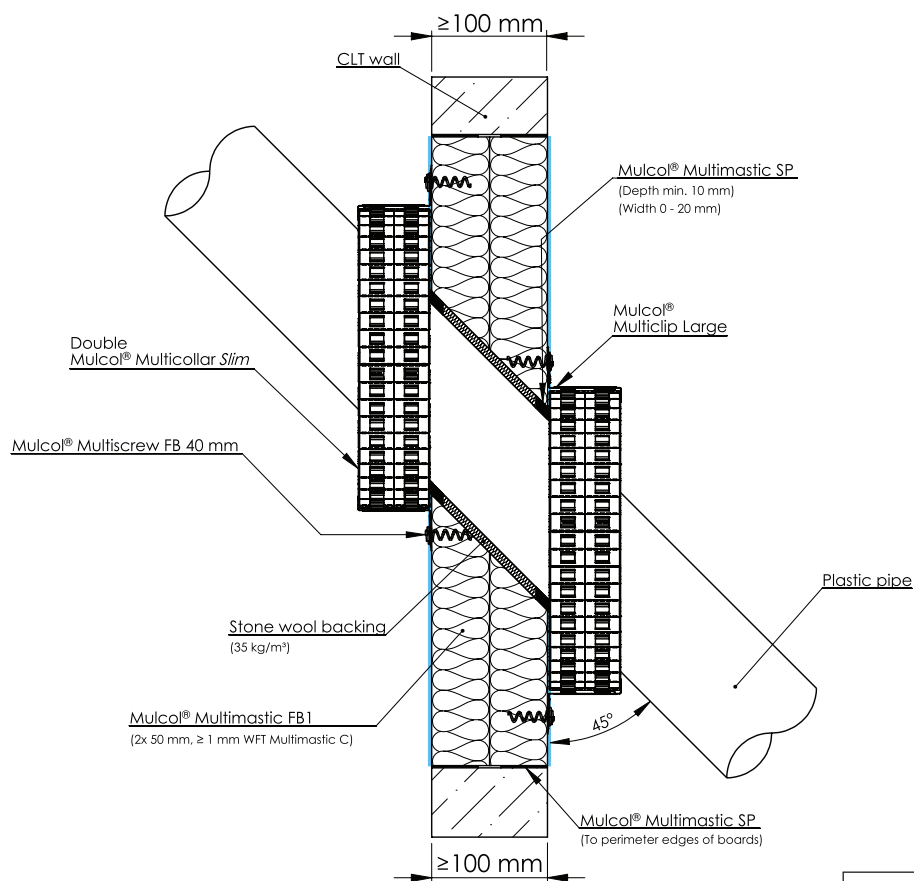


Drawing: WCLT.E-MC60-PP-MFB1-20.1.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	2.7	Multicollar <i>Slim</i> Double	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 90 U/U
		2.7 - 10.0			EI 90 U/C
PP		2.7			EI 30 U/U
		3.4			EI 90 U/C
		3.4 - 10.0			EI 60 U/C
PVC(-U/-C)		2.7			EI 30 U/U
		3.4			EI 90 U/C
		3.4 - 10.0			EI 60 U/C

A.3.2 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.3.2.4 Plastic pipes - Multiwrap

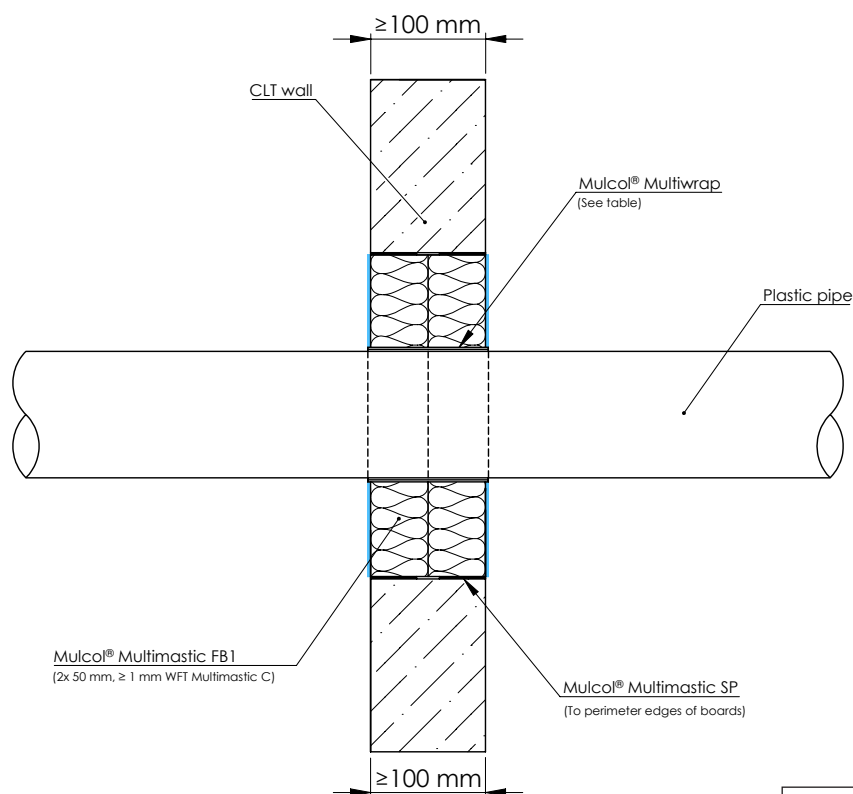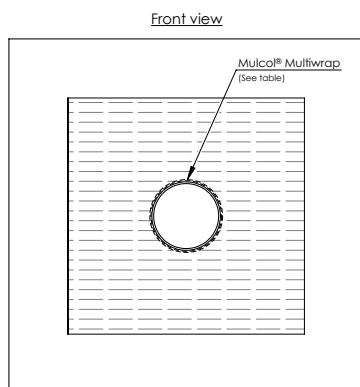

Drawing: WCLT.E-PP-MW2-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 40	2.4 - 3.7	Multiwrap (2 layers)	EI 90 U/U
	≤ Ø 110	2.7 - 10		EI 90 U/C
PP	≤ Ø 40	2.3 - 3.7		EI 90 U/U
		5.5		EI 90 U/C
	≤ Ø 110	3.4		EI 90 U/C
PVC(-U/-C)	≤ Ø 40	1.8 - 3.7		EI 90 U/U
	≤ Ø 110	1.6 - 8.1		EI 90 U/C

A.3.2 Multimastic FB1 - 2x 50 mm - Combustible pipes**A.3.2.4 Plastic pipes - Multiwrap**




Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PE(-HD) / PE / ABS / SAN+PVC	≤ Ø 125	3.9 - 4.8	Multiwrap (3 layers)	EI 90 U/C
PP		3.1		
		3.1 - 11.4		
PVC(-U/-C)		3.7 - 4.8		

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PP	≤ Ø 110	10.0 - 14.6	Multiwrap (4 layers)	EI 90 U/U
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 160	14.6		EI 90 U/C
		5.0		
PVC(-U/-C)		5.0 - 14.6		

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PE(-HD) / PE / ABS / SAN+PVC	≤ Ø 125	11.4	Multiwrap (5 layers)	EI 90 U/U
PVC(-U/-C)		9.2		

A.3.2 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.3.2.5 Plastic pipes (Silent) - Multiwrap

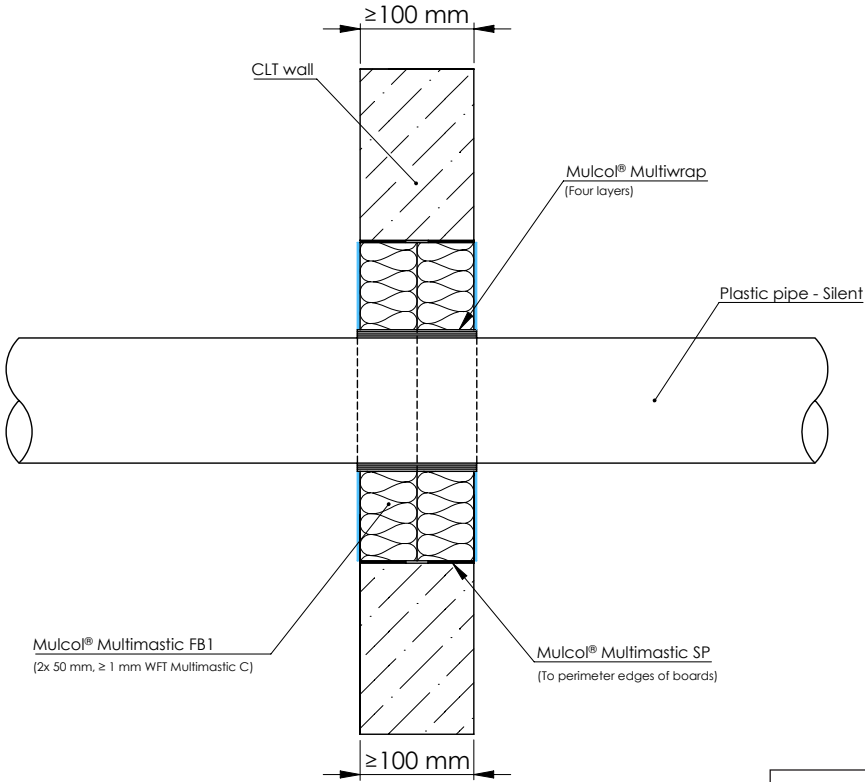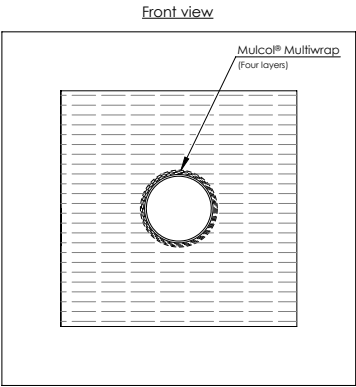

Drawing: WCLT-PPS-MW4-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Raupiano Plus	≤ Ø 50	1.8 - 2.7	Multiwrap (2 layers)	EI 90 U/C
	≤ Ø 110	2.7		
Geberit Silent dB20	≤ Ø 56	3.2 - 6.0		EI 90 U/U
	≤ Ø 110	6.0		
Wavin SiTech+	≤ Ø 40	2.0		
	≤ Ø 40	2.0 - 3.4		
	≤ Ø 50	1.8		
	≤ Ø 110	3.4		
Poloplast PoloKal NG	≤ Ø 50	2.0		EI 90 U/C




A.3.2 Multimastic FB1 - 2x 50 mm - Combustible pipes**A.3.2.5 Plastic pipes (Silent) - Multiwrap**

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Raupiano Plus	$\leq \varnothing 110$	2.7	Multiwrap (4 layers)	EI 90 U/U
	$\leq \varnothing 160$	4.0		EI 90 U/C
Poloplast PoloKal NG	$\leq \varnothing 110$	3.4		

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Raupiano Plus	$\leq \varnothing 160$	3.9	Multiwrap (6 layers)	EI 90 U/U
Poloplast PoloKal NG	$\leq \varnothing 160$	4.9		EI 90 U/C

A.3.2 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.3.2.6 PP-R multilayer pipes - Multicollar *Slim*

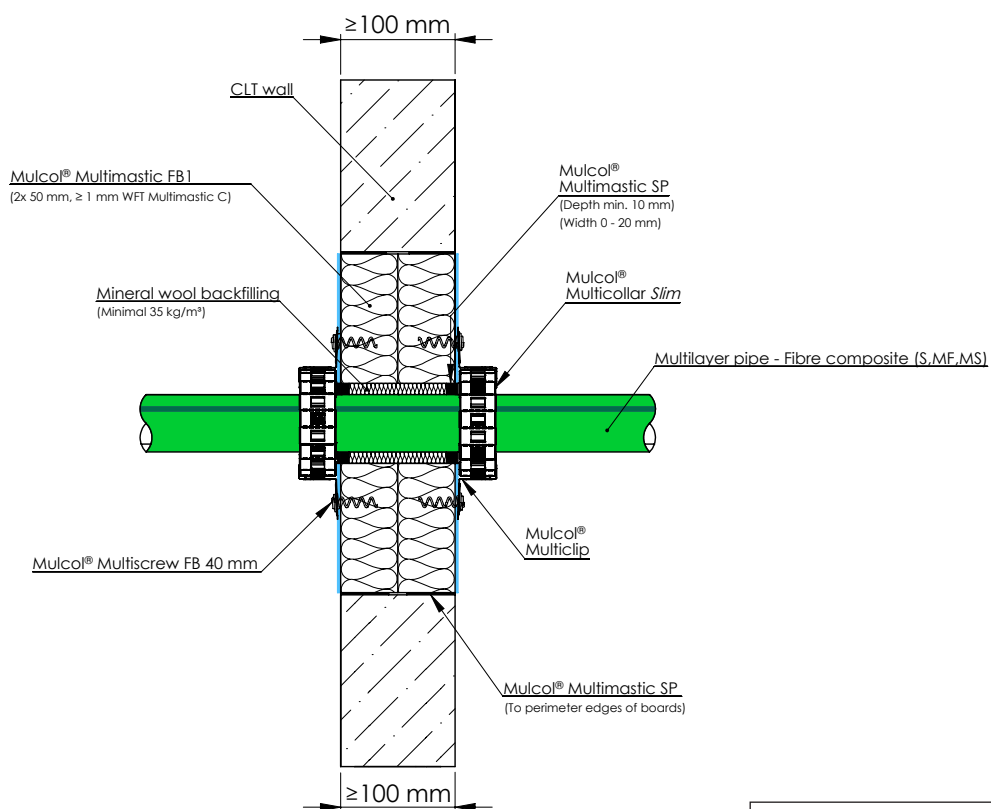

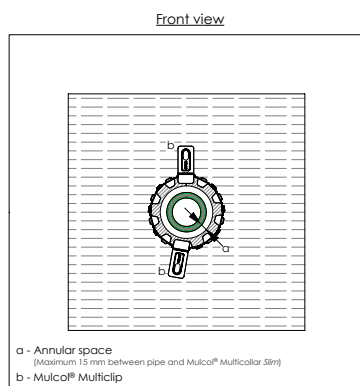


Drawing: WCLT.E-MC30-MLF-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Aquatherm Green	≤ Ø 50	6.9	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 90 U/C

A.3.2 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.3.2.7 PP-R multilayer pipes - Multiwrap

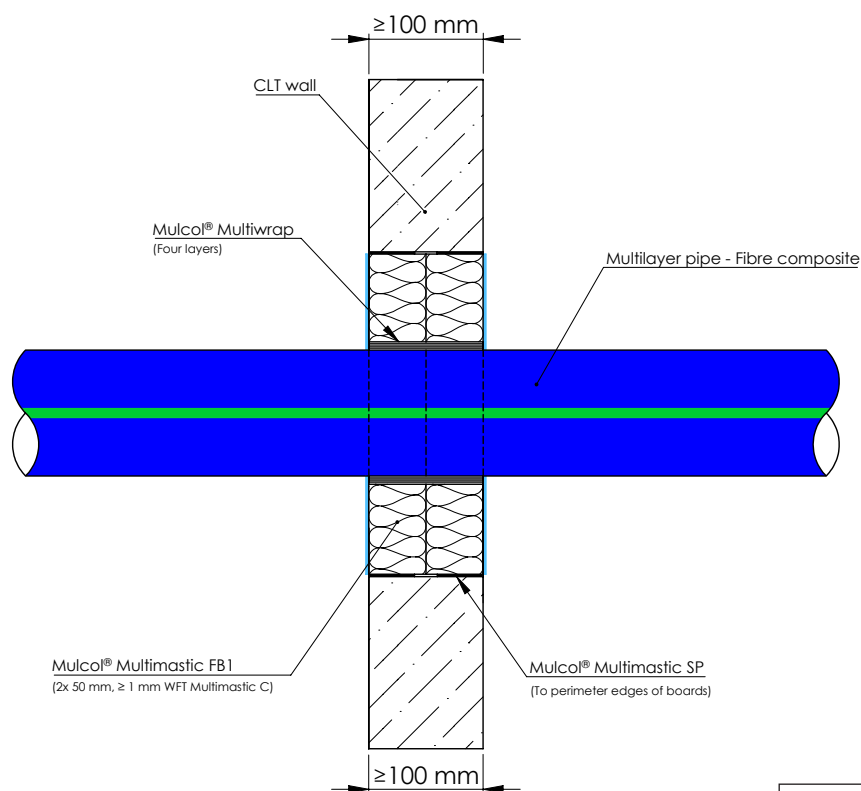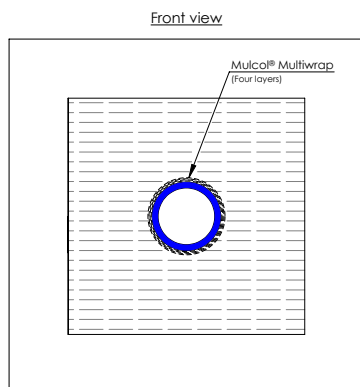


Drawing: WCLT.E-MLF-MW4-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Aquatherm Blue	≤ Ø 40	3.7	Multiwrap (2 layers)	EI 90 U/C
	≤ Ø 50	4.6		EI 90 U/U
	≤ Ø 110	10	Multiwrap (4 layers)	EI 90 U/C

A.3.2 Multimastic FB1 - 2x 50 mm - Combustible pipes




A.3.2.8 Drinks tubing system - Multicollar *Slim*

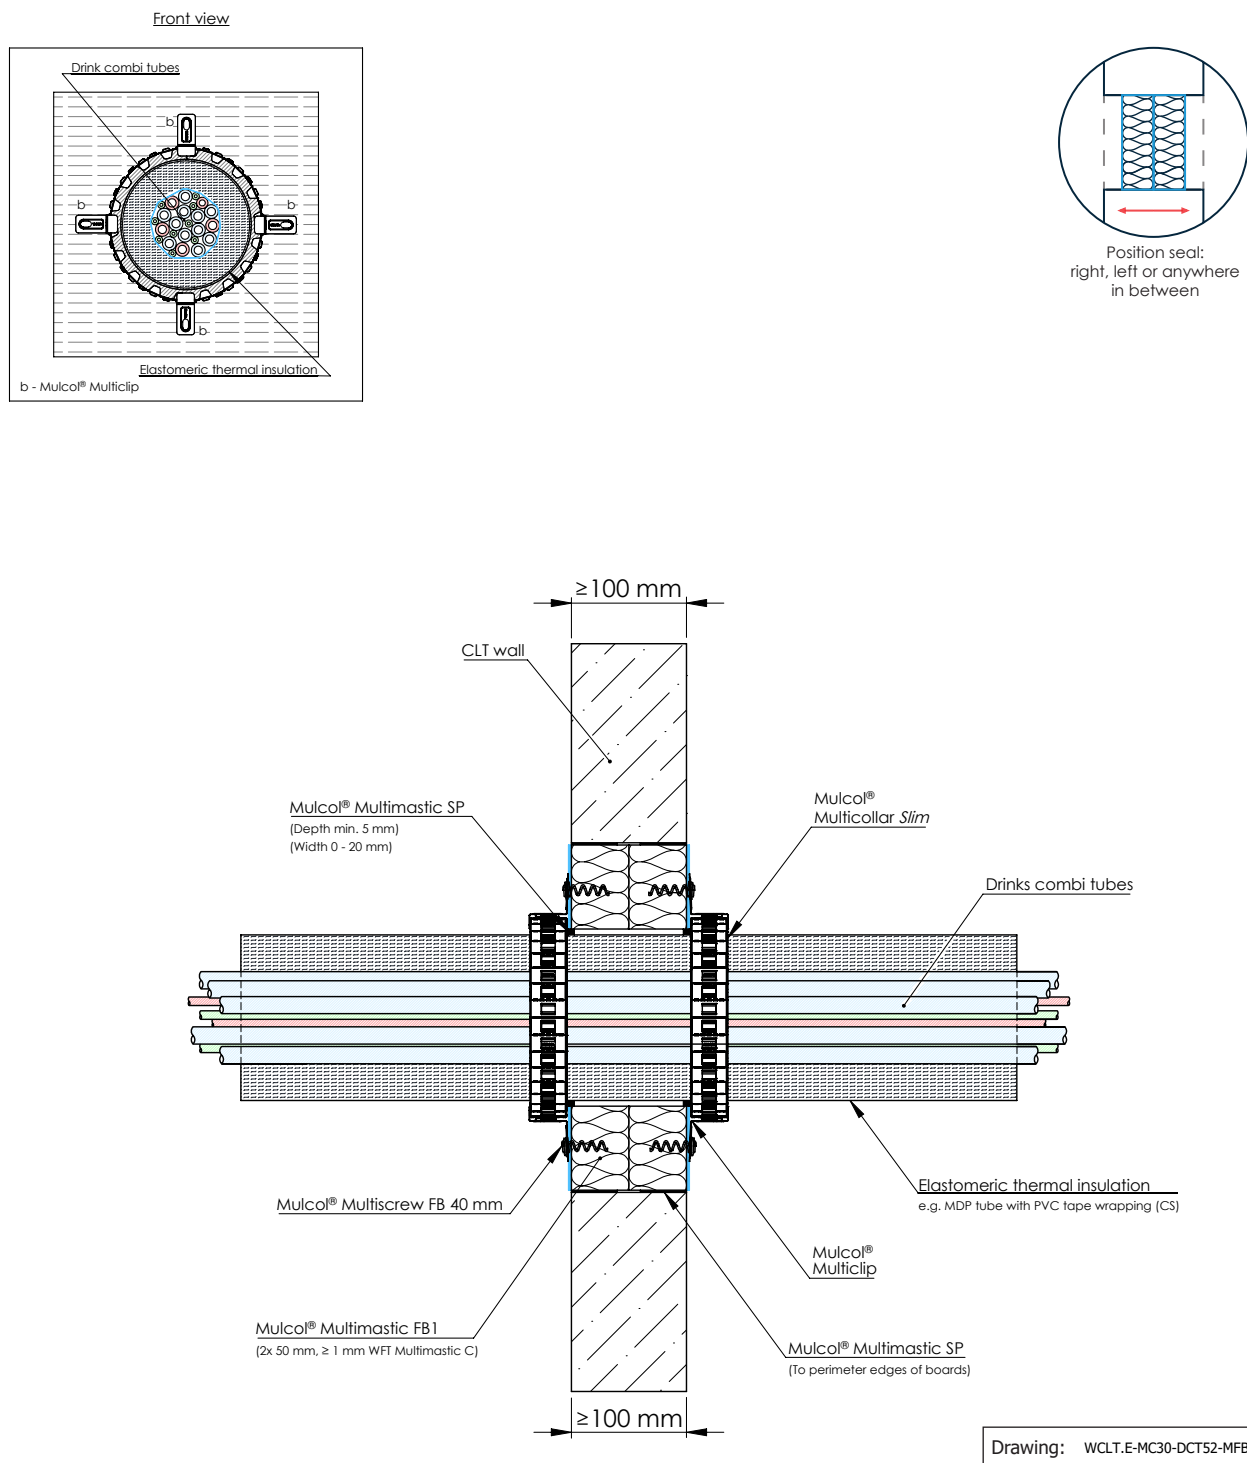

Services	Dimensions (mm)		Insulation			Product	Sealing (mm)	Classification
	Outer dimension	Hoses no.	Type	Thickness (mm)	Configuration			
Drinks tubing system	≤ Ø 47	≤ 3	Elastomeric foam	8.5 - 35	CS	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 60 U/C
	≤ Ø 145	≤ 52						

A.3.3 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)

A.3.3.1 Multilayer pipes (MLC) - Multisealant GR

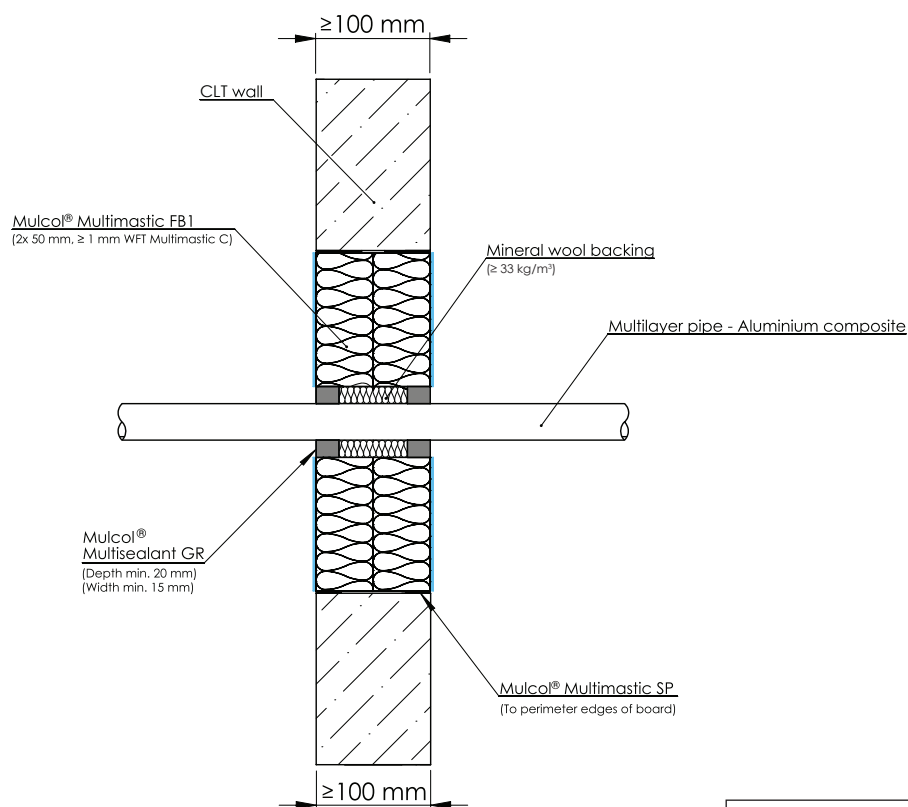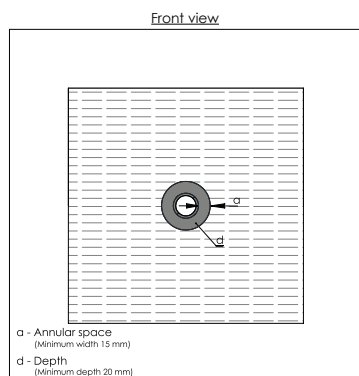


Drawing: WCLT.E-MLA-MFB1-G2.4.10

Services	Pipe dimensions (mm)		Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness			
Multilayer pipes (MLC)	≤ Ø 32	3.0	Multisealant GR ≥ 15 x 20 (wxd)	Stone wool (≥ 33 kg/m³)	EI 90 U/C
	≤ Ø 40	4.0			

A.3.3 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)




A.3.3.2 Multilayer pipes (MLC) - Conduit - Multisealant GR

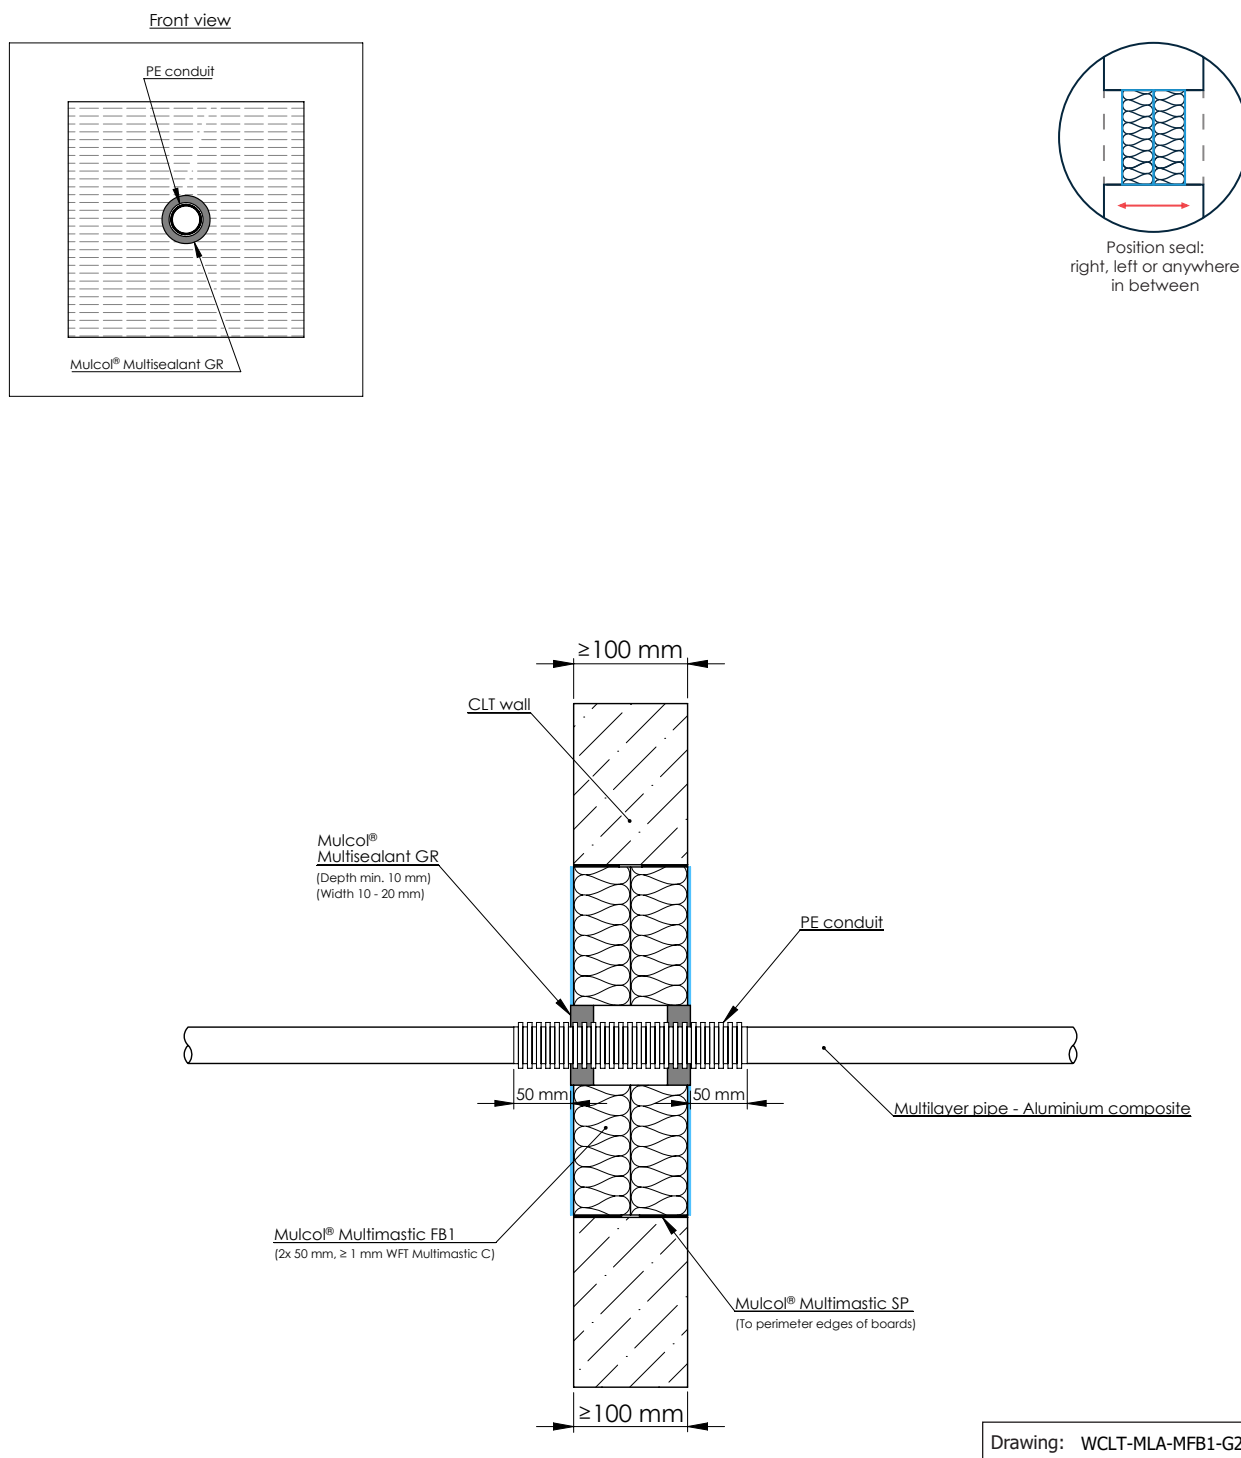

Services	Pipe dimensions (mm)		Conduit			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Outer dimension (mm)	Configuration		
Multilayer pipes (MLC)	$\leq \varnothing 32$	3.0	PE-conduit ribbed	$\leq \varnothing 40$	LS 50 / CS	Multisealant GR 10-20 x ≥ 10 (wxd)	EI 60 U/C

A.3.3 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)

A.3.3.3 Multilayer pipes (MLC) - Elastomer LS 300 / CS - Multisealant GR

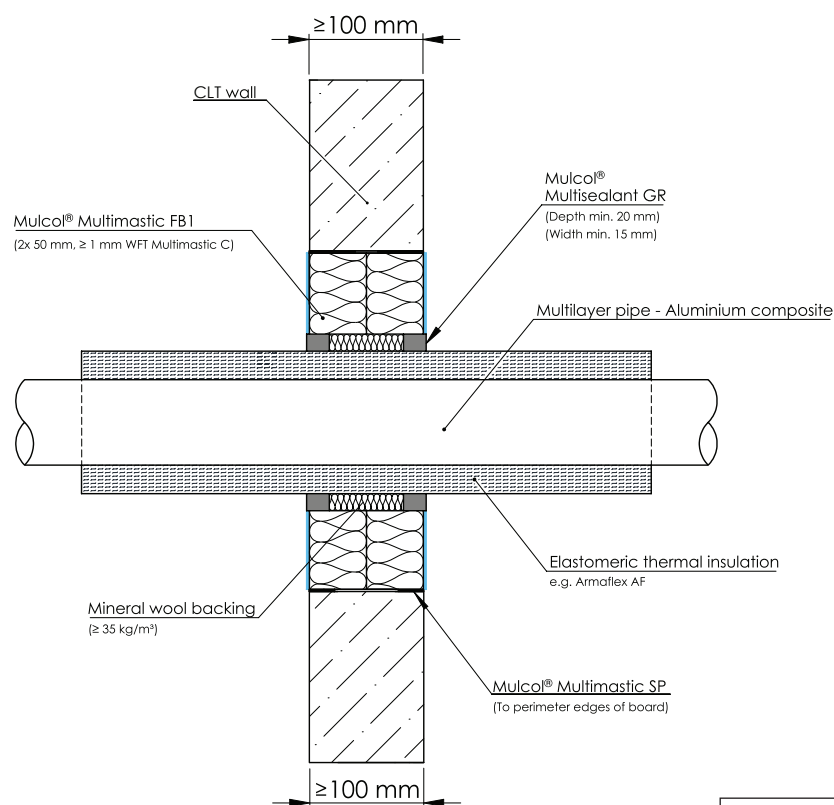

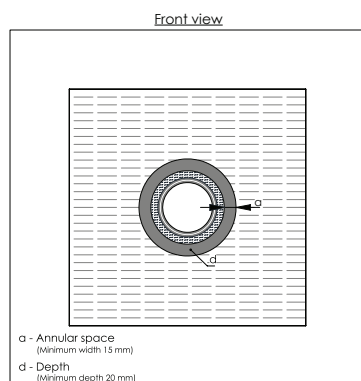


Drawing: WCLT.E-MLA-MFB1-G2.4.22

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 75	6.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	9 - 32	LS 400 / CS	Multisealant GR ≥ 15 x 20 mm (wxd)	EI 90 U/C

A.3.3 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)

A.3.3.4 Multilayer pipes (MLC) - PE foam - Multisealant GR

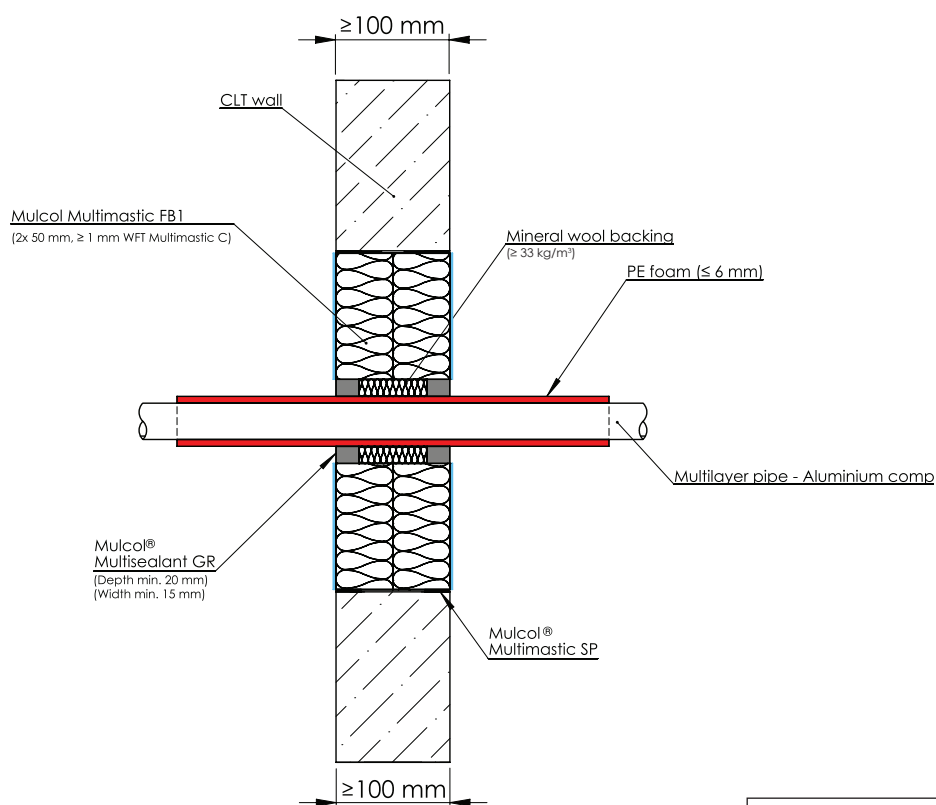

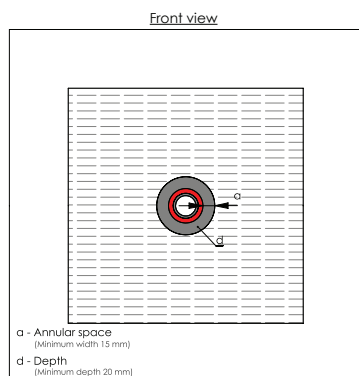


Drawing: WCLT.E-MLA_pr-MFB1-G2.4.23

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 32	3.0	PE Foam	≤ 6	LS 300 / CS LI 300 / CI	Multisealant GR ≥ 15 x 20 (wxd)	EI 90 U/C

A.3.3 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)

A.3.3.5 Multilayer pipes (MLC) - Multidisc

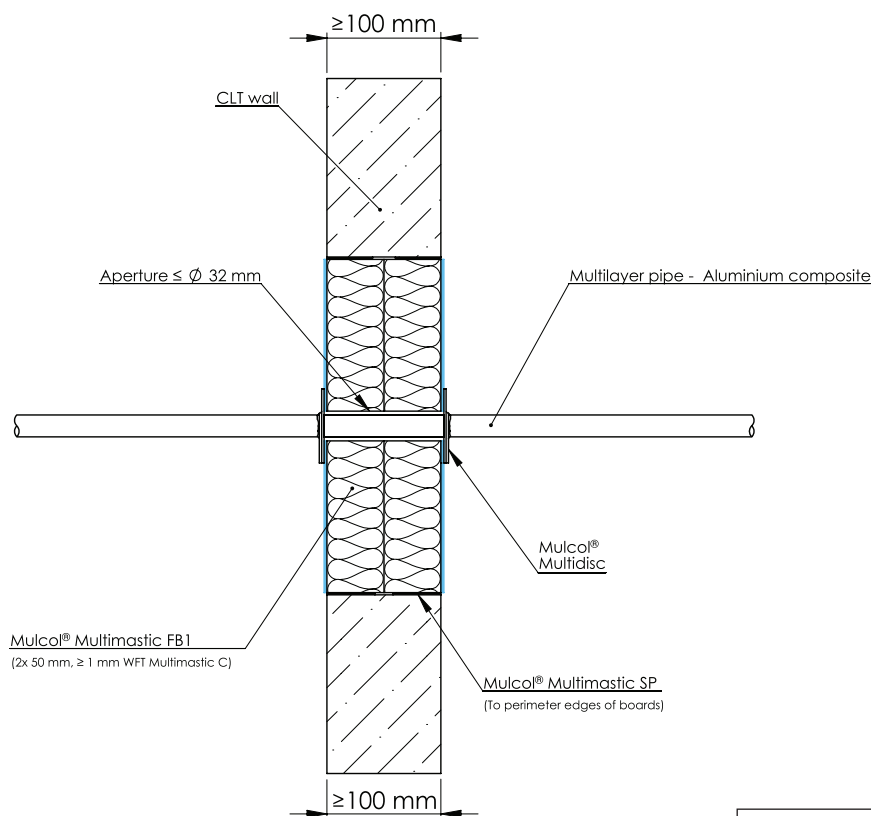


Drawing: WCLT.E-MFB1-MLA-M2.0.10

Services	Pipe dimensions (mm)		Aperture (mm)	Product	Sealing (mm)	Classification
	Outer diameter	Wall thickness				
Multilayer pipes (MLC)	$\leq \text{Ø } 16$	2.0	$\leq \text{Ø } 32$	Multidisc	Not required	EI 60 U/C E 90 U/C

A.3.4 Multimastic FB1 - 2x 50 mm - Metal pipes insulated mineral wool


A.3.4.1 Copper and steel pipes - Stone wool LS 400 / CS

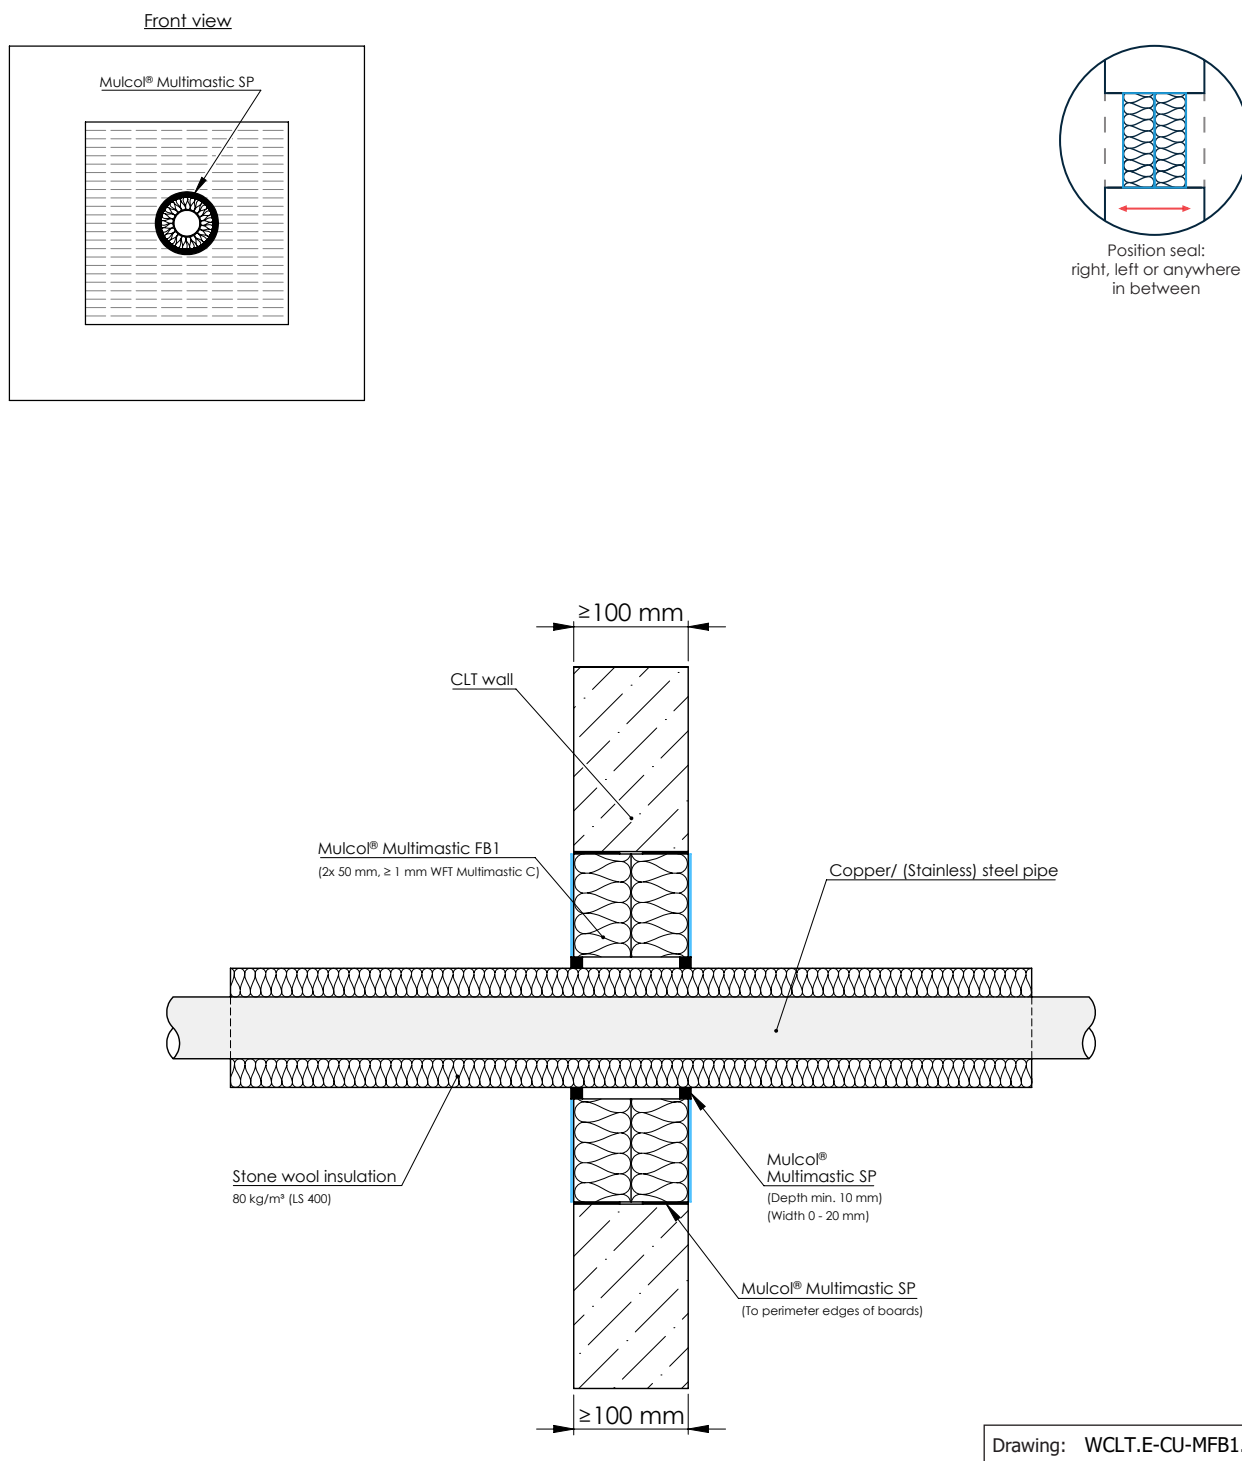

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	25	LS 400 / CS	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 90 C/U
	≤ Ø 54	≥ 1.5					
(Stainless) Steel / cast iron	≤ Ø 12	≥ 1.5					
	≤ Ø 114.3	≥ 3.6					

A.3.5 Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer




A.3.5.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR

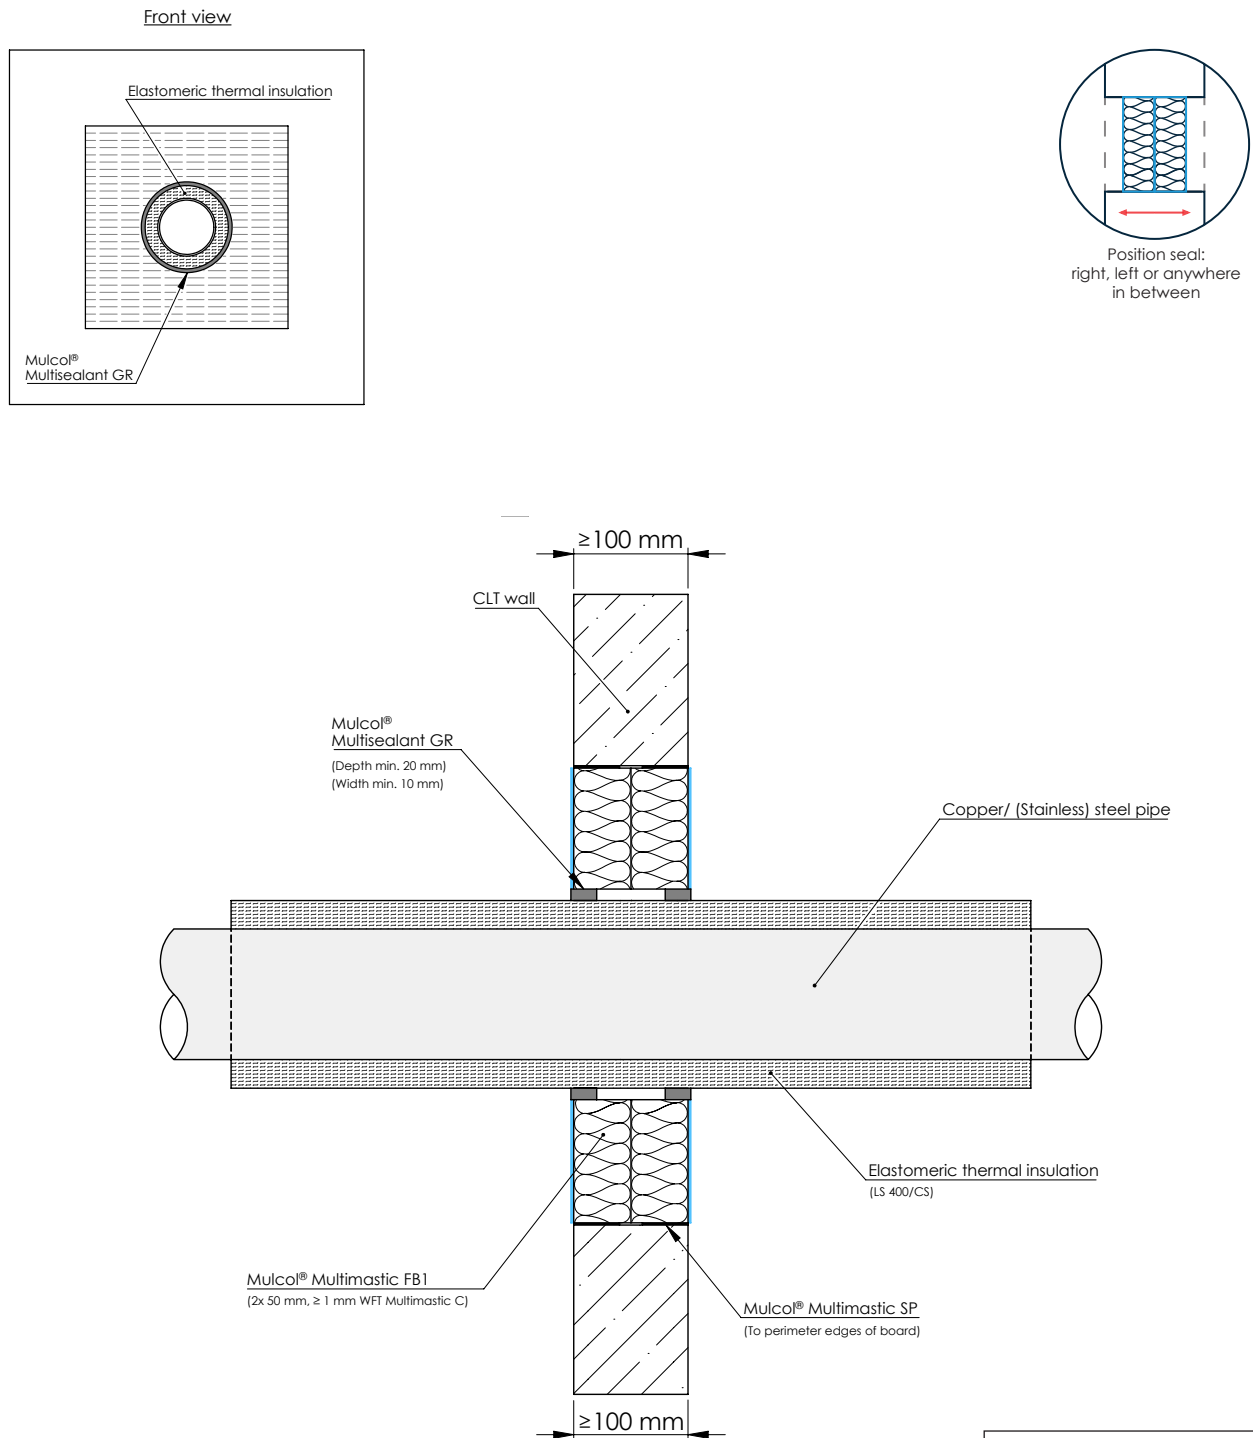

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	8.5 - 38	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	EI 90 C/U
	≤ Ø 54	≥ 1.5		13.5 - 38			EI 30 C/U, E 90 C/U
				13.5	CS		EI 90 C/U
				13.5 - 38			EI 60 C/U, E 90 C/U
				38	LS 400 / CS		EI 90 C/U
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		8.5 - 38			EI 90 C/U
	≤ Ø 114.3	≥ 3.6	15 - 43	EI 45 C/U, E 90 C/U			
			43	EI 60 C/U, E 90 C/U			

A.3.5 Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer

A.3.5.2 Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap

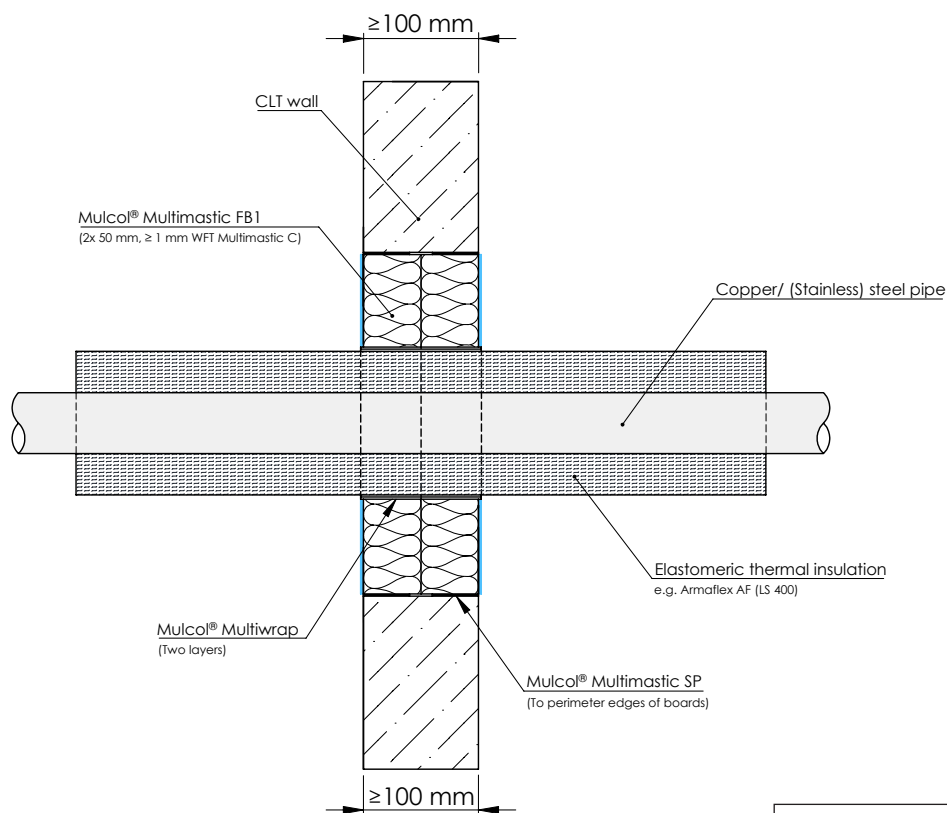

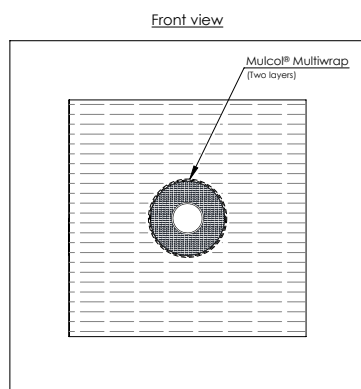


Drawing: WCLT.E-CU-MW2-MFB1.2.22

Services	Pipe dimensions (mm)		Insulation			Product	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 12	≥ 1.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	9	LS 400 / CS	Multiwrap (2 layers)	EI 90 C/U
	≤ Ø 35	≥ 1.1		35			
	≤ Ø 54	≥ 1.5		60			
	≤ Ø 54	≥ 1.5		38			
(Stainless) Steel / cast iron	≤ Ø 114.3	≥ 3.6		15			EI 60 C/U, E 90 C/U

A.3.6 Multimastic FB1 - 2x 50 mm - Metal pipes uninsulated

A.3.6.1 Copper and steel pipes - Multidisc

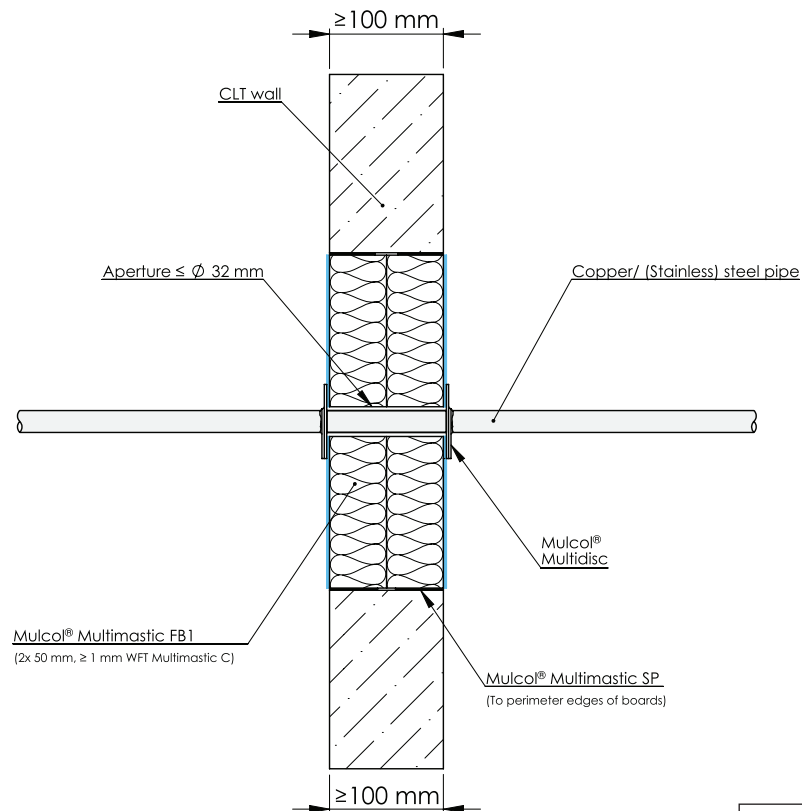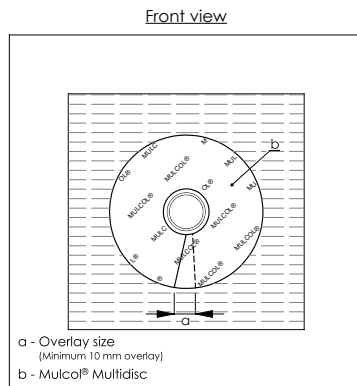


Drawing: WCLT.E-MFB1-CU-M2.0.10

Services	Pipe dimensions (mm)		Product	Aperture (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness				
Copper / (stainless) steel / cast iron	$\leq \varnothing 15$	≥ 1.0	Multidisc	$\leq \varnothing 32$	Not required	EI 45 C/U, E 90 C/U
(Stainless) Steel / cast iron	$\leq \varnothing 17.2$					EI 90 C/U

A.4.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits


A.4.1.1 Cables, trays and conduits - Multimastic C - 50 mm

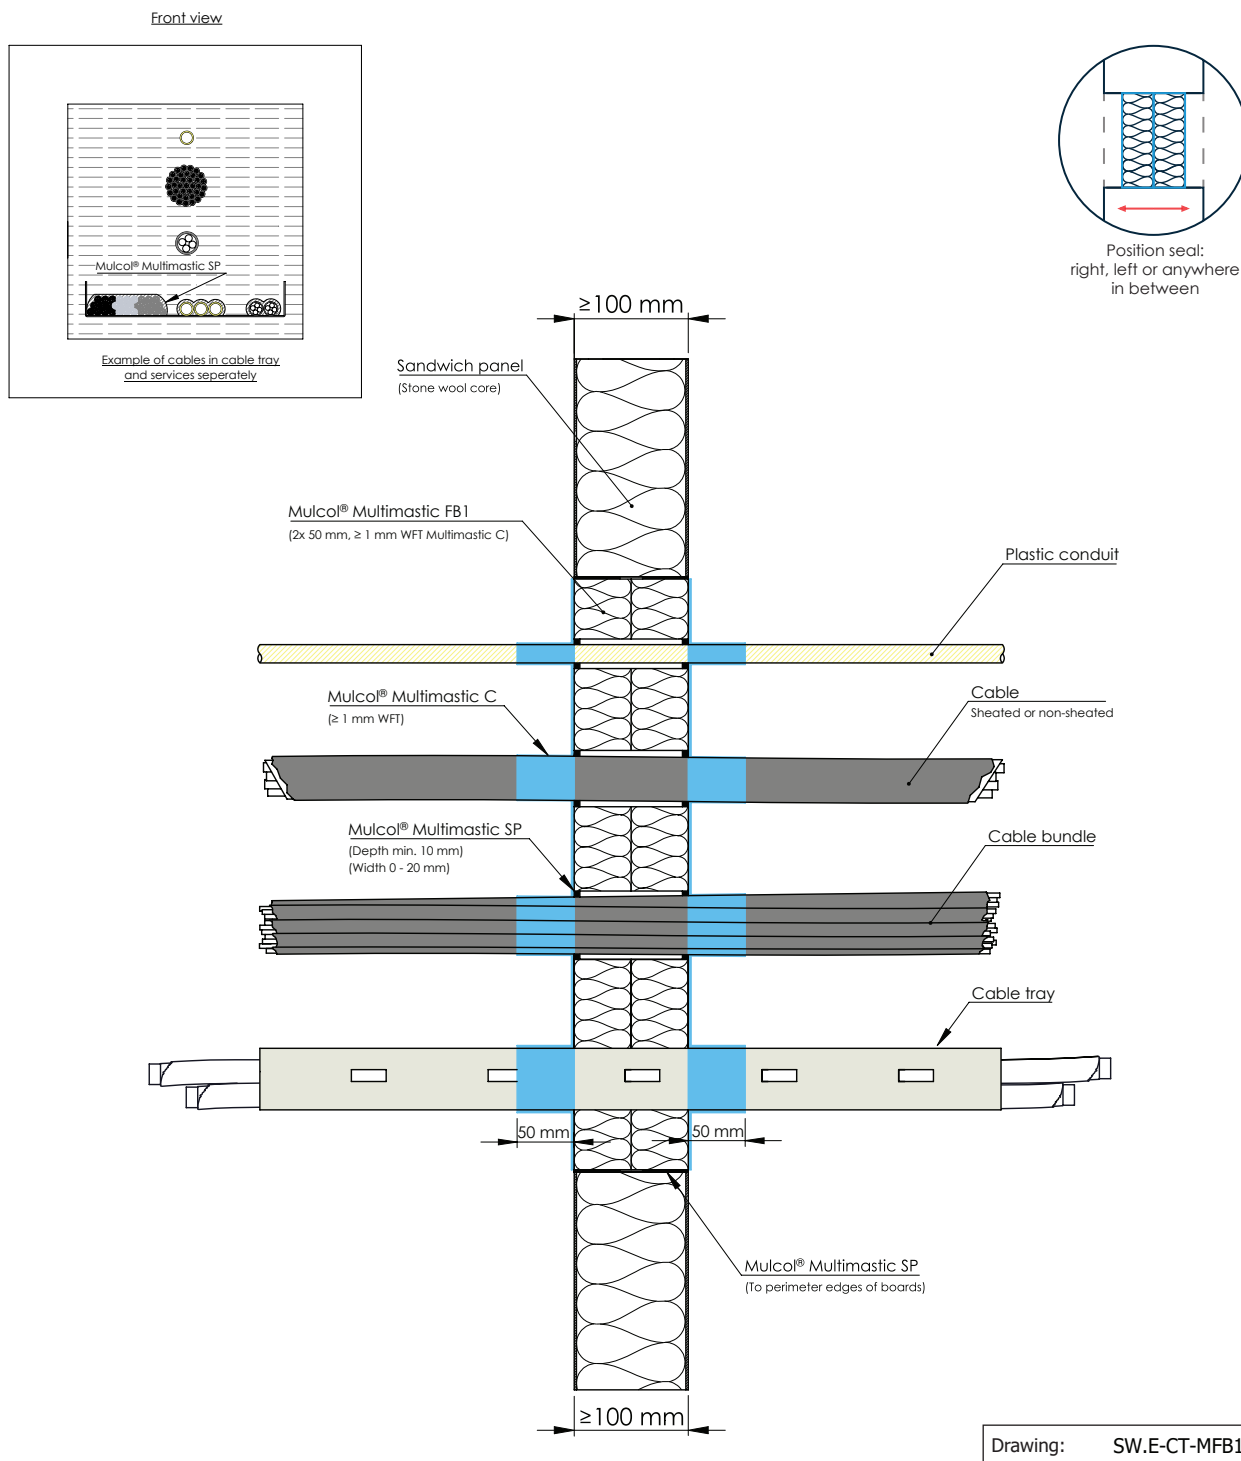

Services	Coating	Classification
Metal cable ladders	Coat back 50 mm ≥ 1 mm WFT Multimastic C	EI 60, E 90
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 80 mm		
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 45, E 90
Non sheathed cables ≤ Ø 24 mm		EI 60 U/C, E 90 U/C
Plastic conduits ≤ Ø 16 mm		EI 45 C/U, E 60 C/U
Copper conduits ≤ Ø 16 mm		EI 60 C/U
Steel conduits ≤ Ø 16 mm		

A.4.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits




A.4.1.2 Cables, trays and conduits - Multimastic C - 150 mm

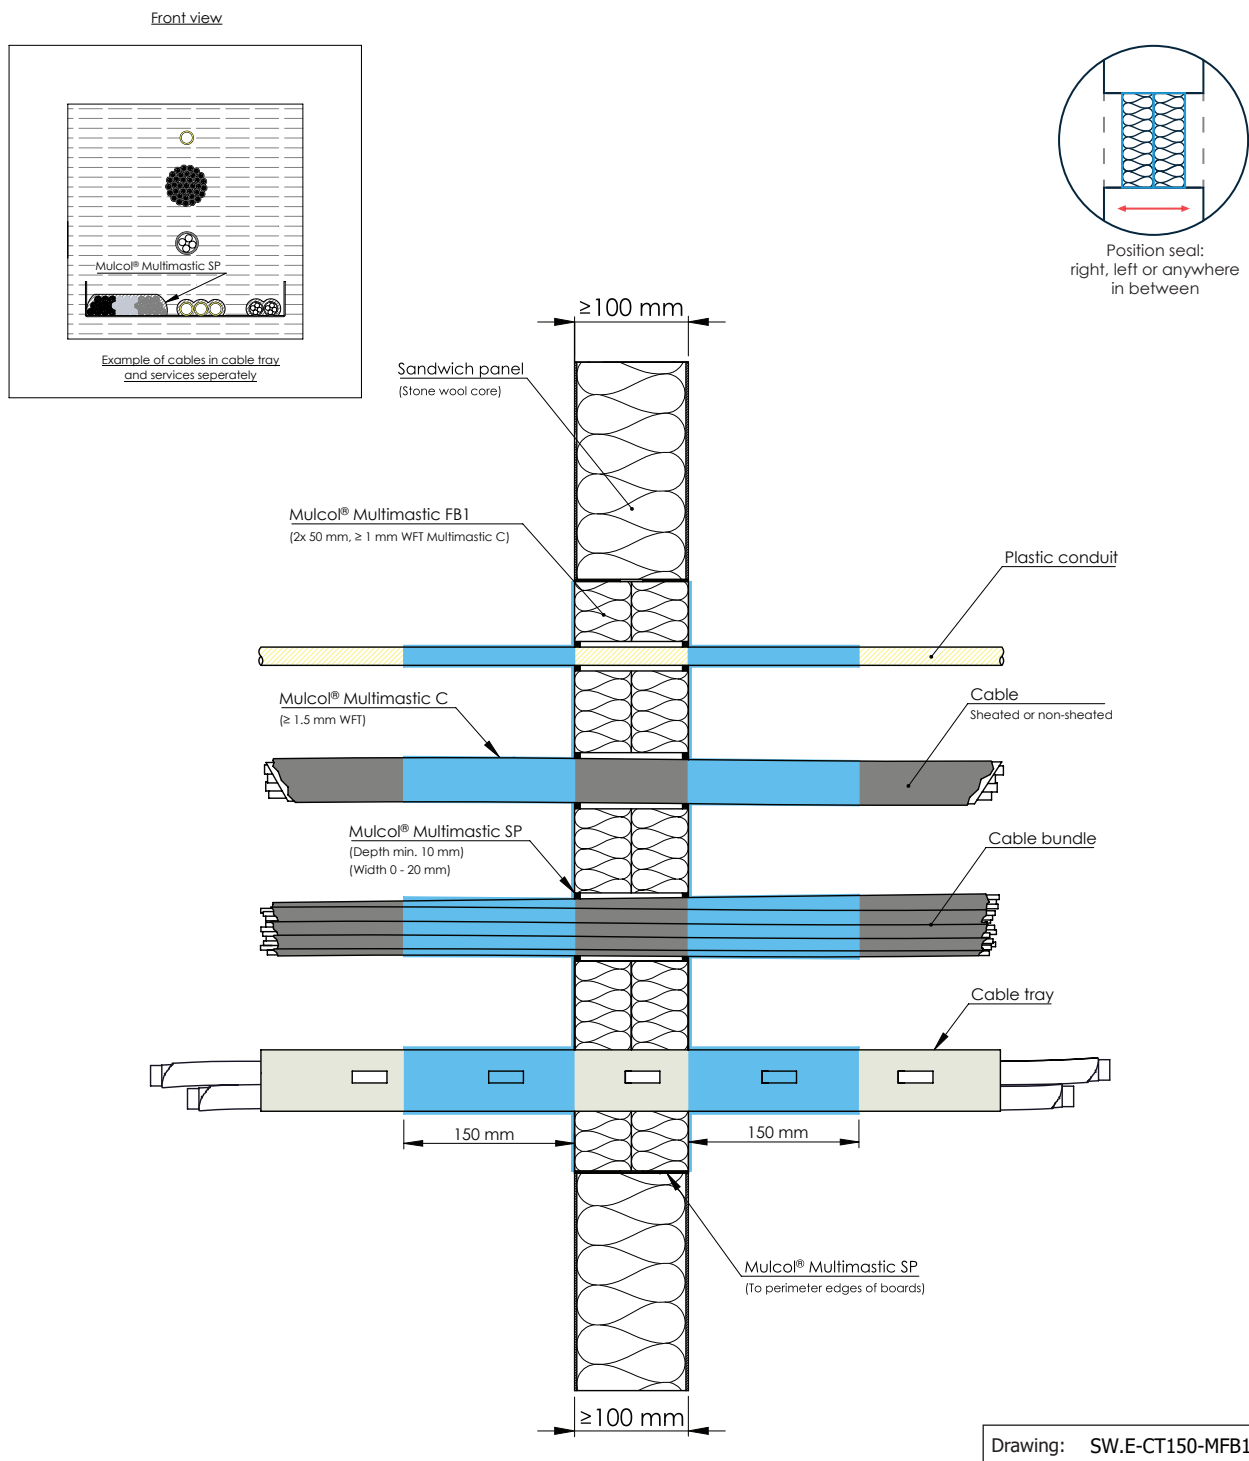

Services	Coating	Classification
Metal cable ladders	Coat back 150 mm ≥ 1.5 mm WFT Multimastic C	EI 90
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		EI 60, E 90
Cables ≤ Ø 80 mm		
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 90 U/C
Non sheathed cables ≤ Ø 24 mm		
Plastic conduits ≤ Ø 16 mm		EI 45 C/U, E 90 C/U
Copper conduits ≤ Ø 16 mm		EI 90 C/U
Steel conduits ≤ Ø 16 mm		

A.4.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits

A.4.1.3 Single plastic conduits - Multidisc

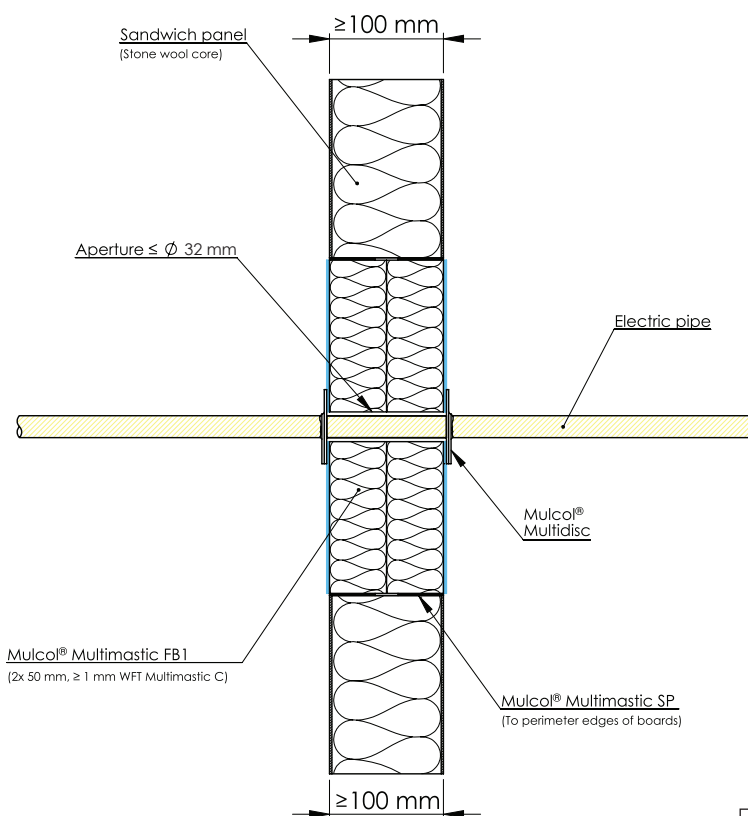




Drawing: SW.E-EP-MFB1-M2.0.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Plastic conduits $\leq \varnothing 25 \text{ mm}$, with or without cables	Multidisc	$\leq \varnothing 32$	Not required	EI 90 U/U

A.4.1 Multimastic FB1 - 2x 50 mm - Cables, trays and conduits

A.4.1.4 Multiple cables - Multidisc

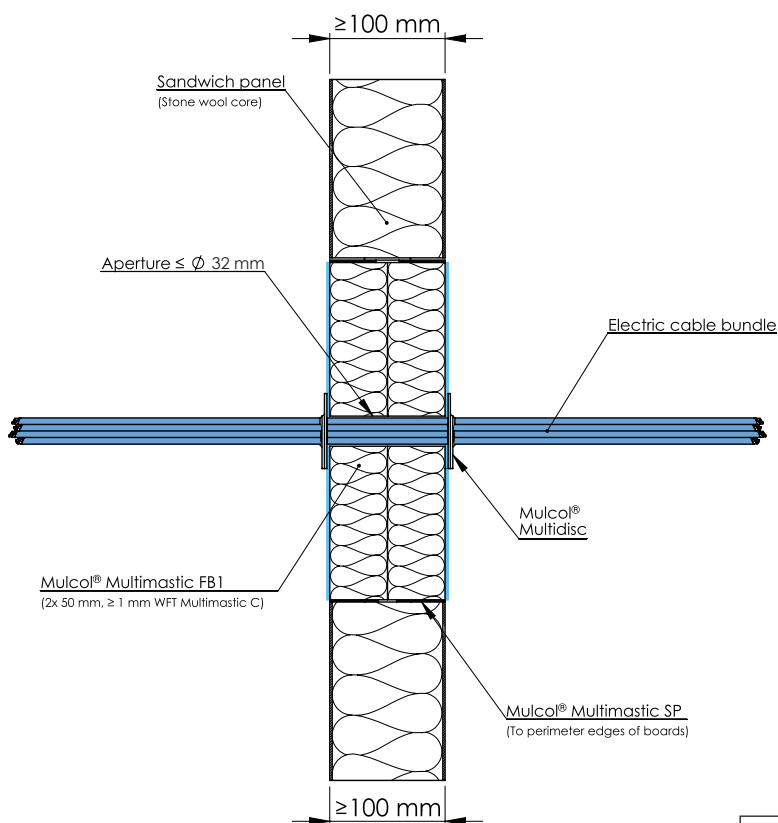

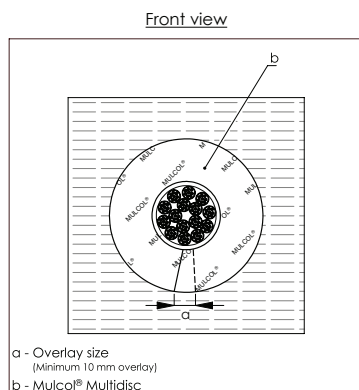


Drawing: SW.E-ECB-MFB1-M2.0.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Multiple electrical / telecommunication cables max. 15 pcs., max. ≤ Ø 25	Multidisc	≤ Ø 32	Not required	EI 120

A.4.2 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.4.2.1 Plastic pipes - Multicollar *Slim*

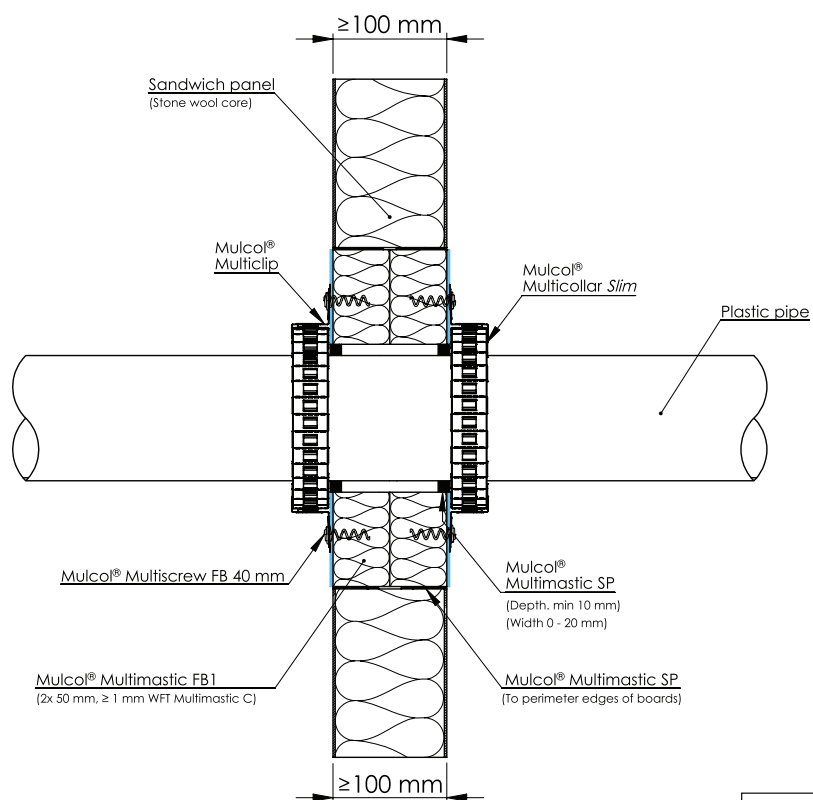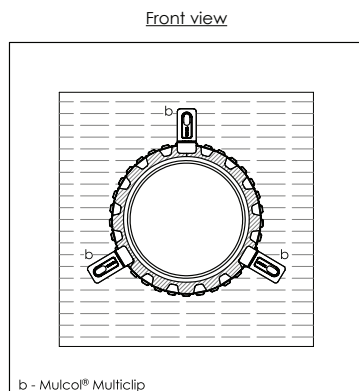

Drawing: SW.E-MC30-PP-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 40	2.3 - 9.3	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 60 U/U
	≤ Ø 110	2.7 - 6.6			EI 120 U/U
		6.6 - 9.3			EI 60 U/U
	≤ Ø 125	3.1 - 9.3			EI 60 U/C
	≤ Ø 160	4.0 - 9.5			

A.4.2 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.4.2.1 Plastic pipes - Multicollar *Slim*



Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PP	≤ Ø 40	2.3 - 9.3	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 60 U/U
	≤ Ø 110	2.7			EI 120 U/U
		2.7 - 9.3			EI 60 U/U
	≤ Ø 125	3.1 - 9.3			EI 60 U/C
≤ Ø 160	4.0 - 9.1				
Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PVC(-U/-C)	≤ Ø 40	2.3 - 9.3	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 60 U/U
	≤ Ø 110	2.7			EI 120 U/U
		2.7 - 9.3			EI 60 U/U
	≤ Ø 125	3.1 - 9.3			EI 60 U/C
≤ Ø 160	4.0 - 9.1				

A.4.2 Multimastic FB1 - 2x 50 mm - Combustible pipes


A.4.2.2 Plastic pipes perpendicular to 45° - Multicollar *Slim*

Front view

a - Annular space
(Maximum 15 mm between pipe and Mulcol® Multicollar *Slim*)
b - Mulcol® Multiclip

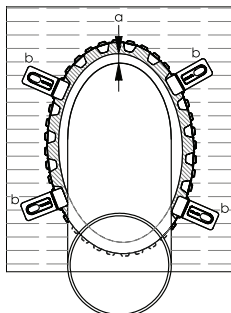

Position seal:
right, left or anywhere
in between

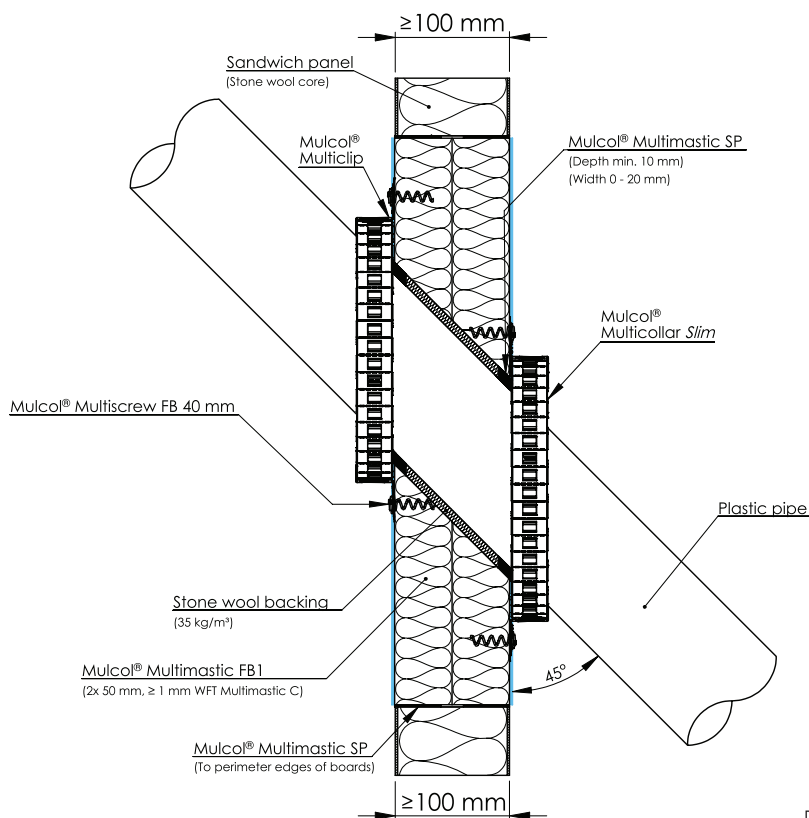

Drawing: SW.E-MC30-PP-MFB1-10.1.10



Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	2.7	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 90 U/C
PP					
PVC(-U/-C)					

A.4.2 Multimastic FB1 - 2x 50 mm - Combustible pipes


A.4.2.3 Plastic pipes perpendicular to 45° - double Multicollar *Slim*

Front view

- a - Annular space
(Maximum 15 mm between pipe and Mulcol® Multicollar Slim)
b - Mulcol® Multiclip
c - Mulcol® Multiclip Large

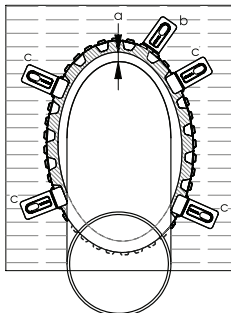

Position seal:
right, left or anywhere
in between



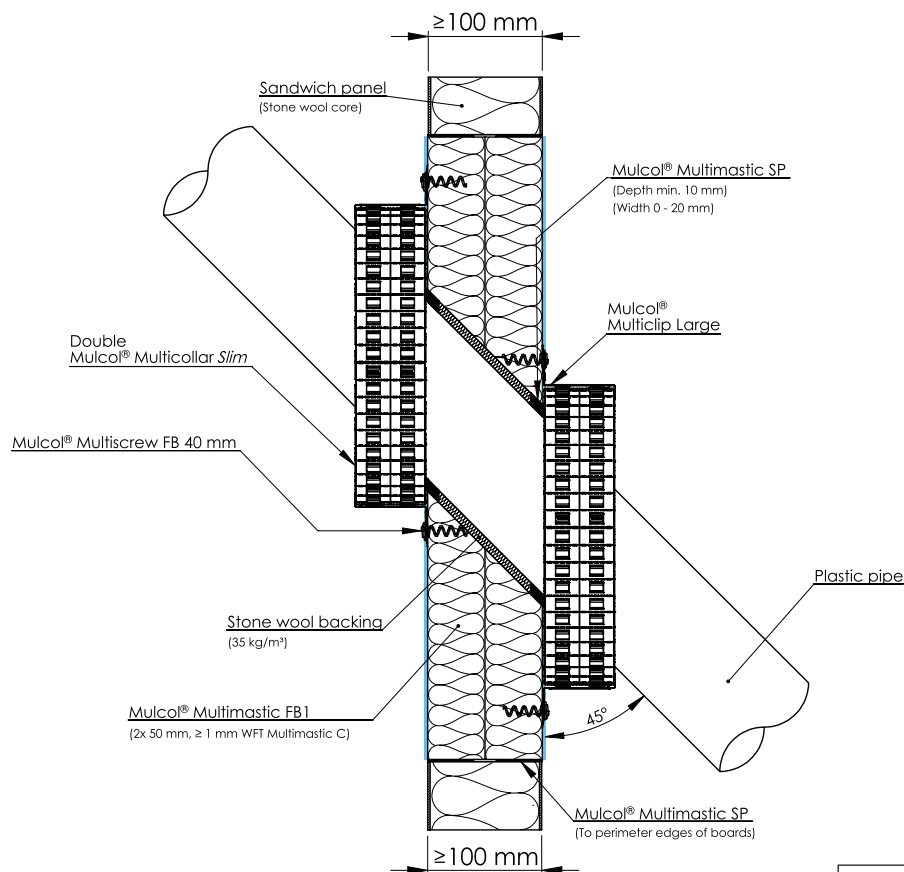


Drawing: SW.E-MC60-PP-MFB1-20.1.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	2.7	Multicollar <i>Slim</i> double	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 90 U/U
		3.4 - 10.0			EI 120 U/C
PP		2.7			EI 30 U/U
		3.4			EI 120 U/C
		3.4 - 10.0			EI 60 U/C
PVC(-U/-C)		2.7			EI 30 U/U
		3.4			EI 120 U/C
		3.4 - 10.0			EI 60 U/C

A.4.2 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.4.2.4 Plastic pipes - Multiwrap

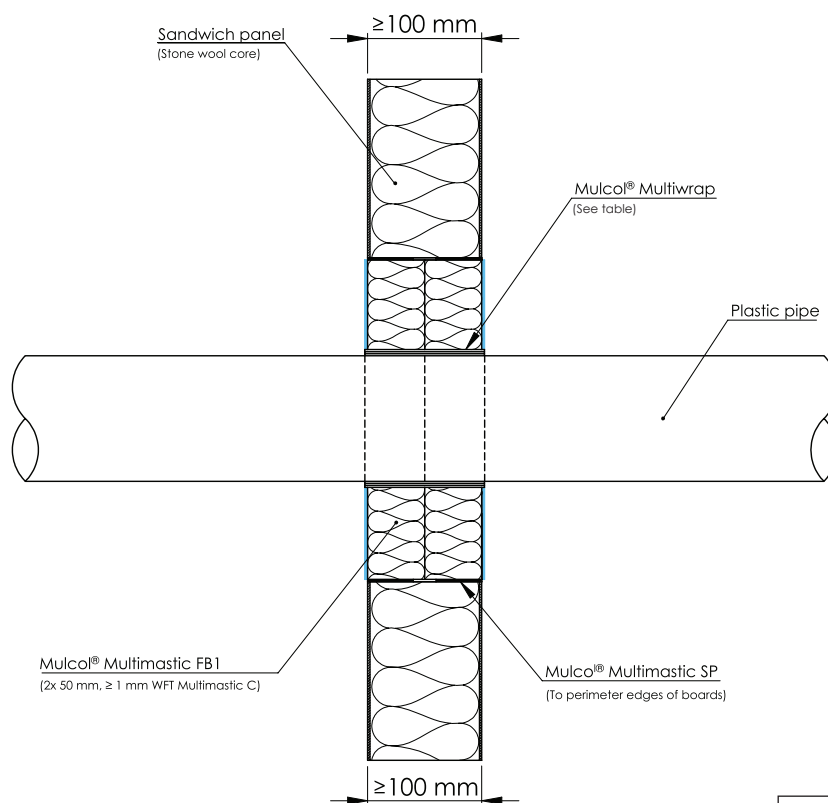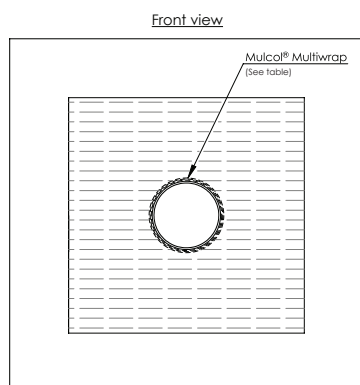

Drawing: SW.E-PP-MW3-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 40	2.4 - 3.7	Multiwrap (2 layers)	EI 120 U/U
	≤ Ø 110	2.7 - 10		EI 120 U/C
PP	≤ Ø 40	2.3 - 5.5		EI 120 U/U
	≤ Ø 110	3.4		EI 90 U/C, E 120 U/C
PVC(-U/-C)	≤ Ø 40	1.8 - 3.7		EI 120 U/U
	≤ Ø 110	1.6		EI 90 U/C, E 120 U/C
		1.6 - 8.1		EI 90 U/C

A.4.2 Multimastic FB1 - 2x 50 mm - Combustible pipes**A.4.2.4 Plastic pipes - Multiwrap**




Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PE(-HD) / PE / ABS / SAN+PVC	≤ Ø 125	3.9	Multiwrap (3 layers)	EI 120 U/C
		3.9 - 4.8		EI 90 U/C, E 120 U/C
PP		3.1		EI 120 U/C
		3.1 - 11.4		EI 90 U/C, E 120 U/C
PVC(-U/-C)		3.7 - 4.8		

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PP	≤ Ø 110	10.0	Multiwrap (4 layers)	EI 120 U/U
		10.0 - 14.6		EI 90 U/U
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 160	14.6		EI 90 U/C
PVC(-U/-C)		5.0		EI 90 U/C, E 120 U/C
		5.0 - 14.6		EI 90 U/C

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PE(-HD) / PE / ABS / SAN+PVC	≤ Ø 125	11.4	Multiwrap (5 layers)	EI 120 U/U
PVC(-U/-C)		9.2		

A.4.2 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.4.2.5 Plastic pipes (Silent) - Multicollar *Slim*

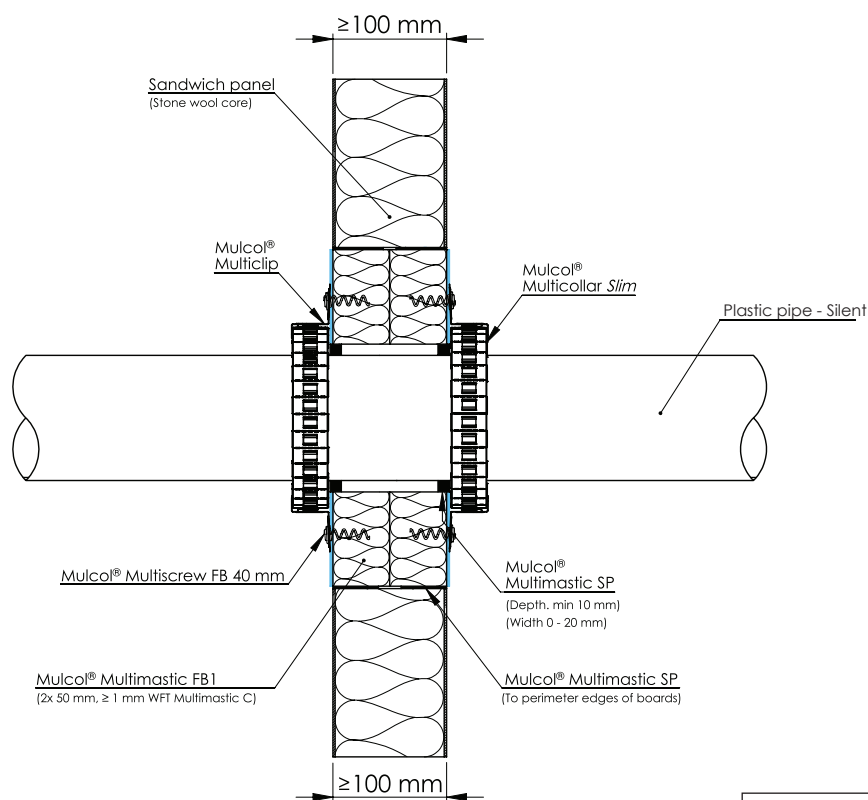

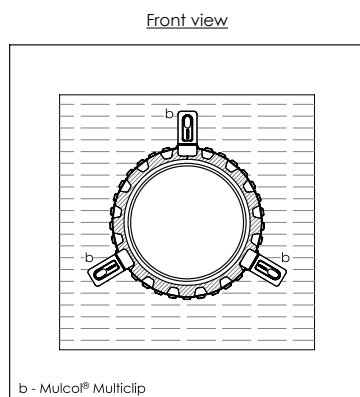


Drawing: SW.E-MC30-PPS-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Geberit Silent dB20	≤ Ø 110	6.0	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 60 U/U

A.4.2 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.4.2.6 Plastic pipes (Silent) - Multiwrap

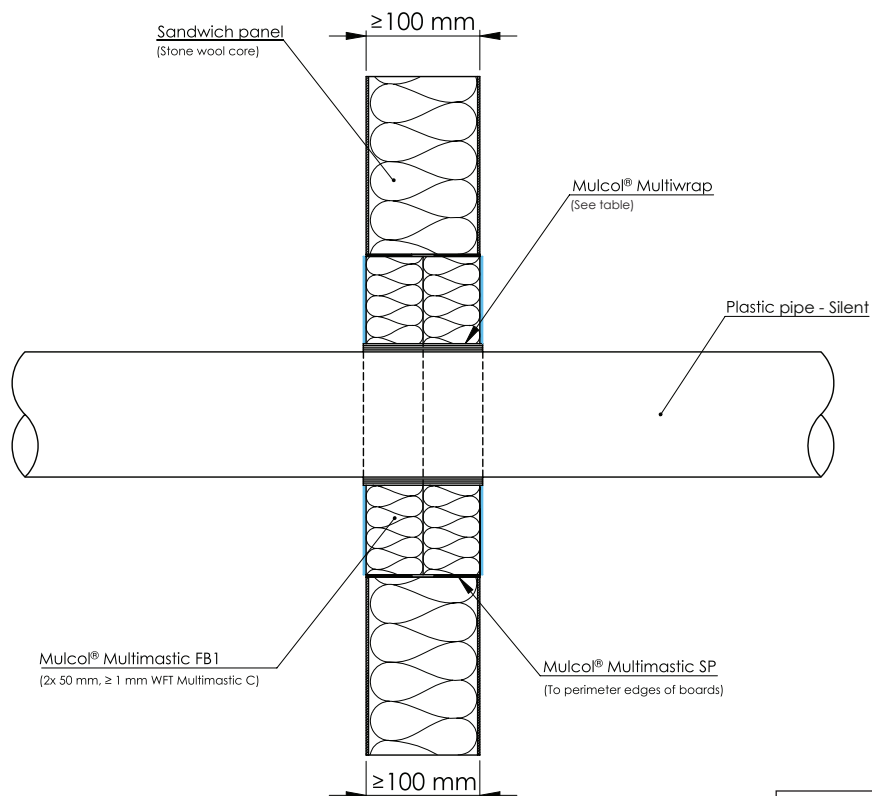

Drawing: SW.E-PPS-MW4-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Raupiano Plus	≤ Ø 50	1.8 - 2.7	Multiwrap (2 layers)	EI 120 U/C
	≤ Ø 110	2.7		
Geberit Silent dB20	≤ Ø 56	3.2 - 6.0		EI 120 U/U
	≤ Ø 110	6.0		
Wavin SiTech+	≤ Ø 40	2.0		EI 120 U/C
	≤ Ø 50	1.8		
	≤ Ø 110	3.4		
Poloplast PoloKal NG	≤ Ø 50	2.0		




A.4.2 Multimastic FB1 - 2x 50 mm - Combustible pipes**A.4.2.6 Plastic pipes (Silent) - Multiwrap**

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Raupiano Plus	$\leq \varnothing 110$	2.7	Multiwrap (4 layers)	EI 120 U/U
	$\leq \varnothing 160$	4.0		EI 90 U/C, E 120 U/C
Poloplast PoloKal NG	$\leq \varnothing 110$	3.4		EI 120 U/C

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Raupiano Plus	$\leq \varnothing 160$	3.9	Multiwrap (6 layers)	EI 120 U/U
Poloplast PoloKal NG		4.9		EI 90 U/C, E 120 U/C

A.4.2 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.4.2.7 PP-R multilayer pipes - Multicollar *Slim*

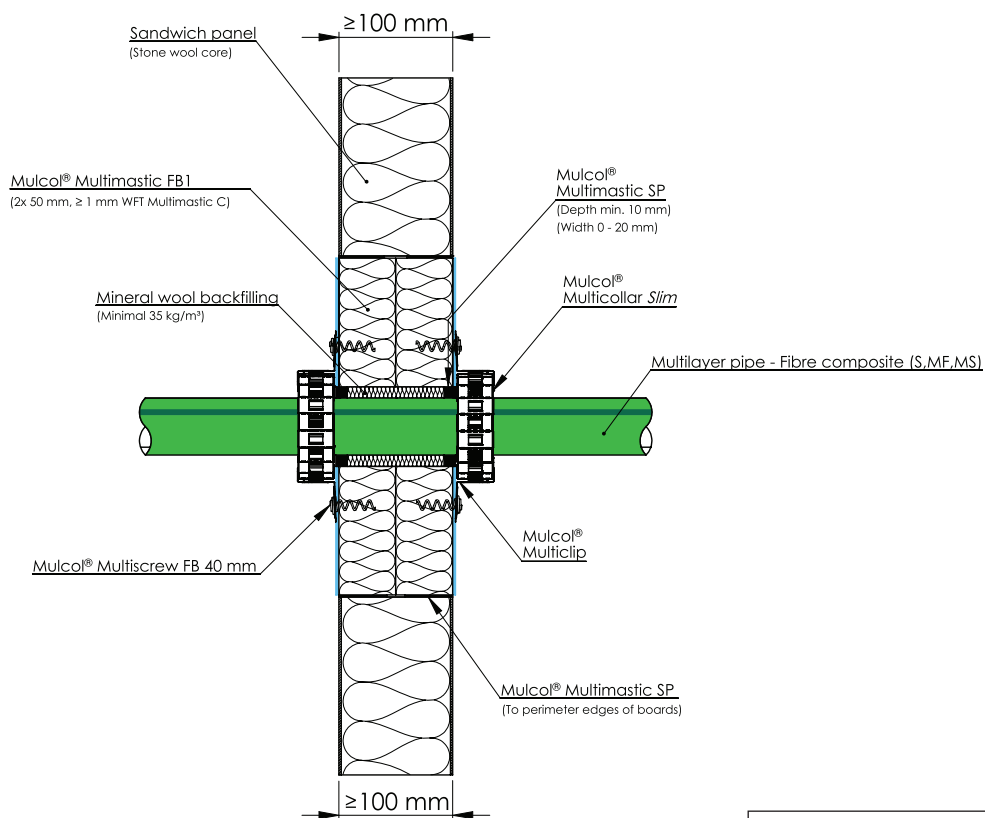




Drawing: SW.E-MC30-MLF-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Aquatherm Green	≤ Ø 50	6.9	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 120 U/C

A.4.2 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.4.2.8 PP-R multilayer pipes - Multiwrap

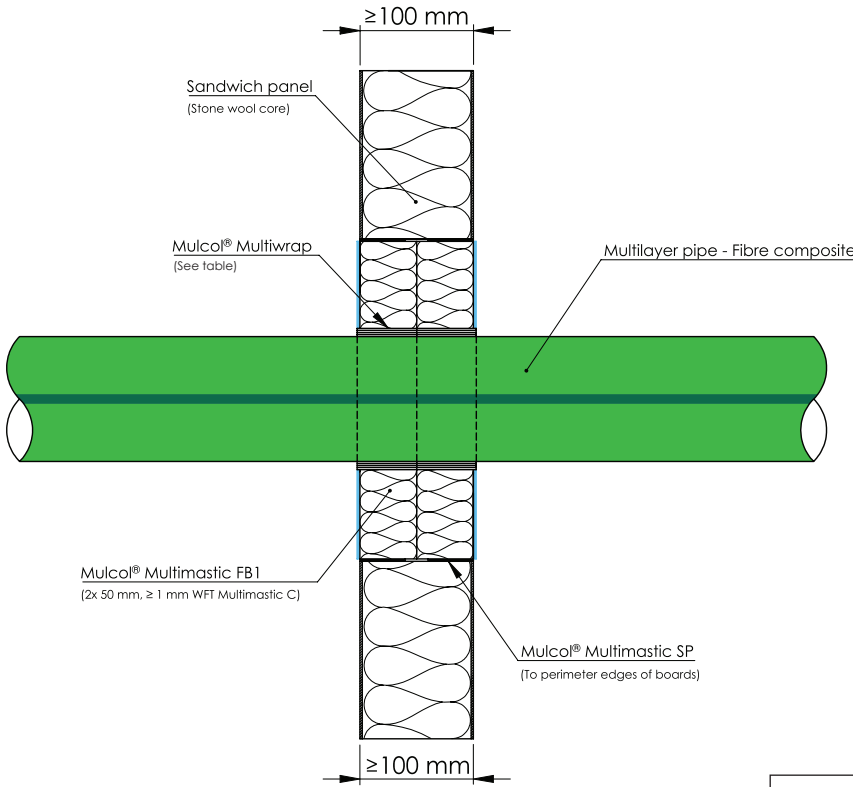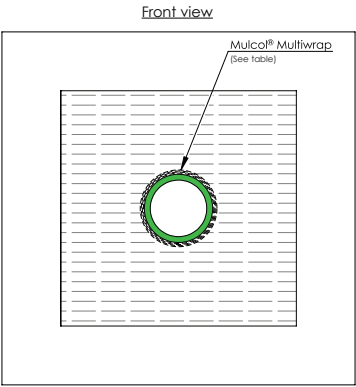


Drawing: SW.E-MLF-MW4-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Aquatherm Blue	≤ Ø 40	3.7	Multiwrap (2 layers)	EI 120 U/C
	≤ Ø 50	4.6		EI 120 U/U
	≤ Ø 110	10	Multiwrap (4 layers)	EI 120 U/C
Aquatherm Green	≤ Ø 90	12.3		

A.4.2 Multimastic FB1 - 2x 50 mm - Combustible pipes




A.4.2.9 Drinks tubing system - Multicollar *Slim*

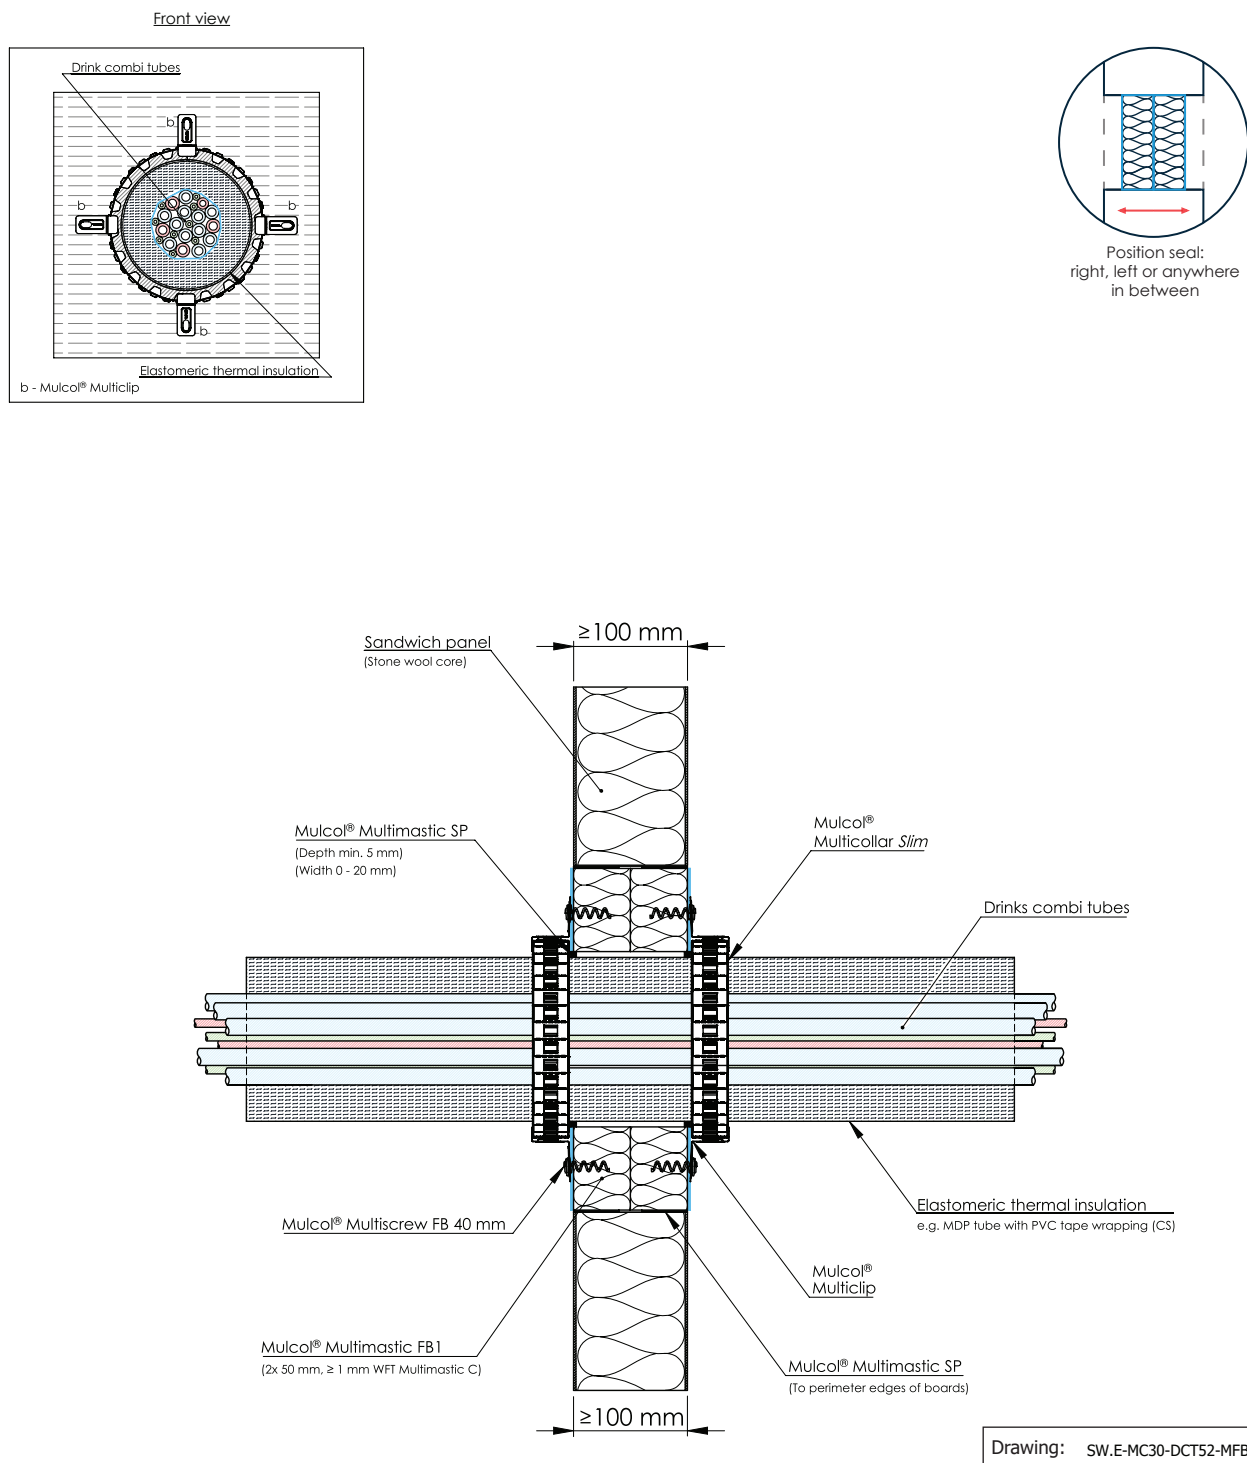

Services	Dimensions (mm)		Insulation			Product	Sealing (mm)	Classification
	Outer dimension	Hoses no.	Type	Thickness (mm)	Configuration			
Drinks tubing system	≤ Ø 145	≤ 52	Elastomeric foam	8.5 - 35	CS	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 60 U/C

A.4.2 Multimastic FB1 - 2x 50 mm - Combustible pipes

A.4.2.10 PE Pipe insulated PIR - double Multicollar *Slim*

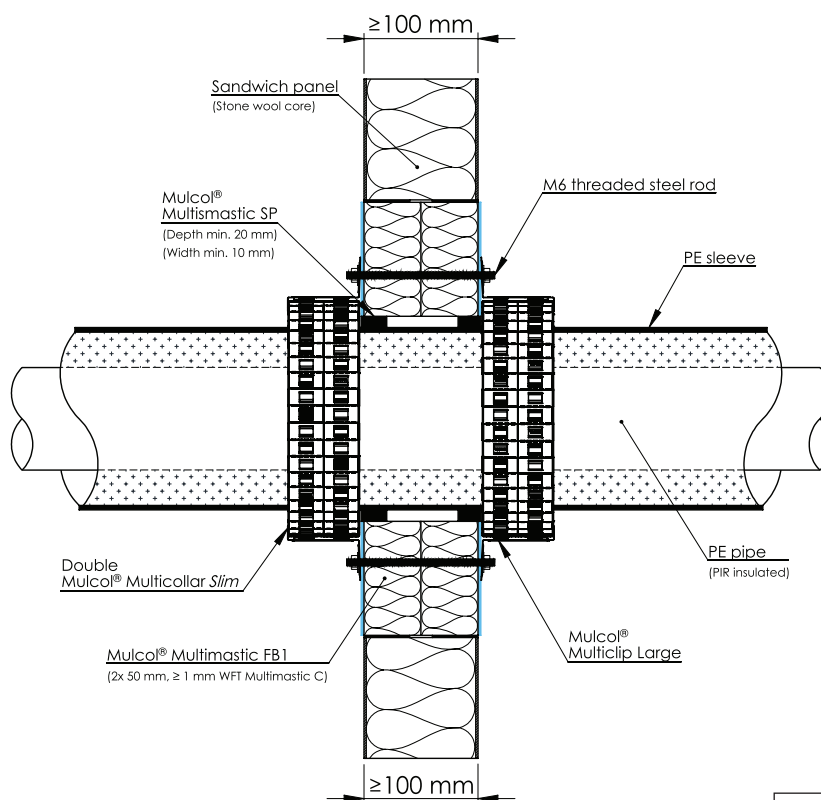




Drawing: SW.E-MC60-PP_pr-MFB1.2.23

Services	Pipe dimensions (mm)		Insulation			Product	Classification
	Outer dimensions	Wall thickness	Type	Thickness (mm)	Configuration		
PE	≤ Ø 160	≥ 3.5	PIR / PUR + PE coating	30	CS	double Multicollar <i>Slim</i>	EI 120 U/C

A.4.3 Multimastic FB1 Pattress fixed to wall - 2x50 mm - Combustible pipes

A.4.3.1 Plastic pipes - Multicollar *Slim*

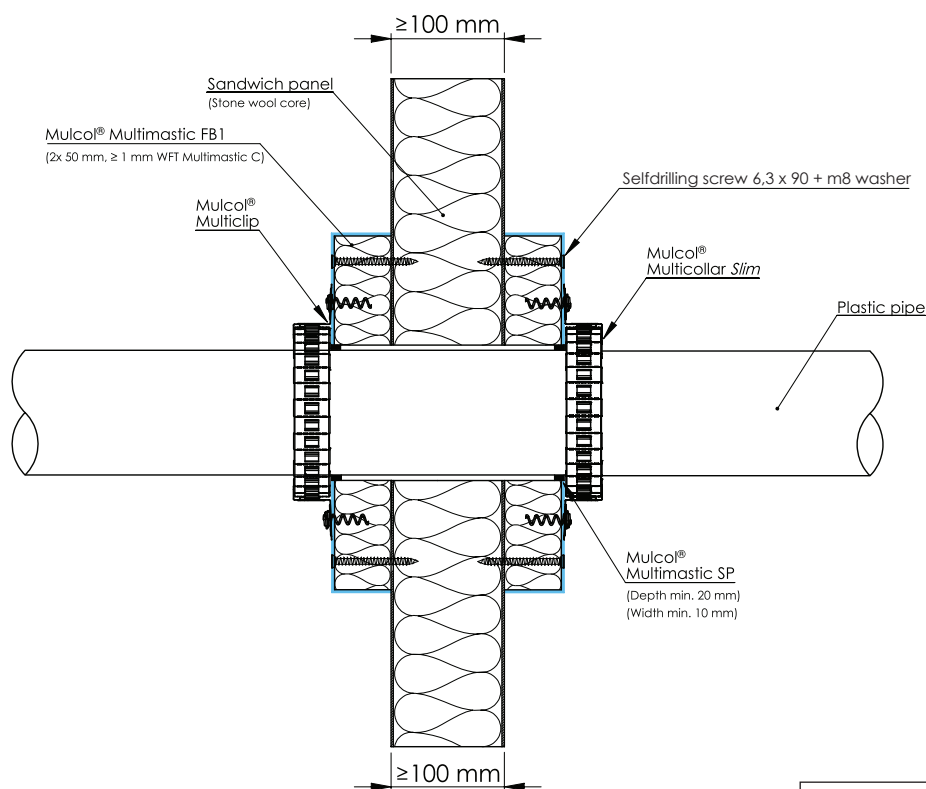

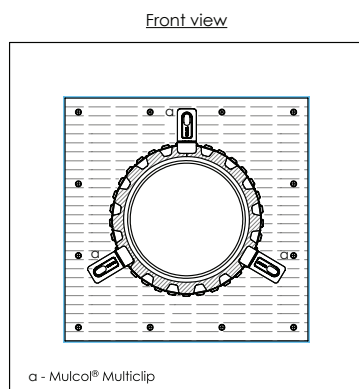


Drawing: SW.E-MC30-PP-MFB1.2.10_pat

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 40	2.4	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 30 U/U, E 90 U/U
	≤ Ø 110	3.4			EI 90 U/U
PP	≤ Ø 40	2.3 - 2.7			
	≤ Ø 110	2.7			EI 30 U/U, E 90 U/U
PVC(-U/-C)	≤ Ø 40	2.4			EI 90 U/U
	≤ Ø 110	3.4			

A.4.4 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)

A.4.4.1 Multilayer pipes (MLC) - Multisealant GR

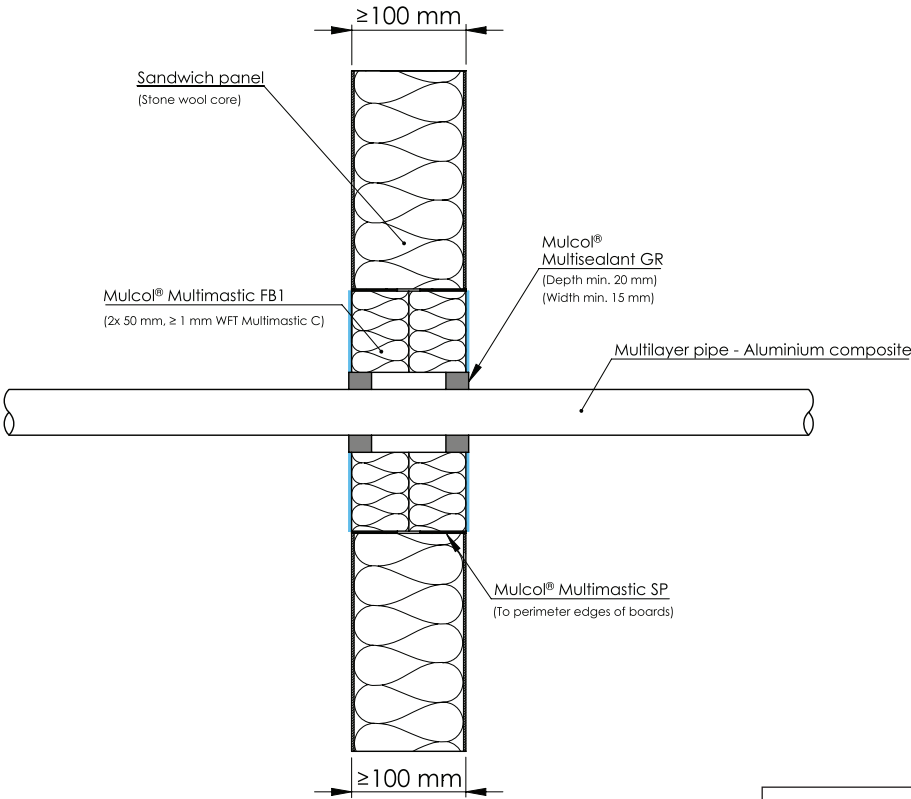

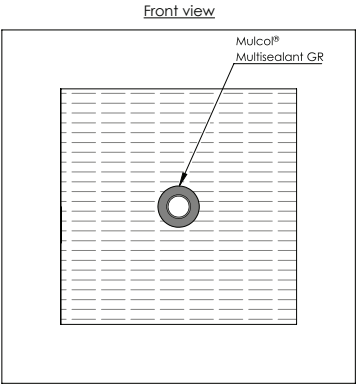


Drawing: SW.E-MLA-G2.4.10

Services	Pipe dimensions (mm)		Sealing (mm)	Classification
	Outer dimension	Wall thickness		
Multilayer pipes (MLC)	≤ Ø 32	3.0	Multisealant GR ≥ 15 x 20 (wxd)	EI 120 U/C
	≤ Ø 40	4.0		

A.4.4 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)


A.4.4.2 Multilayer pipes (MLC) - Multidisc

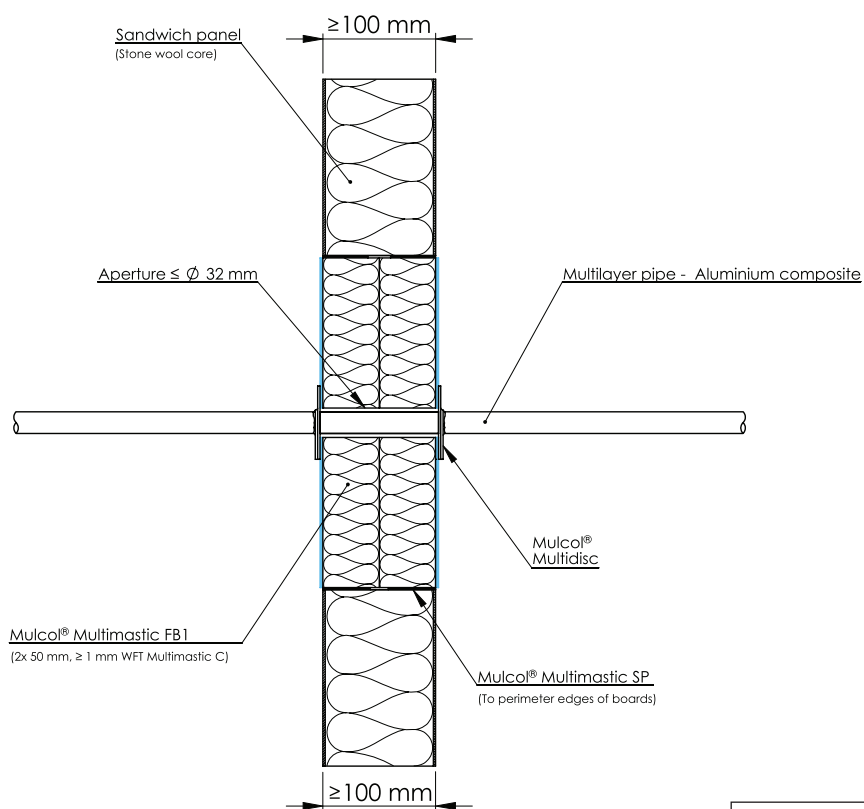

Services	Pipe dimensions (mm)		Aperture (mm)	Product	Sealing (mm)	Classification
	Outer diameter	Wall thickness				
Multilayer pipes (MLC)	$\leq \varnothing 16$	2.0	$\leq \varnothing 32$	Multidisc	Not required	EI 60 U/C E 90 U/C

A.4.4 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)




A.4.4.3 Multilayer pipes (MLC) - PE Conduit - Multisealant GR

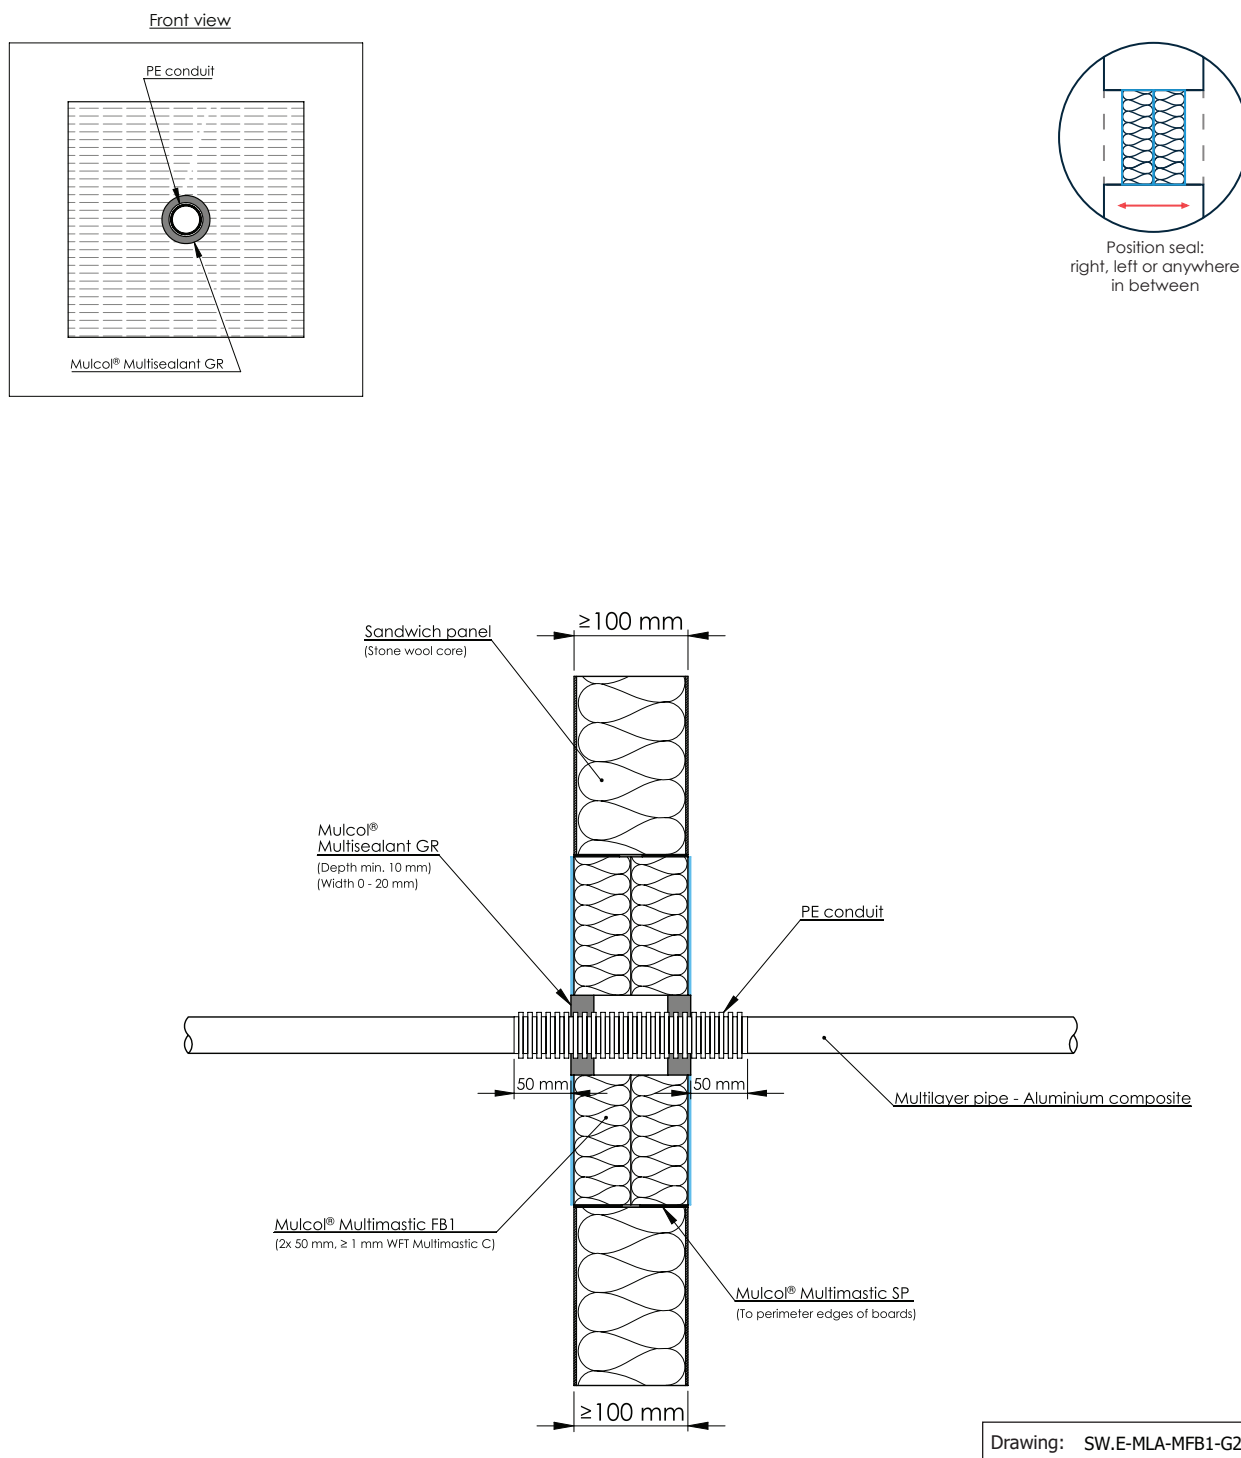

Services	Pipe dimensions (mm)		Conduit			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Outer dimension (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 32	3.0	PE-conduit ribbed	≤ Ø 40	LS 50 / CS	Multisealant GR 10-20 x ≥ 10 (wxd)	EI 60 U/C

A.4.4 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)

A.4.4.4 Multilayer pipes (MLC) - Elastomer LS 400 / CS - Multisealant GR

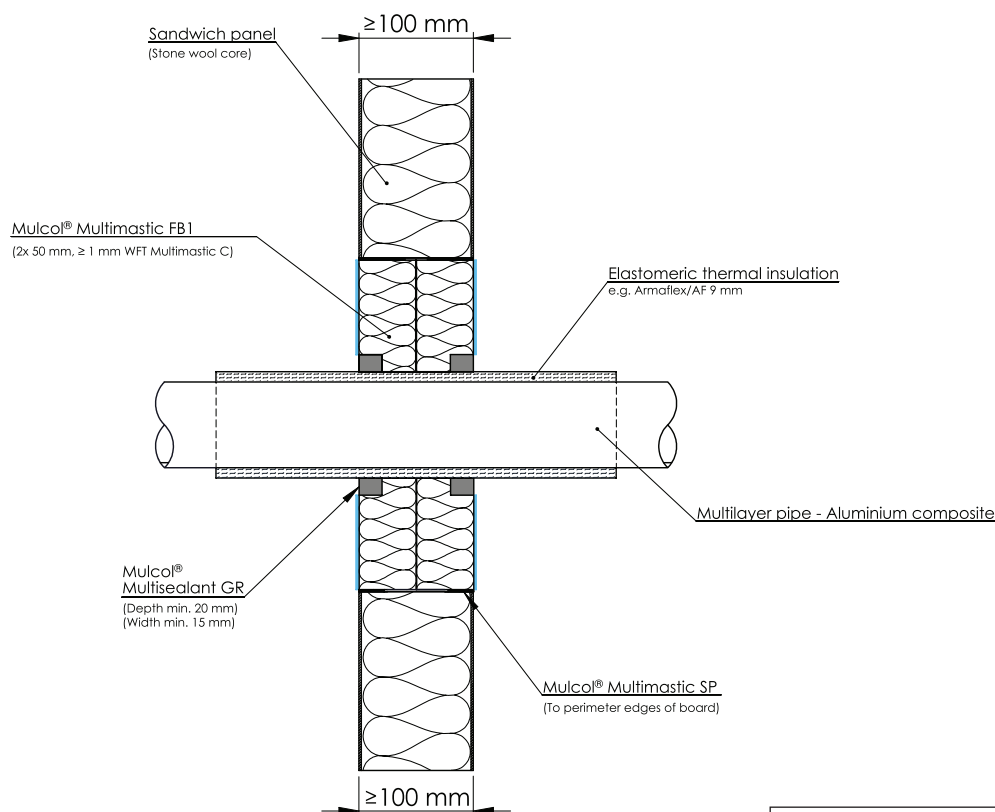

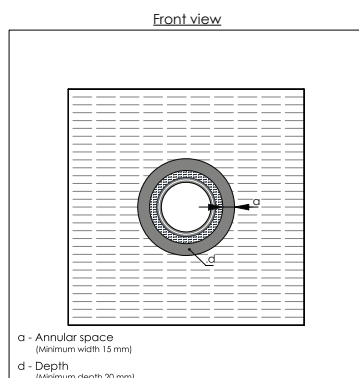


Drawing: SW.E-MLA-MFB1-G2.4.22

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 75	6.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	9 - 32	LS 400 / CS	Multisealant GR ≥ 15 x 20 mm (wxd)	EI 90 U/C E 120 U/C

A.4.4 Multimastic FB1 - 2x 50 mm - Multilayer pipes (MLC)


A.4.4.5 Multilayer pipes (MLC) - PE foam - Multisealant GR

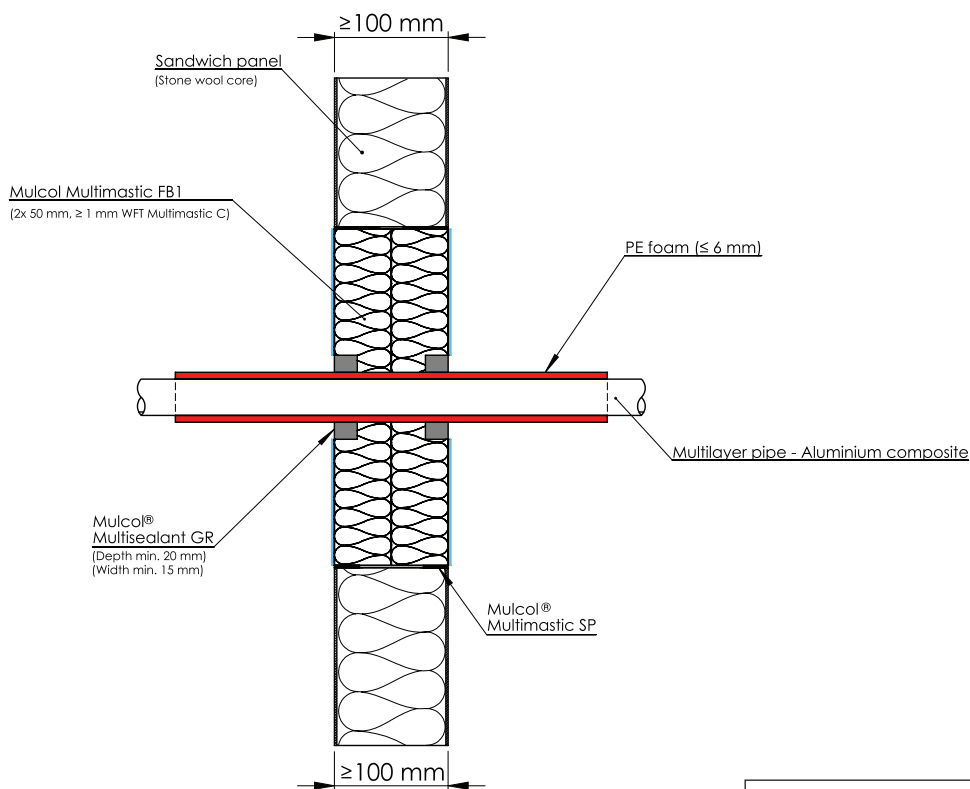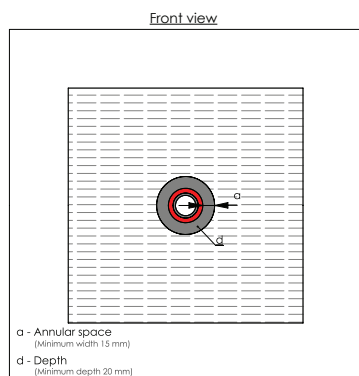

Drawing: SW.E-MLA_pr-MFB1-G2.4.23

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 32	3.0	PE Foam	≤ 6	LS 300 / CS LI 300 / CI	Multisealant GR ≥ 15 x 20 (wxd)	EI 120 U/C


A.4.5.1 Multilayer pipe (MLC) - Elastomer LS 400 / CS - Multicollar *Slim*

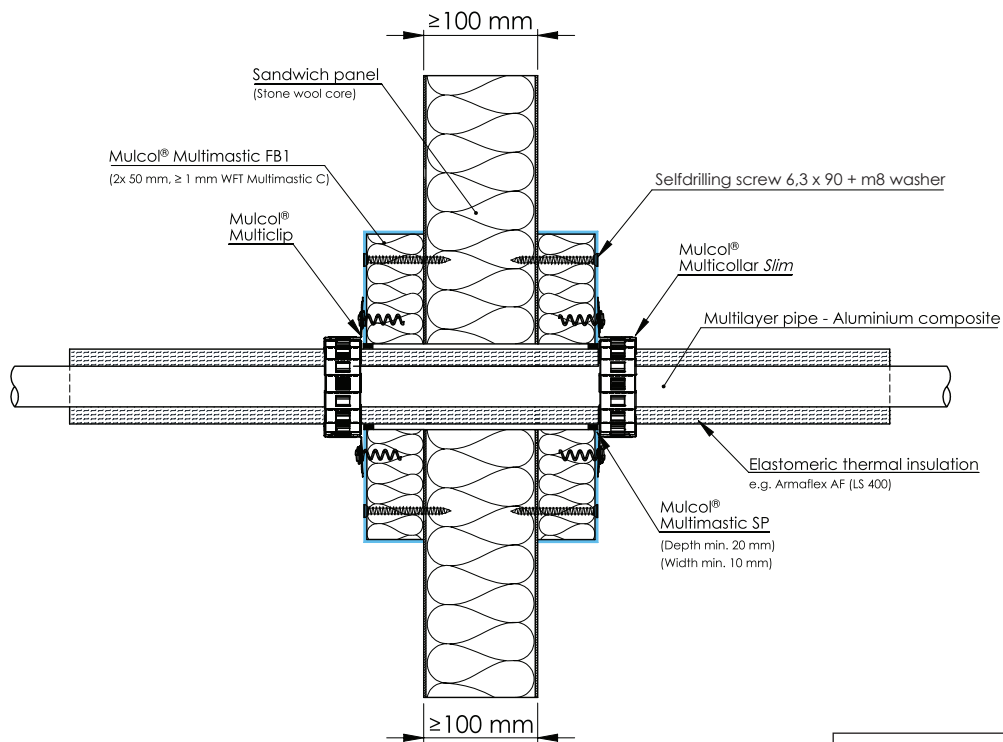

Services	Pipe dimensions (mm)		Insulation			Product	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 32	3.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	13	LS 400 / CS	Multicollar <i>Slim</i>	EI 90 U/C

A.4.6 Multimastic FB1 - 2x 50 mm - Metal pipes insulated mineral wool




A.4.6.1 Copper and steel pipes - Stone wool LS 400 / CS

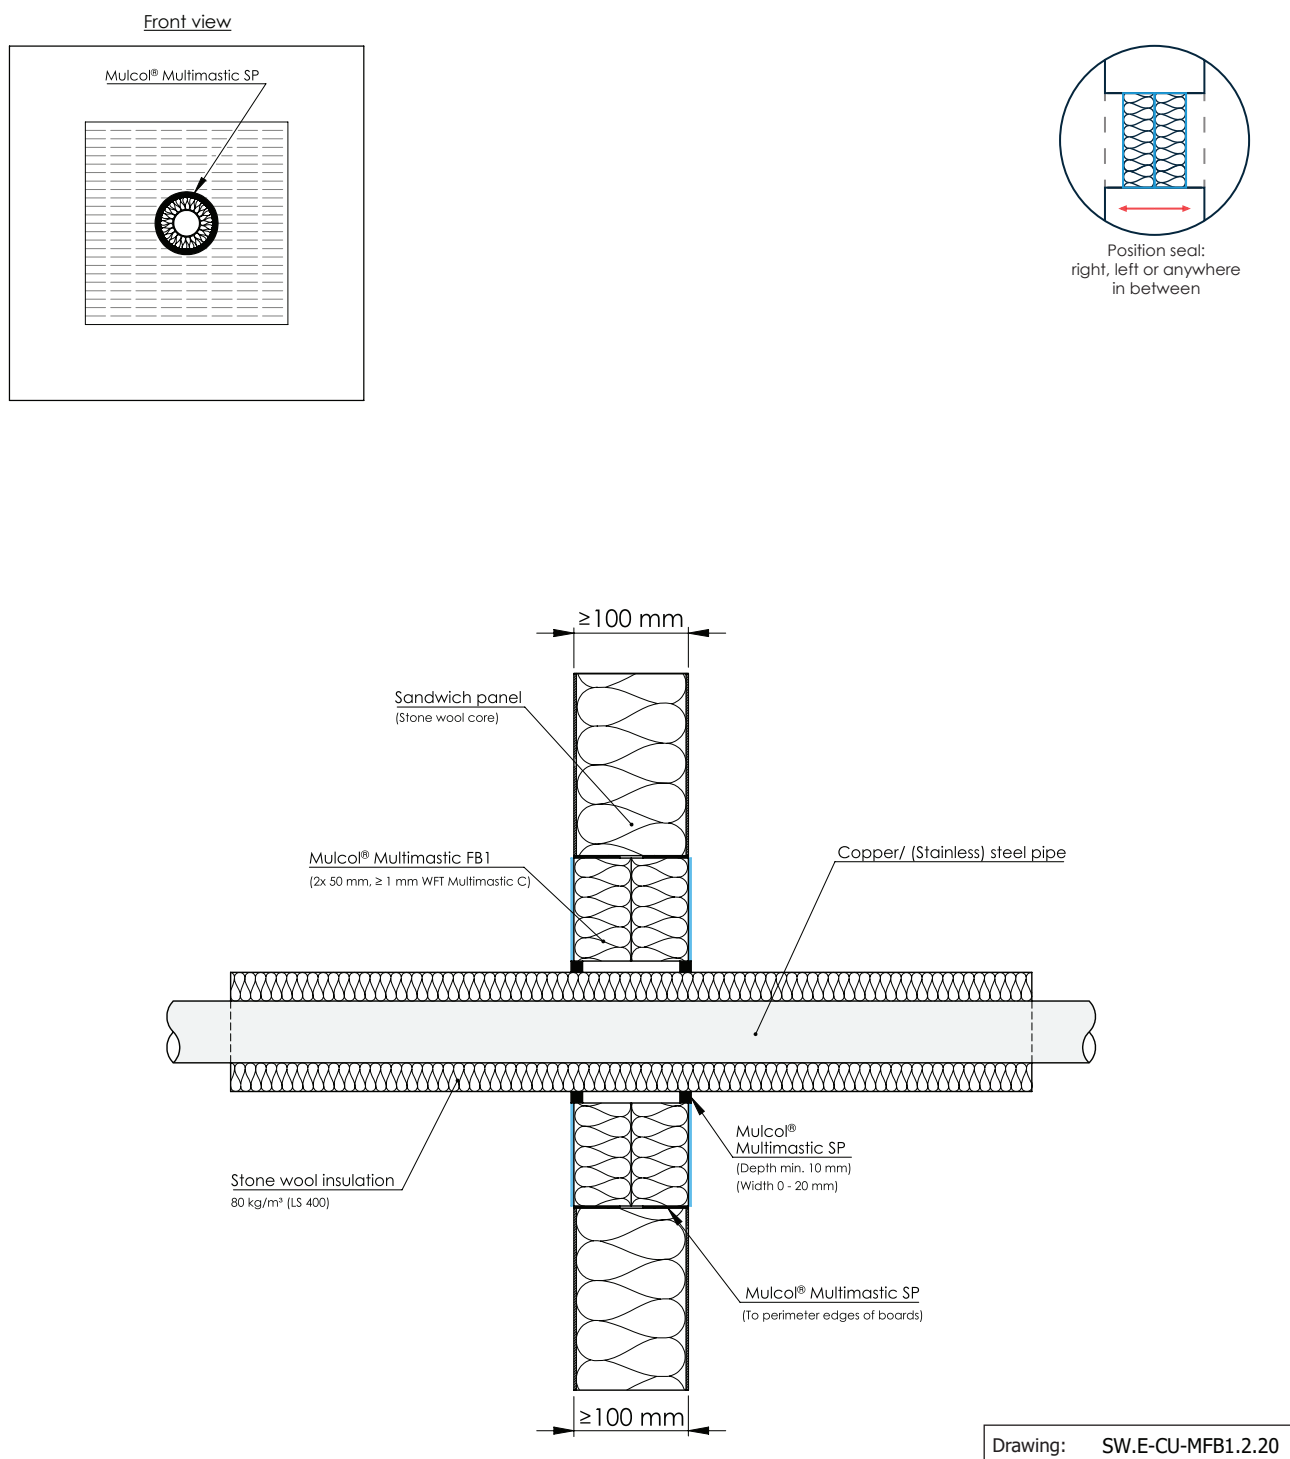

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	≥ 25	LS 400 / CS	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 90 C/U, E 120 C/U
	≤ Ø 54	≥ 1.5					
(Stainless) Steel / cast iron	≤ Ø 12	≥ 3.6					
	≤ Ø 114.3						

A.4.7 Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer

A.4.7.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR

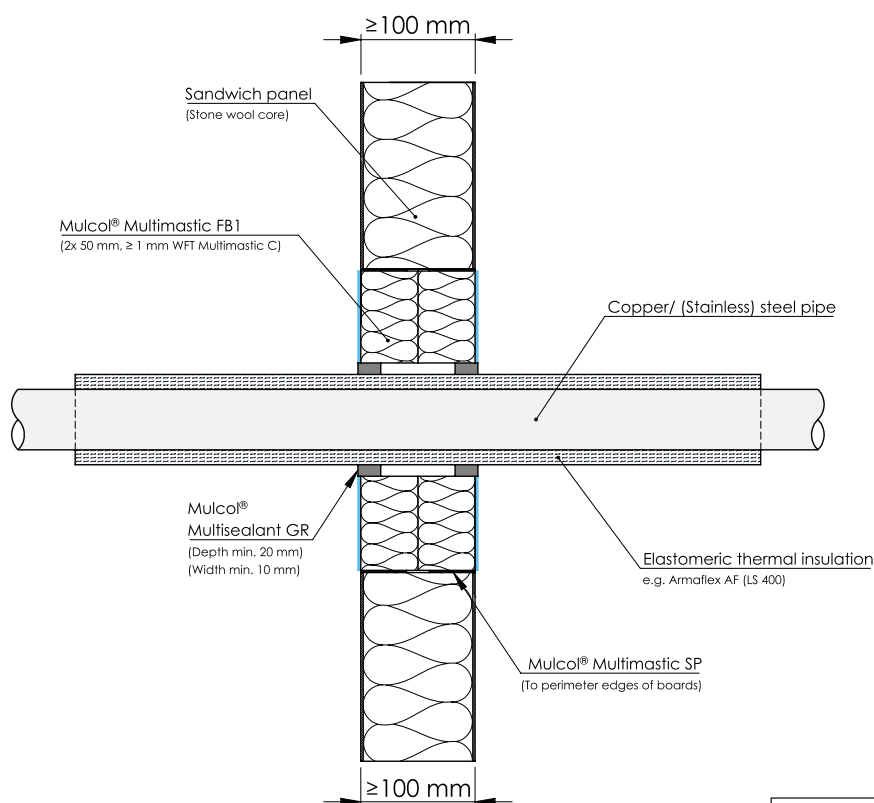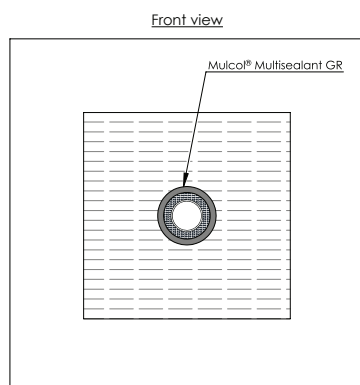

Drawing: SW.E-CU-MFB1-G2.18.22




Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	8.5	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	EI 90 C/U, E 120 C/U
				8.5 - 38			EI 90 C/U
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		8.5			EI 90 C/U, E 120 C/U
				8.5 - 38			EI 90 C/U

A.4.7 Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer**A.4.7.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR**

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 54	≥ 1.5	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	13.5	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	EI 30 C/U, E 90 C/U
					CS		EI 90 C/U
				13.5 - 38	LS 400 / CS		EI 30 C/U, E 90 C/U
					CS		EI 60 C/U, E 90 C/U
(Stainless) Steel / cast iron	≤ Ø 114.3	≥ 3.6		38	LS 400 / CS		EI 90 C/U
				15 - 43			EI 45 C/U, E 90 C/U
			43	EI 60 C/U, E 90 C/U			

A.4.7 Multimastic FB1 - 2x 50 mm - Metal pipes insulated elastomer

A.4.7.2 Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap

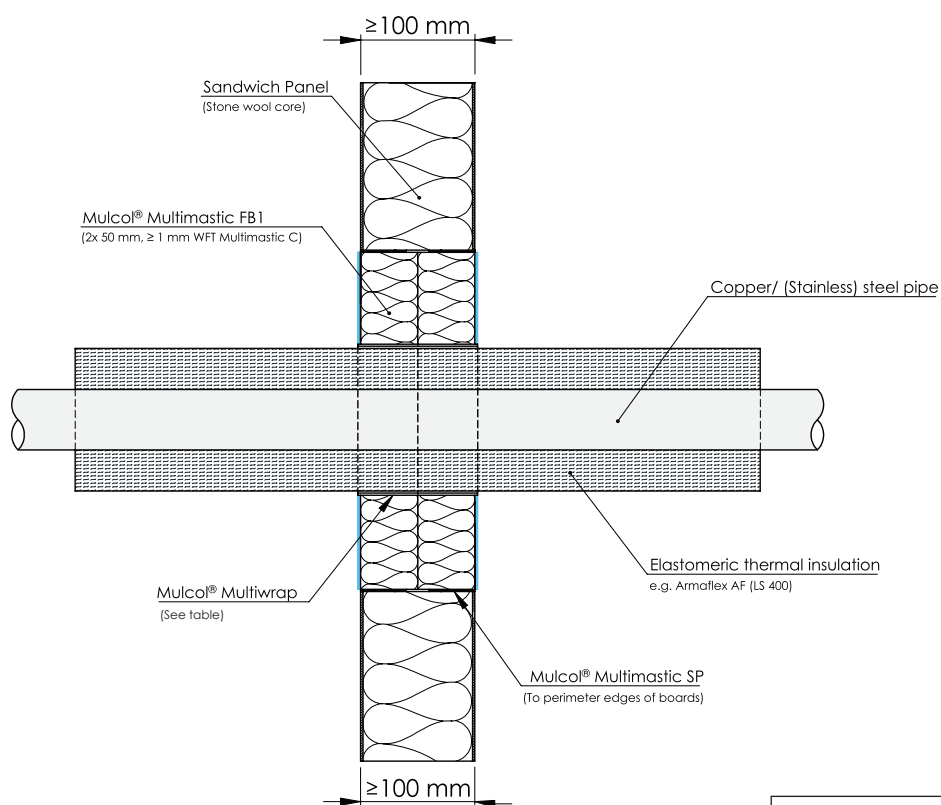

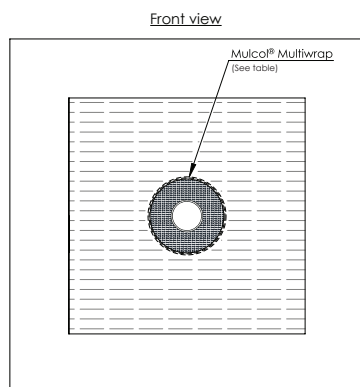


Drawing: SW.E-CU-MW2-MFB1.2.22

Services	Pipe dimensions (mm)		Insulation			Product	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 12	≥ 1.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	9	LS 400 / CS	Multiwrap (2 layers)	EI 90 C/U
	≤ Ø 35	≥ 1.1		35			EI 90 C/U, E 120 C/U
		≥ 1.5		60			EI 120 C/U
				≤ Ø 54			38
(Stainless) Steel / cast iron	≤ Ø 114.3	≥ 3.6		15			EI 60 C/U, E 90 C/U

A.4.8 Multimastic FB1 - 2x50 mm - Metal pipes uninsulated

A.4.8.1 Copper and steel pipes - Multidisc

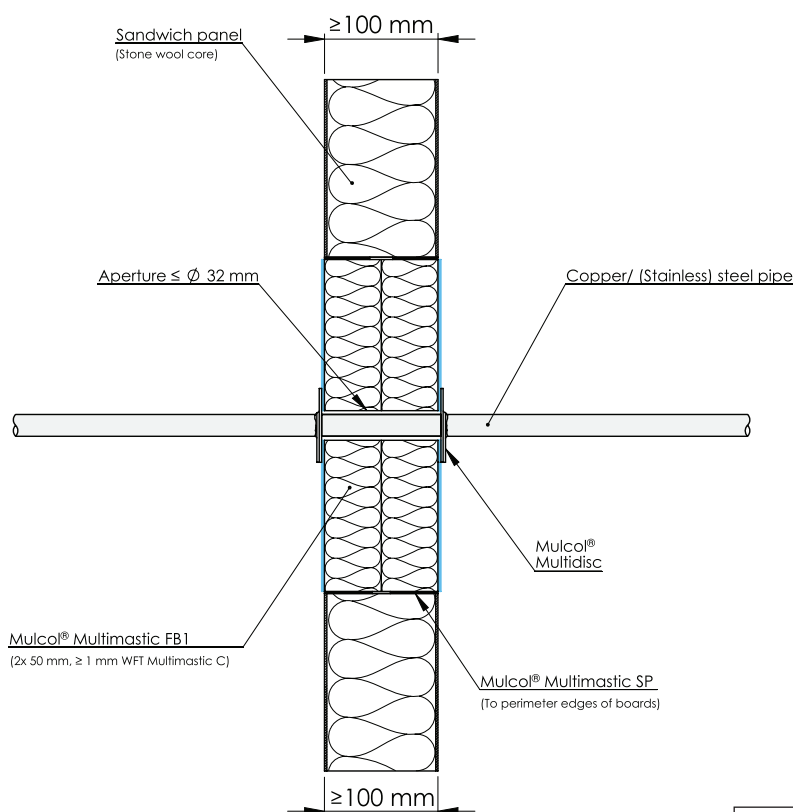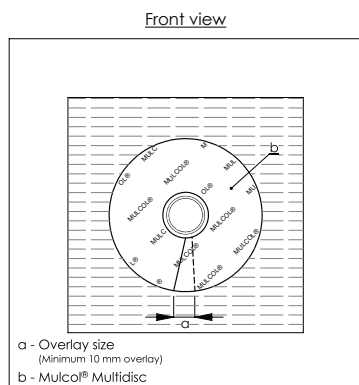


Drawing: SW.E-MFB1-CU-M2.0.10

Services	Pipe dimensions (mm)		Aperture (mm)	Product	Sealing (mm)	Classification
	Outer diameter	Wall thickness				
Copper / (stainless) steel / cast iron	$\leq \varnothing 15$	≥ 1.0	$\leq \varnothing 32$	Multidisc	Not required	EI 45 C/U E 90 C/U
(Stainless) Steel / cast iron	$\leq \varnothing 17.2$					EI 90 C/U

A.4.9 Multimastic FB1 - 2x 50 mm - Multiple penetrations



A.4.9.1 Airconditioning set - Multisealant GR

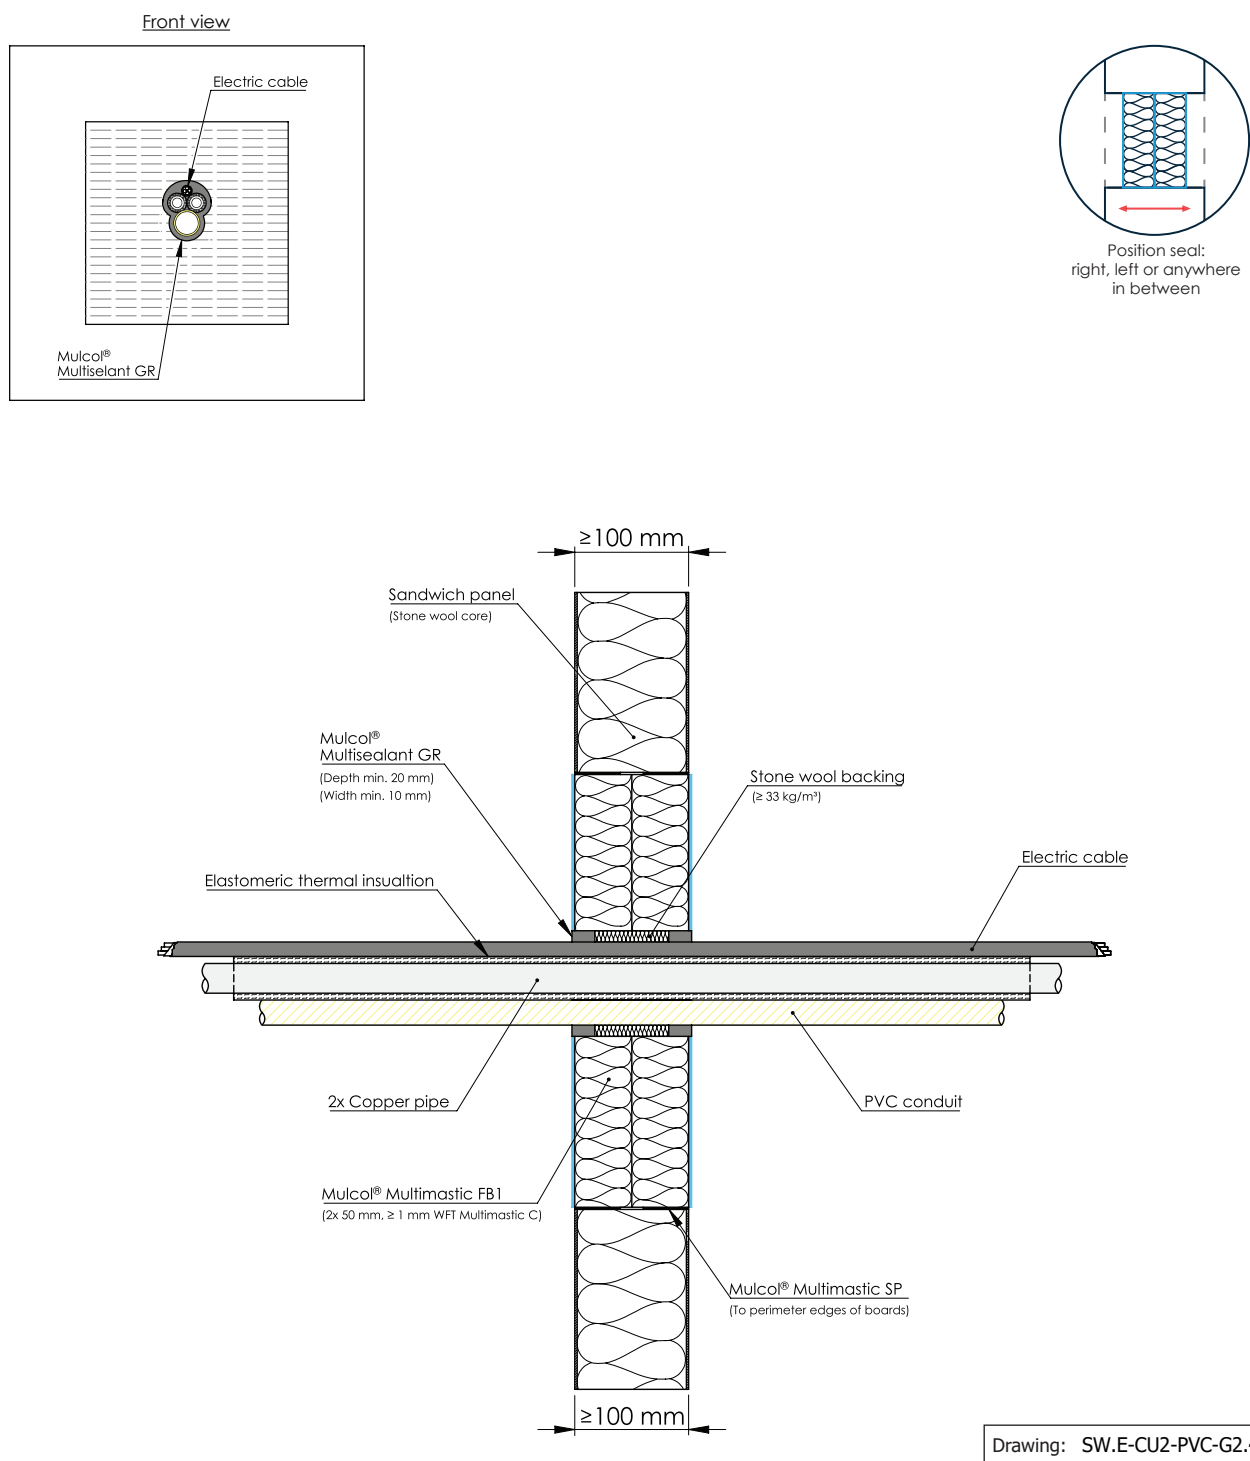

Services	Pipe dimensions (mm)	Insulation		Product	Classification
	Outer diameter	Type	Thickness (mm)		
Set of airconditioning pipes	$2x \leq \varnothing 13$	PE foam	≥ 6	Multisealant GR $\geq 10 \times 20 \text{ (wxd)}$	EI 120 C/U
PVC-U / PVC-C	$\leq \varnothing 22$	-	-		
Sheathed cable	$\leq 3 \times 2.5 \text{ mm}^2$	-	-		

A.4.10 Multimastic FB1 - 2x 50 mm - Busbar

A.4.10.1 Single busbar - LI 300

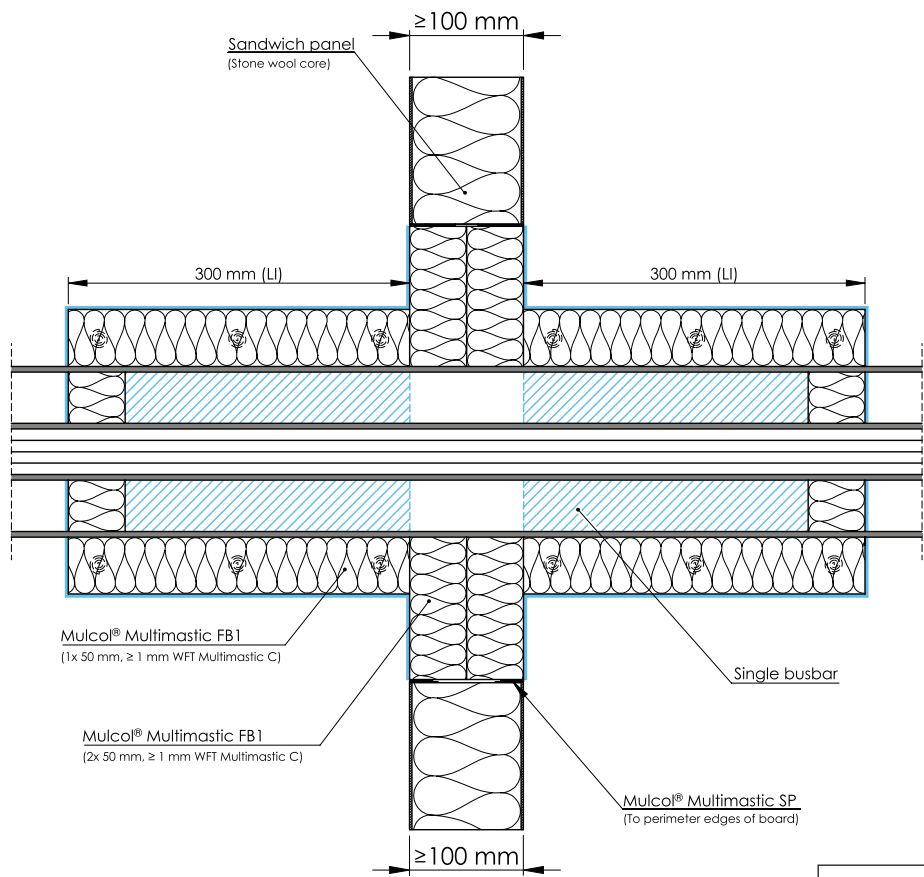


Drawing: SW.E-1BB-MFB1.2.10


Services	Service dimensions		Insulation			Classification
	Outside dimension	Conductor	Type	Thickness (mm)	Configuration	
Single busbar	≤ 150 x 250 mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 300 / CI	EI 120

A.4.10 Multimastic FB1 - 2x 50 mm - Busbar

A.4.10.1 Single busbar - LI 300




Position seal:
right, left or anywhere
in between

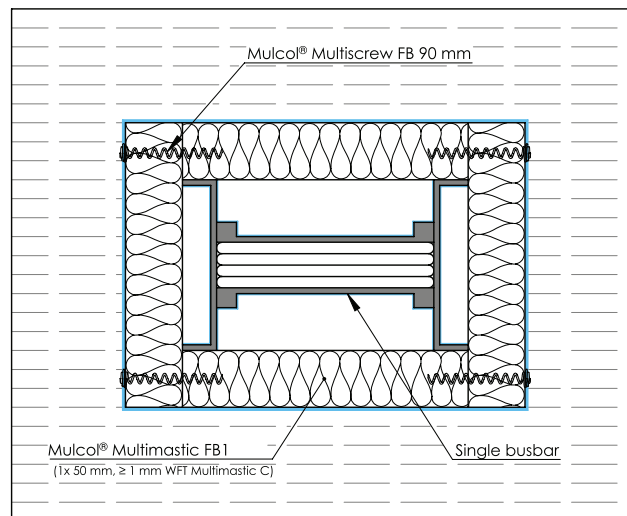

Drawing: SW.E-1BB-MFB1.2.10

A.4.10 Multimastic FB1 - 2x 50 mm - Busbar

A.4.10.2 Multiple busbars - LI 300


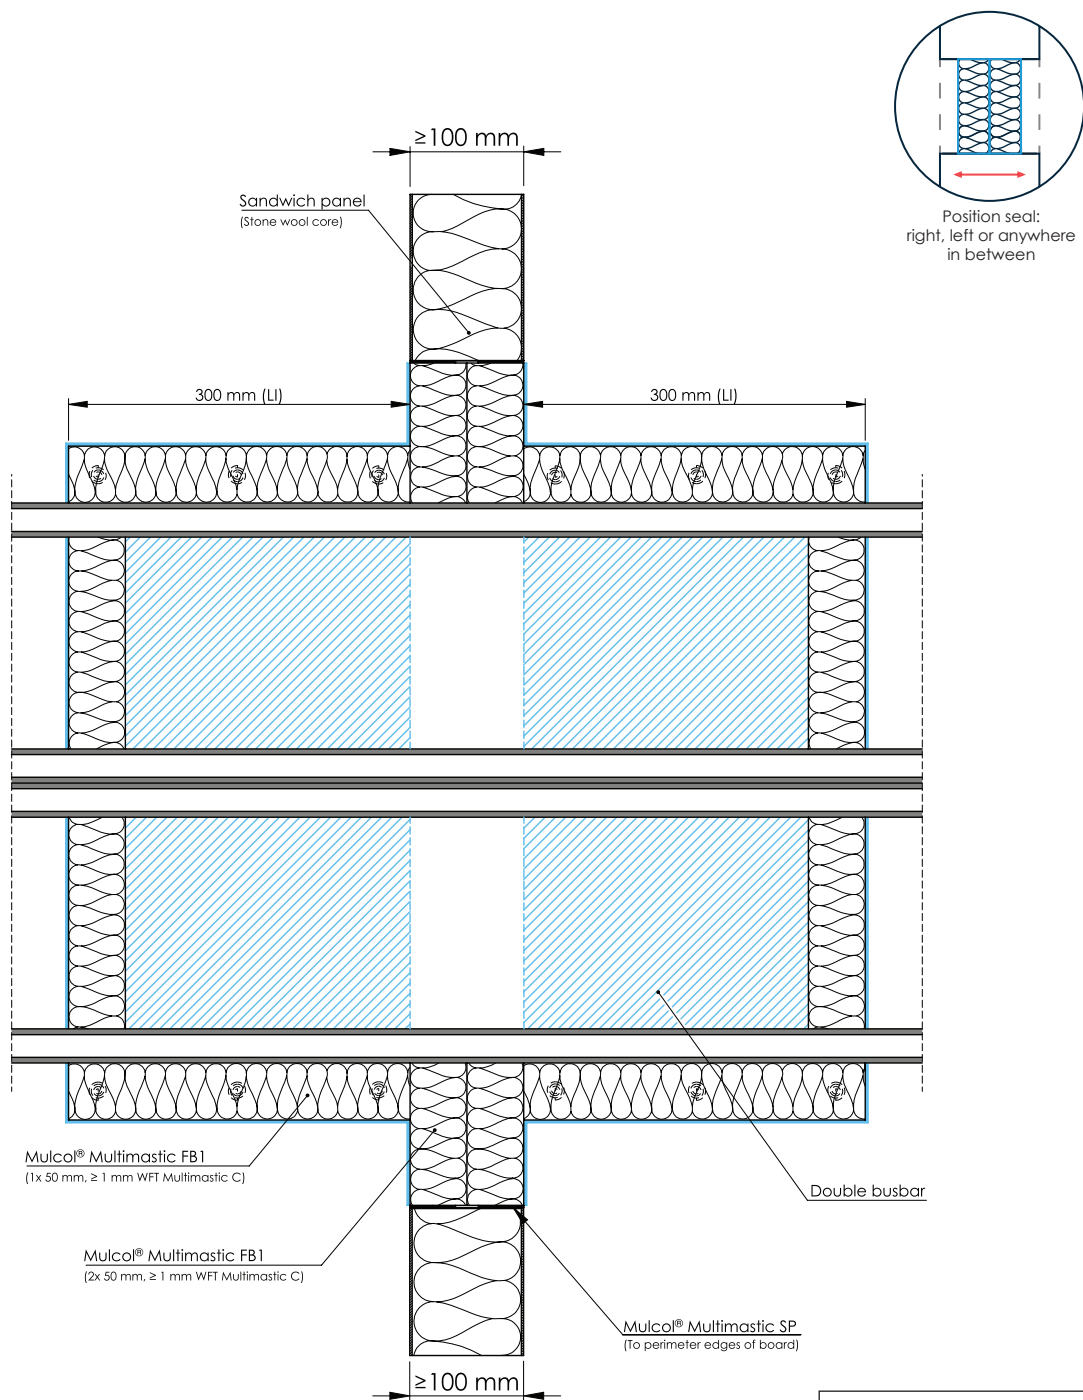


Drawing: SW.E-2BB-MFB1.2.10

Services	Service dimensions		Insulation			Classification
	Outside dimension	Conductor	Type	Thickness (mm)	Configuration	
Multiple busbars	≤ 150 x 500 mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 300 / CI	EI 120

A.4.10 Multimastic FB1 - 2x 50 mm - Busbar


A.4.10.2 Multiple busbars - LI 300

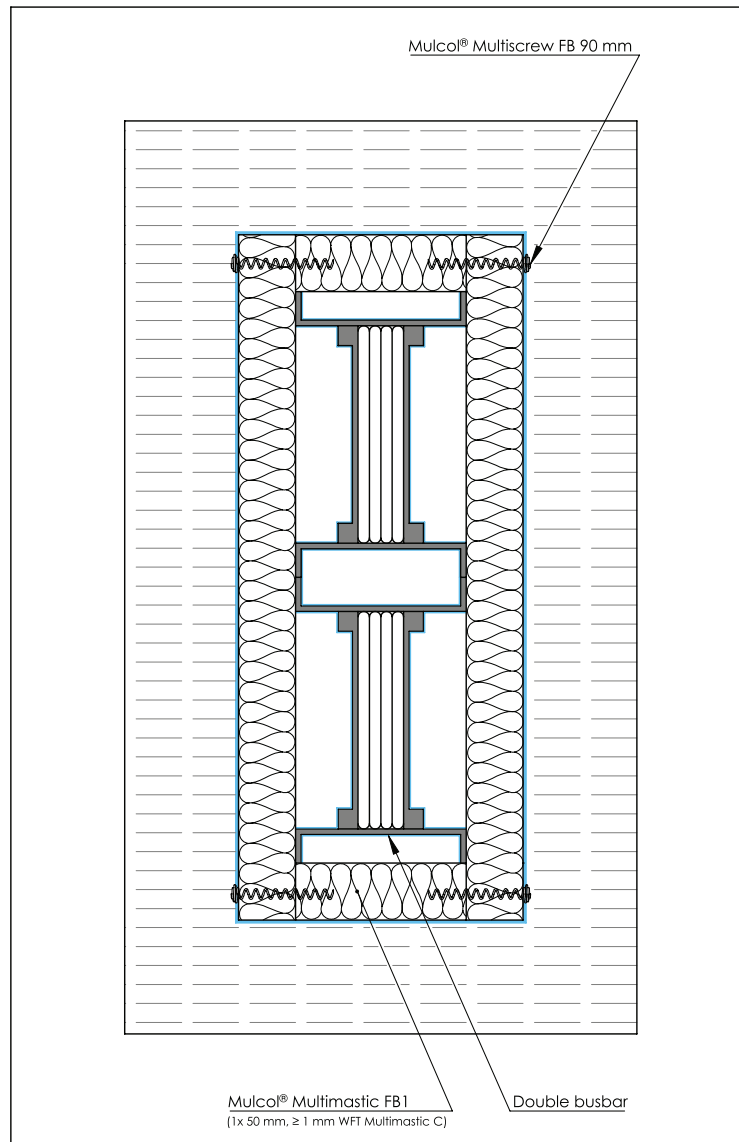

Drawing: SW.E-2BB-MFB1.2.10

B.1.1 Multimastic FB1 - 2x 50 mm no cavity - Cables, trays and conduits

B.1.1.1 Cables, trays and conduits - Multimastic C



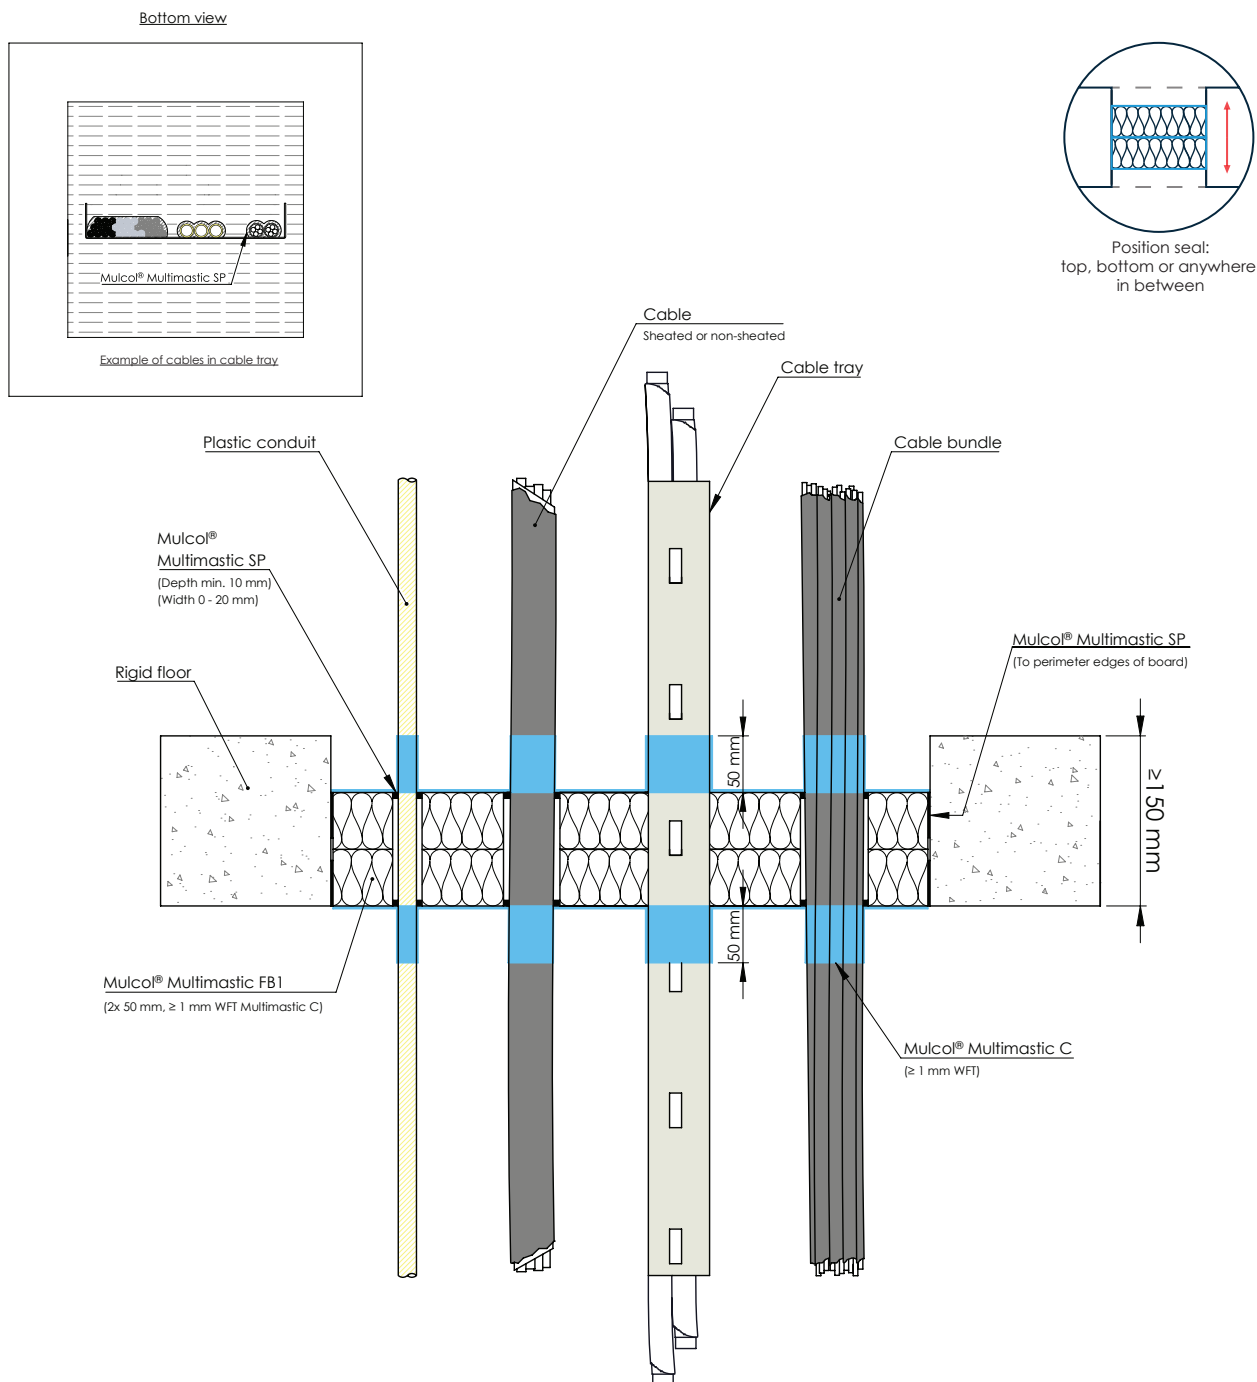


Drawing: PBrf.E-CT-4-MFB1.2.10

Services	Coating	Classification
Metal cable ladders	Coat back 50 mm ≥ 1 mm WFT Multimastic C	EI 90, E 120
Metal (non-)perforated cable trays		EI 60, E 120
Steel wire mesh cable trays (baskets)		EI 90 U/C, E 120 U/C
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 45, E 120
Cables ≤ Ø 50 mm		
Plastic conduits ≤ Ø 16 mm		
Non sheathed cables ≤ Ø 24 mm		

B.1.1 Multimastic FB1 - 2x 50 mm no cavity - Cables, trays and conduits

B.1.1.2 Cables and trays - Multitherm Bandage

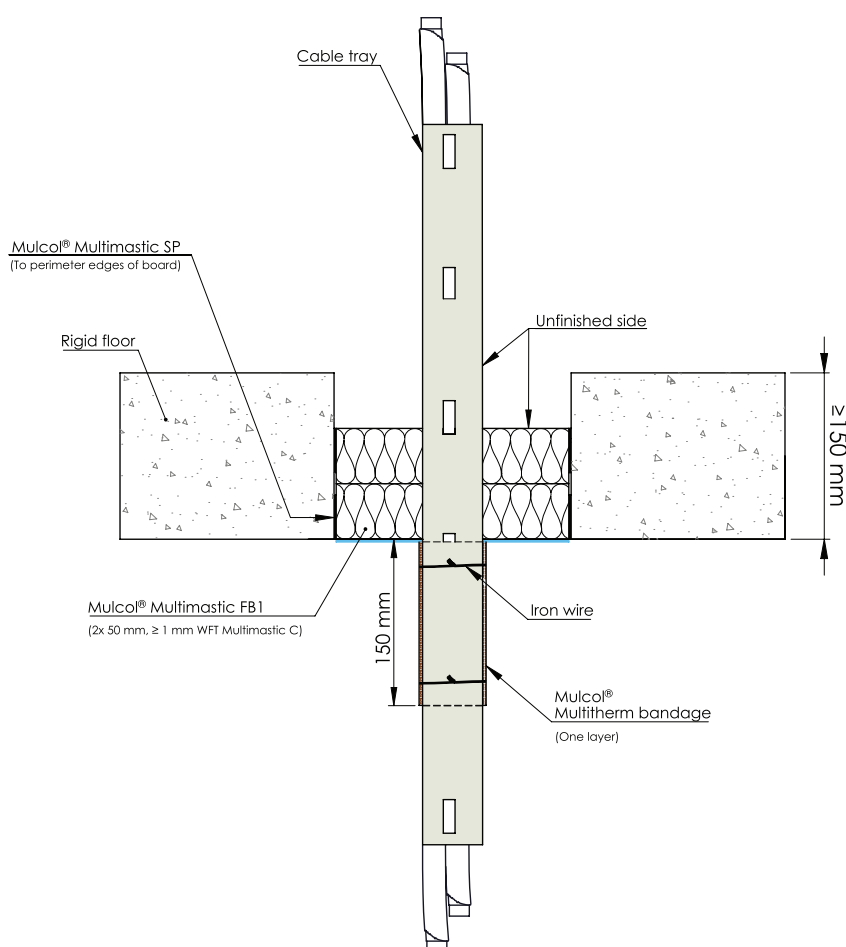

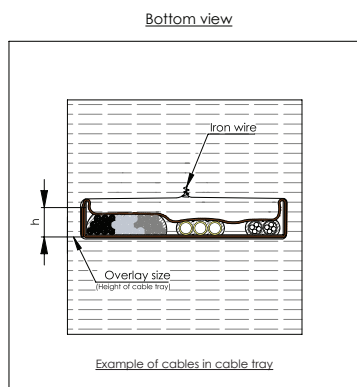


Drawing: PBrf.E-CT-MFB1-B1.1.10

Services	Insulation (mm)	Classification
Metal cable ladders	LI 150 Multitherm Bandage bottom of floor (two wires)	EI 60, E 120
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 21 mm		

B.1.1 Multimastic FB1 - 2x 50 mm no cavity - Cables, trays and conduits

B.1.1.2 Cables and trays - Multitherm Bandage

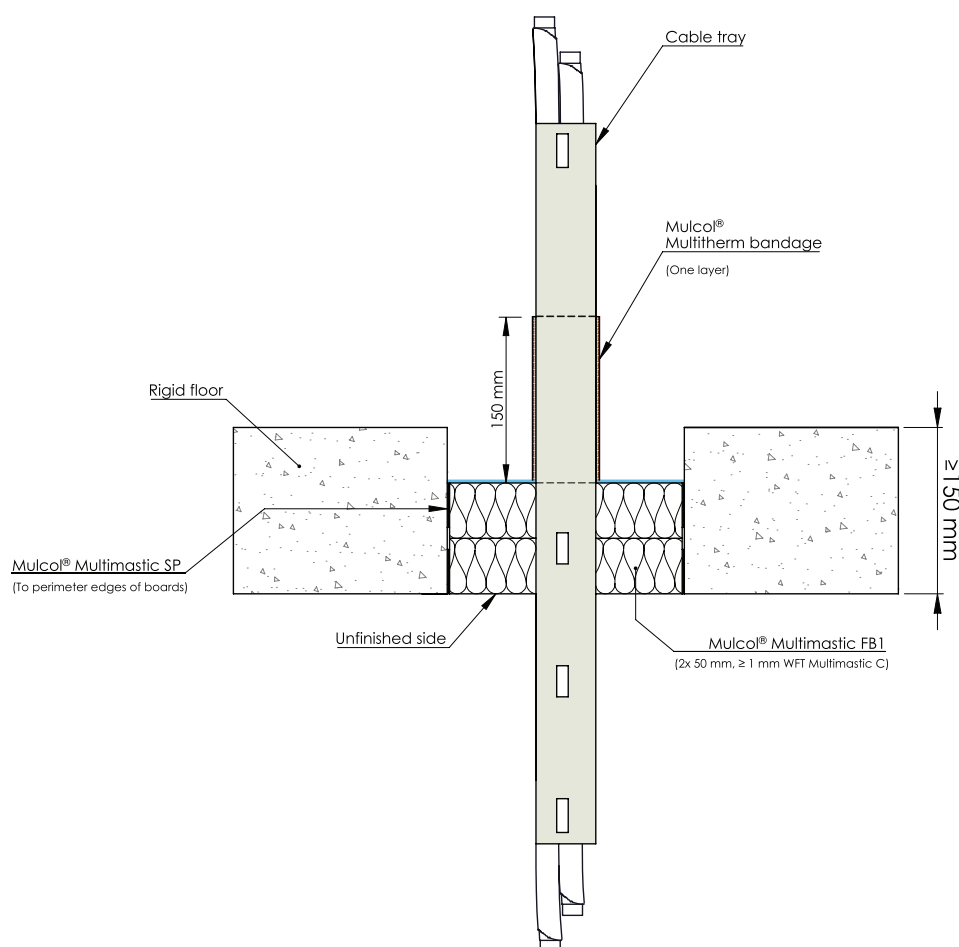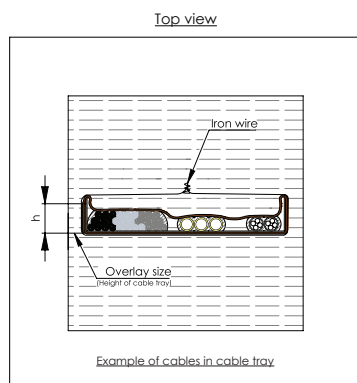


Drawing: PBrf.E-CT-MFB1-B3.1.10


Services	Insulation (mm)	Classification
Metal cable ladders	LI 150 - Multitherm Bandage top of floor	EI 90, E 120
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 21 mm		

B.1.1 Multimastic FB1 - 2x 50 mm no cavity - Cables, trays and conduits

B.1.1.3 Cables and trays - Multifoam 2K



Position seal:
top, bottom or anywhere
in between



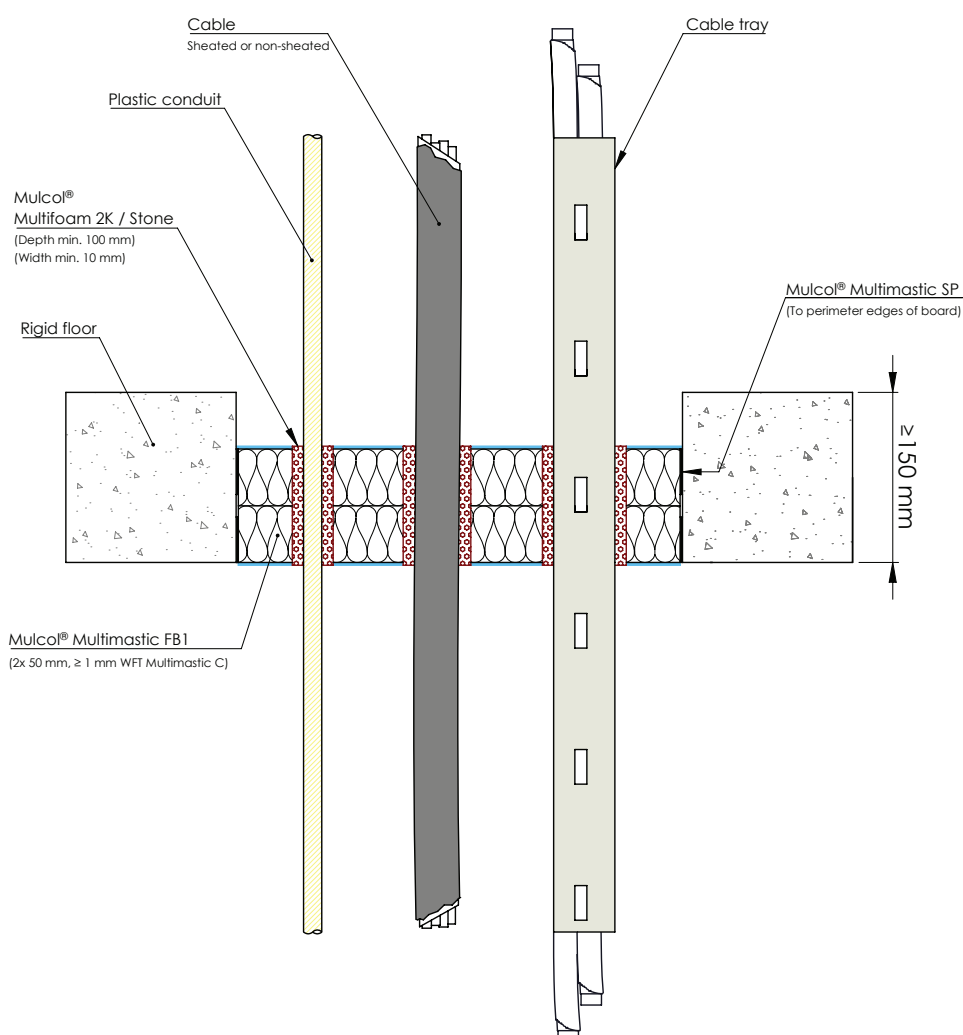


Drawing: PBrf.E-CT-3-MF-MFB1.2.10

Services	Sealing (mm)	Classification
Metal cable ladders	Multifoam 2K / Stone ≥ 0 x 100 (wxd)	EI 60, E 120
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 21 mm	Multifoam 2K / Stone ≥ 10 x 100 (wxd)	EI 60 C/U, E 90 C/U
Plastic conduits ≤ Ø 16 mm		

B.1.1 Multimastic FB1 - 2x 50 mm no cavity - Cables, trays and conduits

B.1.1.4 Single plastic conduits - Multidisc

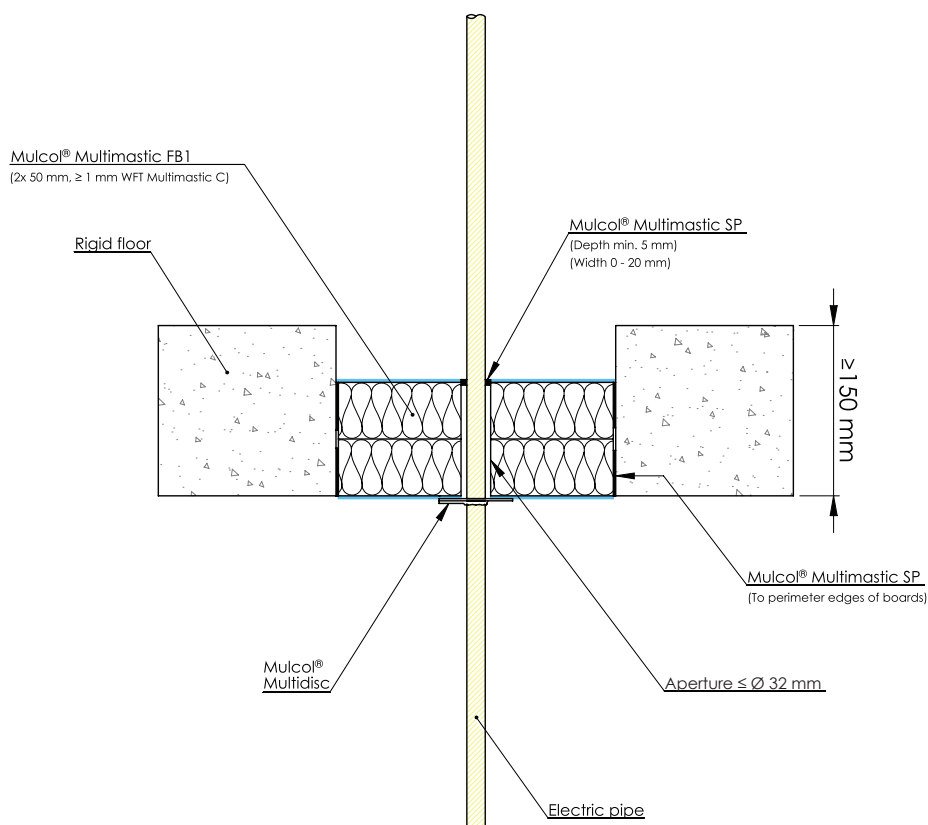

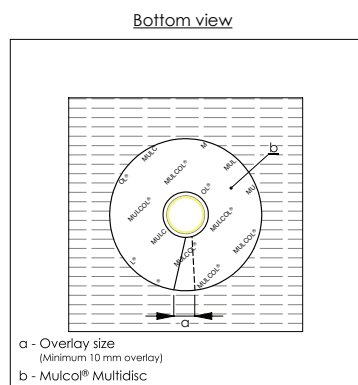


Drawing: PBrf.E-MFB1-EP19-M2.0.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Plastic conduits $\leq \varnothing 25$ mm, with or without cables	Multidisc bottom of floor	$\leq \varnothing 32$	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 90 U/U, E 120 U/U

B.1.1 Multimastic FB1 - 2x 50 mm no cavity - Cables, trays and conduits

B.1.1.5 Multiple plastic conduits - Multidisc

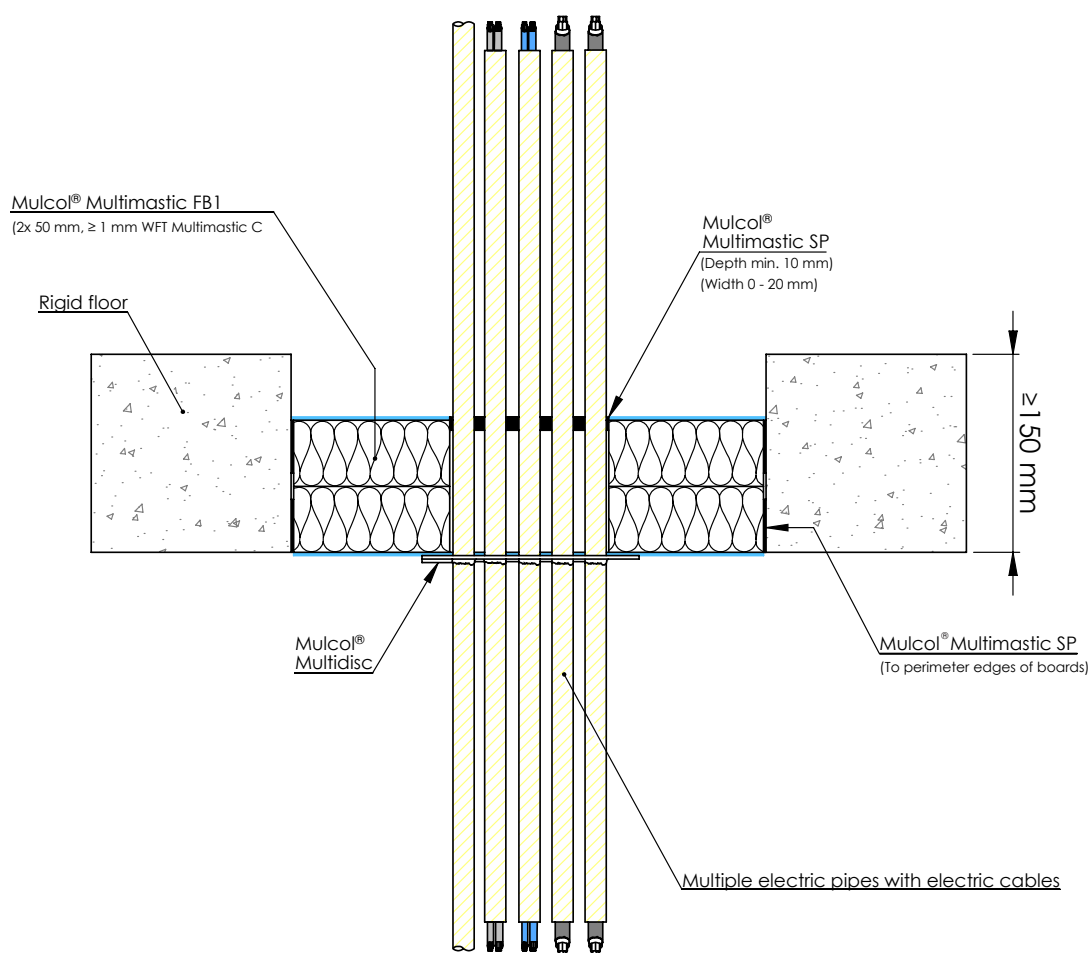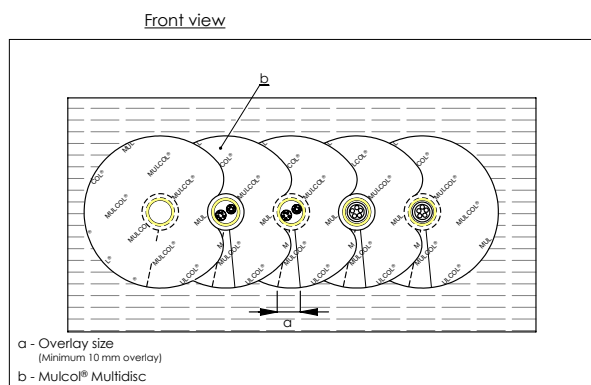


Drawing: PBrf.E-EP-M5.0.30

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Multiple plastic conduits, max 5 pcs. $\leq \varnothing 16$ mm, with or without cables	Multidisc bottom of floor	$\leq \varnothing 32$	Multimastic SP 0-10 x ≥ 20 (wxd) top of floor	EI 90 U/U, E 120 U/U

B.1.1 Multimastic FB1 - 2x 50 mm no cavity - Cables, trays and conduits

B.1.1.6 Single cables - Multidisc


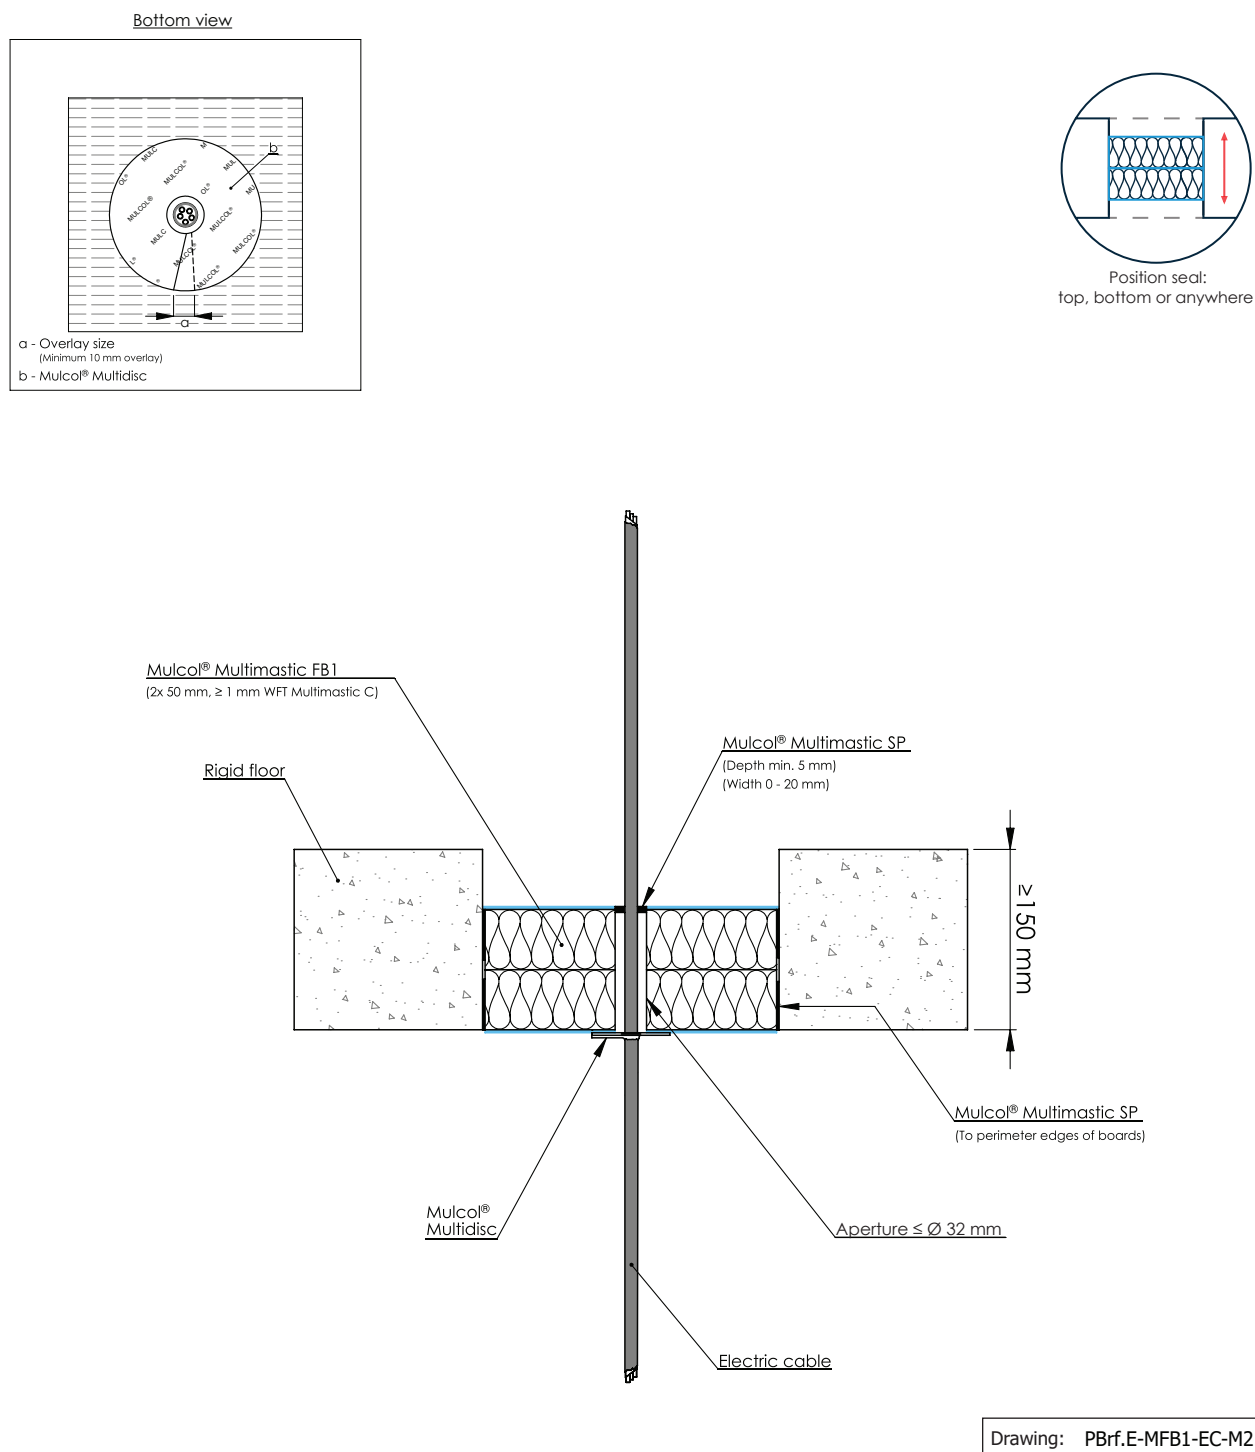


Services	Product	Aperture (mm)	Sealing (mm)	Classification
Cables ≤ Ø 12 mm (e.g. YMKV 5x2.5 mm ²)	Multidisc bottom of floor	≤ Ø 32	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 90, E 120


B.1.1 Multimastic FB1 - 2x 50 mm no cavity - Cables, trays and conduits

B.1.1.7 Multiple cables - Multidisc

Bottom view

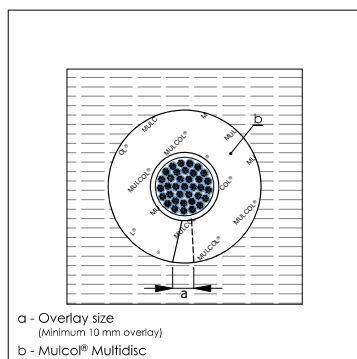

Position seal:
top, bottom or anywhere
in between



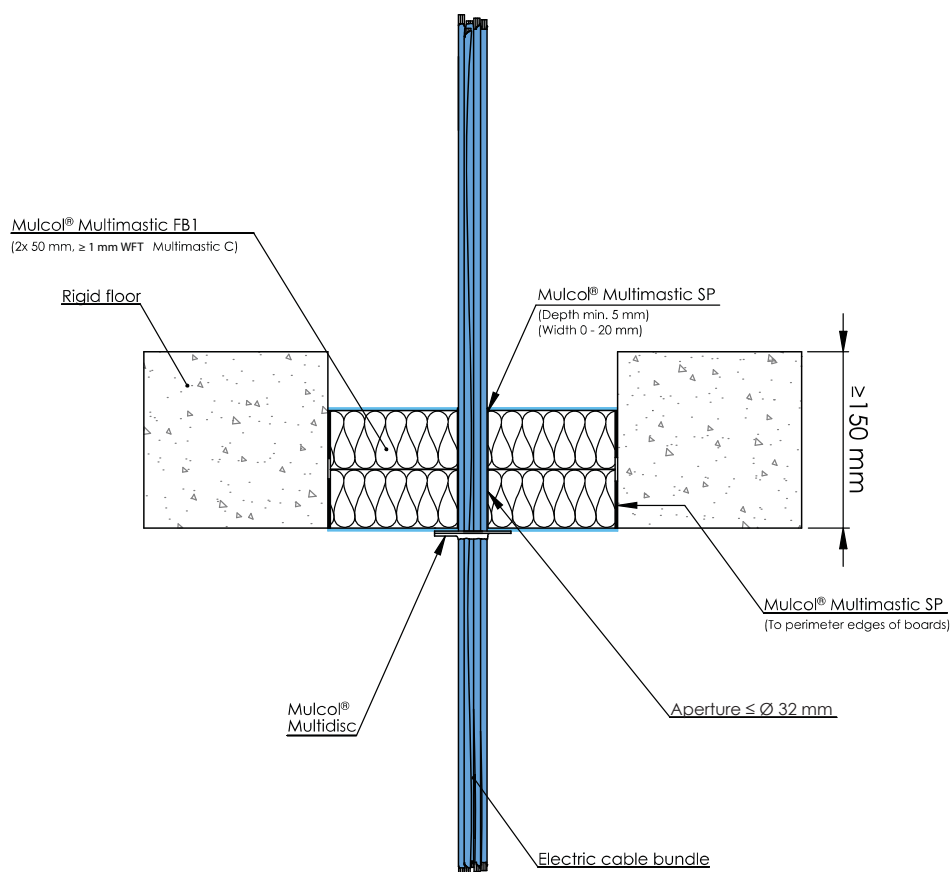


Drawing: PBrf.E-MFB1-ECB-M2.0.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Telecommunication cables ≤ Ø 15 max 15 pcs	Multidisc bottom of floor	≤ Ø 32	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 60, E 120

B.1.1 Multimastic FB1 - 2x 50 mm no cavity - Cables, trays and conduits

B.1.1.8 Multiple plastic conduits - Multisealant GR

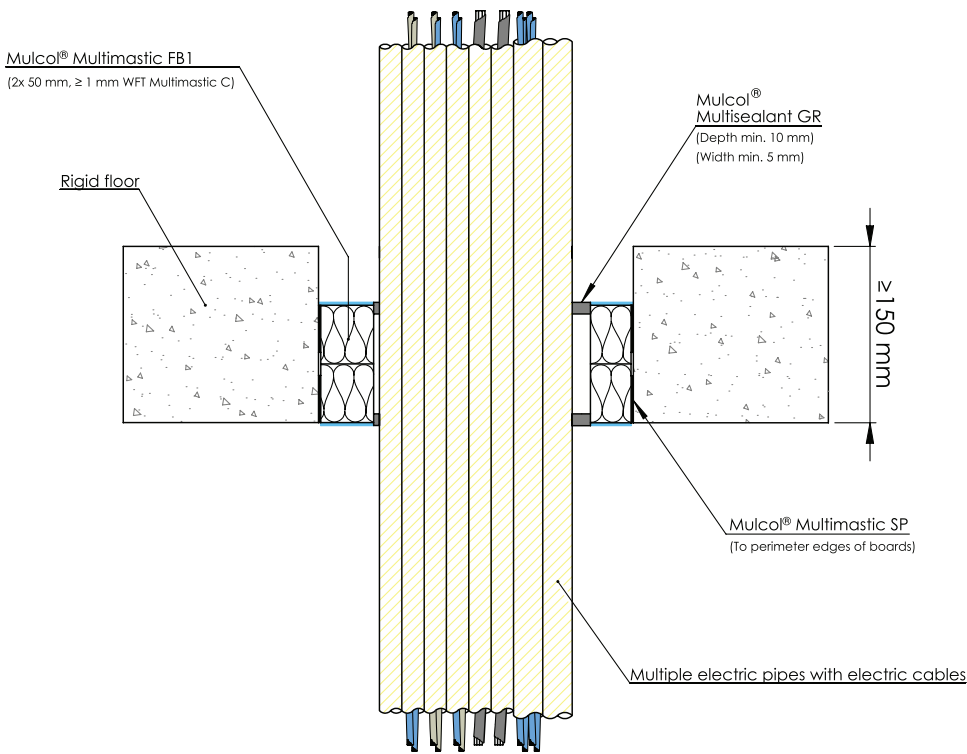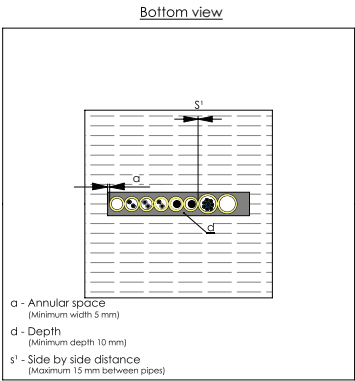


Drawing: PBrf.E-EP8-G2.1.10

Services	Sealing (mm)	Classification
Multiple plastic conduits ≤ Ø 25 mm, max 8 pcs. with or without cables	Multisealant GR ≥ 5x10 mm (wxd)	EI 90 U/U

B.1.2 Multimastic FB1 - 2x 50 mm cavity 50 mm - Cables, trays and conduits

B.1.2.1 Cables, trays and conduits - Multimastic C



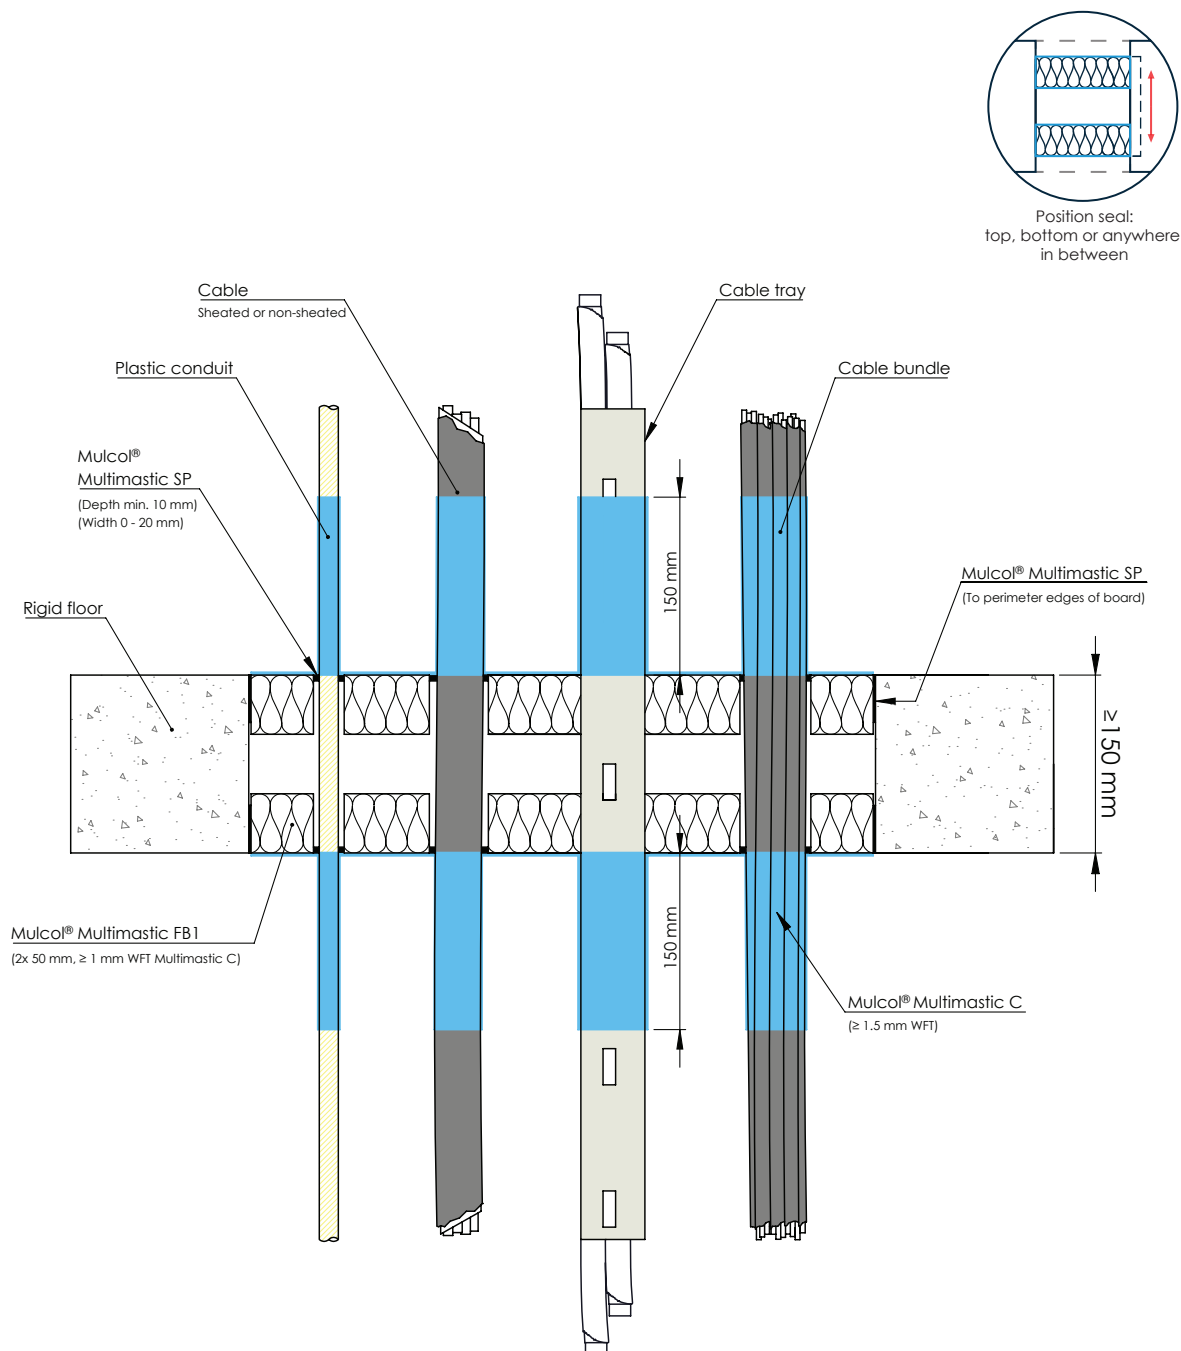


Drawing: PBrf.E-CT-4-MFB1.2.10.C

Services	Coating	Classification
Metal cable ladders	Coat back 150 mm ≥ 1.5 mm WFT Multimastic C	EI 120
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 120 U/C
Non sheathed cables ≤ Ø 17 mm		
Plastic conduits ≤ Ø 16 mm		EI 90, E 120
Cables ≤ Ø 80 mm		
Non sheathed cables ≤ Ø 24 mm		

B.1.2 Multimastic FB1 - 2x 50 mm cavity 50 mm - Cables, trays and conduits

B.1.2.2 Cables and trays - Multitherm Bandage

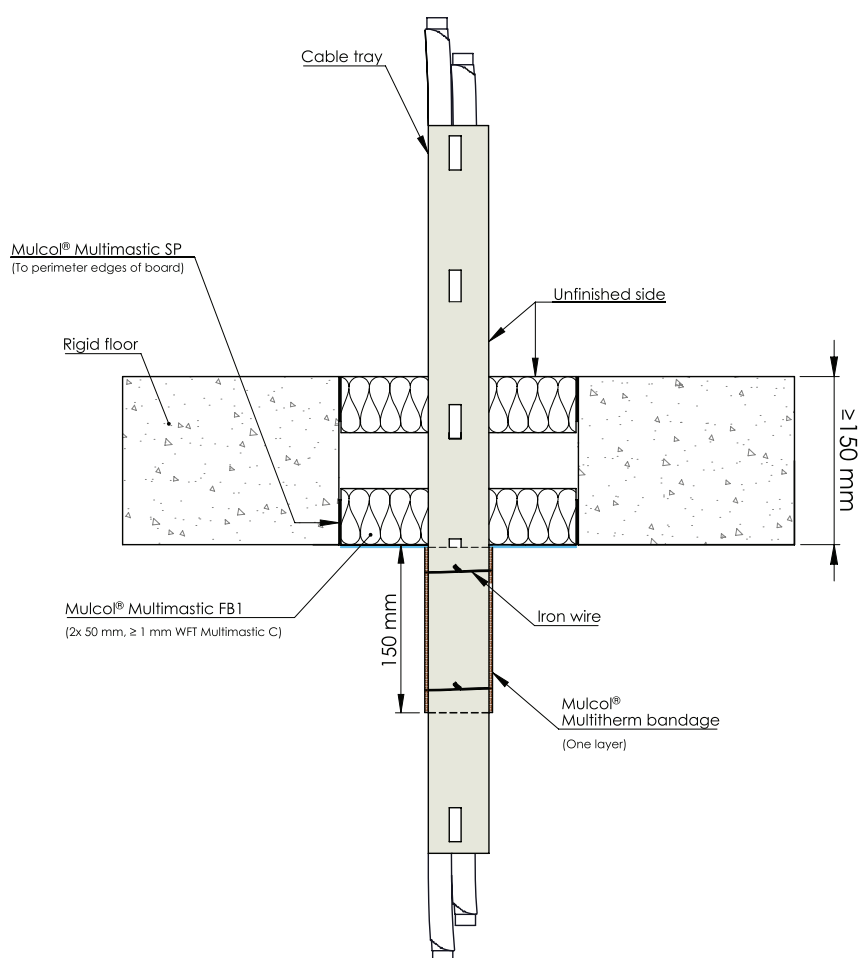

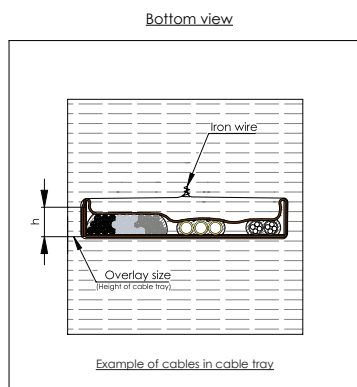


Drawing: PBrf.E-CT-MFB1-B1.1.10.C

Services	Insulation	Classification
Metal cable ladders	LI 150 Multitherm Bandage bottom of floor (two wires)	EI 60, E 120
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 21 mm		

B.1.2 Multimastic FB1 - 2x 50 mm cavity 50 mm - Cables, trays and conduits

B.1.2.2 Cables and trays - Multitherm Bandage

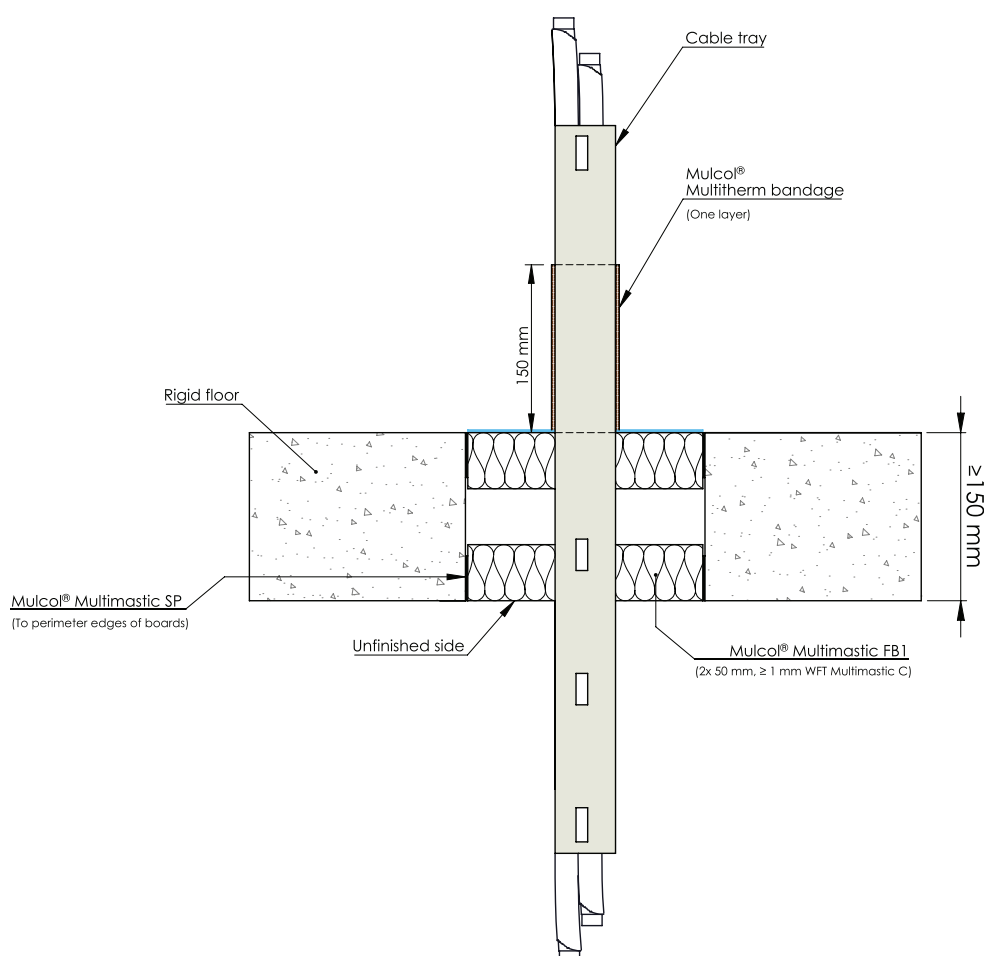


Drawing: PBrf.E-CT-MFB1-B3.1.10.C

Services	Insulation	Classification
Metal cable ladders	LI 150 Multitherm Bandage top of floor	EI 90, E 120
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 21 mm		

B.1.2 Multimastic FB1 - 2x 50 mm cavity 50 mm - Cables, trays and conduits

B.1.2.3 Cables and trays - Multifoam 2K



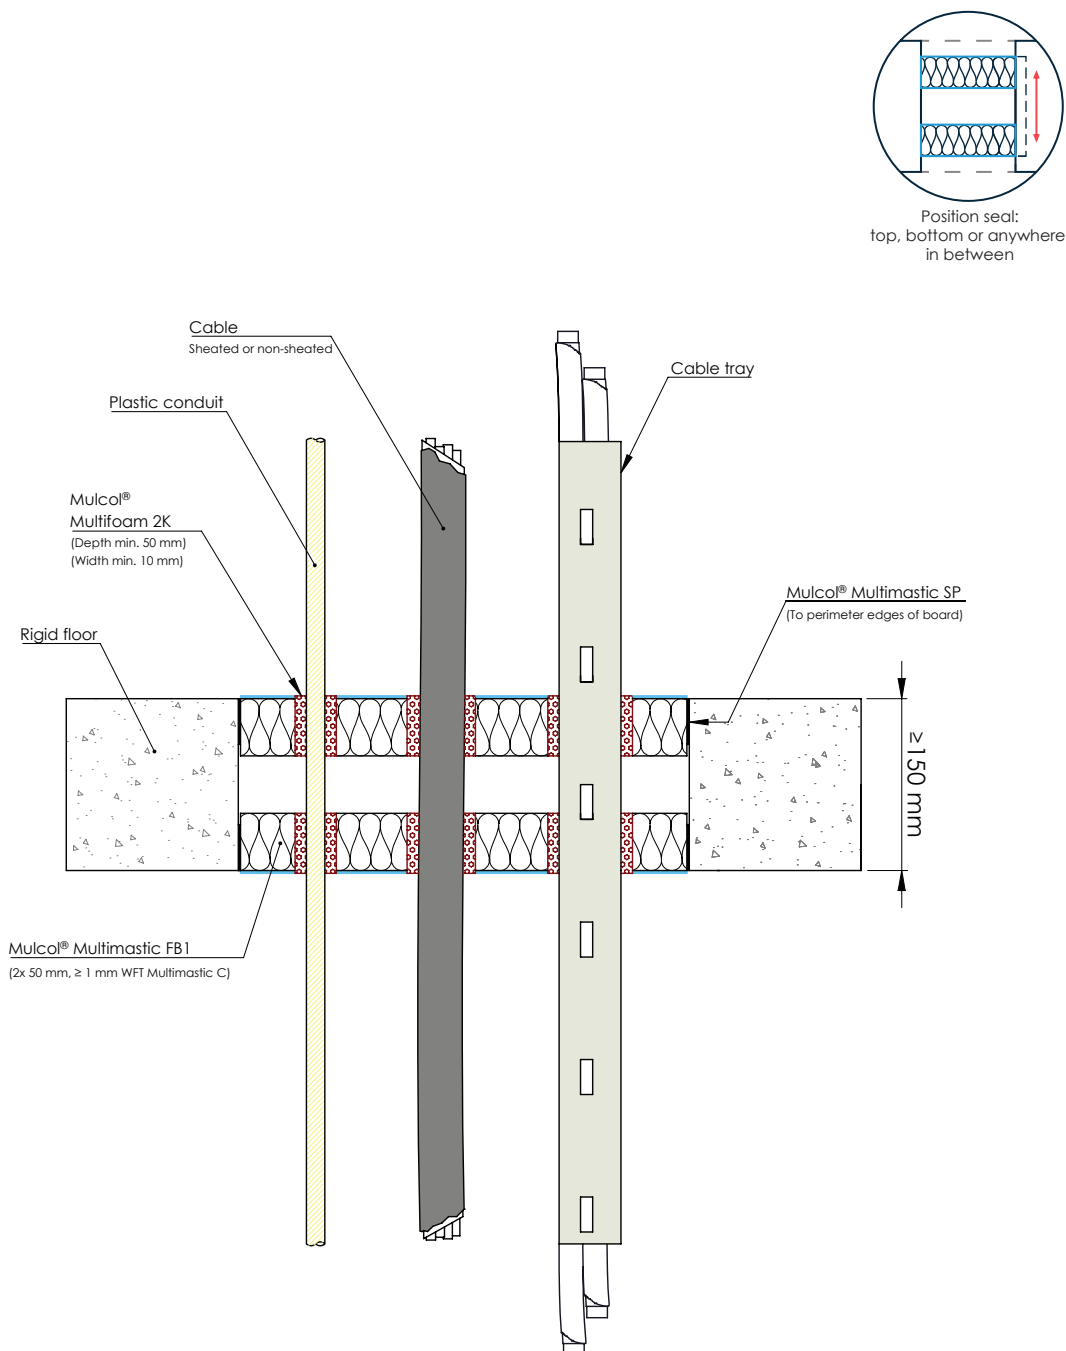


Drawing: PBrf.E-CT-3-MF-MFB1.2.10.C

Services	Sealing (mm)	Classification
Metal cable ladders	Multifoam 2K / Stone ≥ 0 x 100 (wxd)	EI 60, E 120
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 21 mm	Multifoam 2K / Stone ≥ 10 x 100 (wxd)	EI 60, E 90
Plastic conduits ≤ Ø 16 mm		

B.1.2 Multimastic FB1 - 2x 50 mm cavity 50 mm - Cables, trays and conduits

B.1.2.4 Single plastic conduits - Multidisc

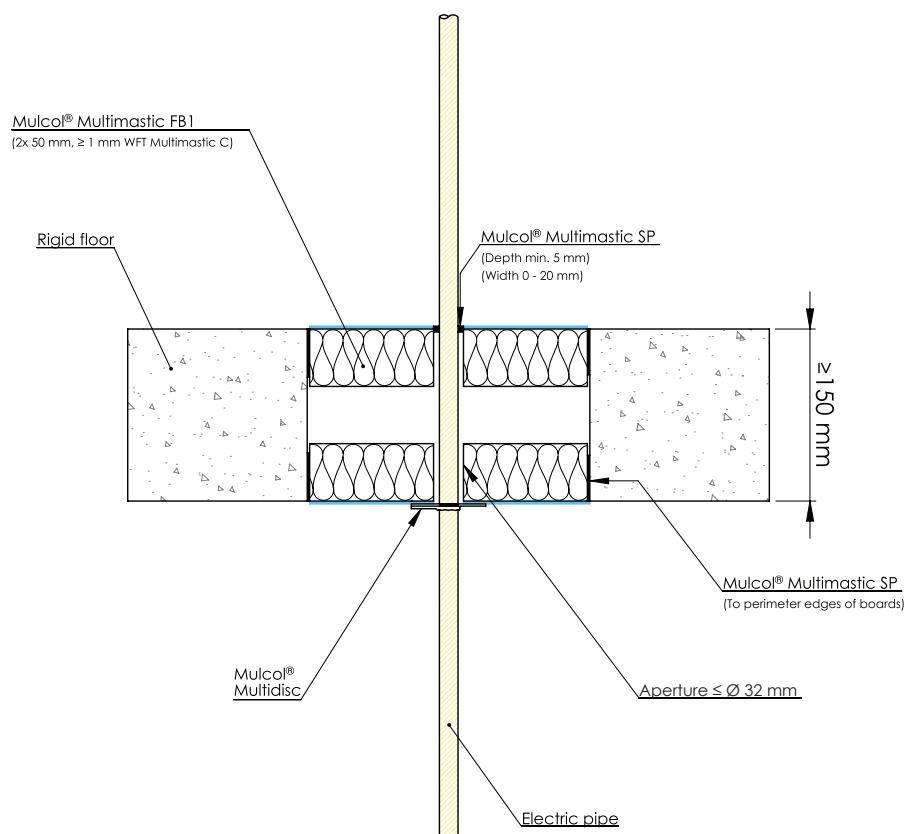

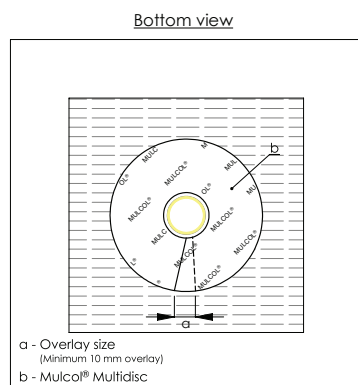


Drawing: PBrf.E-MFB1-EP19-M2.0.10.C

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Plastic conduits ≤ Ø 25 mm with or without cables	Multidisc bottom of floor	≤ Ø 32	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 90 U/U, E 120 U/U

B.1.2 Multimastic FB1 - 2x 50 mm cavity 50 mm - Cables, trays and conduits

B.1.2.5 Multiple plastic conduits - Multidisc

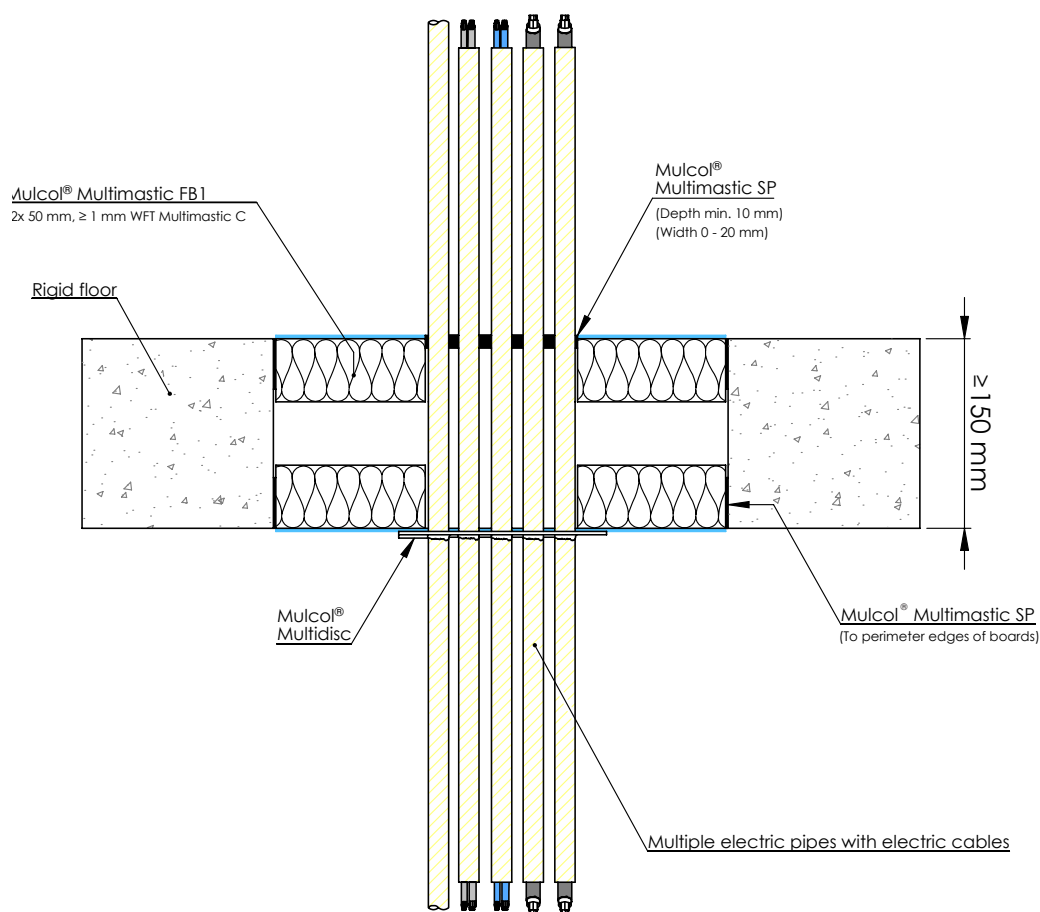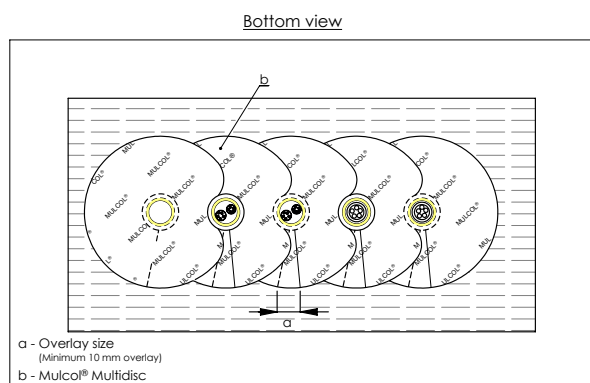



Drawing: PBrf.E-EP-M5.0.30.C

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Plastic conduits ≤ Ø 25 mm with or without cables	Multidisc bottom of floor	≤ Ø 32	Multimastic SP ≥ 0-20 x 5 (wxd) top of floor	EI 90 U/U, E 120 U/U


B.1.2 Multimastic FB1 - 2x 50 mm cavity 50 mm - Cables, trays and conduits

B.1.2.6 Single cables - Multidisc

Bottom view

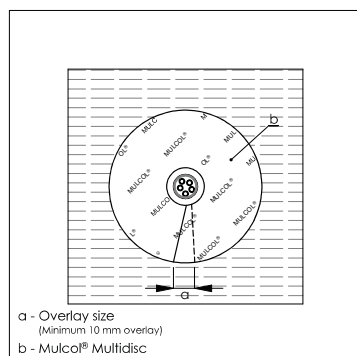

Position seal:
top, bottom or anywhere
in between

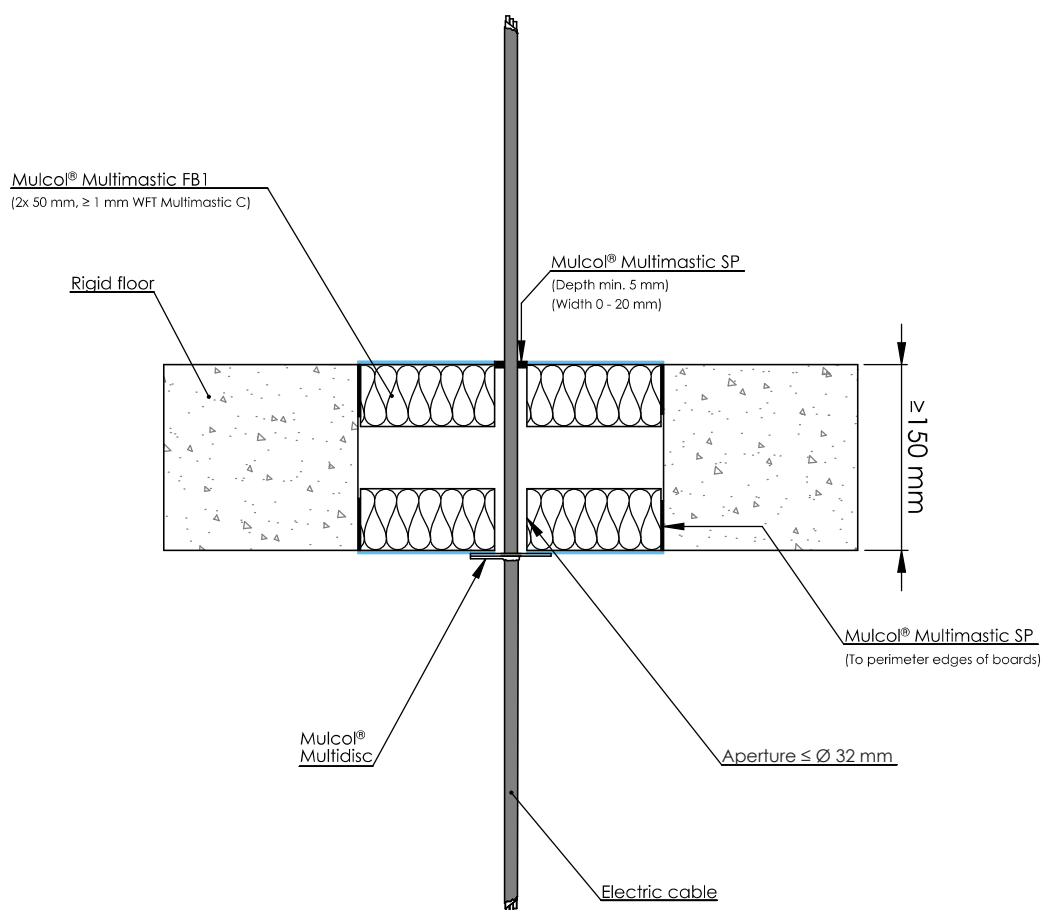



Drawing: PBrf.E-MFB1-EC-M2.0.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Cables $\leq \varnothing 12$ mm (e.g. YMKV 5x2.5 mm ²)	Multidisc bottom of floor	$\leq \varnothing 32$	Multimastic SP $\geq 0-20 \times 5$ (wxd) top of floor	EI 120


B.1.2 Multimastic FB1 - 2x 50 mm cavity 50 mm - Cables, trays and conduits

B.1.2.7 Multiple cables - Multidisc

Bottom view

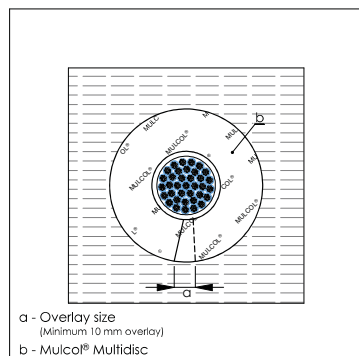

Position seal:
top, bottom or anywhere
in between

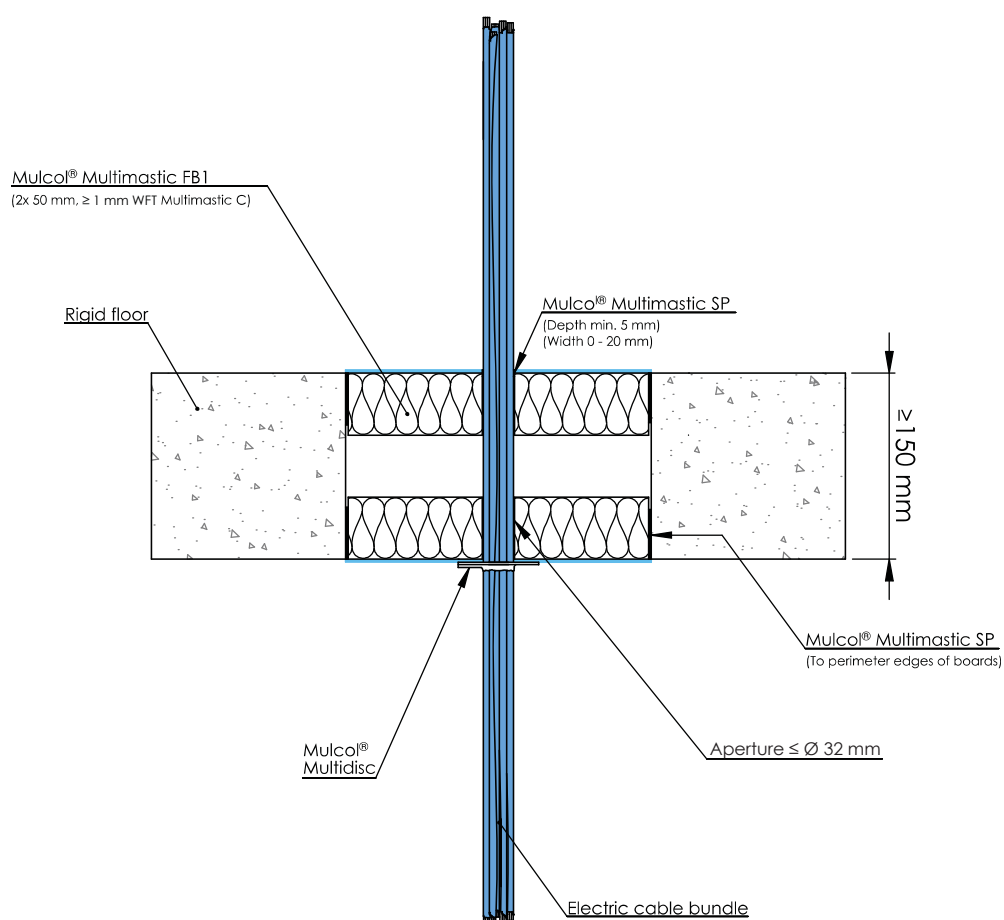


Drawing: PBrf.E-MFB1-ECB-M2.0.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Telecommunication cables ≤ Ø 15 max 15 pcs	Multidisc bottom of floor	≤ Ø 32	Multimastic SP ≥ 0-20 x 5 (wxd) top of floor	EI 60, E 120

B.1.3 Multimastic FB2 - 1x 60 mm - Cables, trays and conduits

B.1.3.1 Cables, trays and conduits - Multimastic C

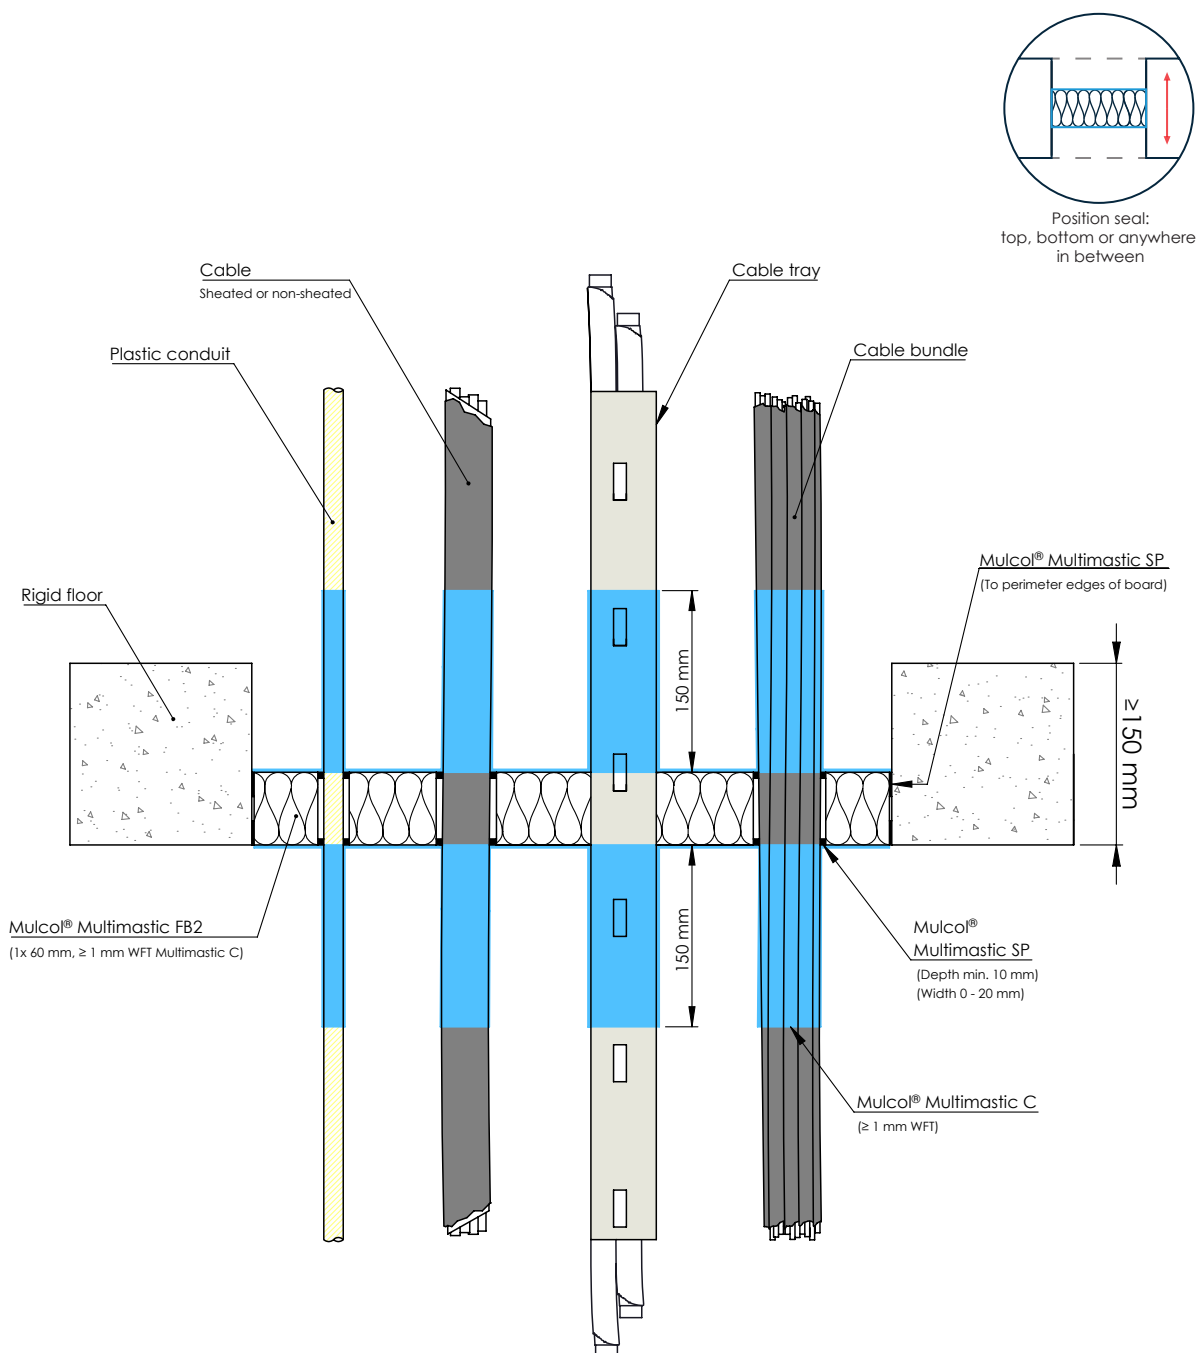




Drawing: PBrf.E-CT-4-MFB2.1.10

Services	Coating	Classification
Metal cable ladders	Coat back 150 mm ≥ 1 mm WFT Multimastic C	EI 90, E 120
Metal (non-)perforated cable trays		EI 60, E 120
Steel wire mesh cable trays (baskets)		
Cables ≤ Ø 50 mm		EI 90, E 120
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 45, E 120
Plastic conduits ≤ Ø 16 mm		
Non sheathed cables ≤ Ø 24 mm		

B.1.3 Multimastic FB2 - 1x 60 mm - Cables, trays and conduits

B.1.3.2 Single plastic conduits - Multidisc

Bottom view

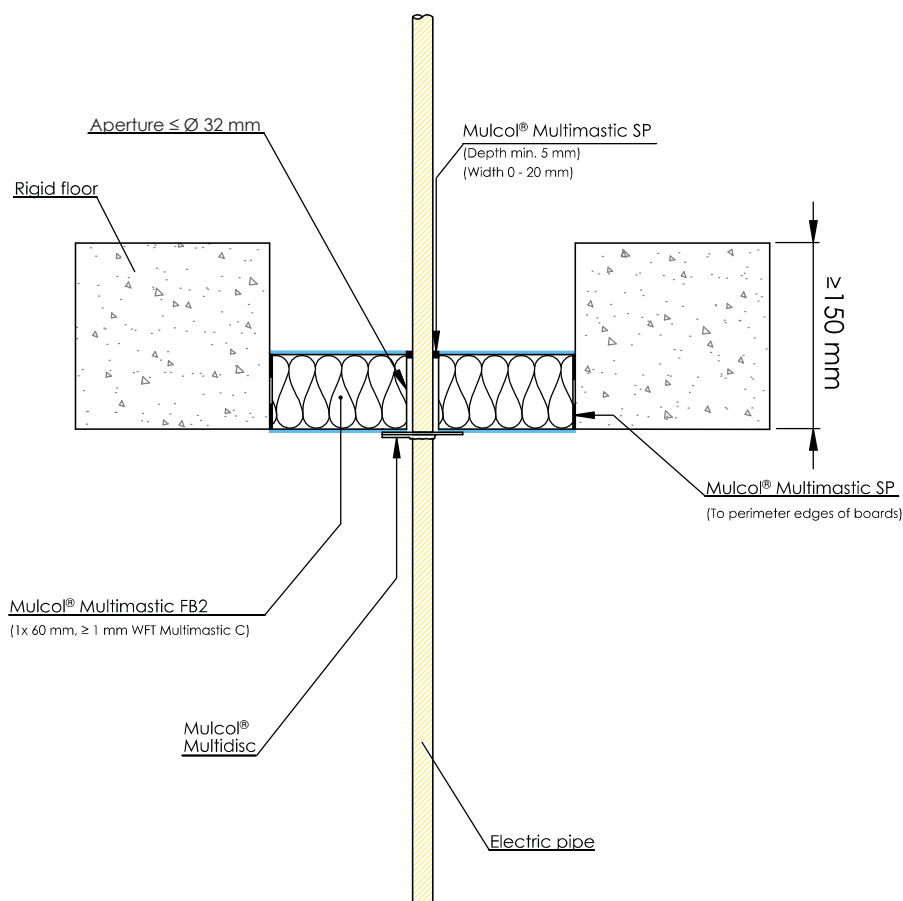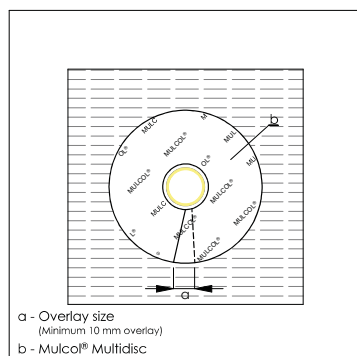



Drawing: PBf.E-MFB2-EP19-M2.0.1

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Plastic conduits $\leq \varnothing 25$ mm with or without cables	Multidisc bottom of floor	$\leq \varnothing 32$	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 60 U/C, E 90 U/C


B.1.3 Multimastic FB2 - 1x 60 mm - Cables, trays and conduits

B.1.3.3 Single cables - Multidisc

Bottom view

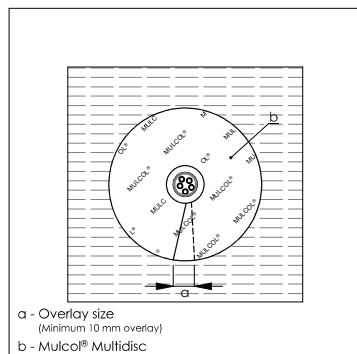



Position seal:
top, bottom or anywhere
in between

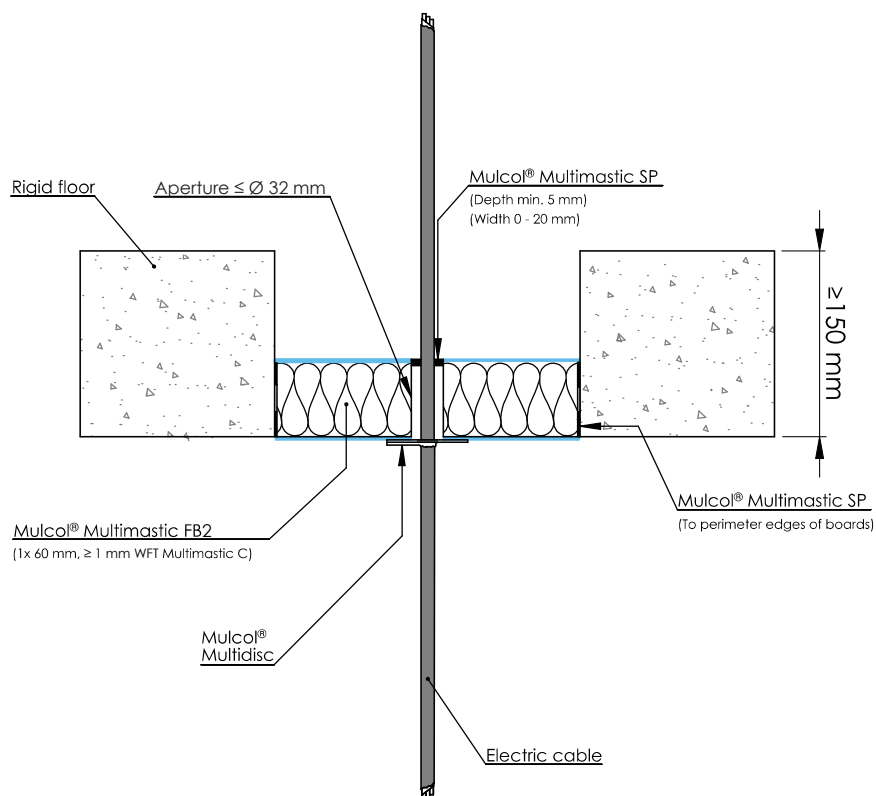

Drawing: PBrf.E-MFB2-EC-M2.0.1

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Cables $\leq \varnothing 12$ mm (e.g. YMKV 5x2.5 mm ²)	Multidisc bottom of floor	$\leq \varnothing 32$	Multimastic SP $\geq 0-20 \times 5$ (wxd) top of floor	EI 60, E 90

B.1.4.1 Plastic pipes - Multicollar *Slim*





Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	2.7	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 90 U/U
		2.7 - 6.6			EI 60 U/U
PP		2.7			EI 90 U/U
		2.7 - 6.3			EI 60 U/U
PVC(-U/-C)		2.7			EI 90 U/U
		2.7 - 6.3			EI 60 U/U
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 160	4.0			EI 90 U/C, E 120 U/C
		4.0 - 14.6			EI 60 U/C
PP		4.0			
		4.0 - 14.6			EI 45 U/C, E 60 U/C


B.1.4 Multimastic FB1 - 2x 50 mm no cavity - Combustible pipes

B.1.4.2 Plastic pipes - Multiwrap

Bottom view

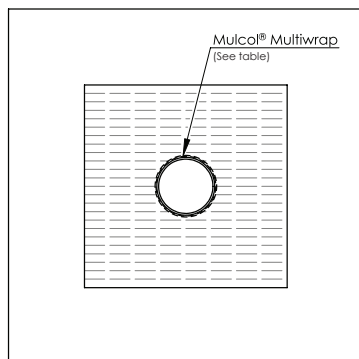

Position seal:
top, bottom or anywhere
in between



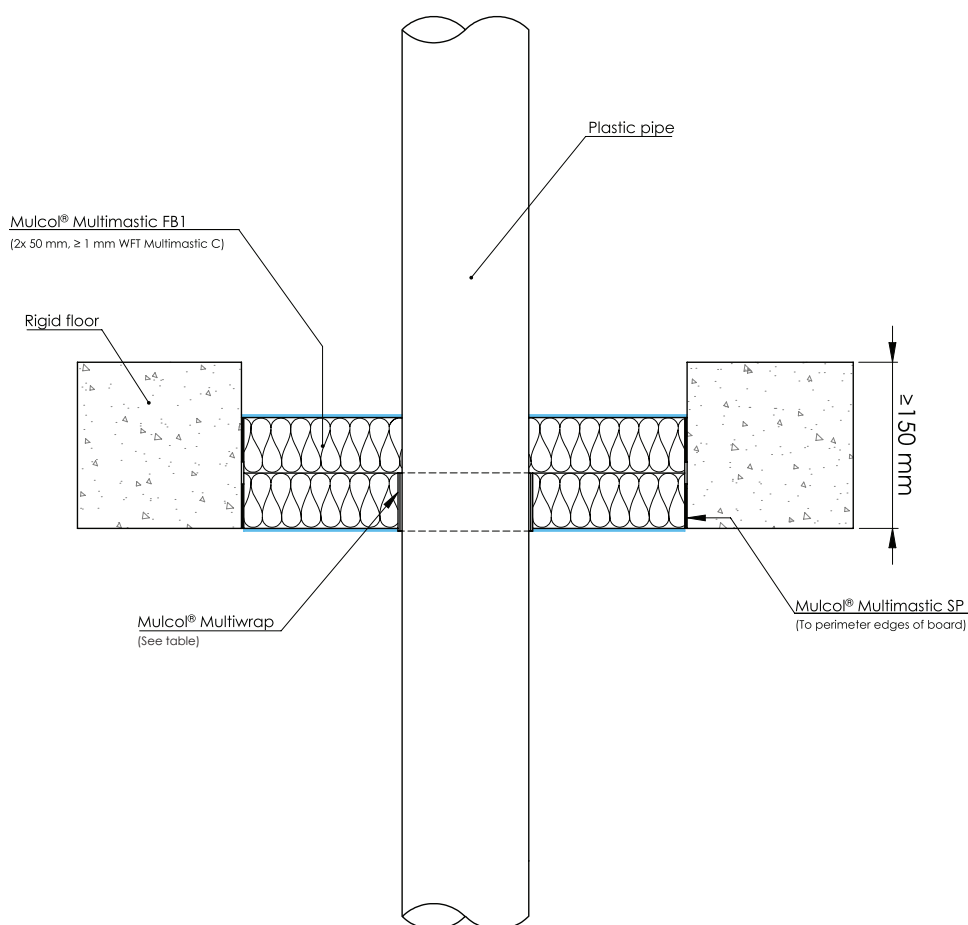


Drawing: PBrf.E-PP-MW2-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PVC(-U/-C)	≤ Ø 110	3.2	Multiwrap (2 layers)	EI 120 U/C

B.1.4 Multimastic FB1 - 2x 50 mm no cavity - Combustible pipes

B.1.4.3 Plastic pipes (Silent) - Multicollar *Slim*

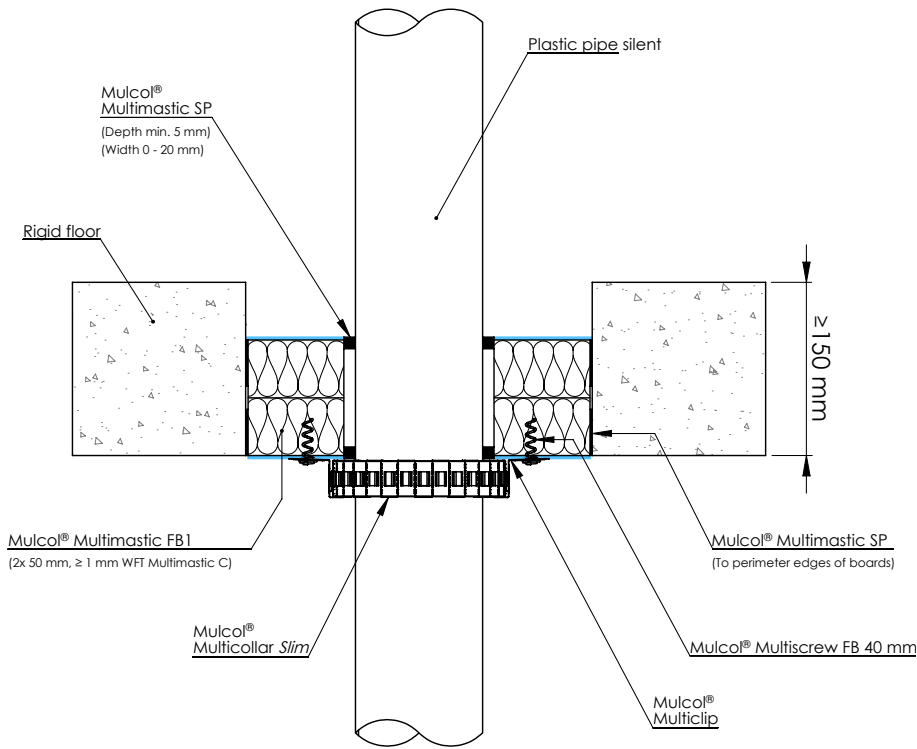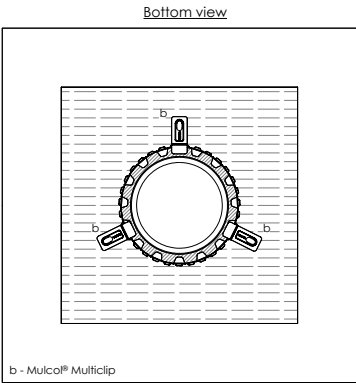



Drawing: PBrf.E-PPS-MFB1.2.10

Services	Pipe dimensions (mm)		System	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Geberit Silent dB20	≤ Ø 110	6.0	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 90 U/U


B.1.4 Multimastic FB1 - 2x 50 mm no cavity - Combustible pipes

B.1.4.4 Plastic pipes (Silent) - Multiwrap

Bottom view

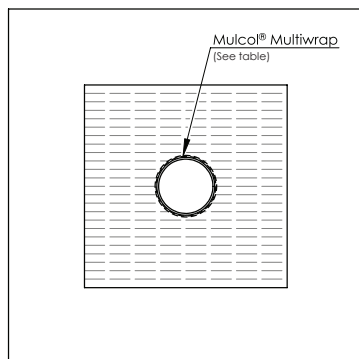

Position seal:
top, bottom or anywhere
in between



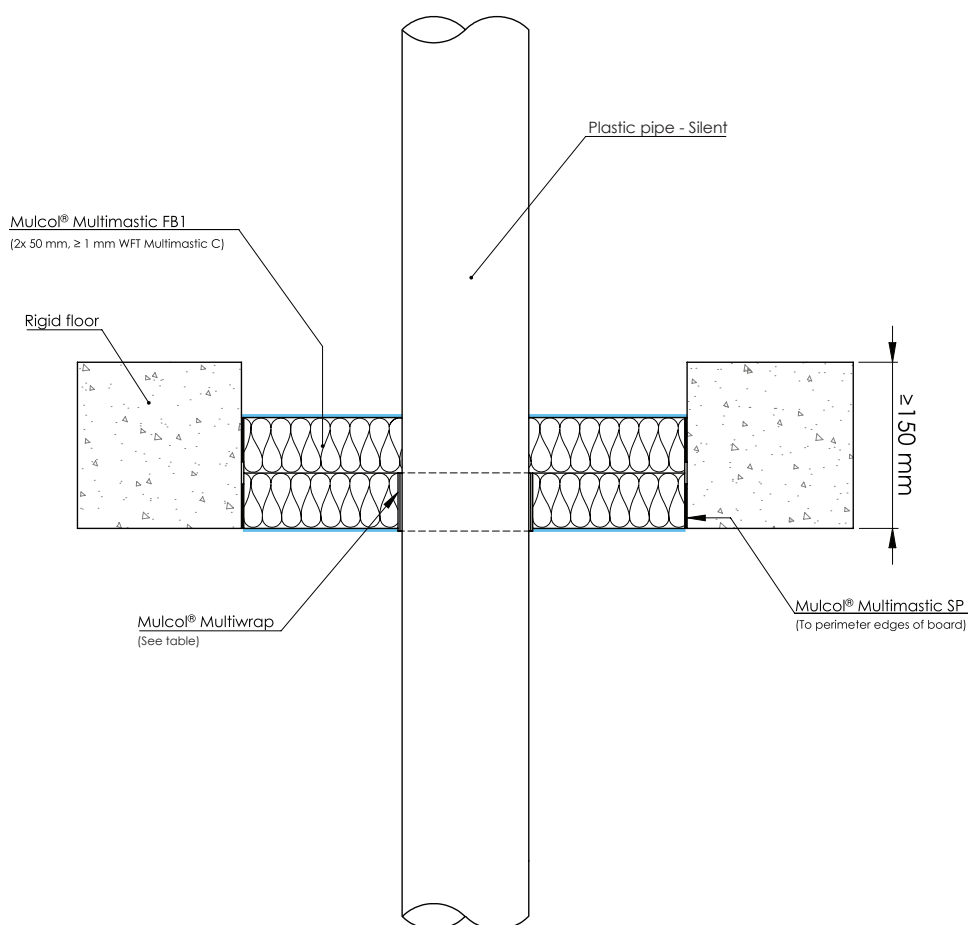


Drawing: PBrf.E-PPS-MW2-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Poloplast PoloKal NG	≤ Ø 50	2.0	Multiwrap (2 layers)	EI 240 U/U
	≤ Ø 110	3.4		
Geberit Silent dB20	≤ Ø 56	3.2		
	≤ Ø 110	6.0	Multiwrap (4 layers)	EI 240 U/C
Poloplast PoloKal NG	≤ Ø 125	3.9		

B.1.4 Multimastic FB1 - 2x 50 mm no cavity - Combustible pipes

B.1.4.5 PP-R Multilayer pipes - Multicollar *Slim*

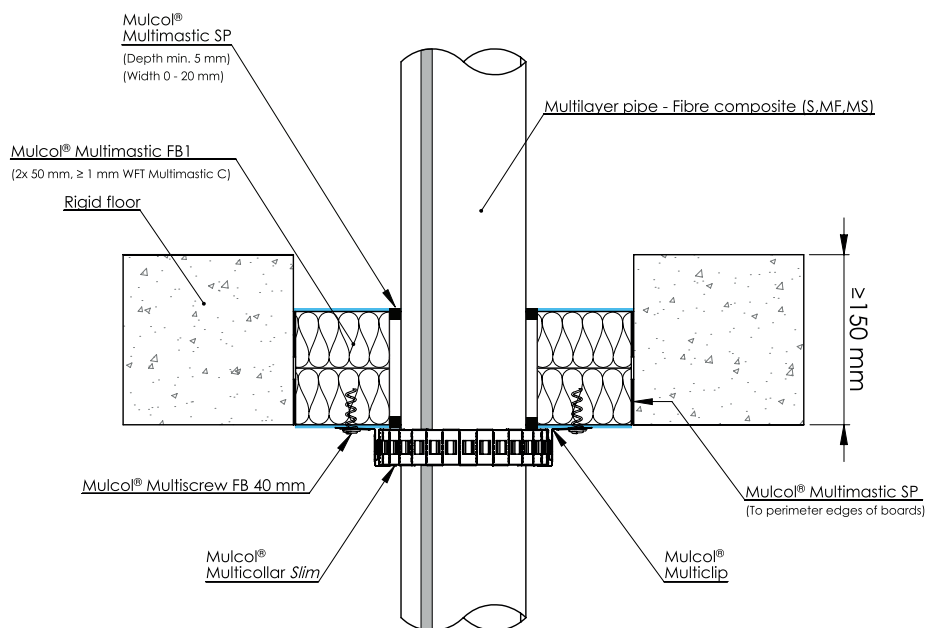

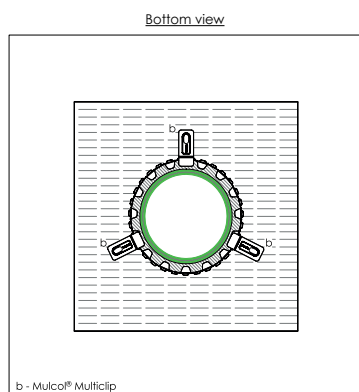


Drawing: PBrf.E-MLF-11.0.10

Services	Pipe dimensions (mm)		System	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Aquatherm Green-MF	≤ Ø 50	6.9	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 90 U/C
	≤ Ø 110	10.0			EI 60 U/C

B.1.5 Multimastic FB1 - 2x 50 mm cavity 50 mm - Combustible pipes

B.1.5.1 Plastic pipes - Multicollar *Slim*

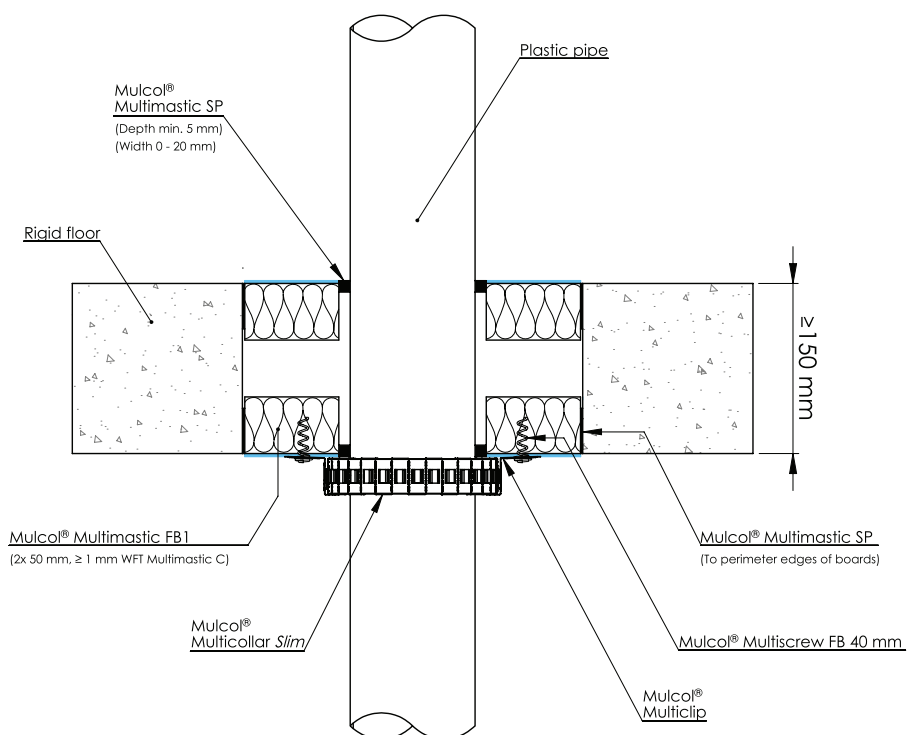



Drawing: PBrf.E-PP-MFB1.2.10.C

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	2.7	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wx d)	EI 90 U/U
		2.7 - 6.6			EI 60 U/U
		2.7 - 3.1			EI 120 U/C
PP	≤ Ø 125	3.1			EI 90 U/U
		2.7			EI 60 U/U
		2.7 - 6.3			EI 90 U/U
PVC(-U/-C)	≤ Ø 110	2.7			EI 60 U/U
		2.7 - 6.3			EI 60 U/U


B.1.5 Multimastic FB1 - 2x 50 mm cavity 50 mm - Combustible pipes

B.1.5.2 Plastic pipes - Multiwrap

Bottom view

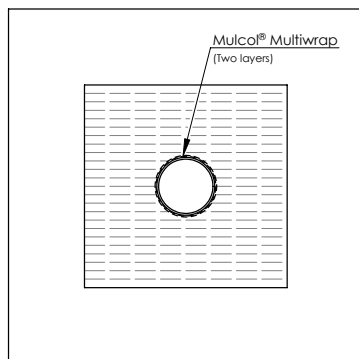

Position seal:
top, bottom or anywhere
in between

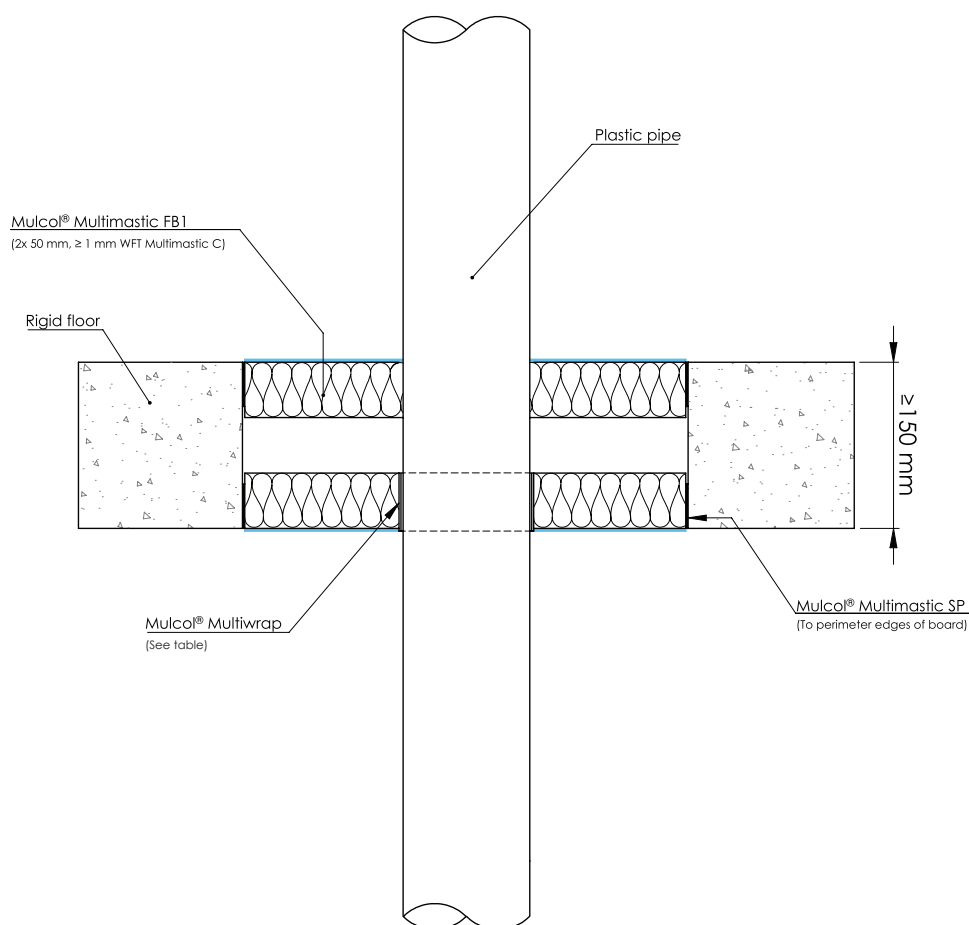



Drawing: PBrf.E-PP-MW2-MFB1.2.10.C

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PVC(-U/-C)	≤ Ø 110	3.2	Multiwrap (2 layers)	EI 120 U/C


B.1.5 Multimastic FB1 - 2x 50 mm cavity 50 mm - Combustible pipes

B.1.5.3 Plastic pipes - Multimastic SP

Bottom view

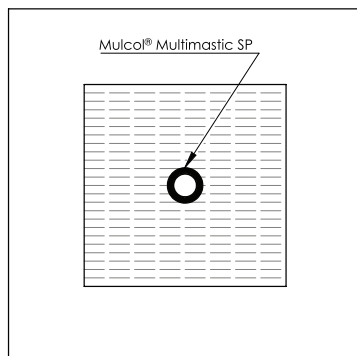

Position seal:
top, bottom or anywhere
in between

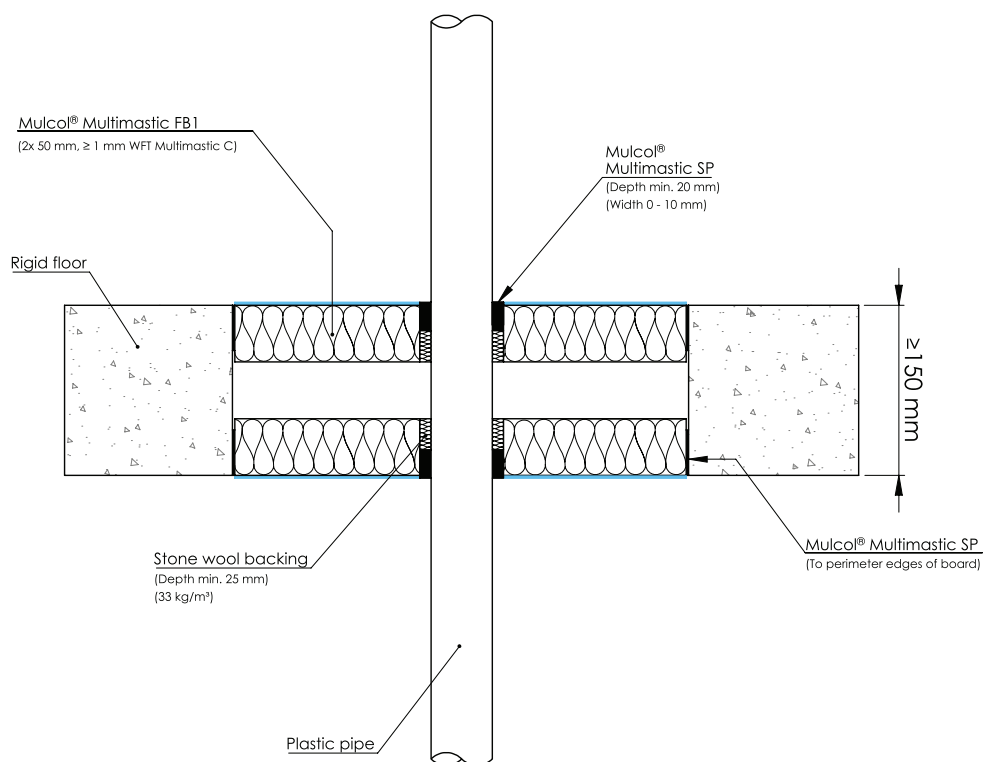



Drawing: PBrf.E-CU-MFB1.2.20.C

Services	Pipe dimensions (mm)		Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 40	3.7	Multimastic SP 0-10 x ≥ 20 (wxd)	Stone wool (≥ 33 kg/m³)	EI 120 U/C
PP	≤ Ø 40	3.7			
PVC(-U/-C)	≤ Ø 40	1.8 - 3.7			
	≤ Ø 50	2.0			


B.1.5 Multimastic FB1 - 2x 50 mm cavity 50 mm - Combustible pipes

B.1.5.4 Plastic pipes - Multisealant GR

Bottom view

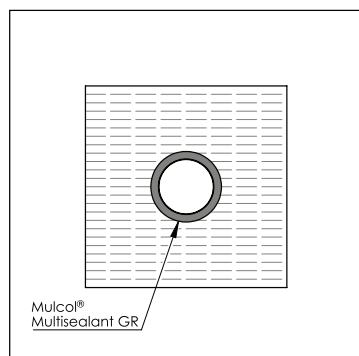

Position seal:
top, bottom or anywhere
in between



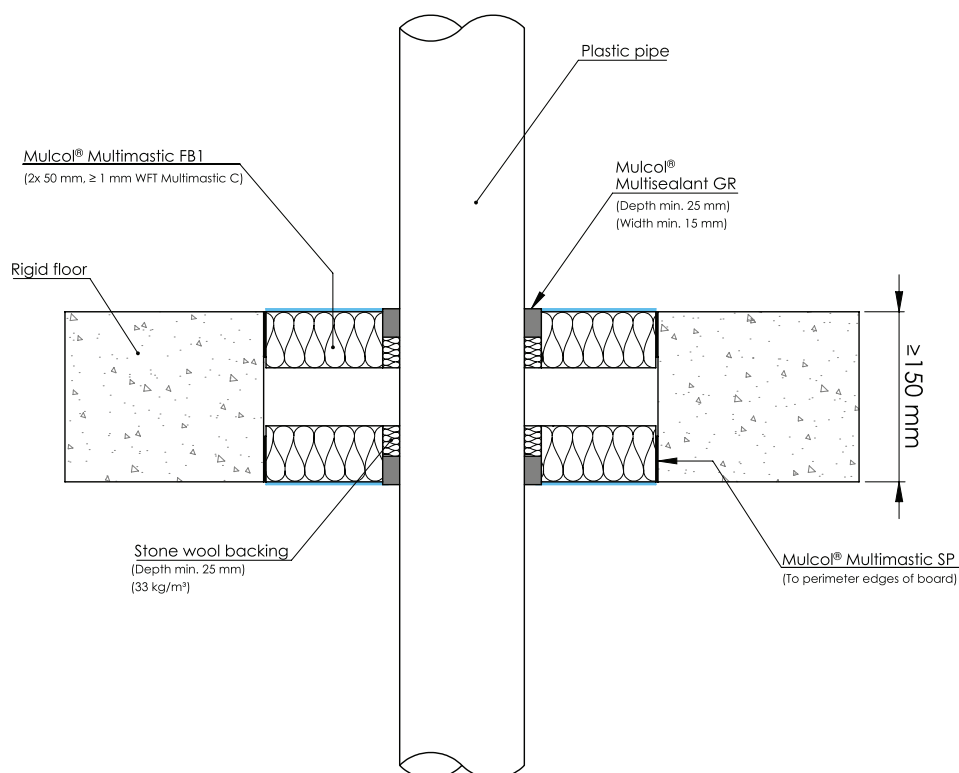


Drawing: PBrf.E-PP-MFB1-G2.5.10.C

Services	Pipe dimensions (mm)		Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 40	2.4 - 10	Multisealant GR ≥ 15 x 25 (wxd)	Stone wool (≥ 33 kg/m³)	EI 120 U/U
	≤ Ø 110	2.7 - 10			
PP	≤ Ø 40	2.3 - 10			
	≤ Ø 110	2.7 - 10			
PVC(-U/-C)	≤ Ø 40	2.4 - 10			
	≤ Ø 110	2.7 - 10			

B.1.5 Multimastic FB1 - 2x 50 mm cavity 50 mm - Combustible pipes

B.1.5.5 Plastic pipes (Silent) - Multicollar *Slim*

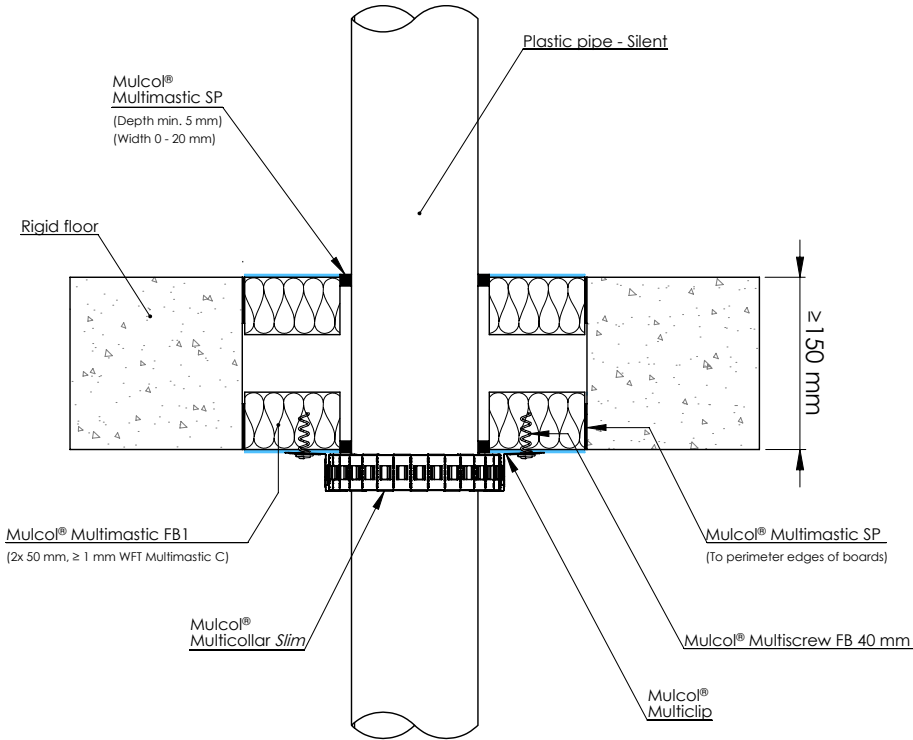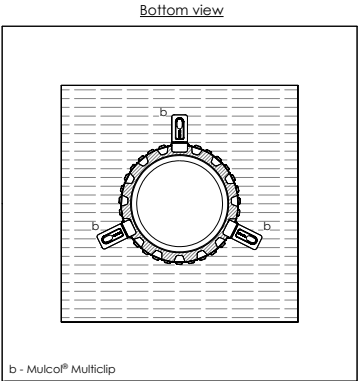



Drawing: PBrf-PPS-MFB1.2.10.C

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimensions	Wall thickness			
Geberit Silent dB20	≤ Ø 110	6.0	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 90 U/U


B.1.5 Multimastic FB1 - 2x 50 mm cavity 50 mm - Combustible pipes

B.1.5.6 Plastic pipes (Silent) - Multiwrap

Bottom view

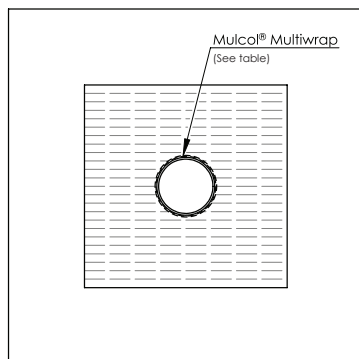

Position seal:
top, bottom or anywhere
in between



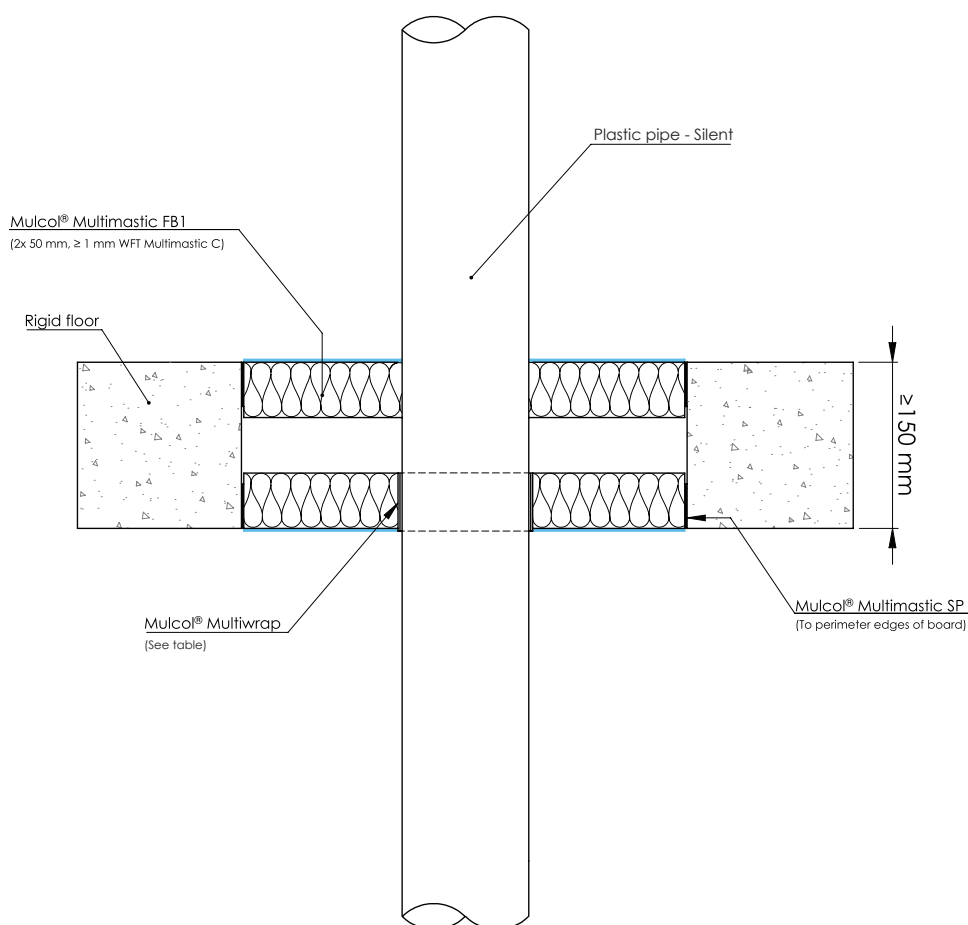


Drawing: PBrf.E-PPS-MW2-MFB1.2.10.C

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Poloplast PoloKal NG	≤ Ø 50	2.0	Multiwrap (2 layers)	EI 240 U/U
	≤ Ø 110	3.4		
Geberit Silent dB20	≤ Ø 56	3.2		EI 240 U/C
	≤ Ø 110	6.0		
Poloplast PoloKal NG	≤ Ø 125	3.9	Multiwrap (4 layers)	

B.1.5 Multimastic FB1 - 2x 50 mm cavity 50 mm - Combustible pipes

B.1.5.7 PP-R Multilayer pipes - Multicollar *Slim*

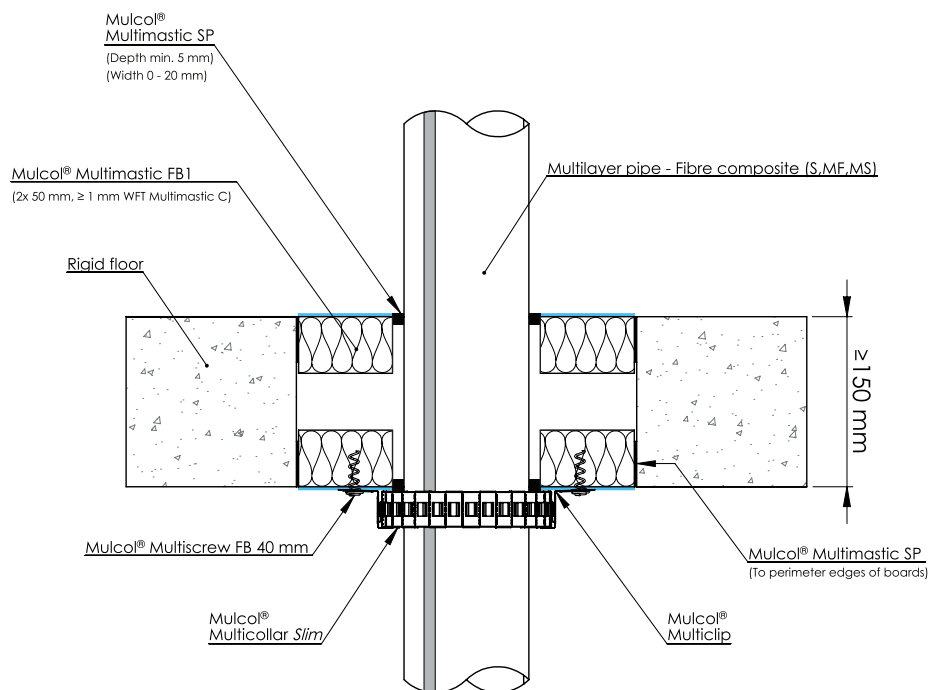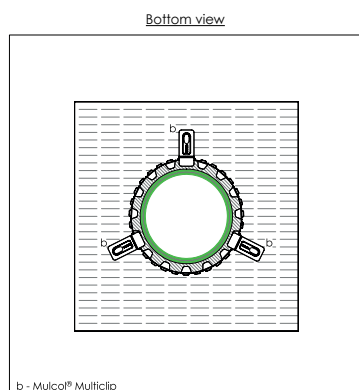




Drawing: PBrf.E-MLF-11.0.10.C

Services	Pipe dimensions (mm)		System	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Aquatherm Green-MF	$\leq \varnothing 50$	6.9	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 90 U/C
	$\leq \varnothing 110$	10.0			EI 120 U/C

B.1.5 Multimastic FB1 - 2x 50 mm cavity 50 mm - Combustible pipes

B.1.5.8 Drinks tubing system - Multicollar *Slim*

Bottom view

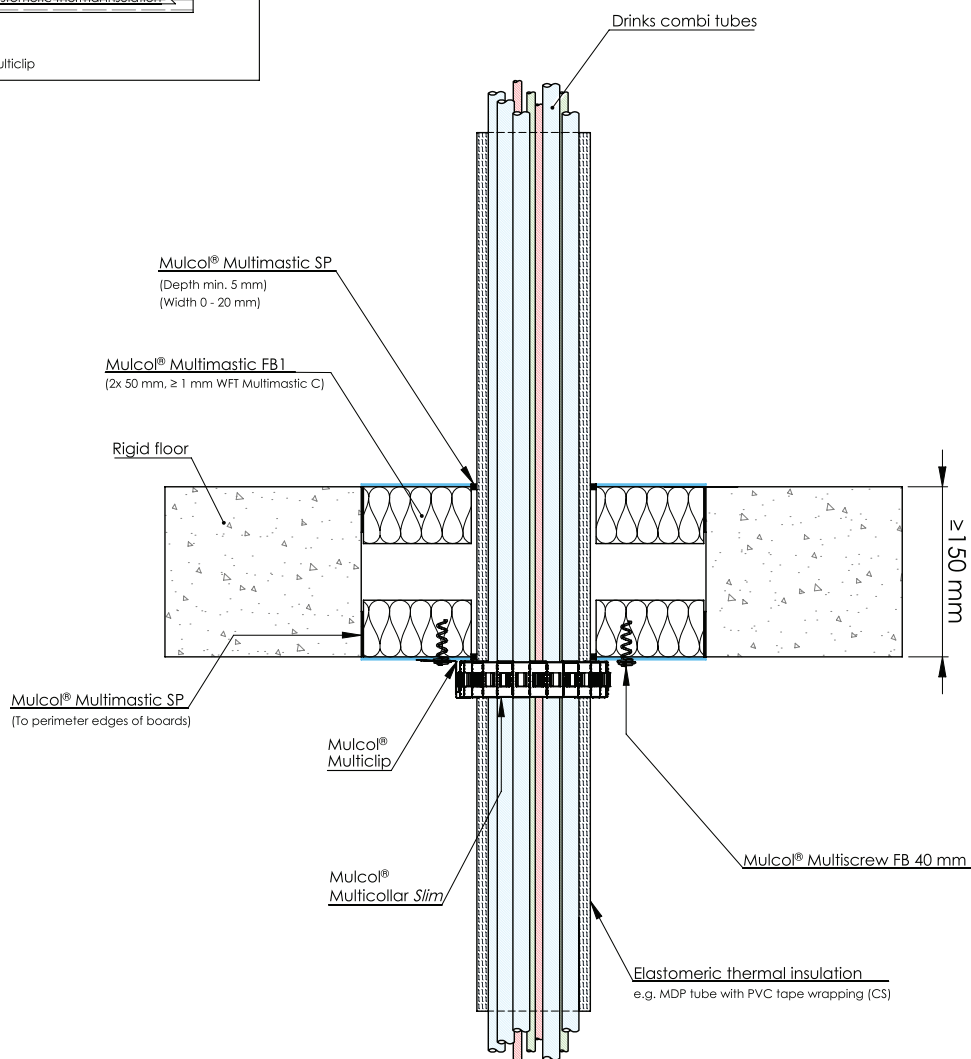

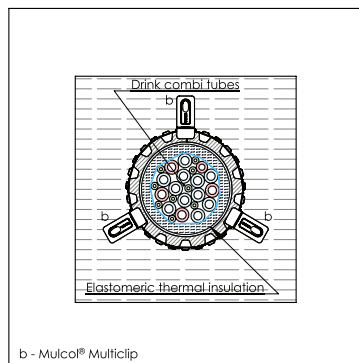


Drawing: PBrf.E-MC30-DCT25-11.0.22.C

Services	Dimensions (mm)		Insulation			Product	Sealing (mm)	Classification
	Outer dimension	No. of Hoses	Type	Thickness (mm)	Configuration			
Drinks tubing system	≤ Ø 47	≤ 3	Elastomeric foam	8 - 35	CS	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 120 U/C
	≤ Ø 90	≤ 3						
	≤ Ø 100	≤ 25						
	≤ Ø 145	≤ 52						

B.1.6 Multimastic FB2 - 1x 60 mm - Combustible pipes

B.1.6.1 Plastic pipes - Multicollar *Slim*

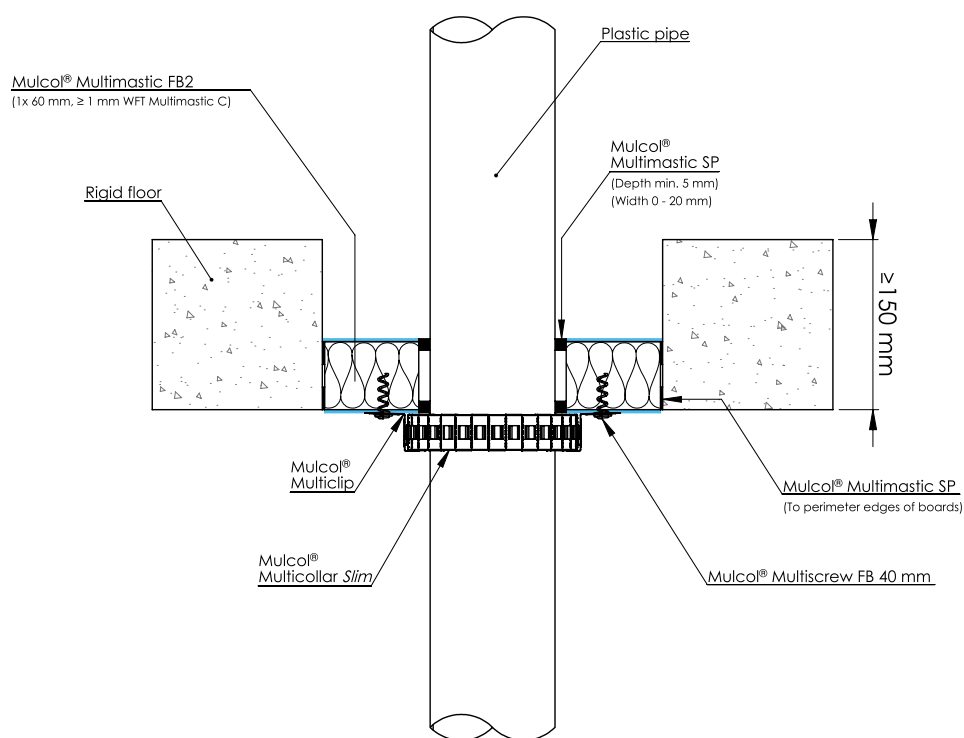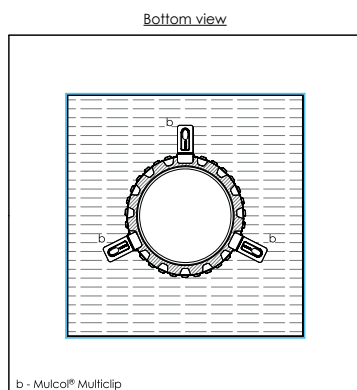



Drawing: PBrf.E-PP-MFB2.1.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	$\leq \varnothing 40$	2.4	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 60 U/U, E 90 U/U
		2.4 - 6.6			EI 30 U/U
PP		1.8			EI 90 U/U, E 180 U/U
		1.8 - 5.5			EI 30 U/U
PVC(-U/-C)		2.4			EI 60 U/U, E 90 U/U
		2.4 - 4.3			EI 30 U/U
	$\leq \varnothing 110$	2.7			EI 120 U/U
PE(-HD) / PE-X / ABS / SAN+PVC		2.7 - 6.6			EI 30 U/U
		3.9			EI 90 U/C
	$\leq \varnothing 125$	3.9 - 7.4			EI 45 U/C
PP		3.1 - 7.1			

B.1.6 Multimastic FB2 - 1x 60 mm - Combustible pipes

B.1.6.2 Plastic pipes - Multiwrap


Bottom view

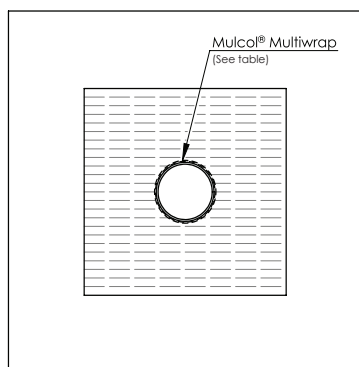

Position seal:
top, bottom or anywhere
in between

Mulcol® Multimastic FB2
(1x 60 mm, ≥ 1 mm WFT Multimastic C)

Rigid floor



Mulcol® Multimastic SP

≥ 150 mm

Mulcol® Multiwrap
(See table)

Mulcol® Multimastic SP
(To perimeter edges of board)

Plastic pipe



Drawing: PBrf.E-PP-MW2-MFB2.1.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	2.7	Multiwrap (2 layers)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 90 U/C, EI 120 U/C
PVC(-U/-C)		3.2			EI 120 U/C


B.1.6 Multimastic FB2 - 1x 60 mm - Combustible pipes

B.1.6.3 Plastic pipes - Multiwrap - both sides

Bottom view

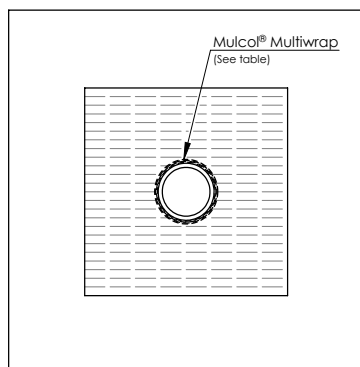

Position seal:
top, bottom or anywhere
in between


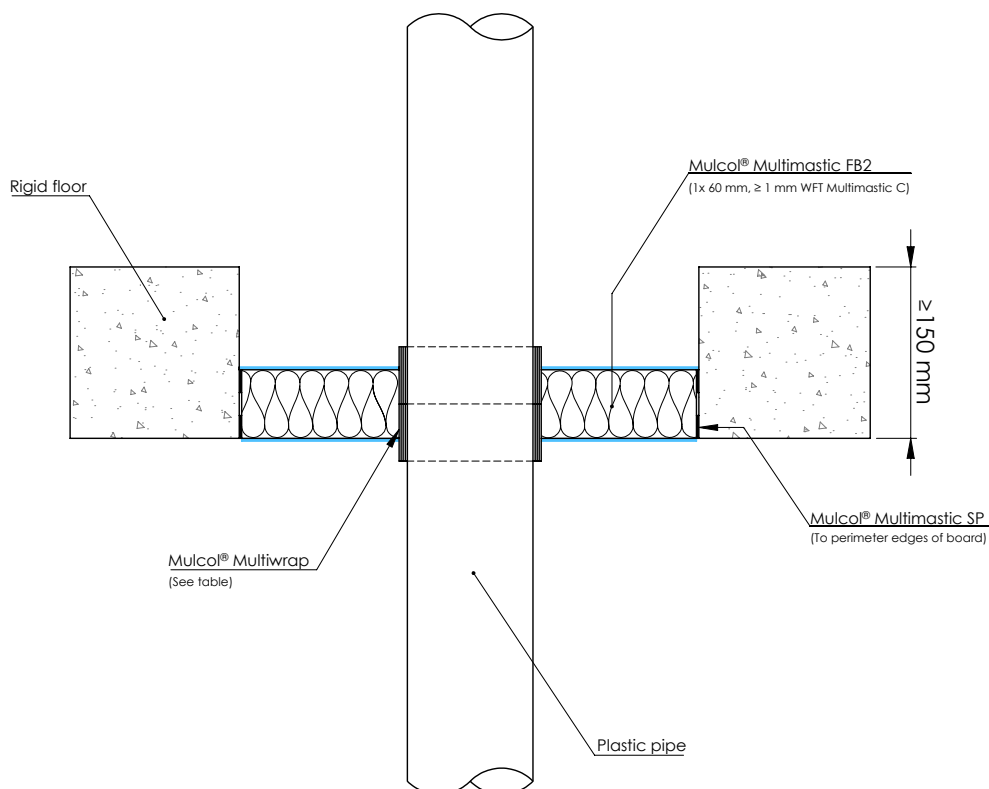


Drawing: PBrf.E-PP-MW4-MFB2.1.10


Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PP	≤ Ø 40	2.3	Multiwrap (2 x 2 layers)	EI 120 U/U
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	10.0	Multiwrap (2 x 4 layers)	EI 45 U/U, E 120 U/U
PVC(-U/-C)		8.1		EI 90 U/U, E 120 U/U

B.1.7 SVT Flamro BS60 - 1x60 mm - Combustible pipes

B.1.7.1 Plastic pipes - Multicollar *Slim*

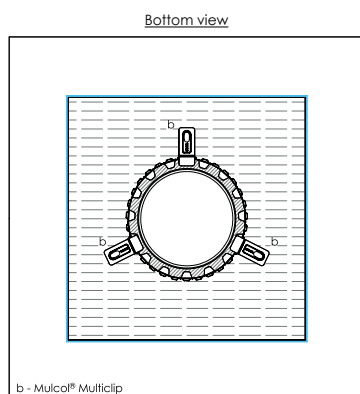

Position seal:
top, bottom or anywhere
in between


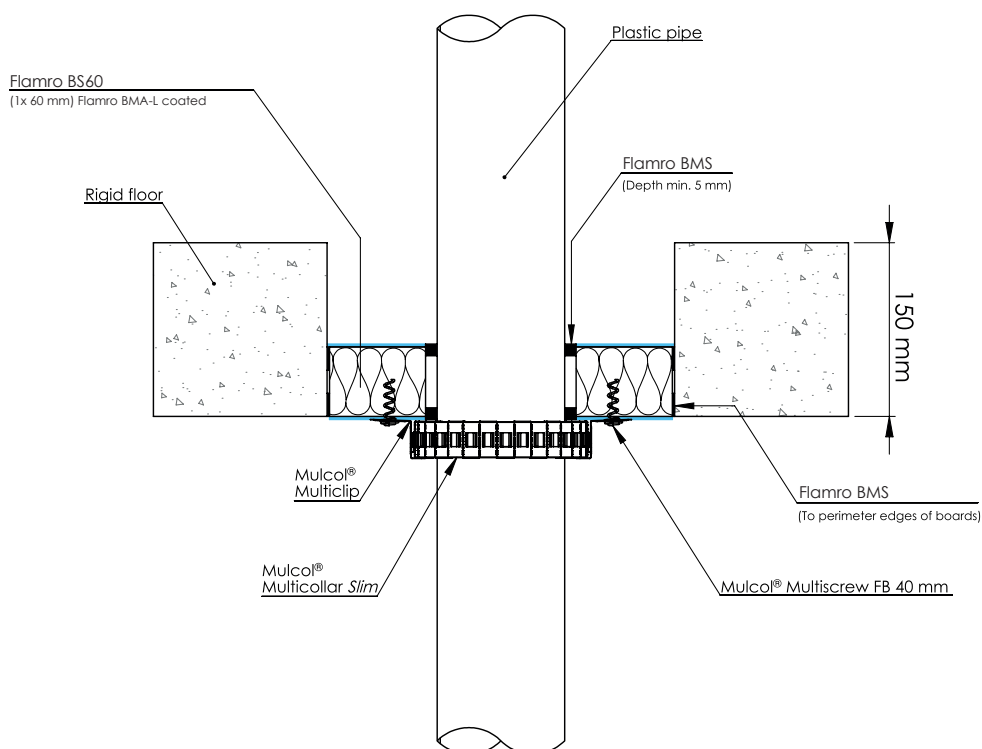


Drawing: PBrf.E-PP-BS2.1.10


Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	$\leq \varnothing 125$	3.9	Multicollar <i>Slim</i>	Flamro BMS 0-20 x ≥ 5 (wxd)	EI 120 U/C, E 180 U/C

B.1.8 Multimastic FB1 - 2x 50 mm no cavity - Multilayer pipes (MLC)

B.1.8.1 Multilayer pipes (MLC) - Multisealant GR

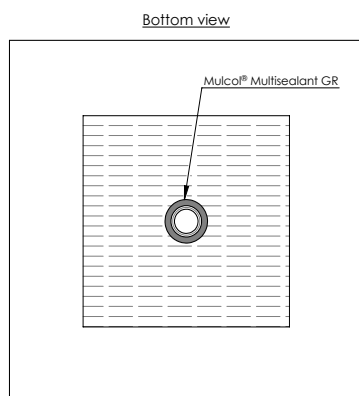

Position seal:
top, bottom or anywhere
in between



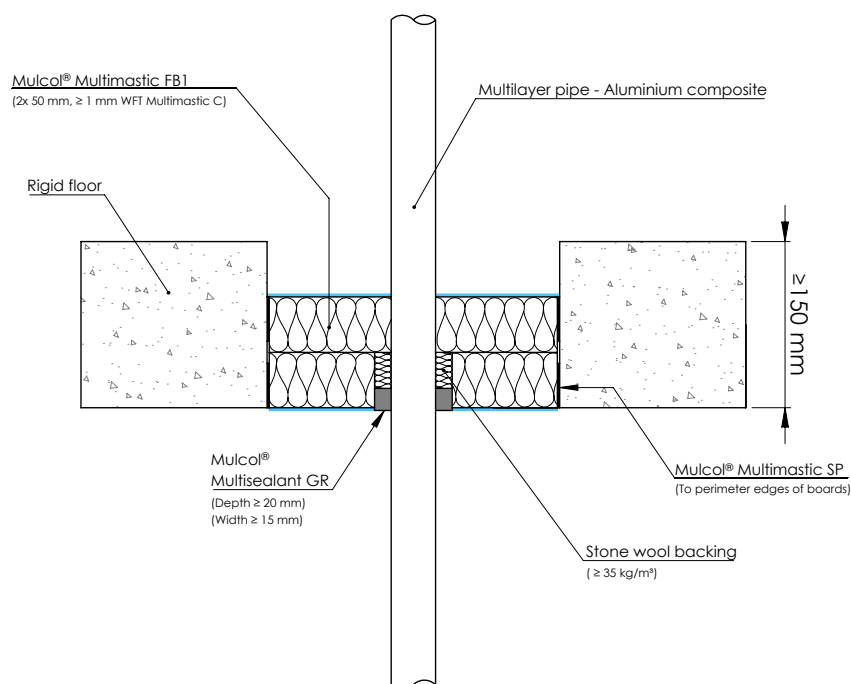


Drawing: PBrf.E-MLA-G1.4.10

Services	Pipe dimensions (mm)		Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness			
Multilayer pipes (MLC)	≤ Ø 20	2.0	Multisealant GR ≥ 15 x 25 (wxd)	Stone wool (≥ 33 kg/m ³)	EI 120 U/C
	≤ Ø 25	3.5			
	≤ Ø 32	3.0			EI 90 U/C EI 120 U/C
	≤ Ø 40	3.5 - 4.0			

B.1.8 Multimastic FB1 - 2x 50 mm no cavity - Multilayer pipes (MLC)

B.1.8.2 Multilayer pipes (MLC) - Elastomer LS 300 / CS - Multisealant GR

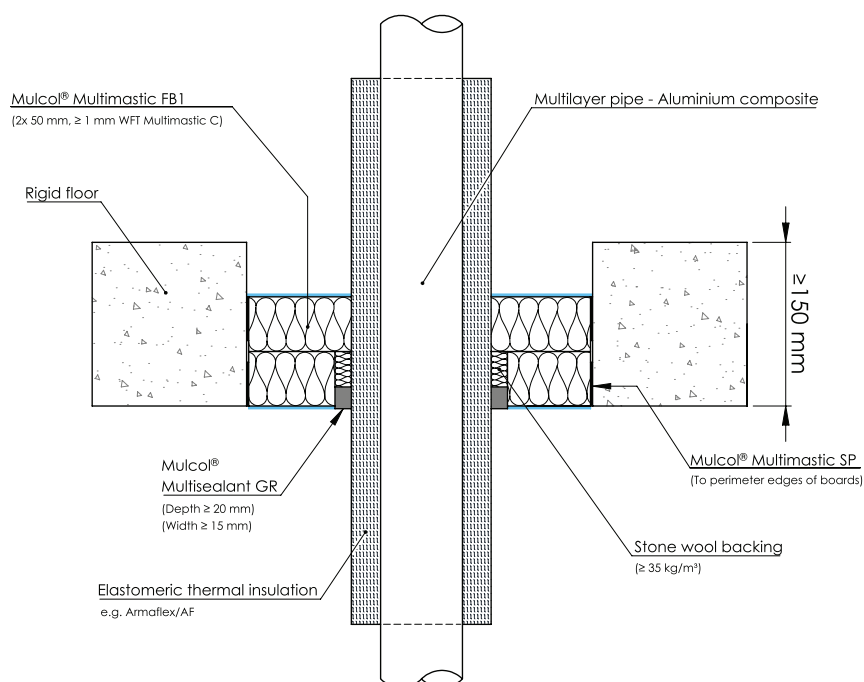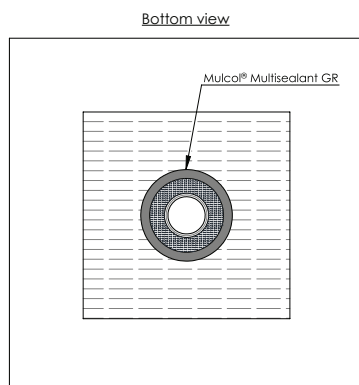



Drawing: PBrf.E-MLA-G1.4.22

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Multilayer pipe (MLC)	≤ Ø 20	2.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	9 - 32	LS 300 / CS	Multisealant GR ≥ 15 x 20 (wxd)	Stone wool (≥ 35 kg/m ³)	EI 120 U/C
	≤ Ø 32	3.0						EI 90 U/C
	≤ Ø 40	3.5						E 120 U/C
	≤ Ø 50	4.0						EI 90 U/C
	≤ Ø 63	4.5						EI 90 U/C
	≤ Ø 75	6.0						


B.1.8 Multimastic FB1 - 2x 50 mm no cavity - Multilayer pipes (MLC)

B.1.8.3 Multilayer pipes (MLC) - Elastomer LI 300 / CI - Multisealant GR

Bottom view

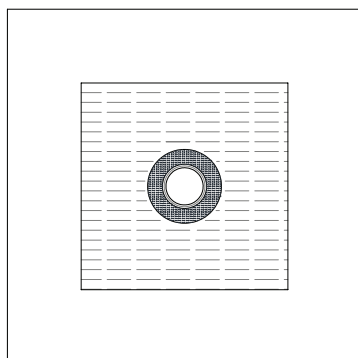

Position seal:
top, bottom or anywhere
in between



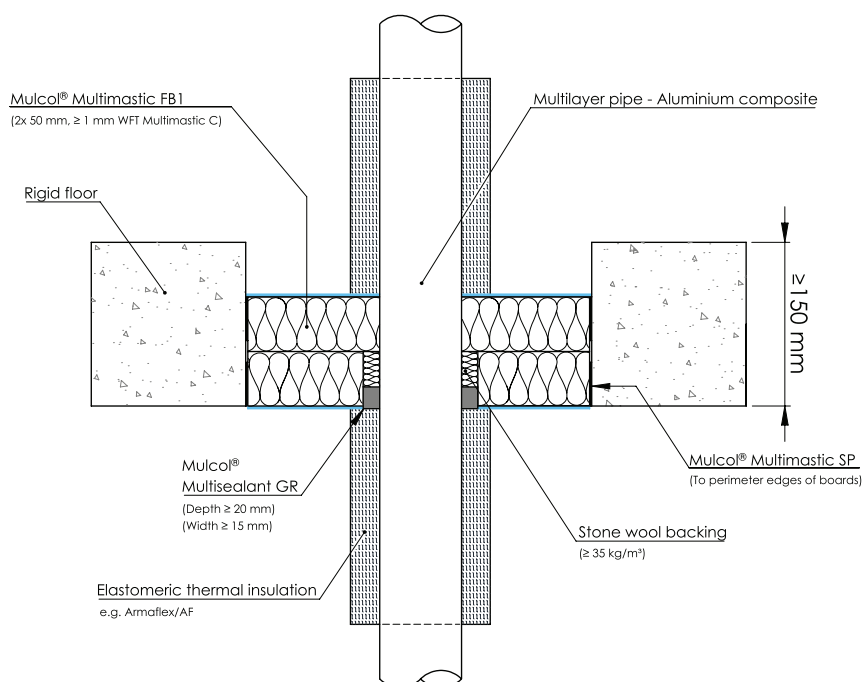


Drawing: PBrf.E-MLA-G1.4.22.LI

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Multilayer pipe (MLC)	≤ Ø 20	2.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	9 - 32	LI 300 / CI	Multisealant GR ≥ 15 x 20 (wxd)	Stone wool (≥ 35 kg/m ³)	EI 120 U/C
	≤ Ø 32	3.0						EI 90 U/C
	≤ Ø 40	3.5						E 120 U/C
	≤ Ø 50	4.0						EI 90 U/C
	≤ Ø 63	4.5						
	≤ Ø 75	6.0						

B.1.8 Multimastic FB1 - 2x 50 mm no cavity - Multilayer pipes (MLC)

B.1.8.4 Multilayer pipes (MLC) - PE foam LS 300 / CS - Multisealant GR

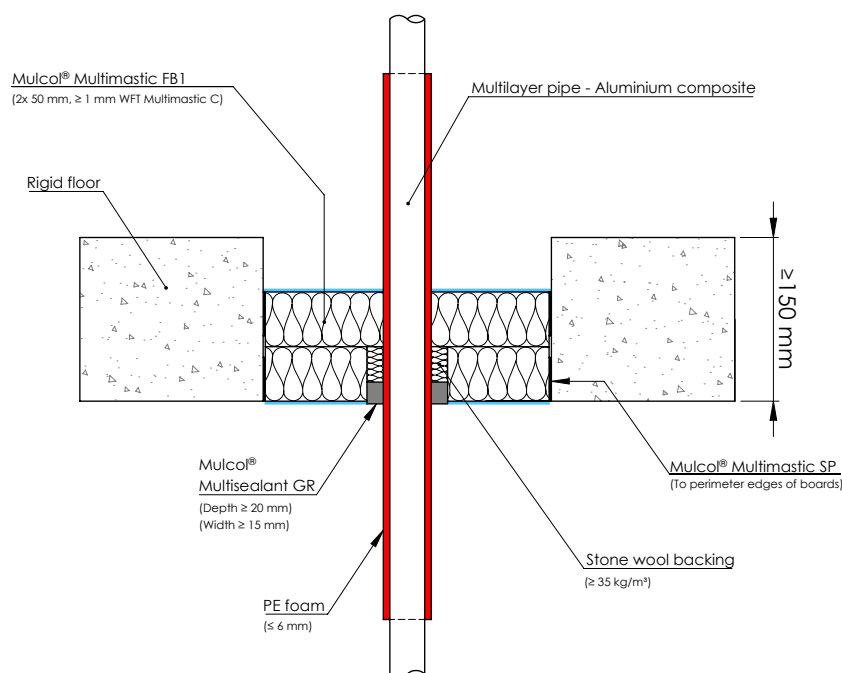

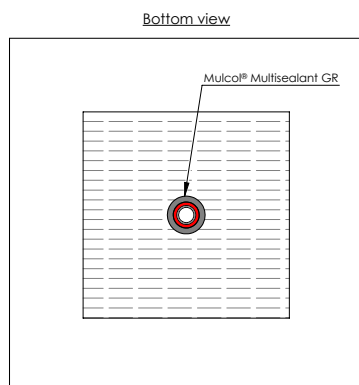


Drawing: PBrf.E-MLA_pr-G1.4.23

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Multilayer pipe (MLC)	≤ Ø 20	2.0	Henco PE foam	≤ 6	LS 300 / CS	Multisealant GR ≥ 15 x 20 (wxd)	Stone wool (≥ 35 kg/m³)	EI 120 U/C
	≤ Ø 25	3.5						
	≤ Ø 32	3.0						

B.1.8 Multimastic FB1 - 2x 50 mm no cavity - Multilayer pipes (MLC)

B.1.8.4 Multilayer pipes (MLC) - PE foam LI 300 / CI - Multisealant GR

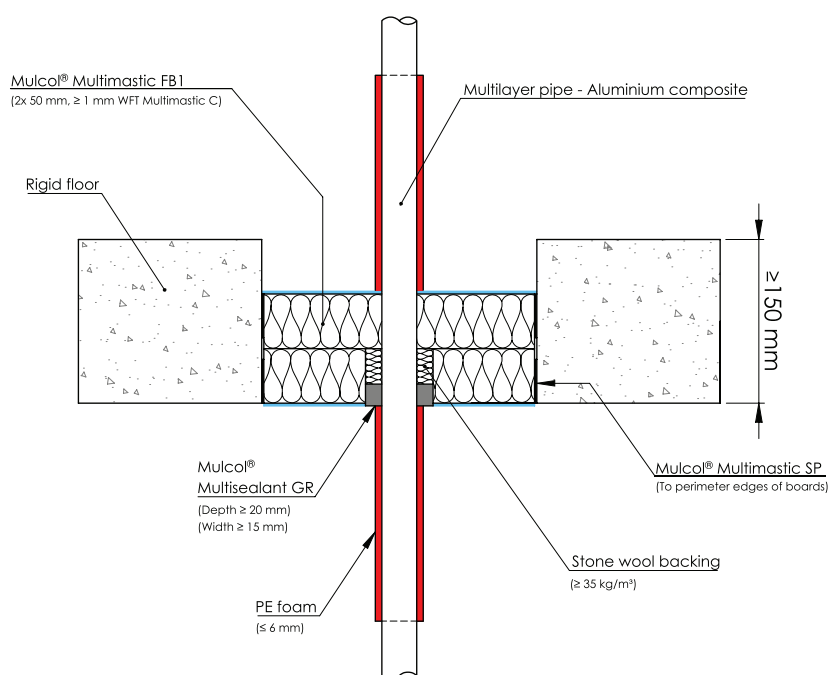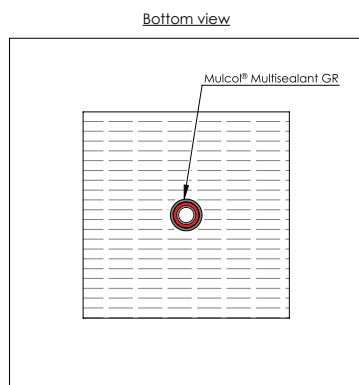



Drawing: PBrf.E-MLA_pr-G1.4.23.LI

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Multilayer pipe (MLC)	≤ Ø 20	2.0	Henco PE foam	≤ 6	LI 300 / CI	Multisealant GR ≥ 15 x 20 (wxd)	Stone wool (≥ 35 kg/m³)	EI 120 U/C
	≤ Ø 25	3.5						
	≤ Ø 32	3.0						


B.1.8 Multimastic FB1 - 2x 50 mm no cavity - Multilayer pipes (MLC)

B.1.8.5 Multilayer pipes (MLC) - Multimastic SP

Bottom view

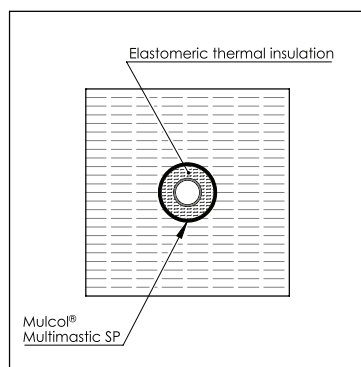

Position seal:
top, bottom or anywhere
in between



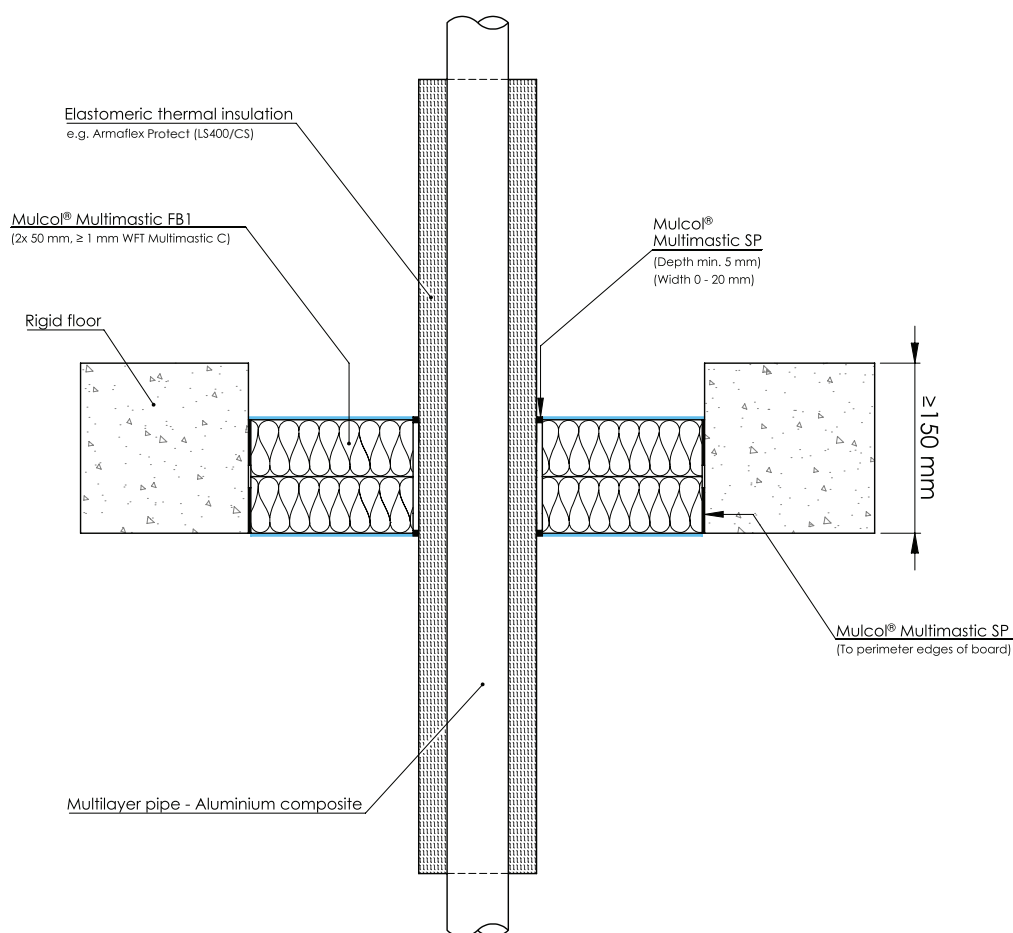


Drawing: PBrf.E-MLA-MFB1.2.22

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 26	3.0	ArmaFlex Protect	20	LS 400 / CS	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 120 U/C
	≤ Ø 75	5.0		25			

B.1.8 Multimastic FB1 - 2x 50 mm no cavity - Multilayer pipes (MLC)

B.1.8.6 Multilayer pipes (MLC) - Multidisc

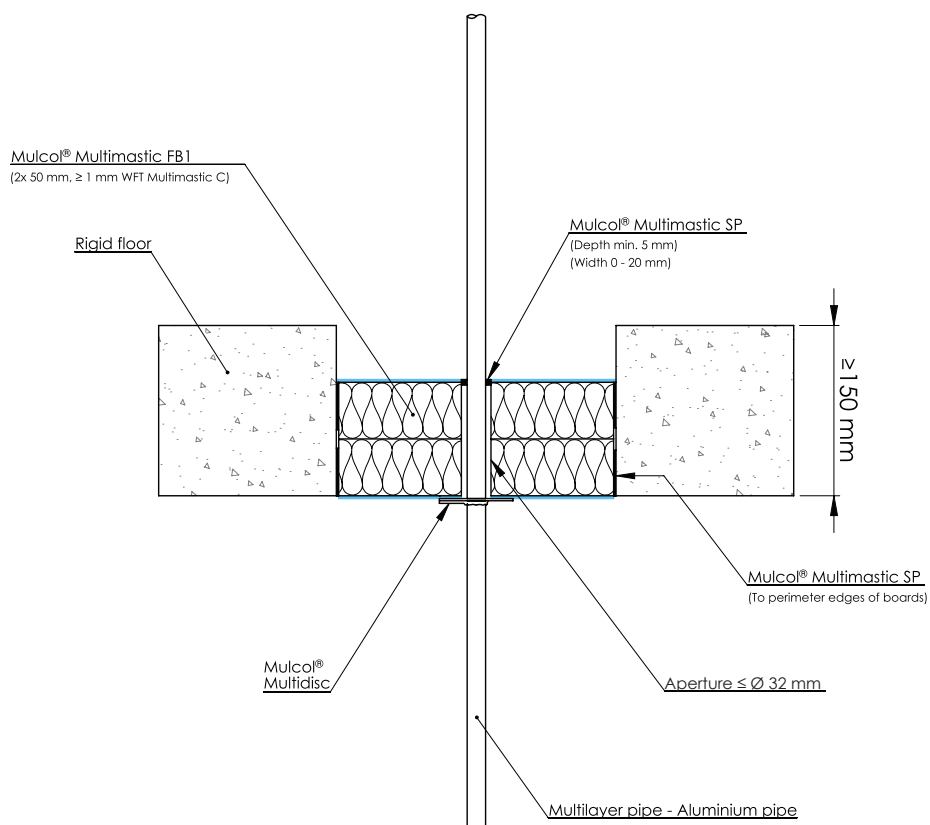

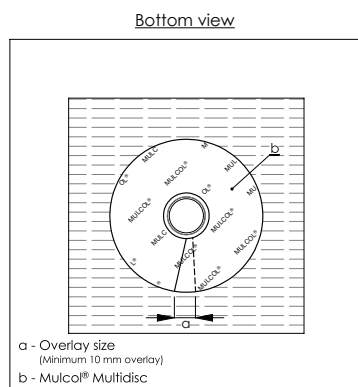


Drawing: PBrf.E-MFB1-MLA-M2.0.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Multilayer pipes (MLC)	$\leq \varnothing 16$	2.0	Multidisc	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 90 U/C E 120 U/C

B.1.9 Multimastic FB1 - 2x 50 mm cavity 50 mm - Multilayer pipes (MLC)

B.1.9.1 Multilayer pipes (MLC) - Multisealant GR

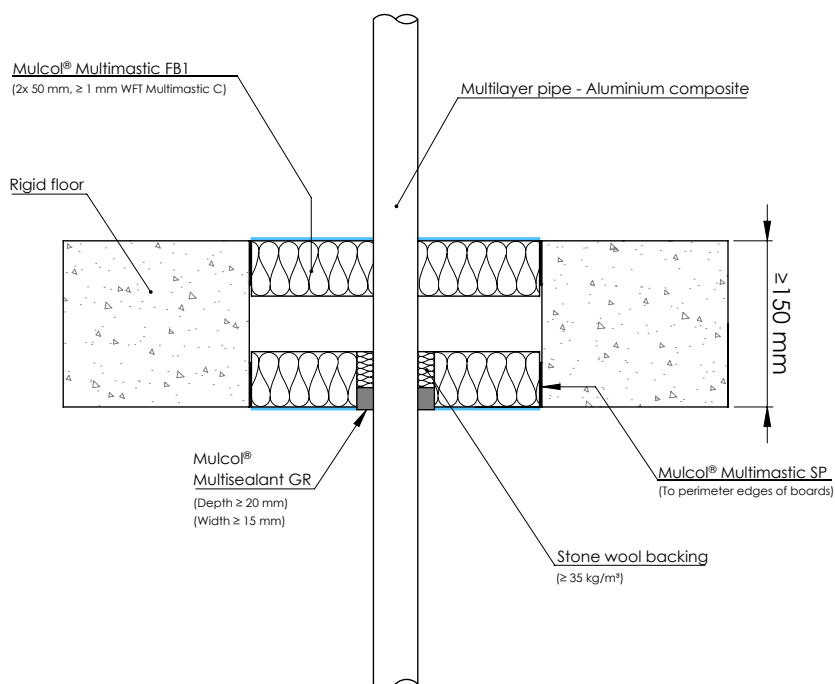

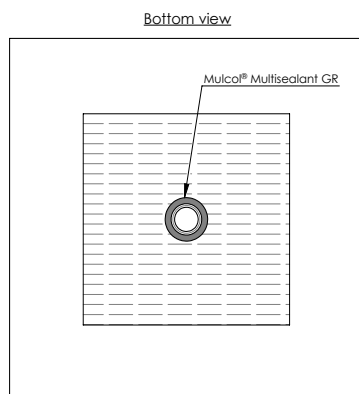


Drawing: PBrf.E-MLA-G1.4.10.C

Services	Pipe dimensions (mm)		Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness			
Multilayer pipes (MLC)	≤ Ø 20	2.0	Multisealant GR ≥ 15 x 25 (wxd)	Stone wool (≥ 33 kg/m³)	EI 120 U/C
	≤ Ø 25	3.5			
	≤ Ø 32	3.0			EI 90 U/C E 120 U/C
	≤ Ø 40	3.5 - 4.0			

B.1.9 Multimastic FB1 - 2x 50 mm cavity 50 mm - Multilayer pipes (MLC)

B.1.9.2 Multilayer pipes (MLC) - Elastomer LS 300 / CS - Multisealant GR

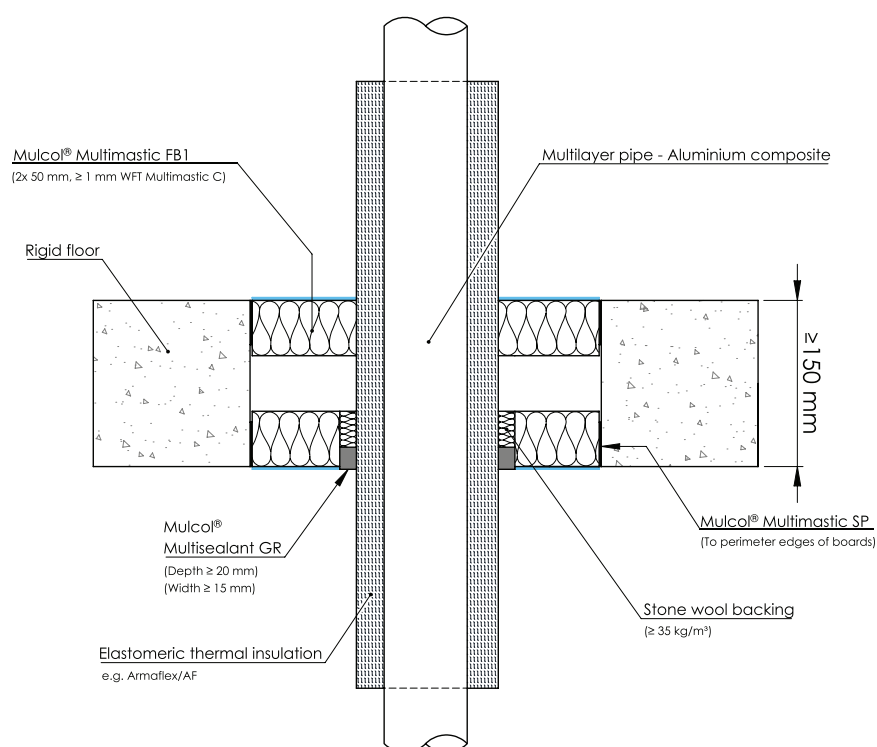

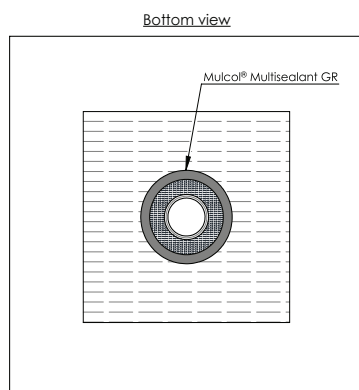


Drawing: PBrf.E-MLA-G1.4.22.C

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Multilayer pipe (MLC)	≤ Ø 20	2.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	9 - 32	LS 300 / CS	Multisealant GR ≥ 15 x 20 (wxd)	Stone wool (≥ 35 kg/m³)	EI 120 U/C
	≤ Ø 32	3.0						EI 90 U/C
	≤ Ø 40	3.5						E 120 U/C
	≤ Ø 50	4.0						EI 90 U/C
	≤ Ø 63	4.5						
	≤ Ø 75	6.0						

B.1.9 Multimastic FB1 - 2x 50 mm cavity 50 mm - Multilayer pipes (MLC)

B.1.9.2 Multilayer pipes (MLC) - Elastomer LI 300 / CI - Multisealant GR

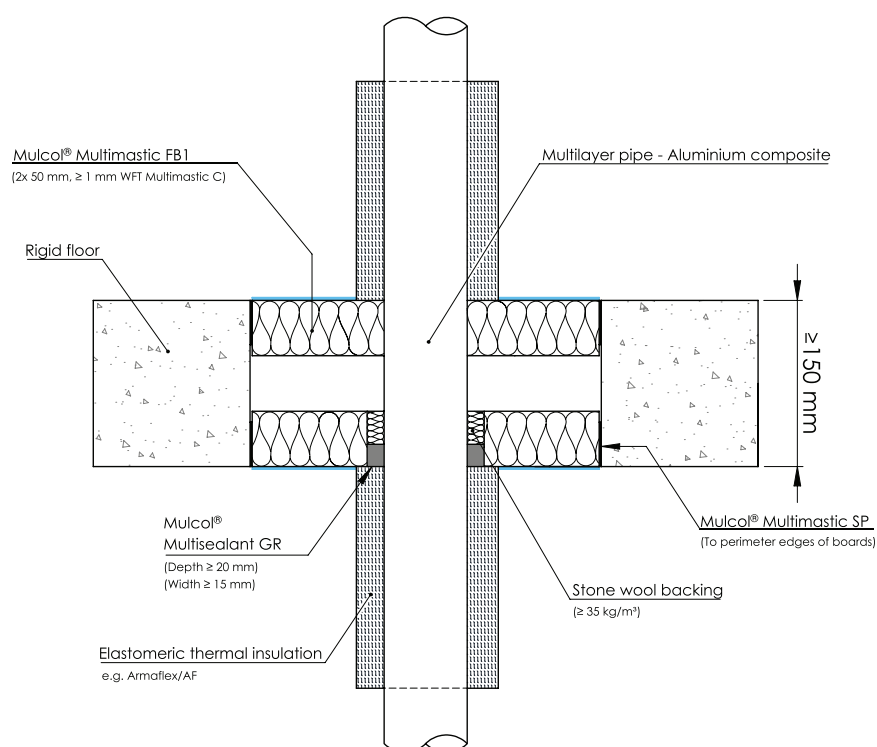

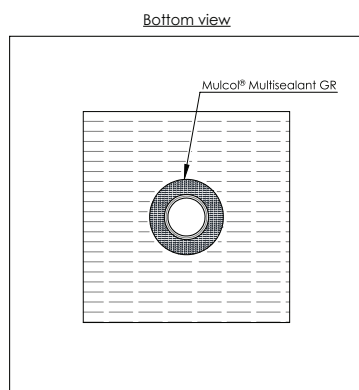


Drawing: PBrf.E-MLA-G1.4.22.C.LI

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Multilayer pipe (MLC)	≤ Ø 20	2.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	9 - 32	LI 300 / CI	Multisealant GR ≥ 15 x 20 (wxd)	Stone wool (≥ 35 kg/m³)	EI 120 U/C
	≤ Ø 32	3.0						EI 90 U/C
	≤ Ø 40	3.5						E 120 U/C
	≤ Ø 50	4.0						EI 90 U/C
	≤ Ø 63	4.5						EI 90 U/C
	≤ Ø 75	6.0						

B.1.9 Multimastic FB1 - 2x 50 mm cavity 50 mm - Multilayer pipes (MLC)

B.1.9.3 Multilayer pipes (MLC) - PE foam - Multisealant GR

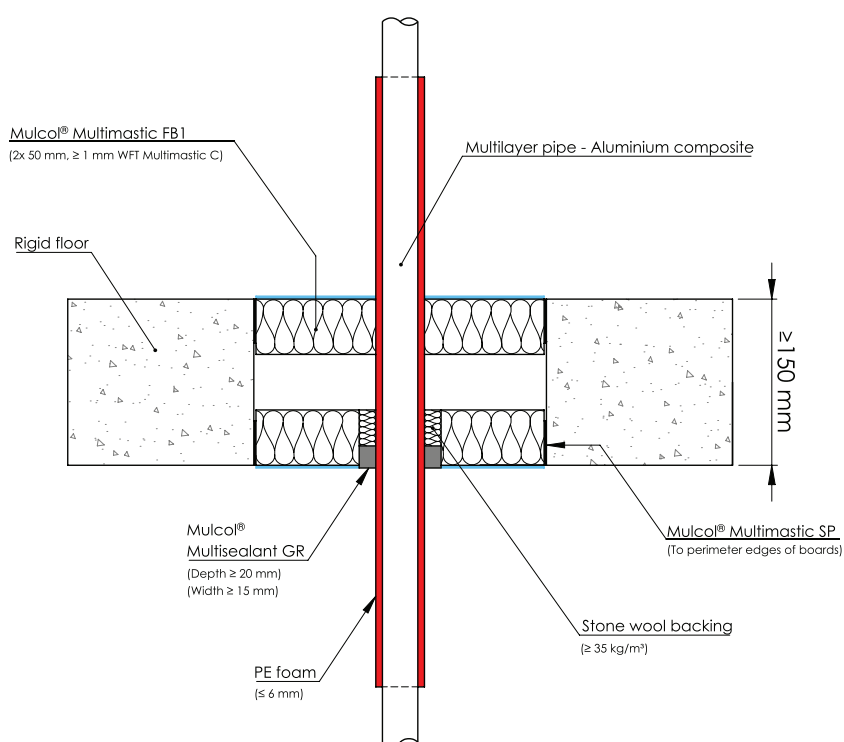

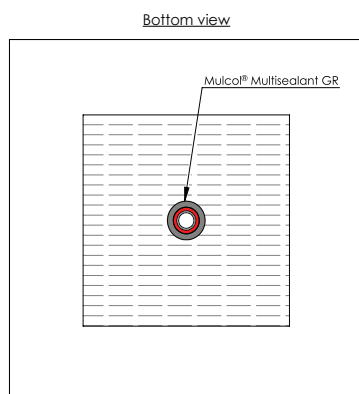


Drawing: PBrf.E-MLA_pr-G1.4.23.C

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 20	2.0	Henco PE Foam	6	LS 300 / CS	Multisealant GR ≥ 15 x 20 (wxd)	EI 120 U/C
	≤ Ø 25	3.5					
	≤ Ø 32	3.0					

B.1.9 Multimastic FB1 - 2x 50 mm cavity 50 mm - Multilayer pipes (MLC)

B.1.9.3 Multilayer pipes (MLC) - PE foam - Multisealant GR

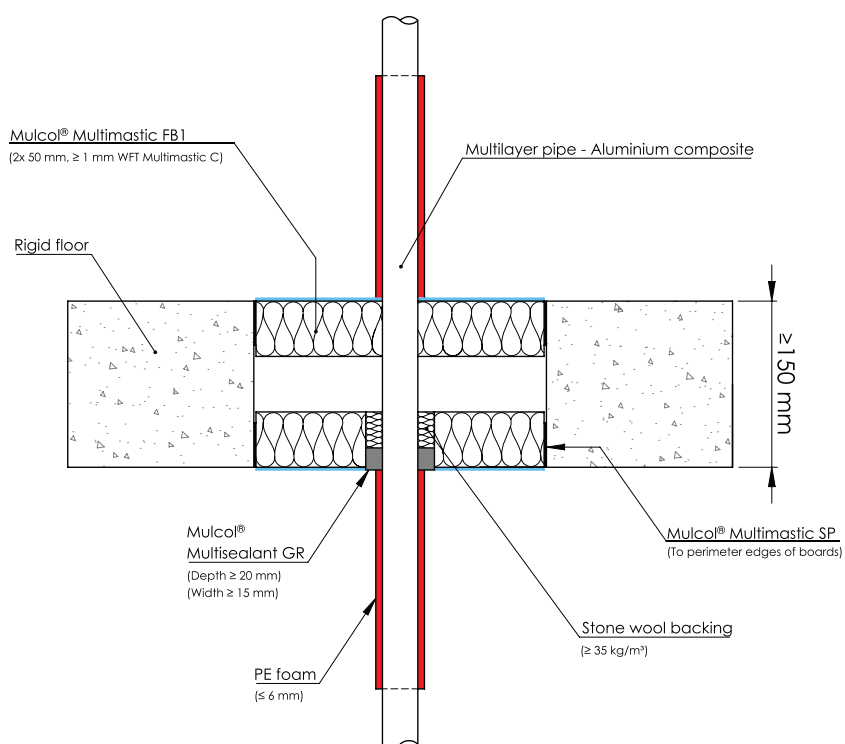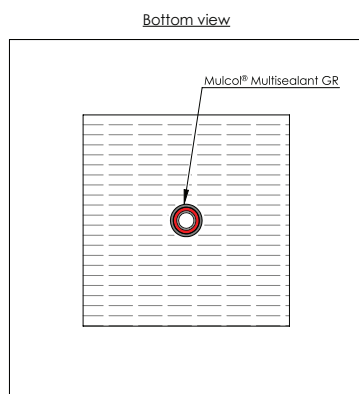


Drawing: PBrf.E-MLA_pr-G1.4.23.C.LI

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 20	2.0	Henco PE Foam	6	LI 300 / CI	Multisealant GR ≥ 15 x 20 (wxd)	EI 120 U/C
	≤ Ø 25	3.5					
	≤ Ø 32	3.0					

B.1.9 Multimastic FB1 - 2x 50 mm cavity 50 mm - Multilayer pipes (MLC)

B.1.9.4 Multilayer pipes (MLC) - Multimastic SP



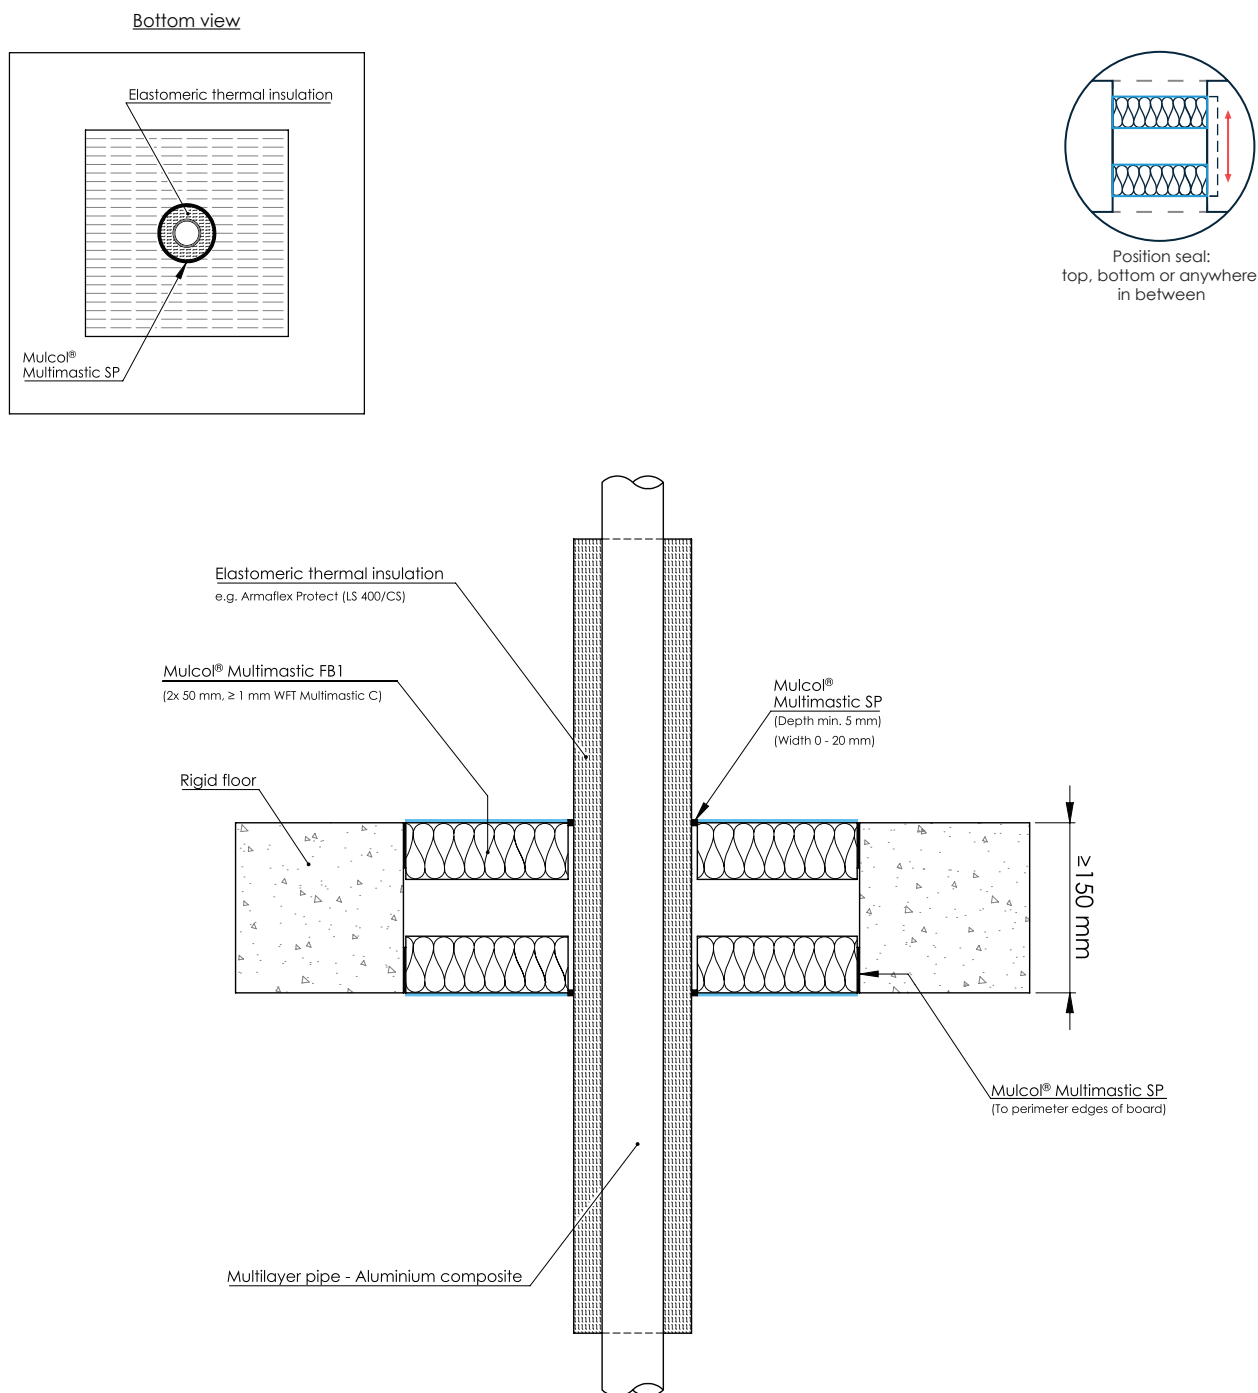


Drawing: PBrf.E-MLA-MFB1.2.22

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Multilayer pipes (MLC)	≤ Ø 26	3.0	ArmaFlex Protect	20	LS 400 / CS	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 120 U/C
	≤ Ø 75	5.0		25			

B.1.9 Multimastic FB1 - 2x 50 mm cavity 50 mm - Multilayer pipes (MLC)

B.1.9.5 Multilayer pipes (MLC) - Multidisc

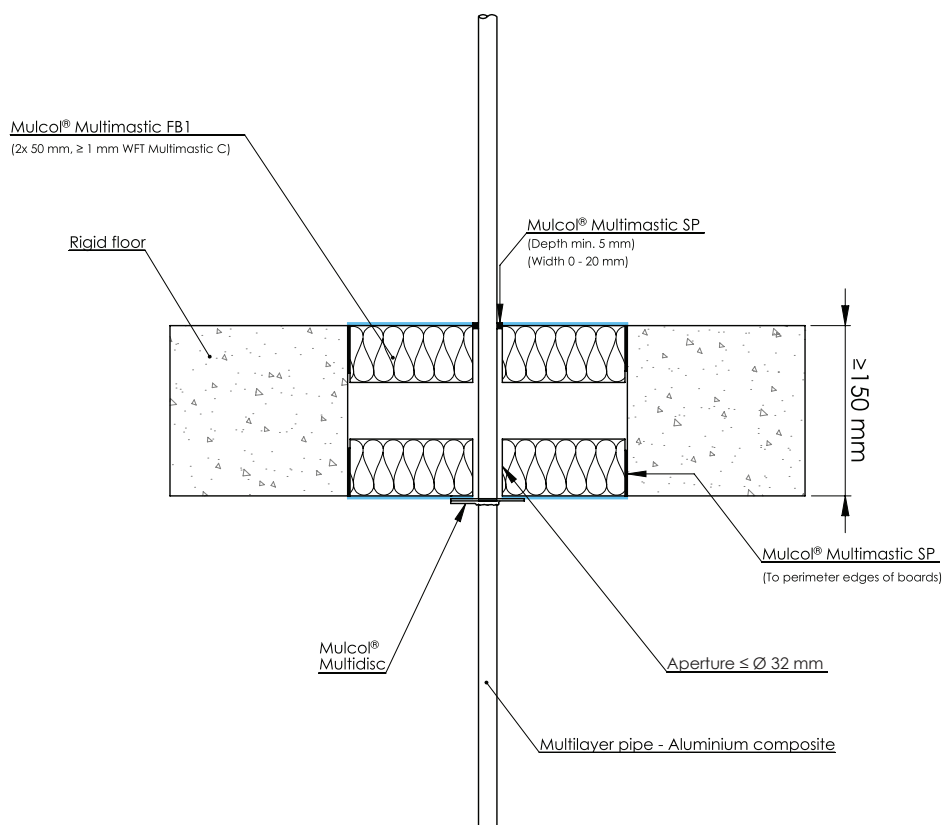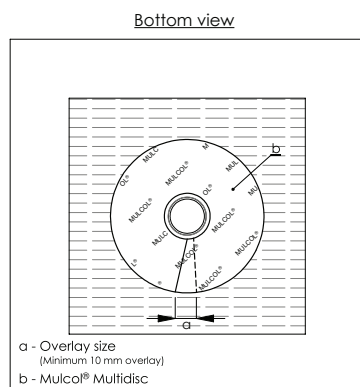



Drawing: PBrf.E-MFB1-MLA-M2.0.10.C

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Multilayer pipes (MLC)	≤ Ø 16	2.0	Multidisc	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 90 U/C, E 120 U/C


B.1.10 Multimastic FB2 - 1x 60 mm - Multilayer pipes (MLC)

B.1.10.1 Multilayer pipes (MLC) - Multidisc

Bottom view

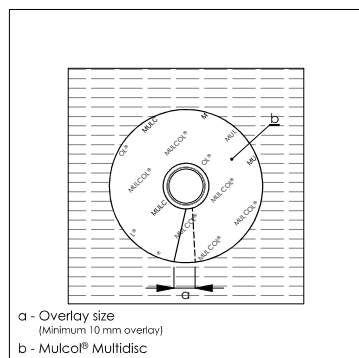

Position seal:
top, bottom or anywhere
in between

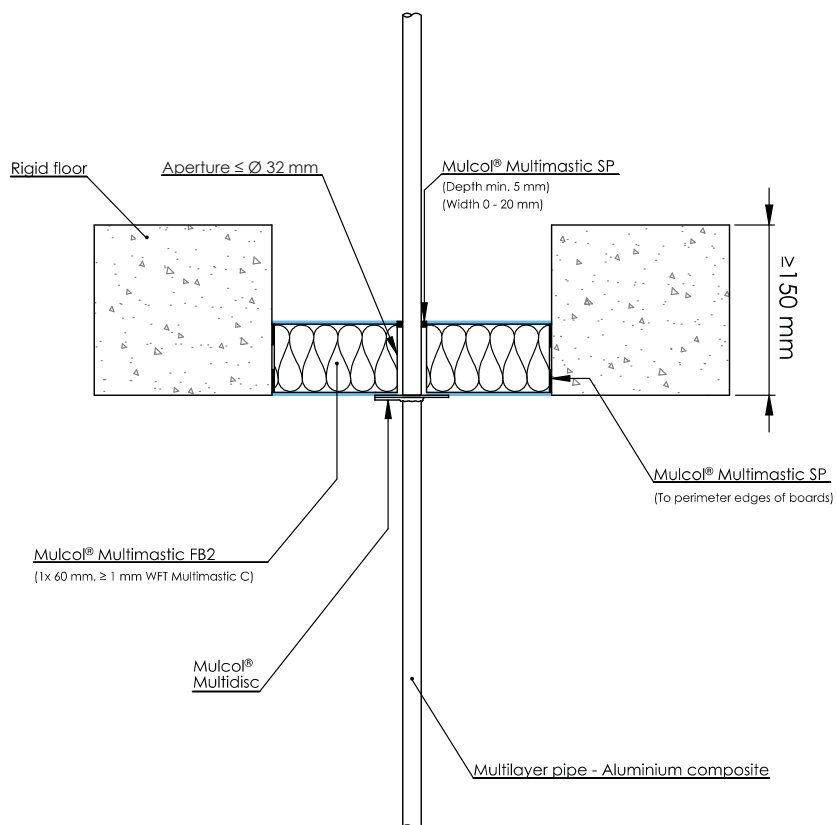



Drawing: PBrf.E-MFB2-MLA-M2.0.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Multilayer pipes (MLC)	$\leq \varnothing 16$	2.0	Multidisc	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 60 U/C, E 90 U/C


B.1.11 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated mineral wool

B.1.11.1 Copper and steel pipes - Stone wool LS 400 / CS

Bottom view

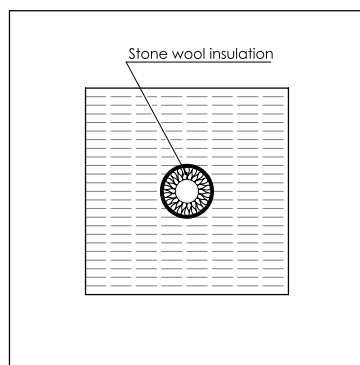

Position seal:
top, bottom or anywhere
in between

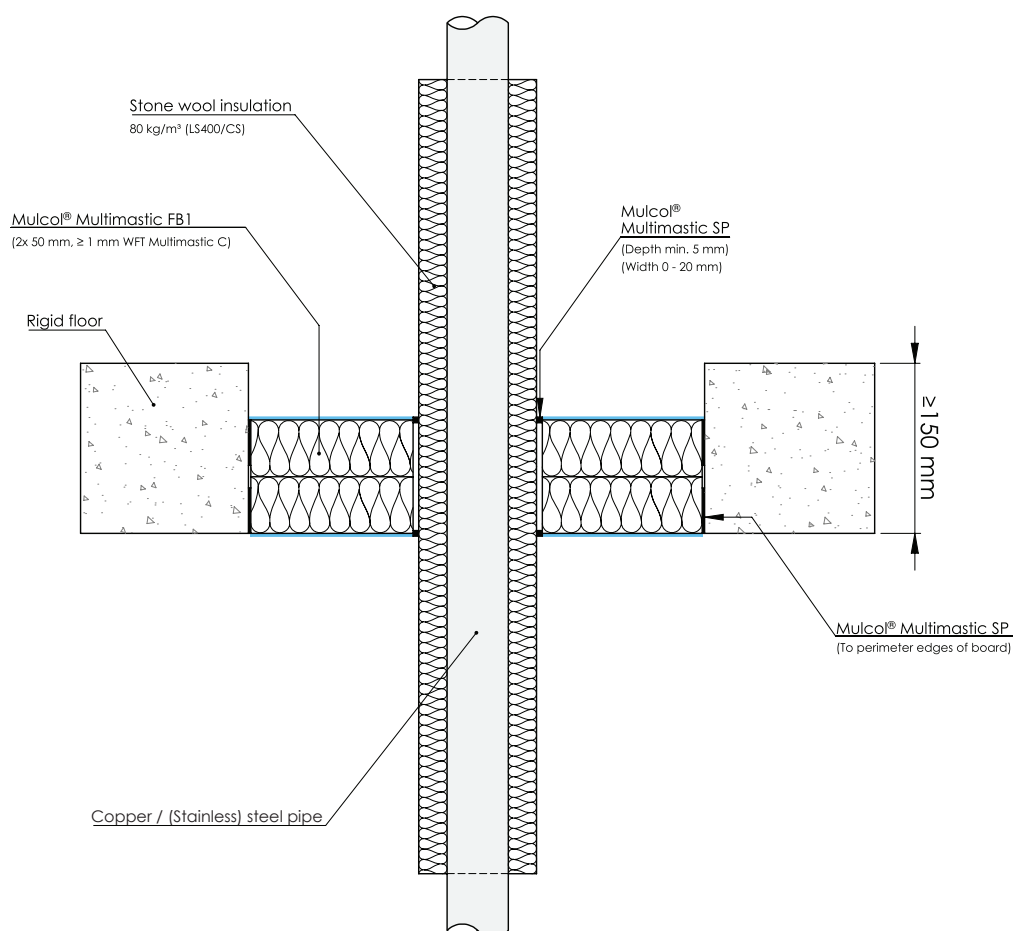



Drawing: PBrf.E-CU-MFB1.2.20.LS

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	25	LS 400 / CS	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 120 C/U
	≤ Ø 54	≥ 1.5					
(Stainless)	≤ Ø 114.3	≥ 3.6					
Steel / cast iron	≤ Ø 324	≥ 3.7		30			


B.1.11 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated mineral wool

B.1.11.2 Copper and steel pipes - Stone wool LI 400 / CI

Bottom view

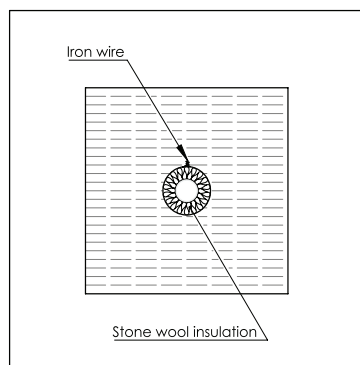

Position seal:
top, bottom or anywhere
in between

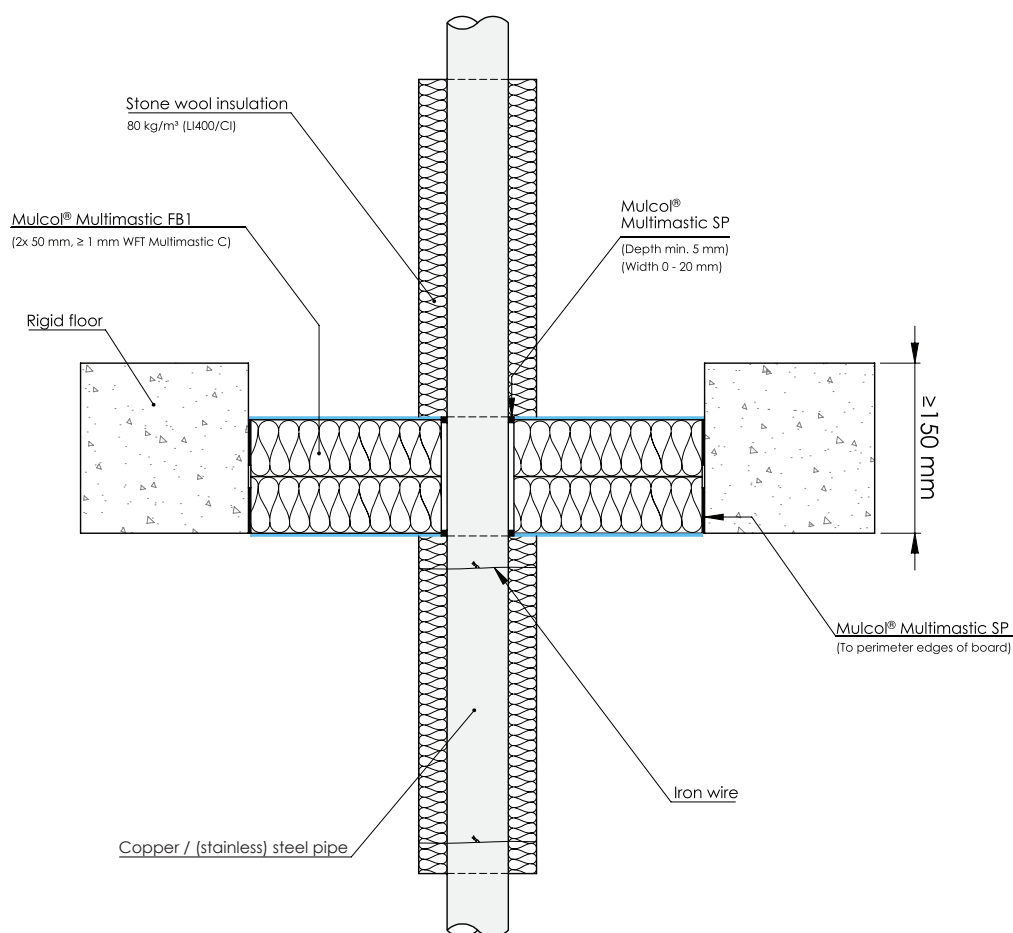



Drawing: PBrf.E-CU-MFB1.2.20.LI

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	≥ 25	LI 400 / CI	Multimastic SP 0 - 20 x ≥ 5 (wxd)	EI 120 C/U
	≤ Ø 54	≥ 1.5					
(Stainless)	≤ Ø 114.3	≥ 3.6					
Steel / cast iron	≤ Ø 219	≥ 4.0					


B.1.11 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated mineral wool

B.1.11.3 Copper and steel pipes - Glass wool LI 400 / CI

Bottom view

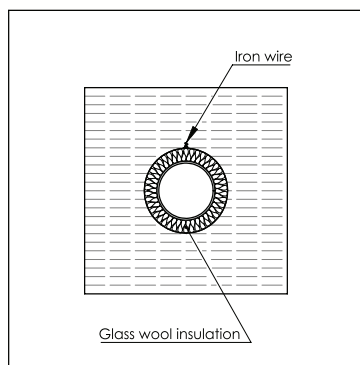

Position seal:
top, bottom or anywhere
in between

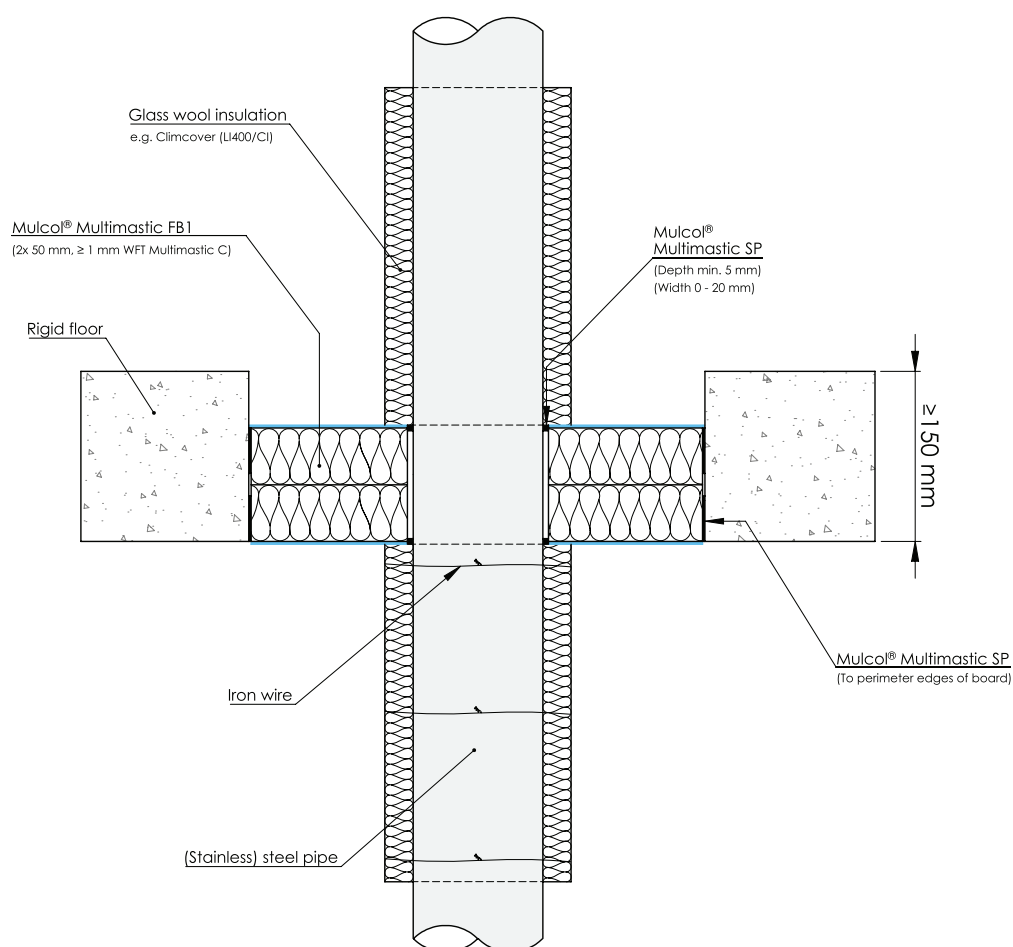



Drawing: PBrf.E-ST-MFB1.2.20.G.LI

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
(Stainless) Steel / cast iron	≤ Ø 40	≥ 2.0	Glass wool (≥ 33 kg/m³)	≥ 25	LI 400 / CI	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 120 C/U
	≤ Ø 114.3	≥ 3.6		≥ 30			EI 90 C/U, E 120 C/U
	≤ Ø 219	≥ 4.0					EI 60 C/U, E 120 C/U


B.1.12 Multimastic FB1 - 2x 50 mm cavity 50 mm - Metal pipes insulated mineral wool

B.1.12.1 Copper and steel pipes - Stone wool LS 400 / CS

Bottom view

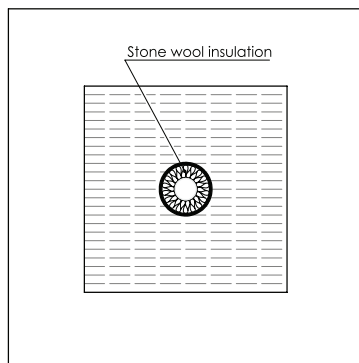

Position seal:
top, bottom or anywhere
in between

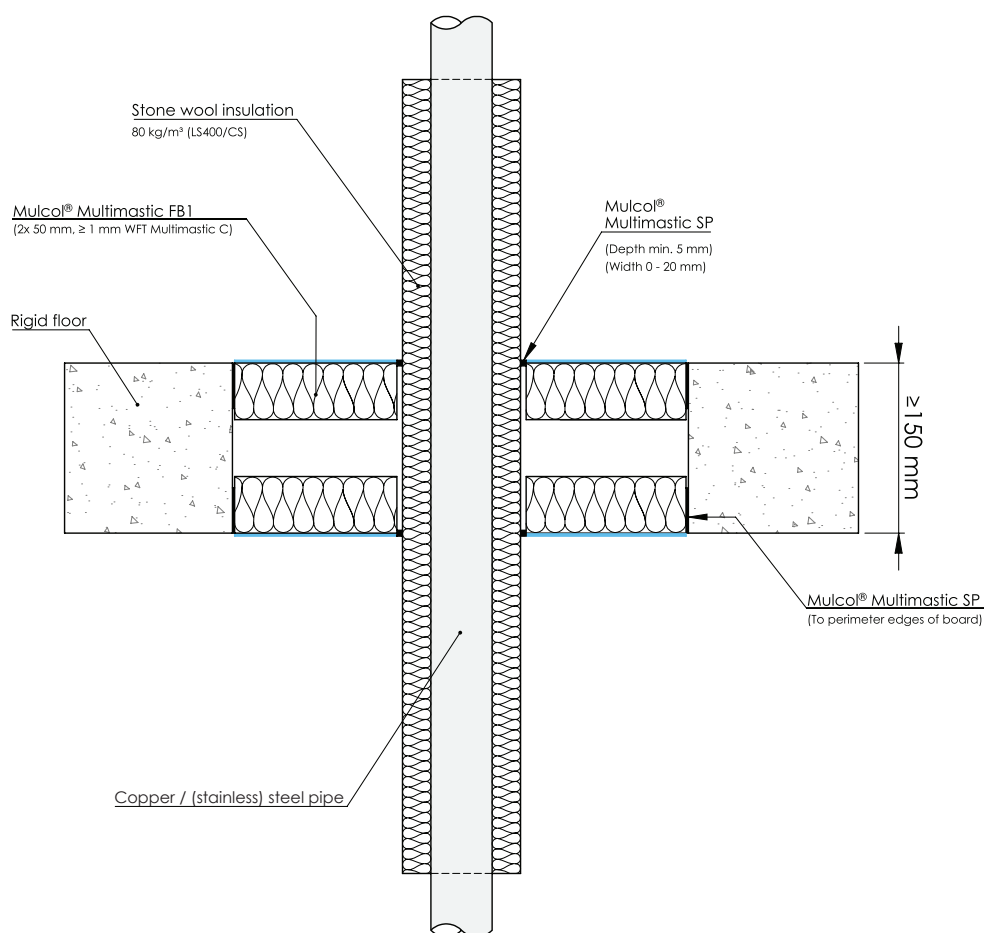



Drawing: PBrf.E-CU-MFB1.2.20.LS.C

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	25	LS 400 / CS	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 120 C/U
	≤ Ø 54	≥ 1.5					
(Stainless)	≤ Ø 114.3	≥ 3.6					
Steel / cast iron	≤ Ø 324	≥ 3.7		30			


B.1.12 Multimastic FB1 - 2x 50 mm cavity 50 mm - Metal pipes insulated mineral wool

B.1.12.2 Copper and steel pipes - Stone wool LI 400 / CI

Bottom view

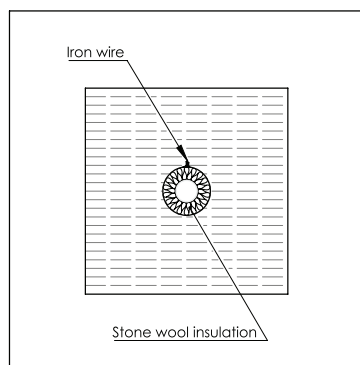

Position seal:
top, bottom or anywhere
in between

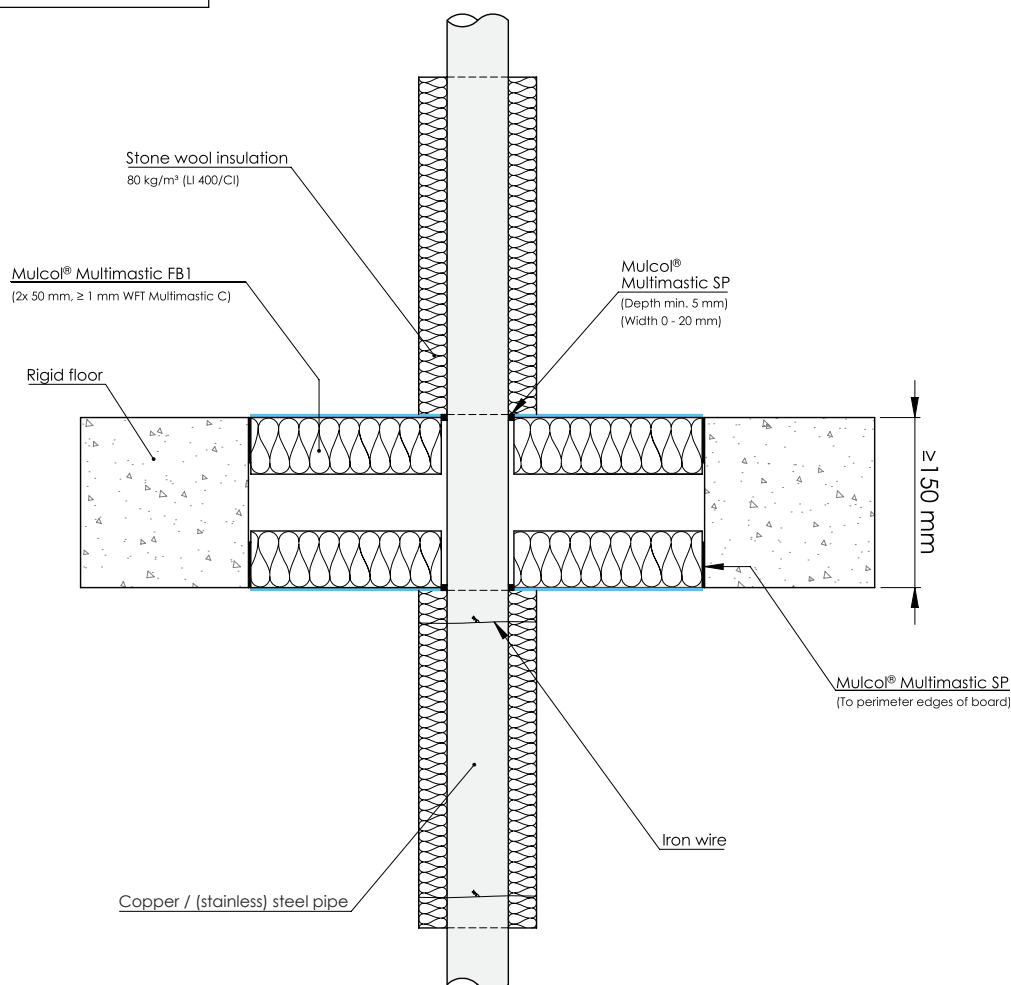



Drawing: PBrf.E-CU-MFB1.2.20.LI.C

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	25	LI 400 / CI	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 120 C/U
	≤ Ø 54	≥ 1.5					
(Stainless)	≤ Ø 114.3	≥ 3.6					
Steel / cast iron	≤ Ø 324	≥ 3.7		30			


B.1.12 Multimastic FB1 - 2x 50 mm cavity 50 mm - Metal pipes insulated mineral wool

B.1.12.3 Copper and steel pipes - Glass wool LI 400 / CI

Bottom view

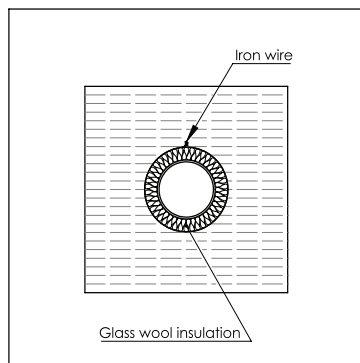

Position seal:
top, bottom or anywhere
in between

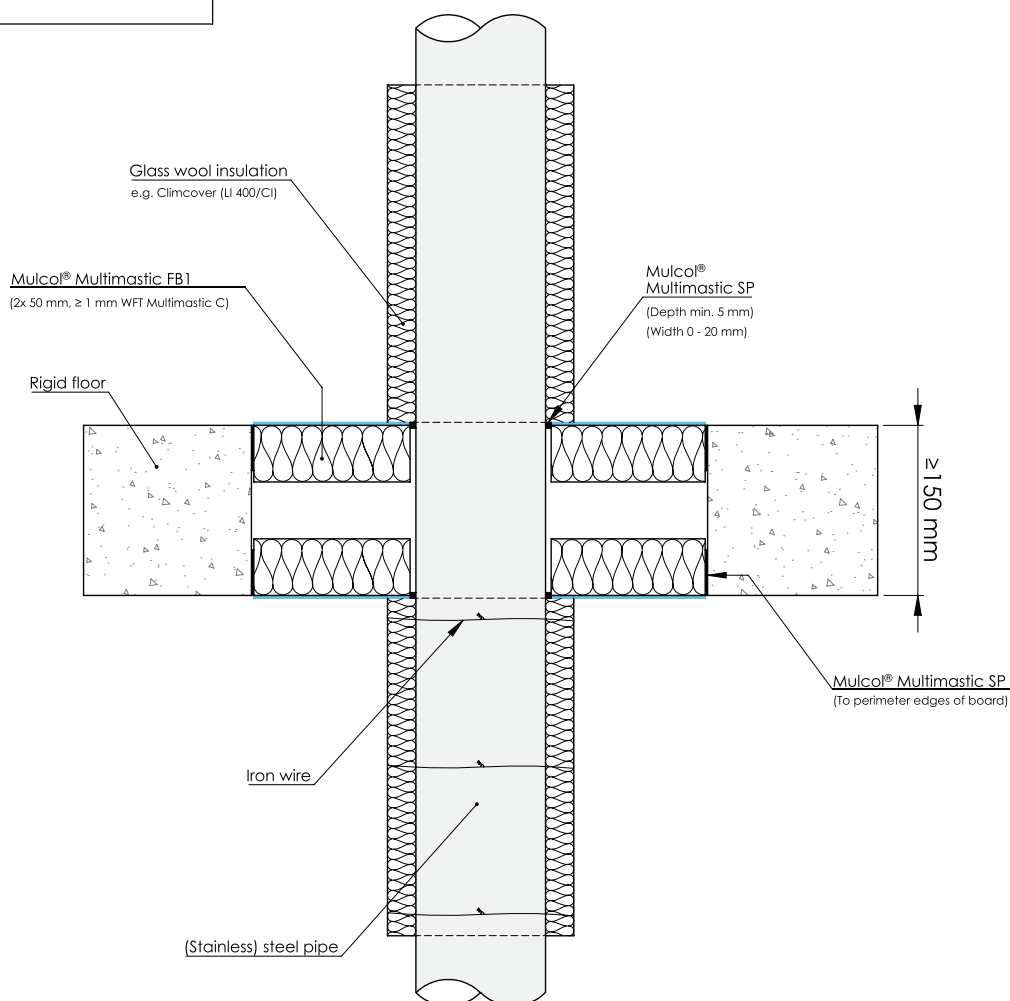



Drawing: PBrf.E-ST-MFB1.2.20.G.I.I.C

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
(Stainless) Steel / cast iron	≤ Ø 40	≥ 2.0	Isover	≥ 25	LI 400 / CI	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 120 C/U
	≤ Ø 114.3	≥ 3.6	Climclover				EI 90 C/U, E 120 C/U
	≤ Ø 219	≥ 4.0	Glass wool (≥ 33 kg/m³)	≥ 30			EI 60 C/U, E 120 C/U


B.1.13 Multimastic FB2 - 1x 60 mm - Metal pipes insulated mineral wool

B.1.13.1 Copper and steel pipes - Stone wool LS 400 / CS

Bottom view

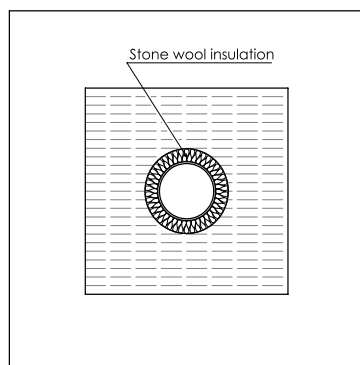

Position seal:
top, bottom or anywhere
in between

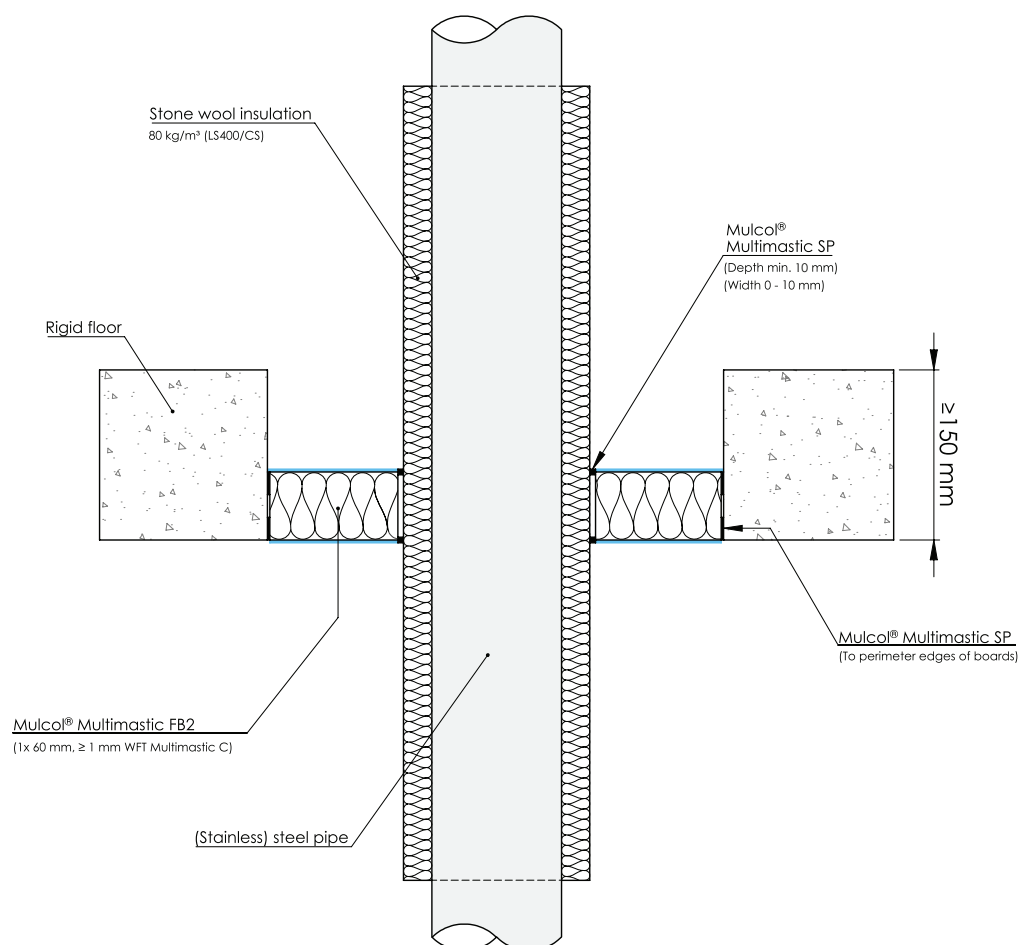



Drawing: PBrf.E-ST-MFB2.1.20

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m ³)	25	LS 400 / CS	Multimastic SP 0-10 x ≥ 10 (wxd)	EI 90 C/U E 120 C/U
(Stainless) Steel / cast iron	≤ Ø 114.3	≥ 3.6					EI 60 C/U E 120 C/U
	≤ Ø 219	≥ 4.0					


B.1.13 Multimastic FB2 - 1x 60 mm - Metal pipes insulated mineral wool

B.1.13.2 Copper and steel pipes - Stone wool LI 400 / CI

Bottom view

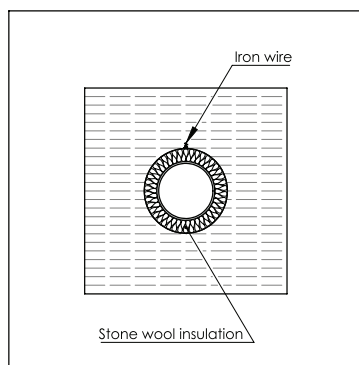

Position seal:
top, bottom or anywhere
in between

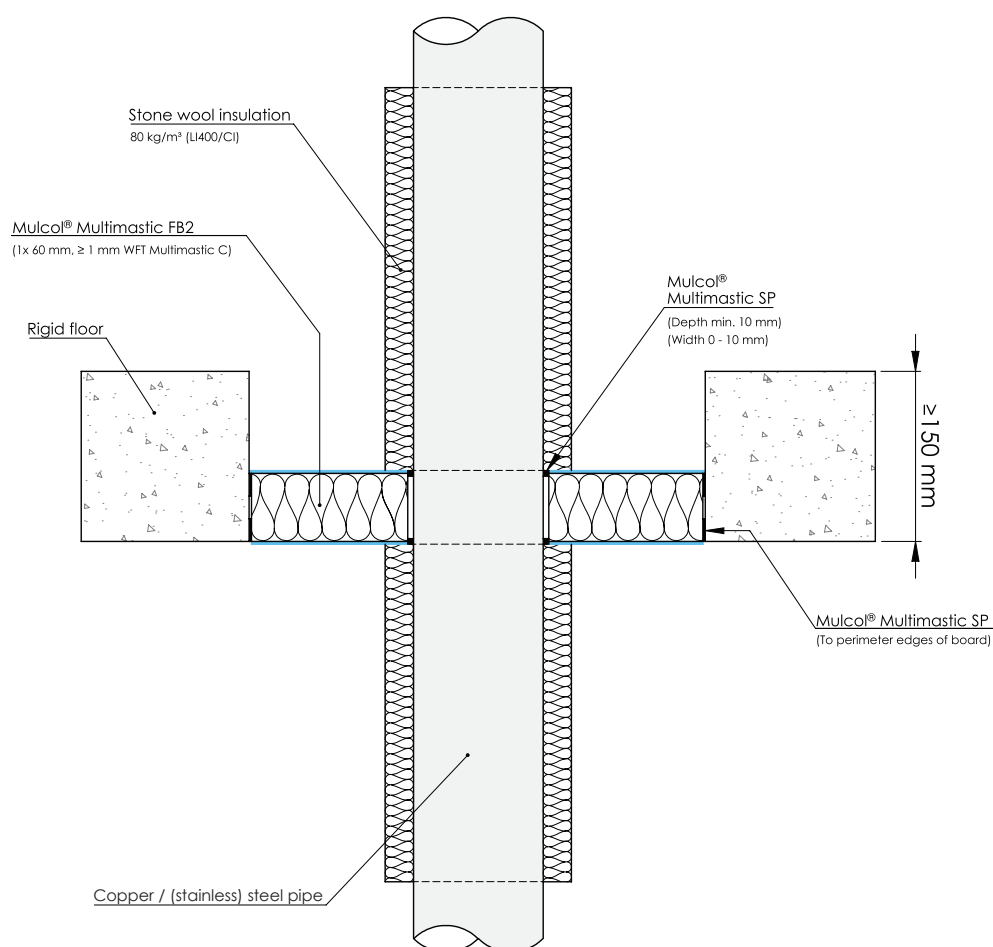



Drawing: PBrf.E-ST-MFB2.1.20.LI

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	≥ 25	LI 400 / CI	Multimastic SP 0-10 x ≥ 10 (wx d)	EI 90 C/U E 120 C/U
(Stainless)	≤ Ø 114.3	≥ 3.6					
Steel / cast iron	≤ Ø 219	≥ 4.0		≥ 30			


B.1.14 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated elastomer

B.1.14.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR

Bottom view

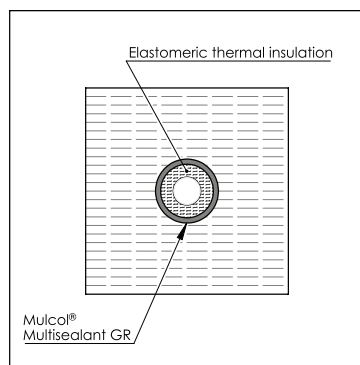

Position seal:
top, bottom or anywhere
in between

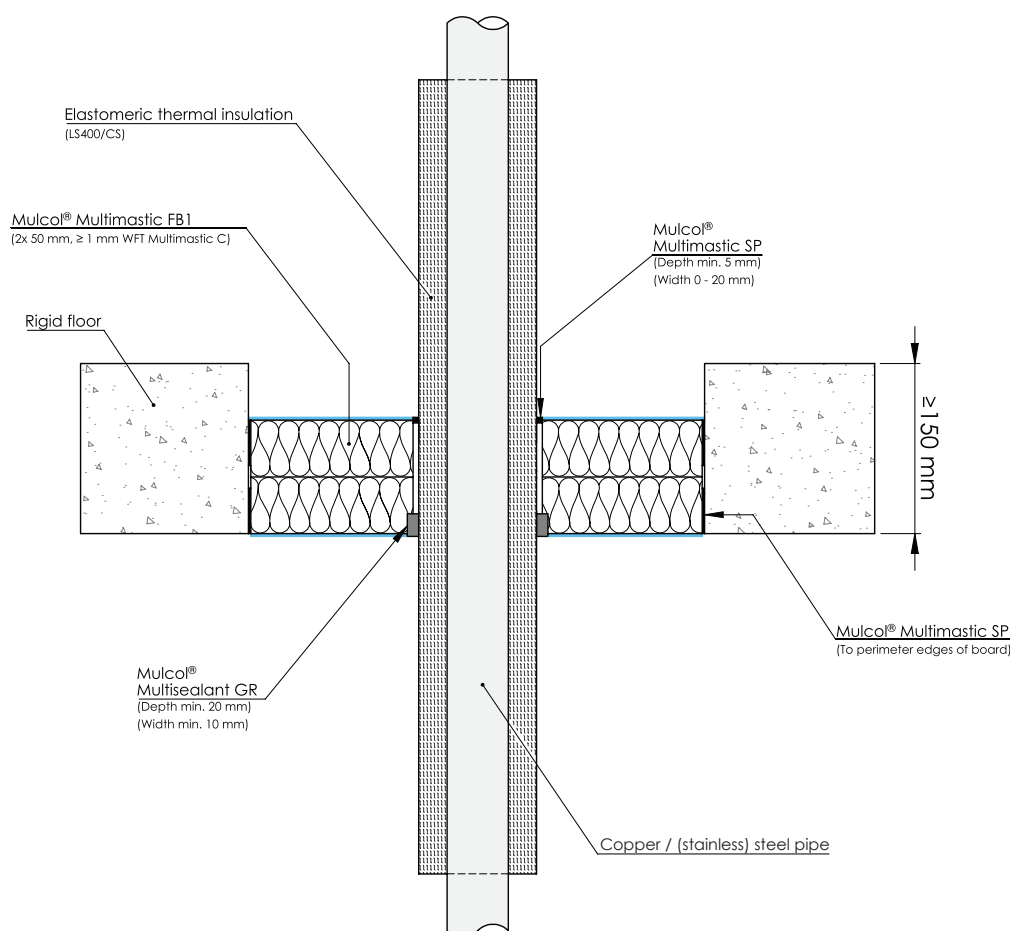

Drawing: PBrf.E-CU-MFB1-G2.4.22

Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	8.5	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 60 C/U, E 120 C/U
				8.5 - 33.5				
≤ Ø 54	≥ 1.5	13.5		CS	EI 120 C/U			
		13.5 - 38		LS 400 / CS	EI 90 C/U, E 120 C/U			
≤ Ø 26.9	≥ 2.3	8.5 - 35						EI 120 C/U
≤ Ø 114.3	≥ 3.6	15		CS				EI 90 C/U, E 120 C/U
		15 - 43	LS 400 / CS					

B.1.14 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated elastomer**B.1.14.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR**




Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3	Kaiflex KK Plus (min. class B-s2, d0 B _L -s2, d0)	8.5	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 60 C/U E 120 C/U

Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex NH (min. class D-s3, d0 D _L -S3, d0)	9 - 25	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 120 C/U
	≤ Ø 54	≥ 1.5		13	LS 400 / CS			EI 90 C/U
				13 - 25	LS 400 / CS			
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		9 - 25	LS 400 / CS			
	≤ Ø 114.3	≥ 3.6		19 - 25	LS 400 / CS			

Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex Ultima (min. class B-s1, d0 B _L -S1, d0)	9 - 25	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 60 C/U E 120 C/U
				25 - 32				EI 90 C/U E 120 C/U
	≤ Ø 54	≥ 1.5		13 - 32				EI 60 C/U E 120 C/U
				13 - 32	CS			EI 90 C/U E 120 C/U
				32	LS 400 / CS			EI 90 C/U
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		9 - 25				EI 60 C/U E 90 C/U
				25				EI 90 C/U E 120 C/U
	≤ Ø 114.3	≥ 3.6		13				EI 60 C/U E 120 C/U
				13 - 32				

B.1.14 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated elastomer

B.1.14.2 Steel pipes - Elastomer LI 300 / CI - Multicollar *Slim*

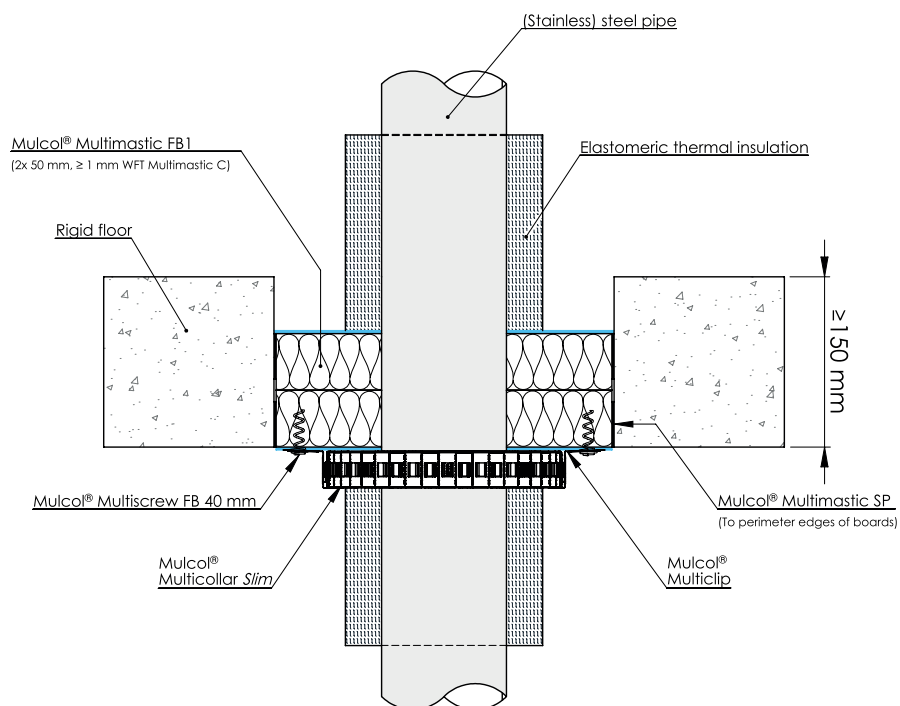

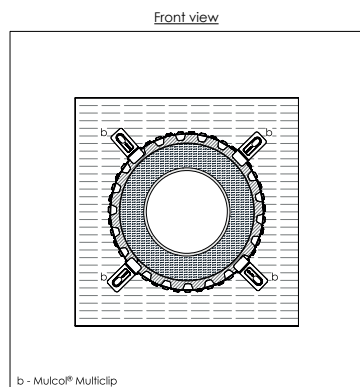


Drawing: PBrf.E-ST-11.0.22.LI

Services	Pipe dimensions (mm)		Insulation			Product	Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configura-tion				
(Stainless) Steel / cast iron	≤ Ø 114.3	≥ 3.6	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	9 - 32	LI 300 / CI	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	25 mm stone wool (33 kg/m ³)	EI 60 C/U E 90 C/U
				32					EI 90 C/U

B.1.14 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated elastomer

B.1.14.3 Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap

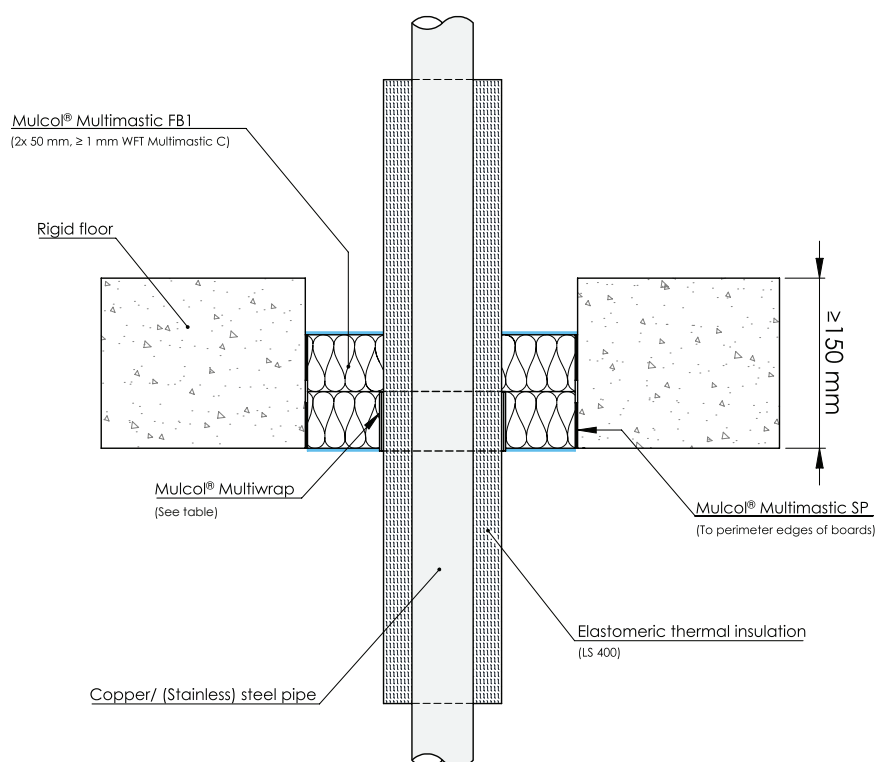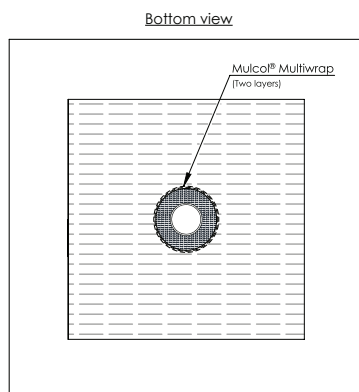


Drawing: PBrf.E-CU-MW2-MFB1.2.22

Services	Pipe dimensions (mm)		Insulation			Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 12	≥ 1	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	11	LS 400 / CS	Multiwrap (2 layers)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 120 C/U E 240 C/U
				11 - 28.5				EI 90 C/U
Copper / (stainless) steel / cast iron	≤ Ø 54	≥ 1.5		13.5				EI 90 C/U E 120 C/U
				13.5 - 28.5				EI 90 C/U
(Stainless) Steel / cast iron	≤ Ø 168.3	≥ 4.5		13 - 19				EI 45 C/U E 120 C/U

B.1.14 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated elastomer

B.1.14.4 Copper and steel pipes - ArmaFlex Protect LS 400 / CS

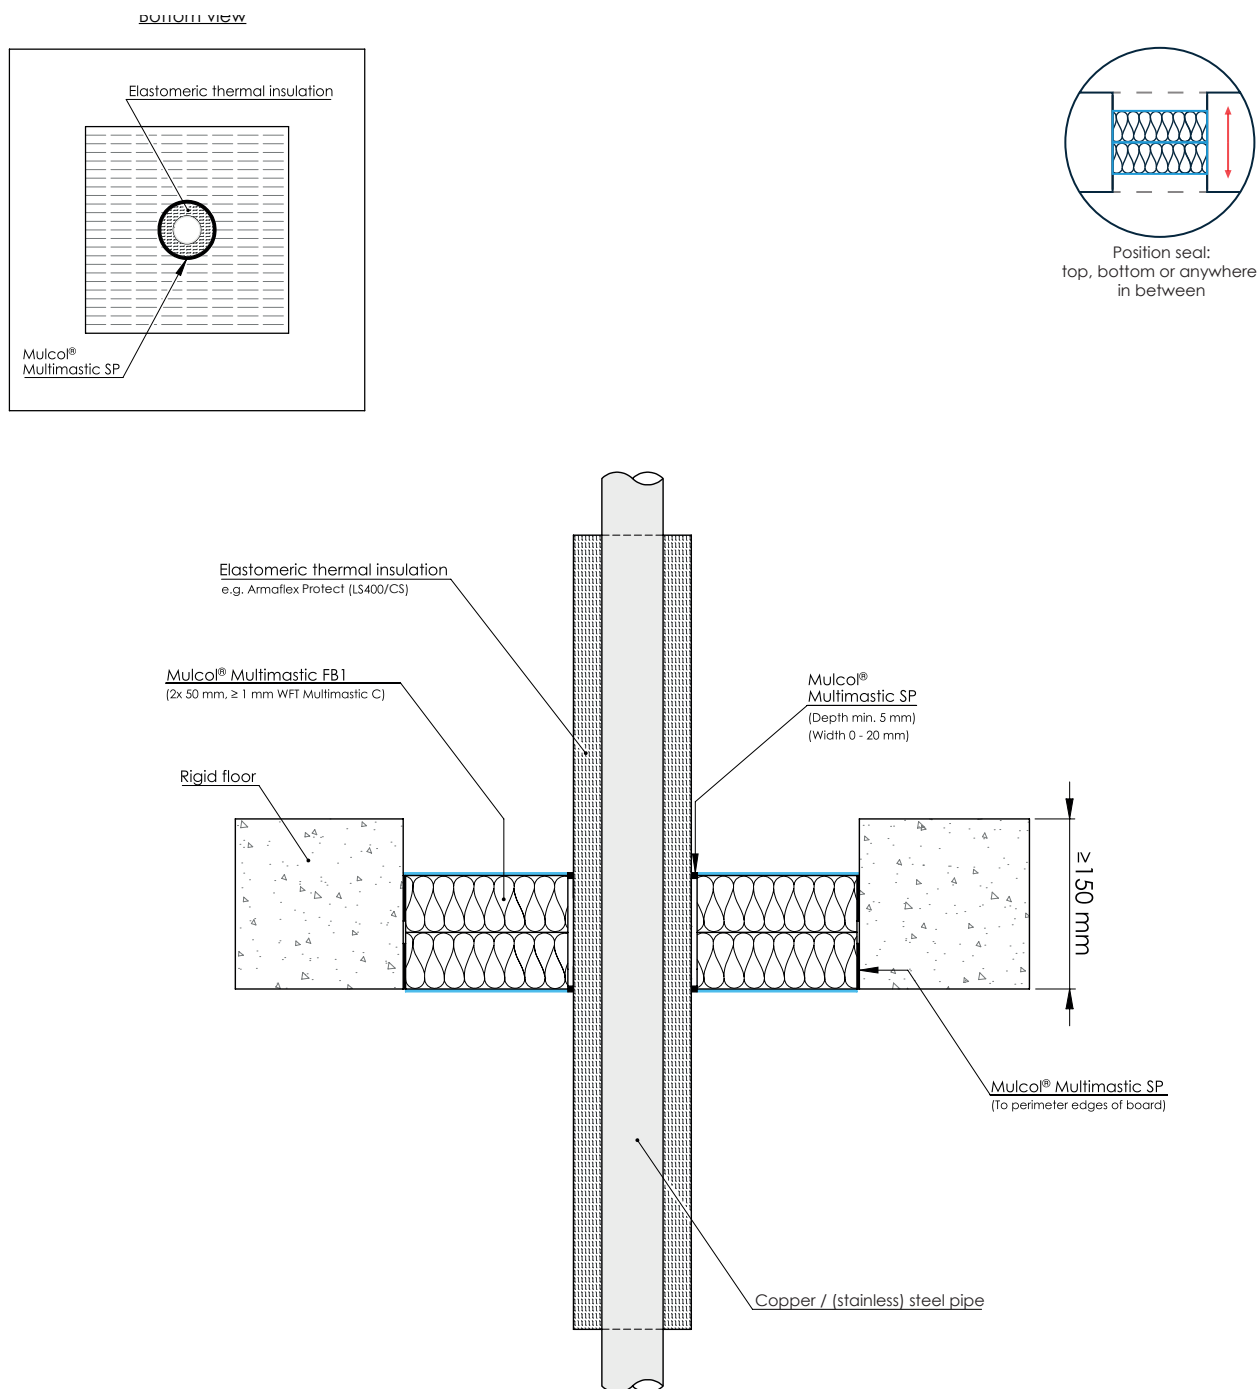



Drawing: PBrf.E-CU-MFB1.2.22.LS

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex Protect	20 - 25	LS 400 / CS	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 120 C/U
	≤ Ø 54	≥ 1.5		25			


B.1.15 Multimastic FB1 - 2x 50 mm cavity 50 mm - Metal pipes insulated elastomer

B.1.15.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR

Bottom view

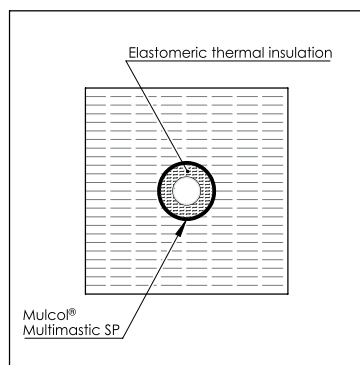

Position seal:
top, bottom or anywhere
in between

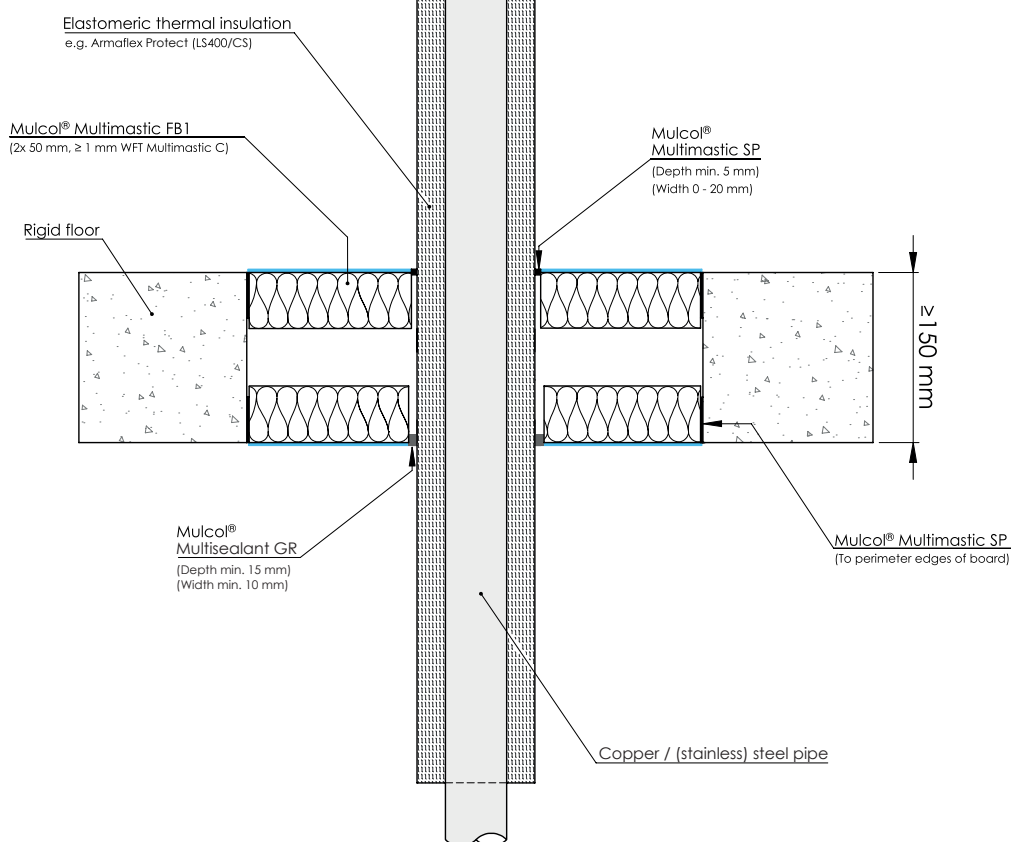

Drawing: PBrf.E-CU-MFB1-G2.2.22.LS.C

Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	8.5	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 60 C/U E 120 C/U
				8.5 - 33.5				EI 60 C/U E 90 C/U
	≤ Ø 54	≥ 1.5		13.5	CS			EI 120 C/U
				13.5 - 38	LS 400 / CS			EI 90 C/U E 120 C/U
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		8.5 - 35				CS
	≤ Ø 114.3	≥ 3.6		15	EI 90 C/U E 120 C/U			
				15 - 43	LS 400 / CS			

B.1.15 Multimastic FB1 - 2x 50 mm cavity 50 mm- Metal pipes insulated elastomer

B.1.15.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR




Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
(Stainless) Steel / cast iron	$\leq \varnothing 26.9$	≥ 2.3	Kaiflex KK Plus (min. class B-s2, d0 B _L -s2, d0)	8.5	LS 400 / CS	Multisealant GR $\geq 10 \times 20$ (wxd)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 60 C/U E 120 C/U

Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex NH (min. class D-s3, d0 D _L -S3, d0)	9 - 25	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 120 C/U
	≤ Ø 54	≥ 1.5		13	LS 400 / CS			EI 90 C/U
				13 - 25	LS 400 / CS			
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		9 - 25	LS 400 / CS			EI 120 C/U
	≤ Ø 114.3	≥ 3.6		19 - 25	LS 400 / CS			

Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex Ultima (min. class B-s1, d0 B _L -S1, d0)	9 - 25	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 60 C/U E 120 C/U
				25 - 32				EI 90 C/U E 120 C/U
	≤ Ø 54	≥ 1.5		13 - 32				EI 60 C/U E 120 C/U
				13 - 32	CS			EI 90 C/U E 120 C/U
				32	EI 90 C/U			
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		9 - 25	LS 400 / CS			EI 60 C/U E 90 C/U
				25				EI 90 C/U E 120 C/U
	≤ Ø 114.3	≥ 3.6		13				EI 60 C/U E 120 C/U
				13 - 32				EI 60 C/U E 120 C/U

B.1.15 Multimastic FB1 - 2x 50 mm cavity 50 mm- Metal pipes insulated elastomer

B.1.15.2 Steel pipes - Elastomer LI 300 / CI - Multicollar *Slim*

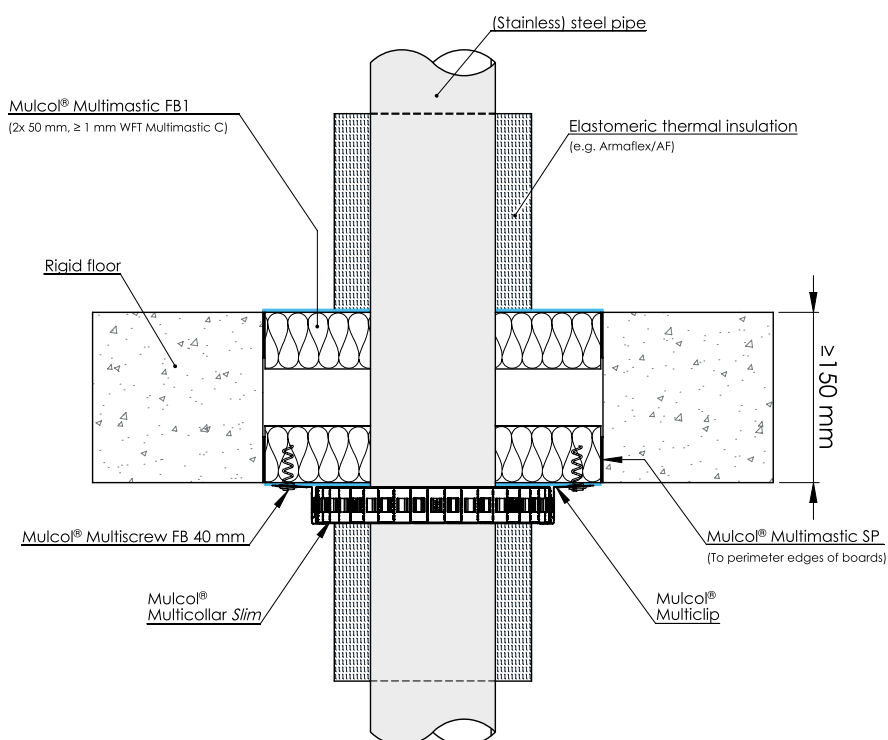




Drawing: PBrf.E-ST-11.0.22.LI.C

Services	Pipe dimensions (mm)		Insulation			Product	Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration				
(Stainless) Steel / cast iron	≤ Ø 114.3	≥ 3.6	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	9 - 32	LI 300 / CI	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	25 mm stone wool (≥ 33kg/m ³)	EI 60 C/U E 90 C/U
				32					EI 90 C/U

B.1.15 Multimastic FB1 - 2x 50 mm cavity 50 mm- Metal pipes insulated elastomer

B.1.15.3 Steel pipes - Elastomer LS 400 / CS - Multiwrap

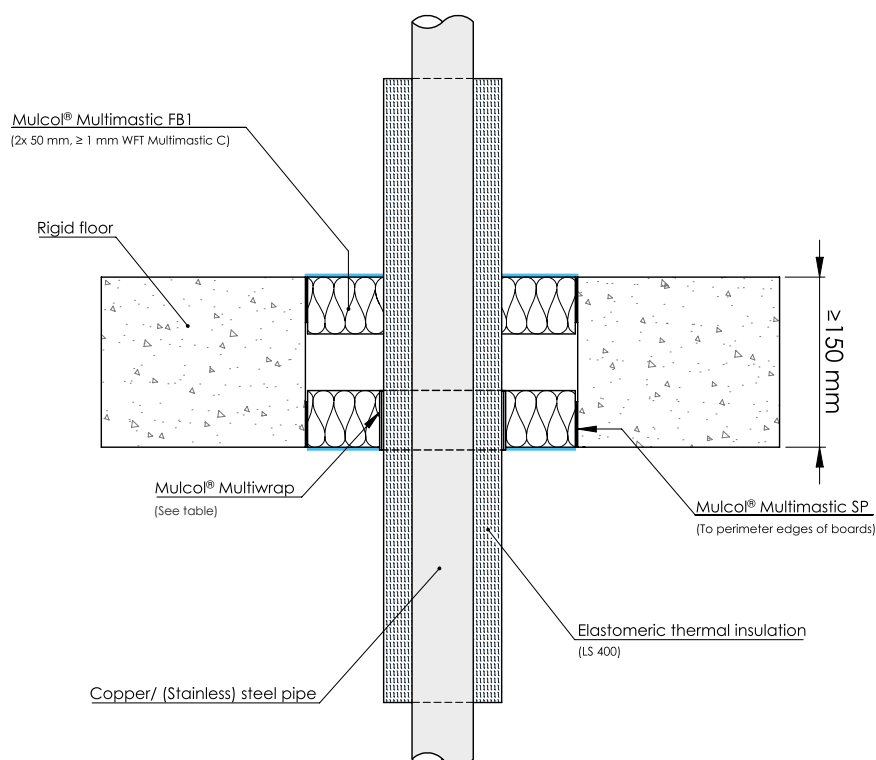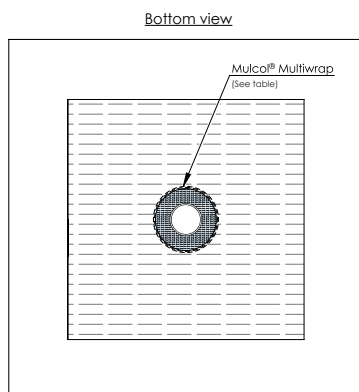

Drawing: PBrf.E-CU-MW2-MFB1.2.22.LS.C

Services	Pipe dimensions (mm)		Insulation			Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 12	≥ 1	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	11	LS 400 / CS	Multiwrap (2 layers)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 120 C/U E 240 C/U
				11 - 28.5				EI 90 C/U
Copper / (stainless) steel / cast iron	≤ Ø 54	≥ 1.5		13.5 - 28.5				EI 45 C/U E 90 C/U
	≤ Ø 54	≥ 1.5		28.5				EI 90 C/U
(Stainless) Steel / cast iron	≤ Ø 168.3	≥ 4.5		13 - 19				EI 45 C/U E 120 C/U



B.1.15 Multimastic FB1 - 2x 50 mm cavity $\geq$ 50 mm- Metal pipes insulated elastomer**B.1.15.3 Steel pipes - Elastomer LS 400 / CS - Multiwrap**

Services	Pipe dimensions (mm)		Insulation			Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
(Stainless) Steel / cast iron	$\leq \varnothing 40$	≥ 2.0	Kaiflex KK Plus (min. class B-s2, d0 B _L -s2, d0)	19	LS 400 / CS	Multiwrap (2 layers)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 45 C/U E 120 C/U


B.1.15 Multimastic FB1 - 2x 50 mm cavity 50 mm- Metal pipes insulated elastomer

B.1.15.4 Copper and steel pipes - ArmaFlex Protect LS 400 / CS

Bottom view

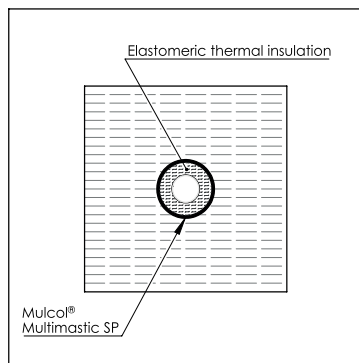

Position seal:
top, bottom or anywhere
in between

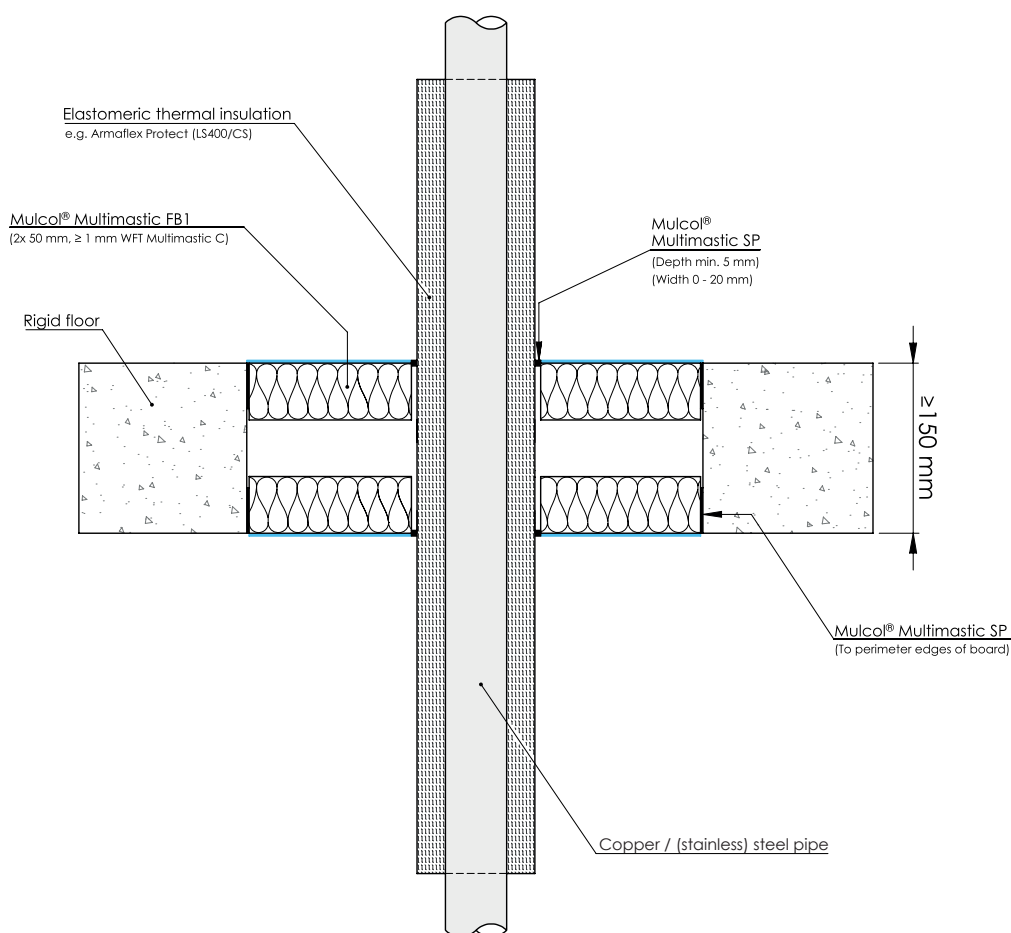



Drawing: PBrf.E-CU-MFB1.2.22.LS.C

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex Protect	20 - 25	LS 400 / CS	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 120 C/U
	≤ Ø 54	≥ 1.5		25			


B.1.16 Multimastic FB2 - 1x 60 mm - Metal pipes insulated elastomer

B.1.16.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR

Bottom view

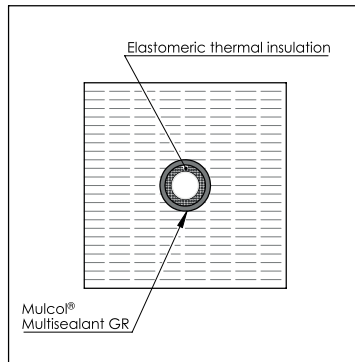

Position seal:
top, bottom or anywhere
in between

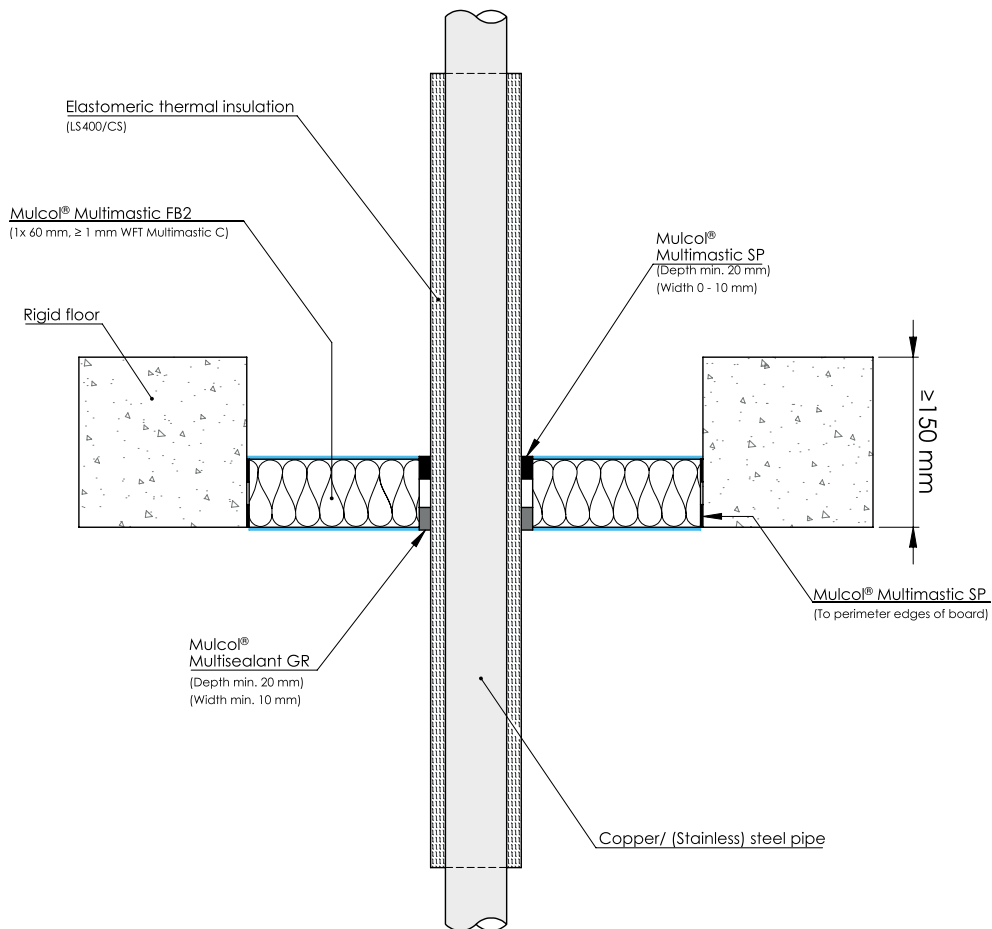

Drawing: PBrf.E-CU-MFB2-G2.4.22.LS

Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	8.5 - 35	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd) bottom of floor	Multimastic SP 0-10 x ≥ 20 (wxd) top of floor	EI 60 C/U
				35				EI 120 C/U
				13.5				EI 60 C/U
(Stainless) Steel / cast iron	≤ Ø 54	≥ 1.5		13.5 - 38				EI 45 C/U
				8.5 - 35				E 120 C/U
	≤ Ø 26.9	≥ 2.3		35				EI 60 C/U
				13.5				EI 90 C/U
	≤ Ø 114.3	≥ 3.6		15 - 43				EI 120 C/U
								EI 60 C/U
								E 120 C/U

B.1.16 Multimastic FB2 - 1x 60 mm - Metal pipes insulated elastomer

B.1.16.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR



Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
(Stainless) Steel / cast iron	$\leq \varnothing 26.9$	≥ 2.3	Kaiflex KK Plus (min. class B-s2, d0 B _L -s2, d0)	8.5	LS 400 / CS	Multisealant GR $\geq 10 \times 20$ (wxd)	Multimastic SP 0-20 x ≥ 10 (wxd) top of floor	EI 45 C/U

Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex NH (min. class D-s3, d0 D _L -S3, d0)	9 - 25	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	Multimastic SP 0-20 x ≥ 10 (wxd) top of floor	EI 60 C/U E 90 C/U
	≤ Ø 54	≥ 1.5		13 - 25				EI 60 C/U
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		9 - 25				EI 30 C/U
	≤ Ø 26.9	≥ 2.3		25				EI 60 C/U E 120 C/U
	≤ Ø 114.3	≥ 3.6		19				EI 30 C/U E 120 C/U
				19 - 25				EI 45 C/U E 120 C/U

Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification			
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration						
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex Ultima (min. class B-s1, d0 B _L -S1, d0)	9 - 25	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	Multimastic SP 0-20 x ≥ 10 (wxd) top of floor	EI 30 C/U E 120 C/U			
				25				EI 60 C/U E 120 C/U			
	≤ Ø 54	≥ 1.5		13 - 32				EI 45 C/U E 120 C/U			
				32				EI 90 C/U			
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		9 - 25							EI 60 C/U E 120 C/U
				25							EI 90 C/U E 120 C/U
	≤ Ø 114.3	≥ 3.6		13							EI 120 C/U
				13 - 32							EI 60 C/U E 120 C/U

B.1.16 Multimastic FB2 - 1x 60 mm - Metal pipes insulated elastomer

B.1.16.2 Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap

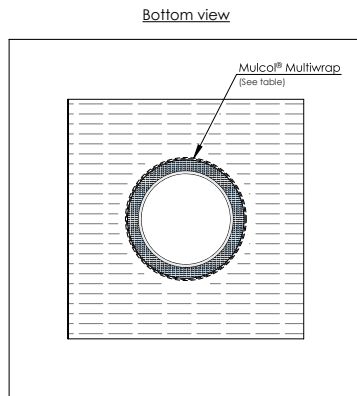

Mulcol® Multimastic FB2
(1x 60 mm, ≥ 1 mm WFT Multimastic C)

Rigid floor

Mulcol® Multiwrap
(See table)

(Stainless) steel pipe

Mulcol® Multimastic SP

≥ 150 mm

Mulcol® Multimastic SP
(To perimeter edges of boards)


Elastomeric thermal insulation
(LS400/CS)

Drawing: PBrf.E-ST-MW2-MFB2.1.22.LS

Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.1	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	12	LS 400 / CS	Multiwrap (2 layers)	Multimastic SP 0-10 x ≥ 20 (wxd) top of floor	EI 90 C/U E 120 C/U
				12 - 33.5				EI 45 C/U E 120 C/U
	13.5 - 38	EI 60 C/U E 120 C/U						
≤ Ø 54	≥ 1.5	38		EI 45 C/U E 120 C/U				
(Stainless) Steel / cast iron	≤ Ø 114.3	≥ 3.6		15 - 32				EI 60 C/U E 120 C/U
				32				EI 45 C/U E 120 C/U
	≤ Ø 168.3	≥ 4.5		13 - 19				EI 45 C/U E 120 C/U

B.1.17 Multimastic FB2 - 1x60 mm - Metal pipes insulated PIR foam


B.1.17.1 Steel pipes - PIR foam CS - Multiwrap - both sides

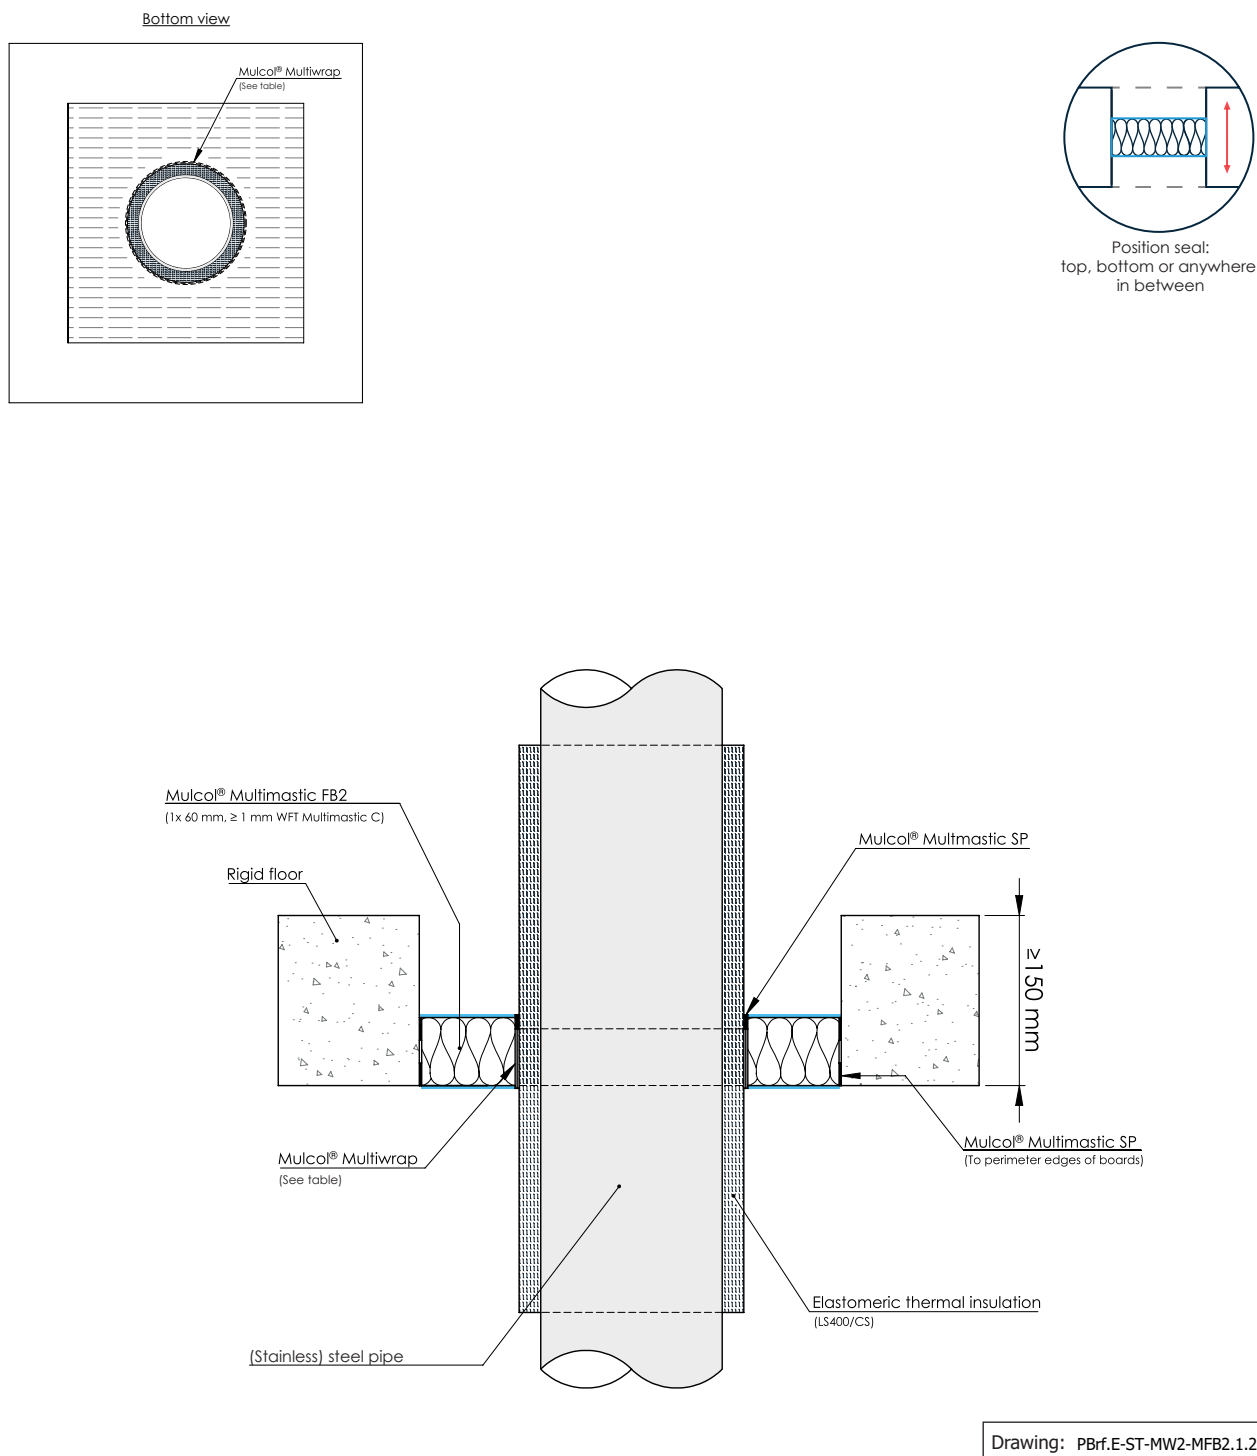

Services	Pipe dimensions (mm)		Insulation			Product (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
(Stainless) Steel / cast iron	≤ Ø 35	≥ 1.5	PIR (min. class E)	40	CS	Multiwrap (2 layers)	EI 60 C/U E 120 C/U

B.1.18 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes uninsulated

B.1.18.1 Copper and steel pipes - Multimastic SP



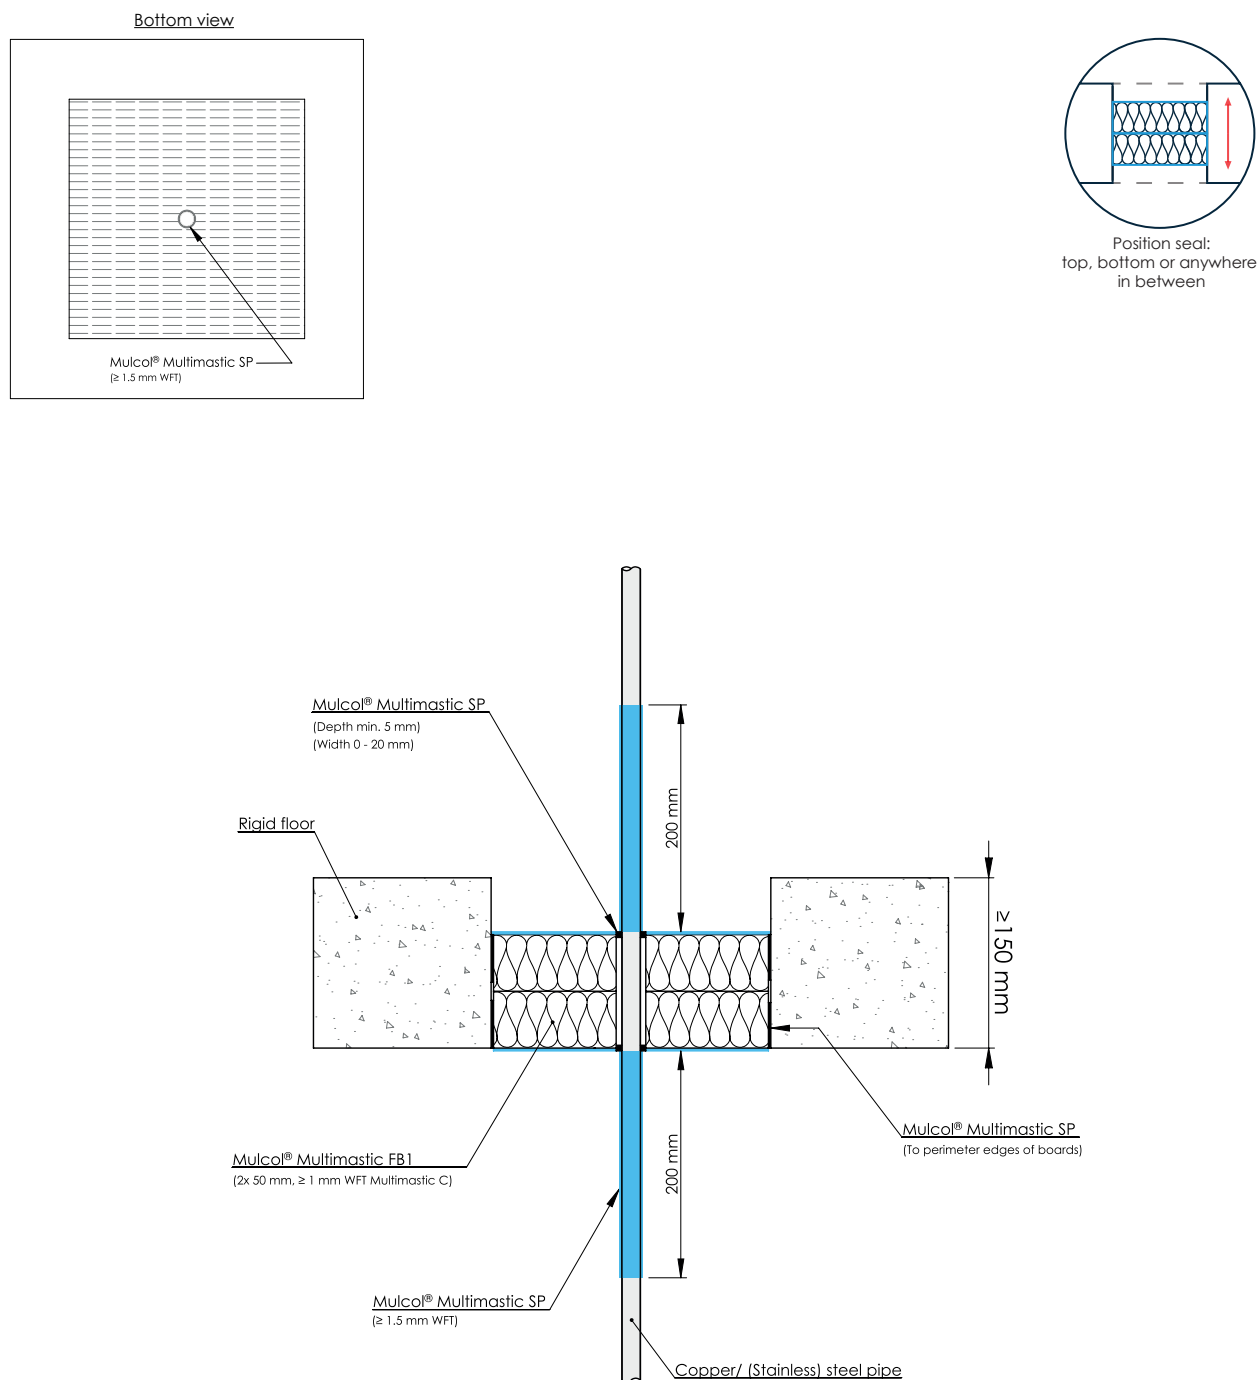


Drawing: PBrf.E-CU-MFB1-SPC.1.10

Services	Pipe dimensions (mm)		Coating	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Copper	≤ Ø 22	≥ 1.0	Coat back 200 mm ≥ 1.5 mm WFT Multimastic SP	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 20 C/U, E 90 C/U
(Stainless) Steel / cast iron		≥ 3.2			EI 30 C/U, E 90 C/U

B.1.18 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes uninsulated

B.1.18.2 Copper and steel pipes - Multisealant GR

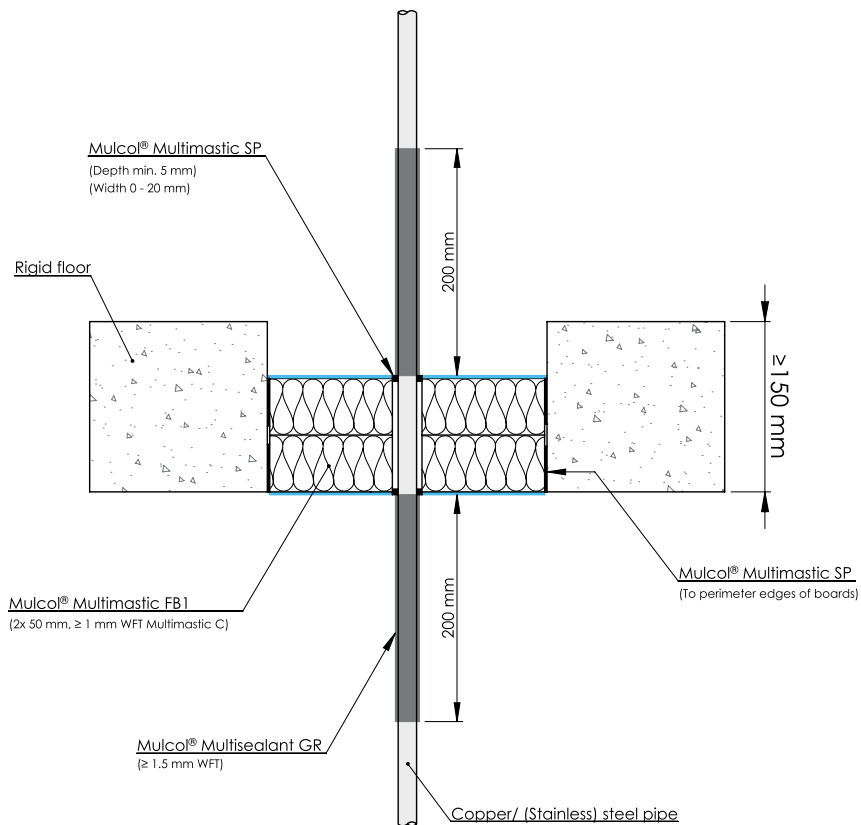

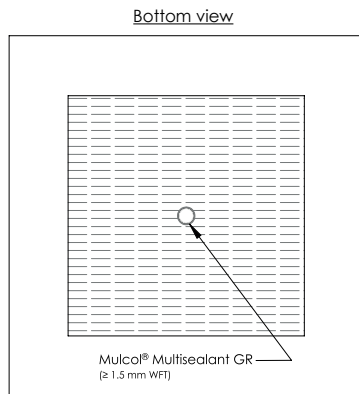


Drawing: PBrf.E-CU-MFB1-GRC.1.10

Services	Pipe dimensions (mm)		Coating	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Copper / (stainless) steel / cast iron	≤ Ø 15	≥ 1.0	Coat back 200 mm ≥ 1.5 mm WFT Multisealant GR	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 60 C/U, E 90 C/U
(Stainless) Steel / cast iron	≤ Ø 42.4	≥ 3.2			

B.1.18 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes uninsulated

B.1.18.3 Copper and steel pipes - Multidisc

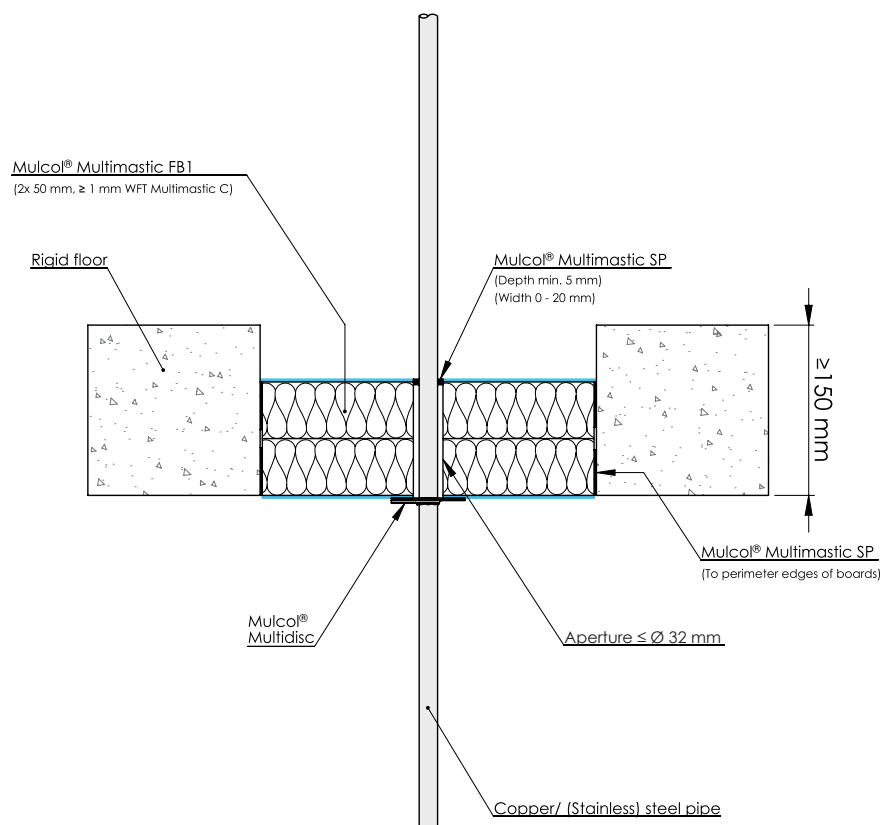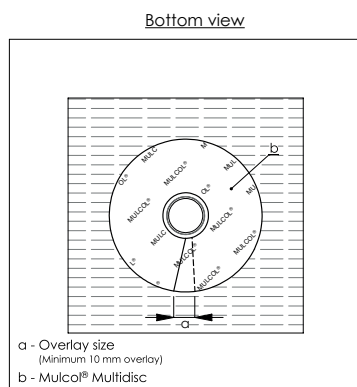




Drawing: PBrf.E-CU-M2.0.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Copper / (stainless) steel / cast iron	≤ Ø 15	≥ 1.0	Multidisc bottom of floor	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 60 C/U

B.1.19 Multimastic FB1 - 2x 50 mm cavity 50 mm - Metal pipes uninsulated

B.1.19.1 Copper and steel pipes - Multimastic SP

Bottom view

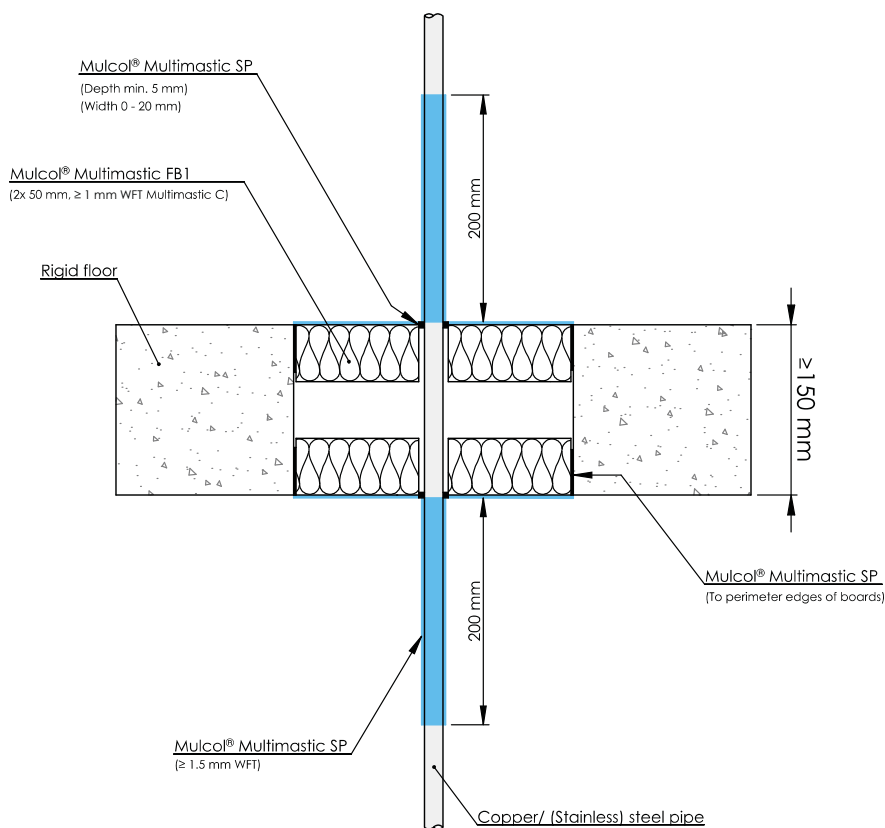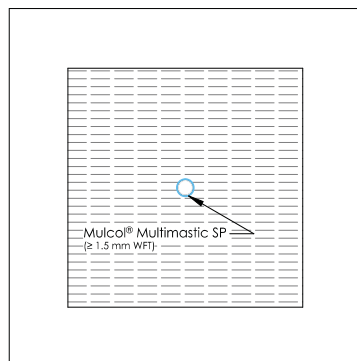



Drawing: PBrf.E-CU-MFB1-SPC.1.10.C

Services	Pipe dimensions (mm)		Coating	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Coat back 200 mm ≥ 1.5 mm WFT Multimastic SP	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 90 C/U, E 120 C/U
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3			EI 120 C/U
	≤ Ø 42.4	≥ 3.2			EI 90 C/U, E 120 C/U


B.1.19 Multimastic FB1 - 2x 50 mm cavity 50 mm - Metal pipes uninsulated

B.1.19.2 Copper and steel pipes - Multisealant GR

Bottom view

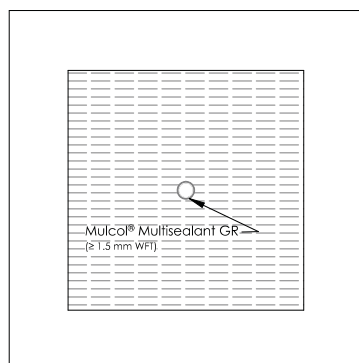

Position seal:
top, bottom or anywhere
in between



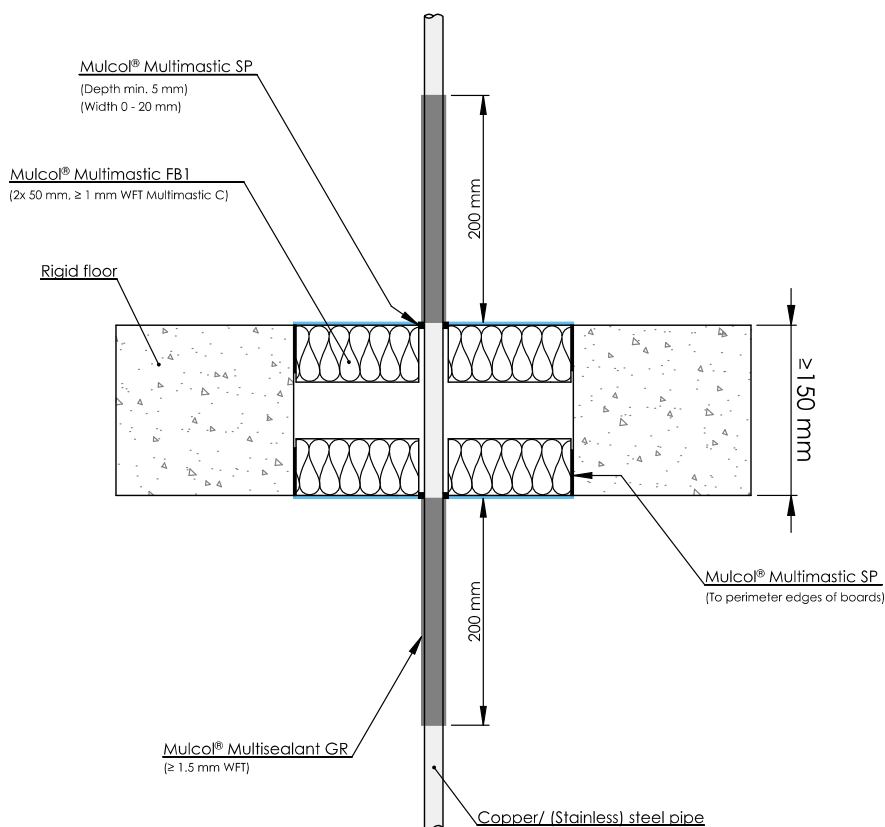


Drawing: PBrf.E-CU-MFB1-GRC.1.10.C

Services	Pipe dimensions (mm)		Coating	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Copper / (stainless) steel / cast iron	≤ Ø 15	≥ 1.0	Coat back 200 mm ≥ 1.5 mm WFT Multisealant GR	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 60 C/U, E 120 C/U
(Stainless) Steel / cast iron	≤ Ø 15	≥ 1.0			EI 120 C/U
	≤ Ø 42.4	≥ 3.2			

B.1.19 Multimastic FB1 - 2x 50 mm cavity 50 mm - Metal pipes uninsulated

B.1.19.3 Copper and steel pipes - Multidisc

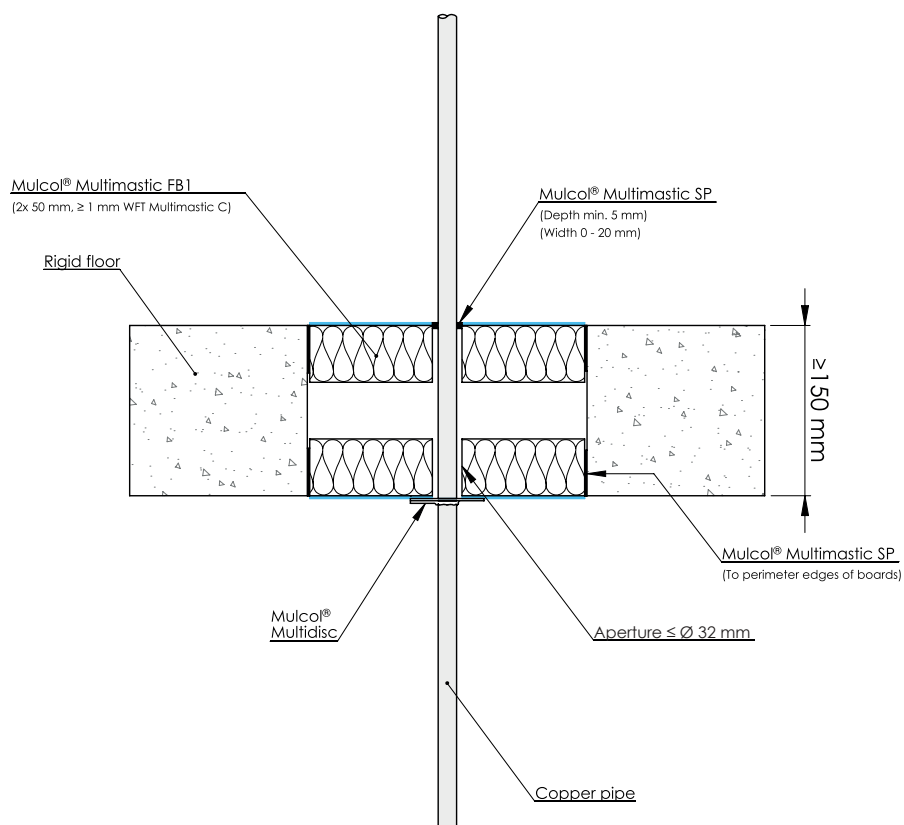




Drawing: PBrf.E-CU-M2.0.10.C

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Copper / (stainless) steel / cast iron	≤ Ø 15	≥ 1.0	Multidisc bottom of floor	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 60 C/U

B.1.19 Multimastic FB1 - 2x 50 mm cavity 50 mm - Metal pipes uninsulated

B.1.19.4 Copper and steel pipes - Multitherm Bandage

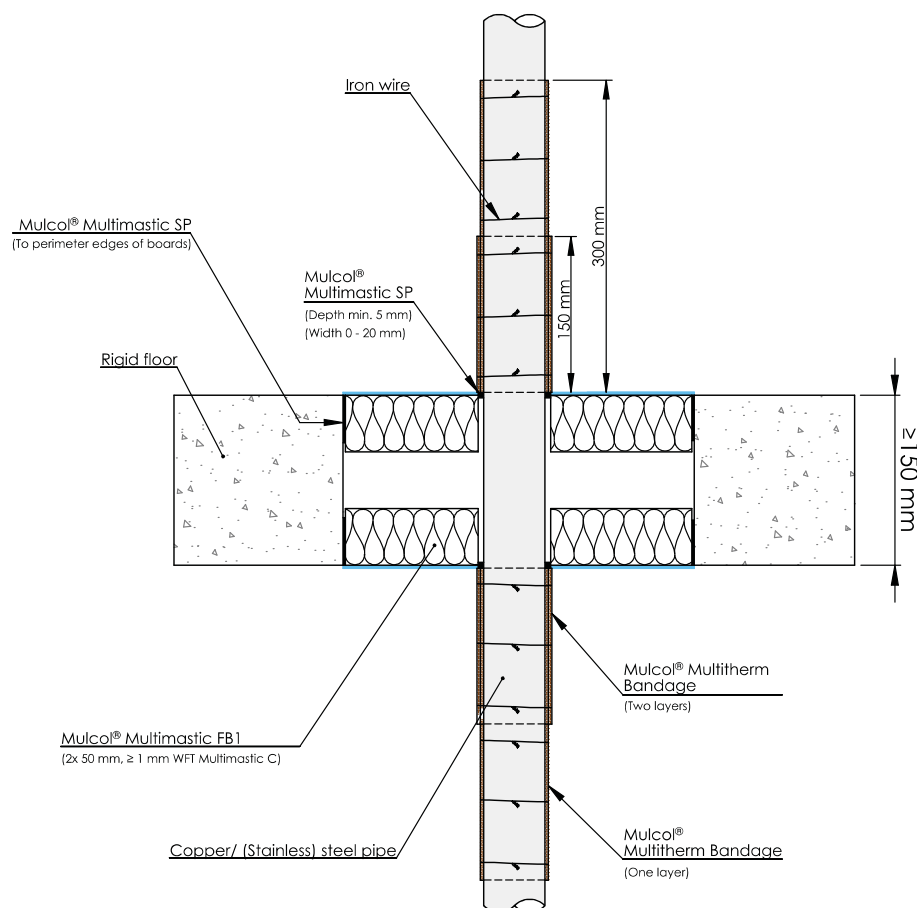

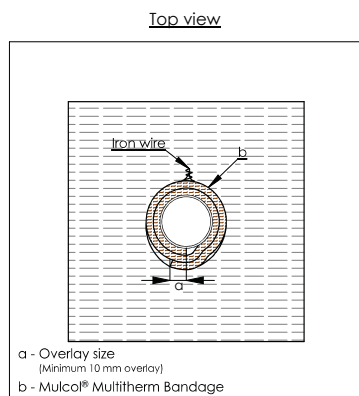


Drawing: PBrf.E-CU-MFB1-B2.3.21.C

Services	Pipe dimensions (mm)		Sealing (mm)	Multitherm Bandage	Classification
	Outer dimension	Wall thickness			
Copper / (stainless) steel / cast iron	≤ Ø 54	≥ 1.5	Multimastic SP 0-20 x ≥ 5 (wxd)	LI 150 two layers (two wires) + LI 300 one layer (two wires)	EI 90 C/U E 120 C/U

B.1.20 Multimastic FB2 - 1x 60 mm - Metal pipes uninsulated

B.1.20.1 Copper and steel pipes - Multimastic SP

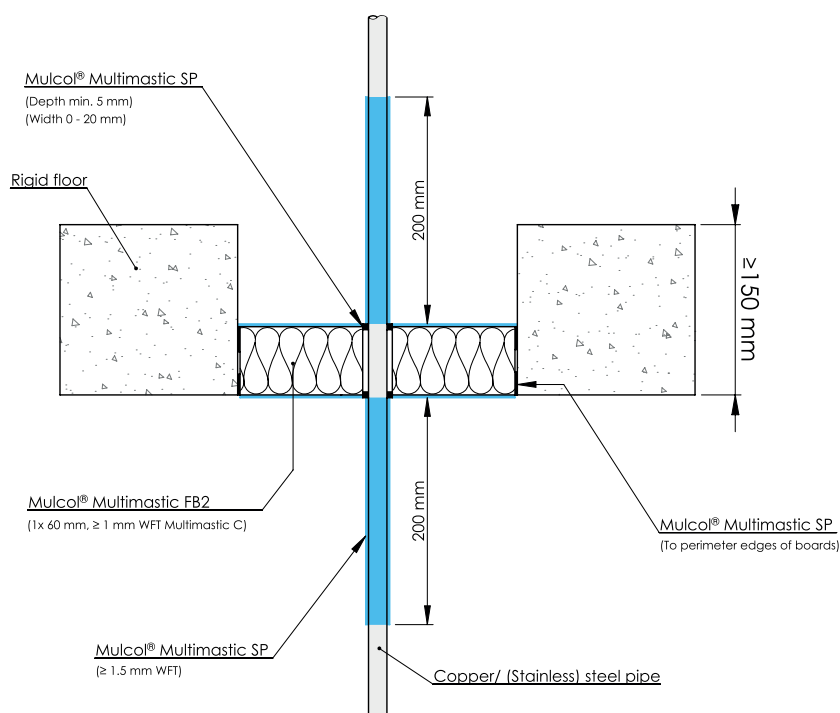

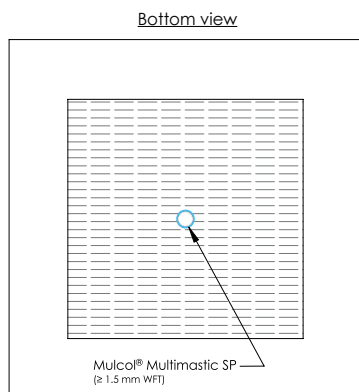


Drawing: PBrf.E-CU-MFB2-SPC.1.10

Services	Pipe dimensions (mm)		Coating	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Copper	≤ Ø 15	≥ 1.0	Coat back 200 mm ≥ 1.5 mm WFT Multimastic SP	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 20 C/U, E 90 C/U
(Stainless) steel / cast iron	≤ Ø 42.4	≥ 3.2			EI 30 C/U, E 90 C/U

B.1.20 Multimastic FB2- 1x 60 mm - Metal pipes uninsulated

B.1.20.2 Copper and steel pipes - Multisealant GR

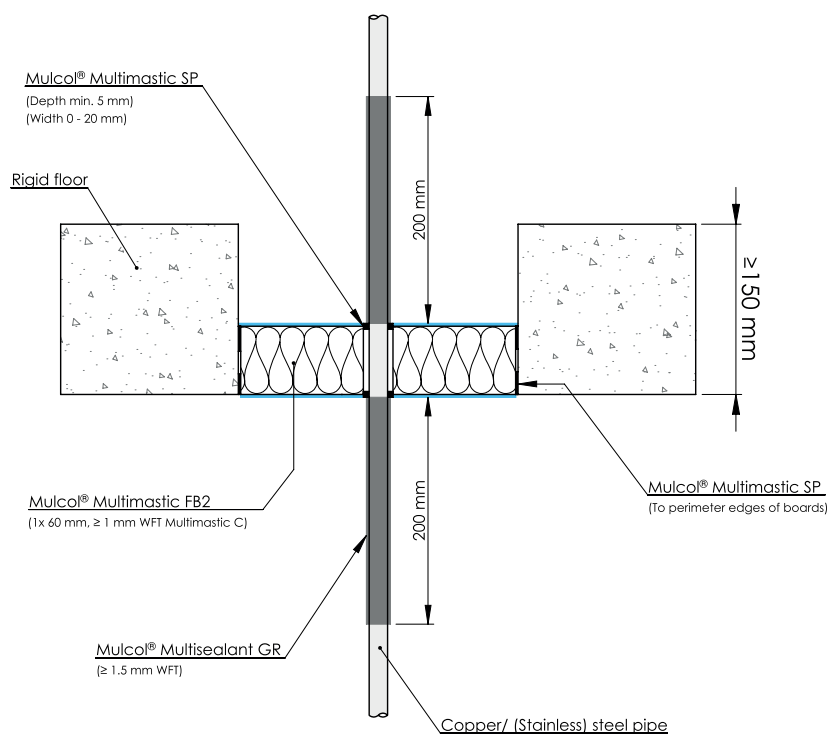

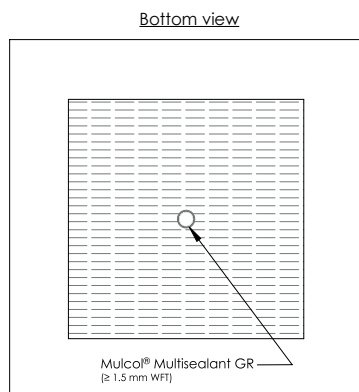


Drawing: PBrf.E-CU-MFB2-GRC.1.10

Services	Pipe dimensions (mm)		Coating	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Copper	≤ Ø 15	≥ 1.0	Coat back 200 mm ≥ 1.5 mm WFT Multisealant GR	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 60 C/U, E 90 C/U
(Stainless) steel / cast iron	≤ Ø 42.4	≥ 3.2			

B.1.21 Multimastic FB1 - 2x 50 mm cavity 50 mm - Gas pipes

B.1.21.1 Corrugated stainless steel tube gas (CSST) pipes - Multicollar - Multitherm Bandage

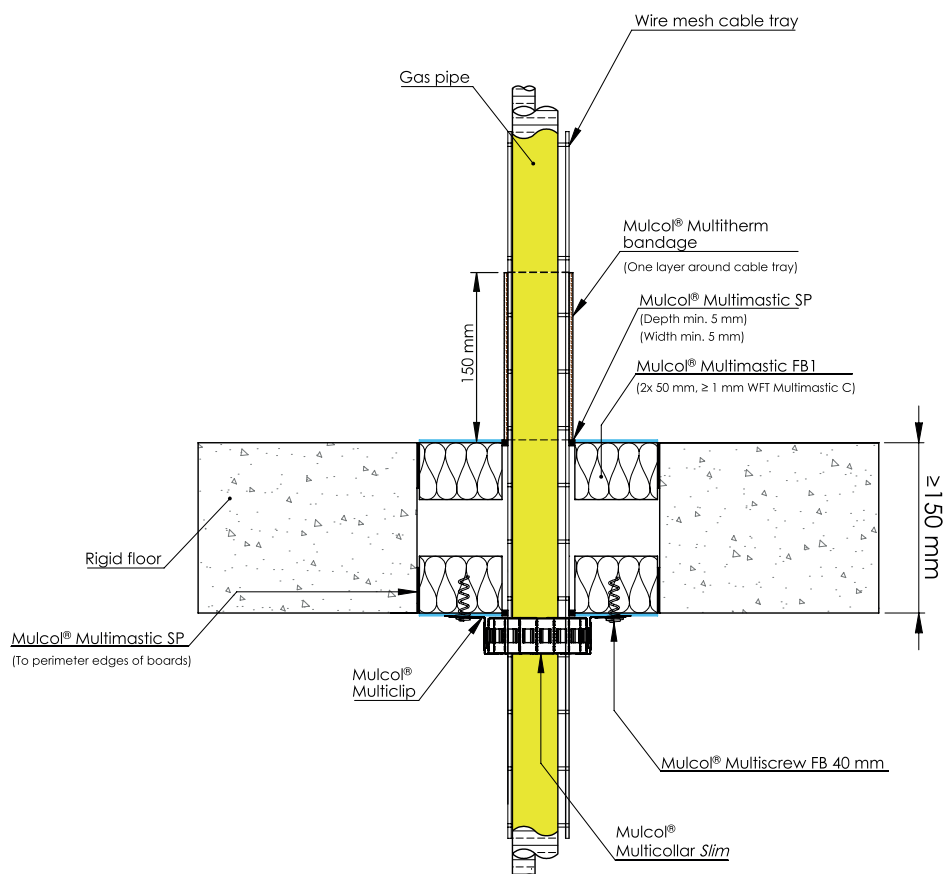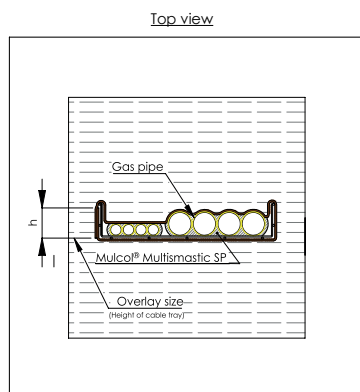


Drawing: PBrf.E-CT-MFB1-B3.1.10.C

Services	Number of pipes	Product	Sealing (mm)	Classification
CFS CSST gas pipe DN 15	≤ 4	Multicollar (bottom of floor) & Multitherm Bandage	Multimastic SP ≥ 5 x 5 (wxd)	EI 120 U/C
CFS CSST gas pipe DN 32	≤ 2			

B.1.21 Multimastic FB1 - 2x 50 mm cavity 50 mm - Gas pipes

B.1.21.2 Corrugated stainless steel tube gas (CSST) pipes - Multisealant GR - Multitherm Bandage

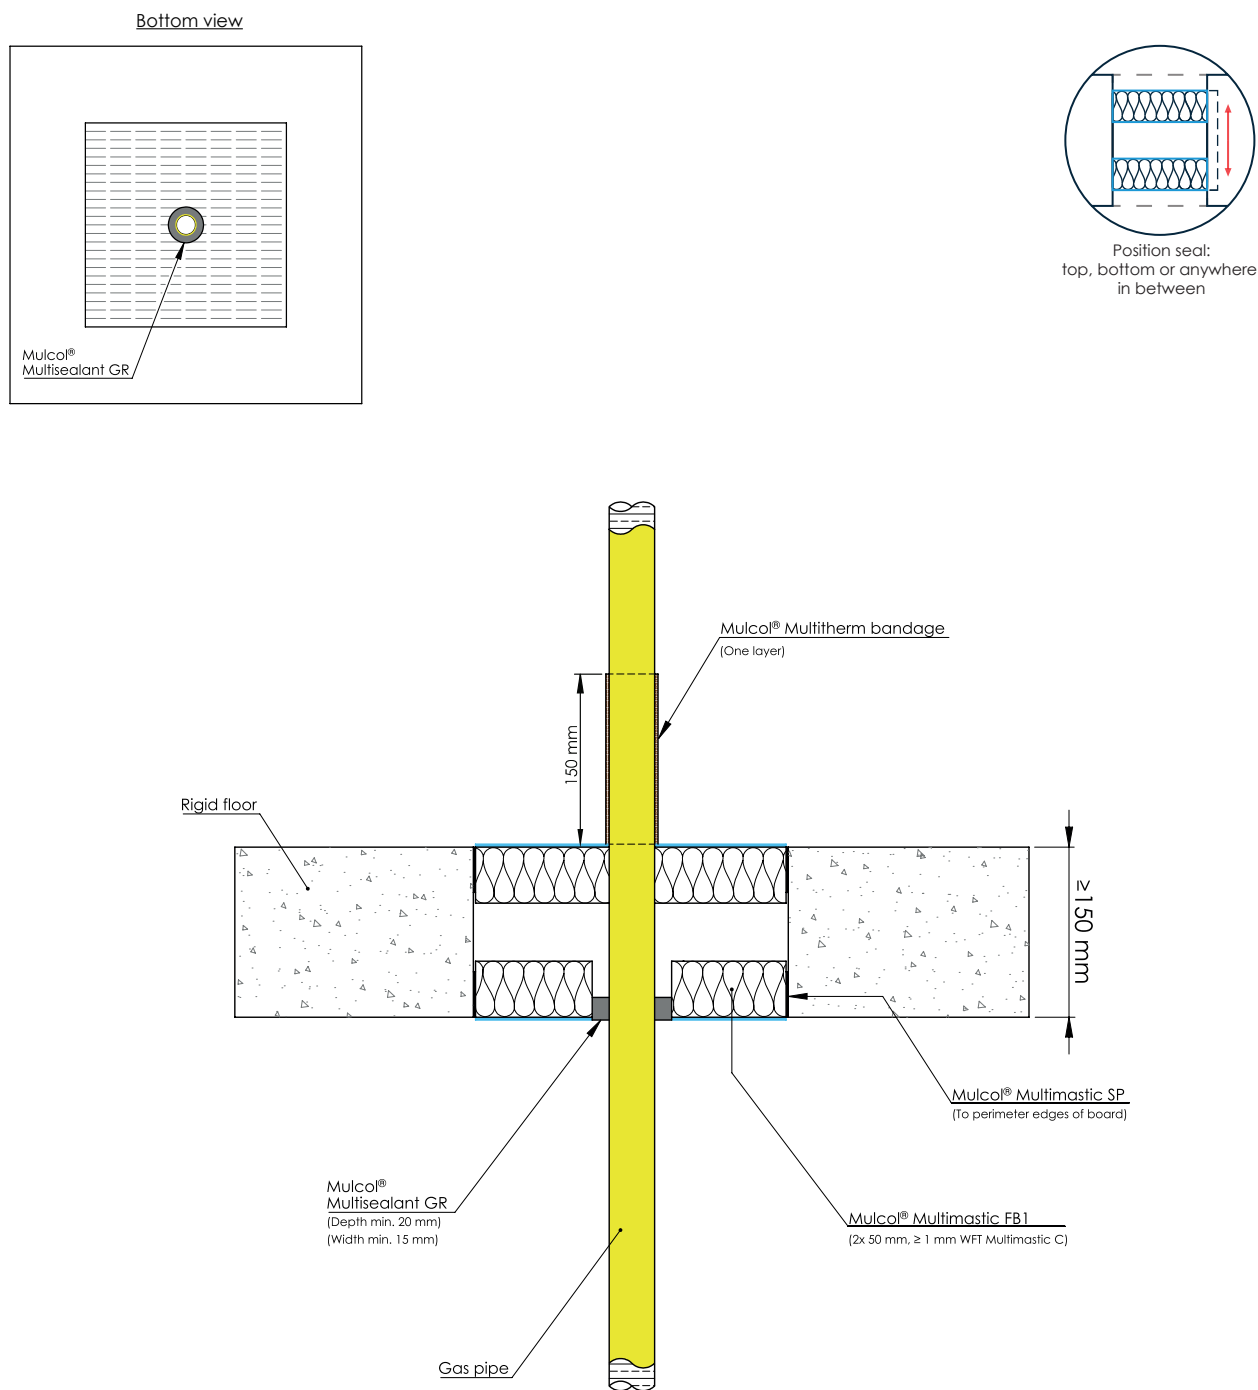


Drawing: PBrf.E-GFS-MFB1-B3.1.10.C

Services	Number of pipes	Product	Sealing (mm)	Classification
CFS CSST gas pipe DN 15	≤ 2	Multisealant GR (bottom of floor) & Multitherm Bandage (top of floor)	Multisealant GR ≥ 15 x 20 (wxd) bottom of floor	EI 120 U/C
CFS CSST gas pipe DN 32	1			


B.1.22 Multimastic FB1 - 2x 50 mm no cavity - Busbars

B.1.22.1 Single busbar



Position seal:
top, bottom or anywhere
in between

Side view

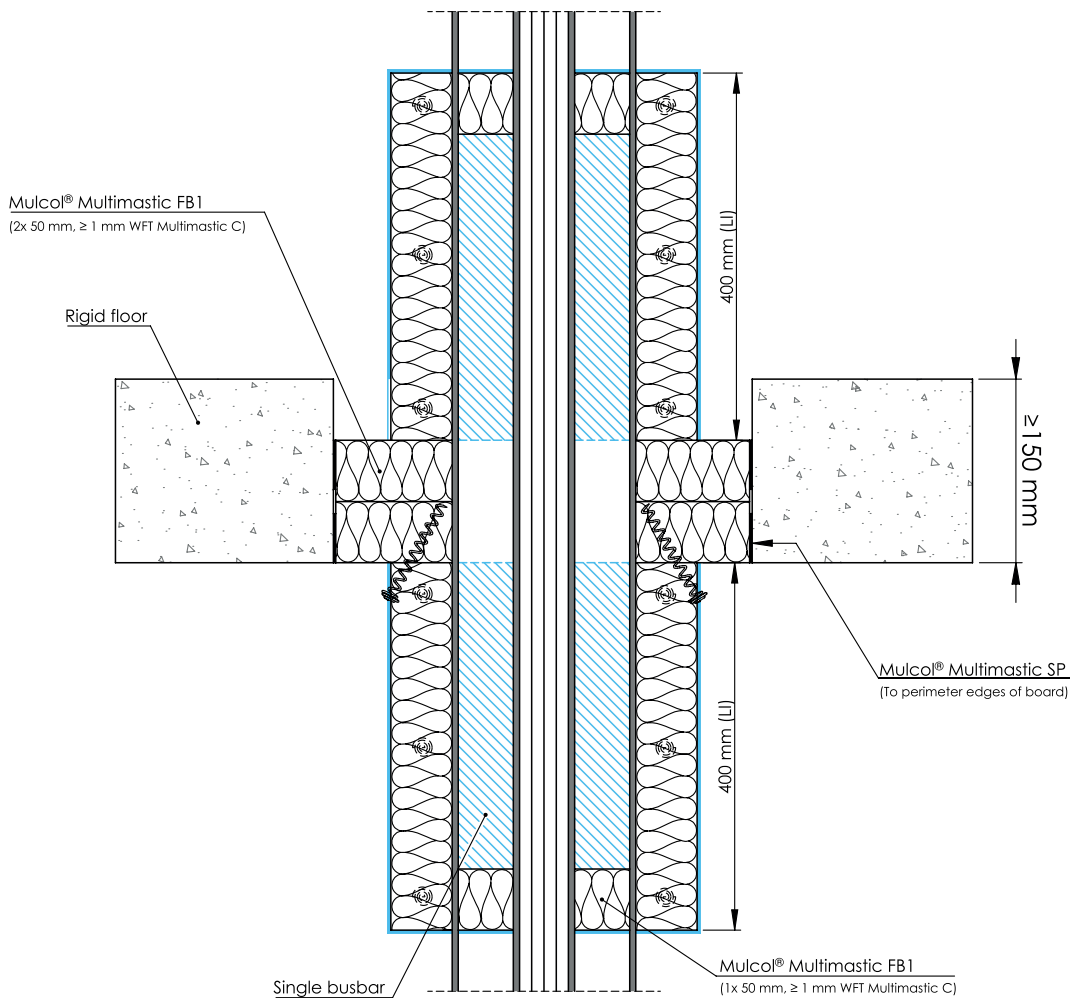


Drawing: PBrf.E-1BB-MFB1.2.10

Services	Service dimensions		Insulation			Classification
	Outside dimension	Conductors	Type	Thickness (mm)	Configuration	
Single busbar	≤ 150 x 250 mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 400 / CI	EI 120


B.1.22 Multimastic FB1 - 2x 50 mm no cavity - Busbars

B.1.22.1 Single busbar



Position seal:
top, bottom or anywhere
in between


Bottom view

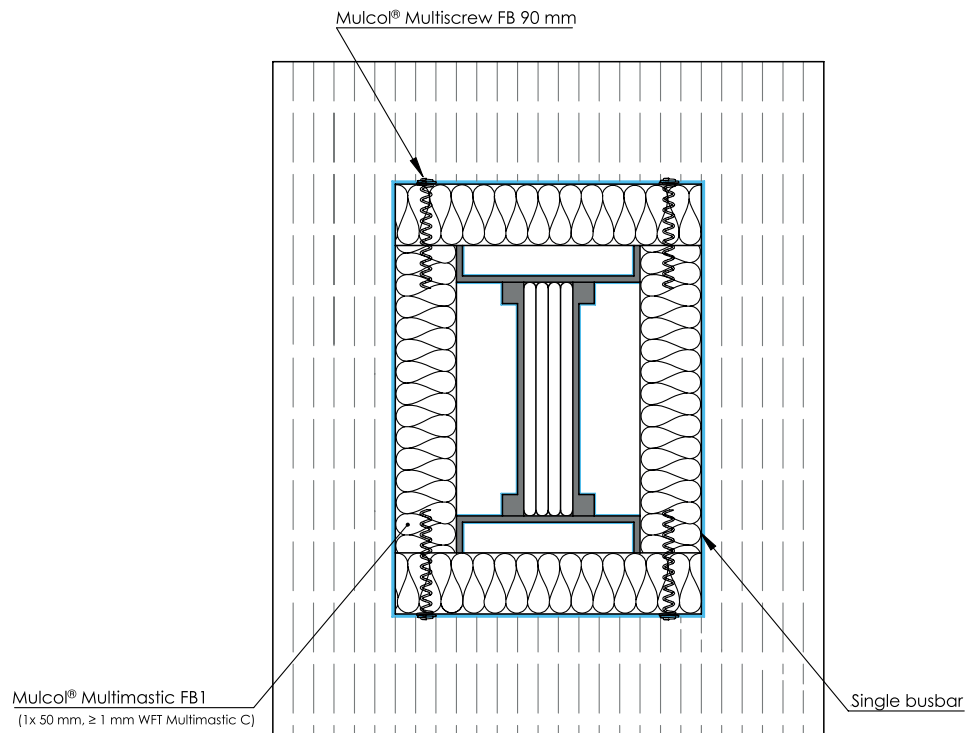

Drawing: PBrf.E-1BB-MFB1.2.10

B.1.22 Multimastic FB1 - 2x 50 mm no cavity - Busbars

B.1.22.2 Multiple busbars

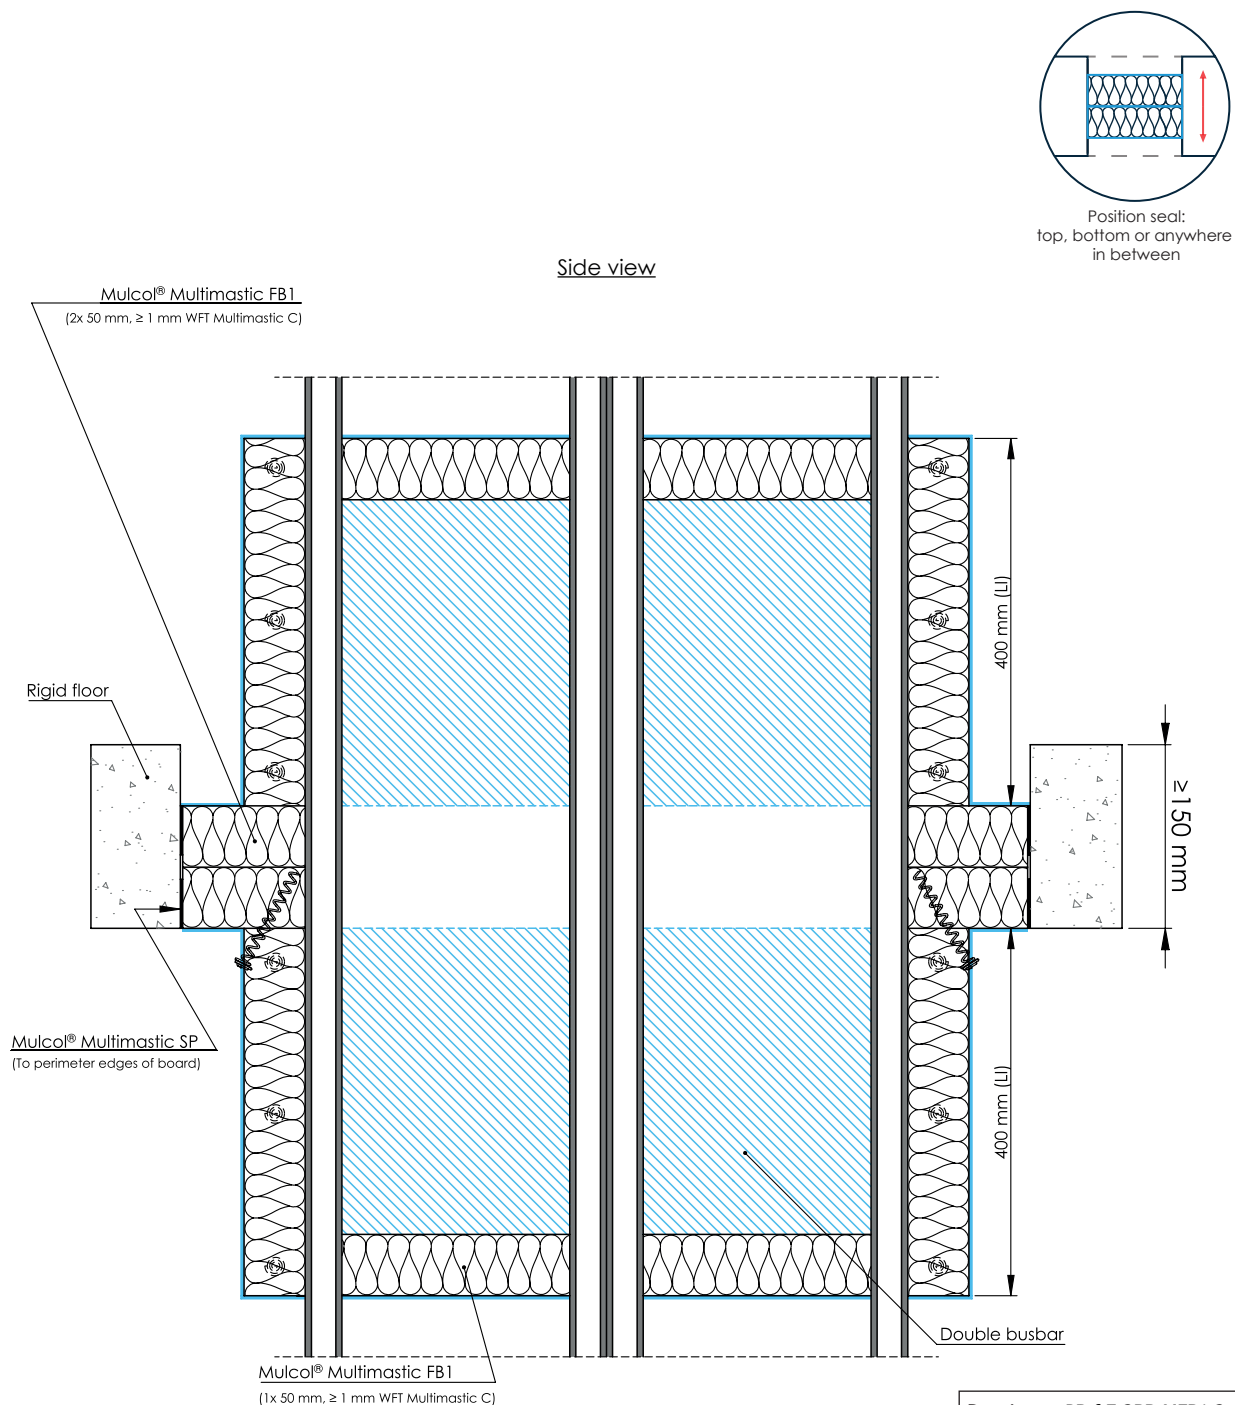


Drawing: PBrf.E-2BB-MFB1.2.10

Services	Service dimensions		Insulation			Classification
	Outside dimension	Conductors	Type	Thickness (mm)	Configuration	
Double busbar	≤ 150 x 500 mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 400 / CI	EI 120

B.1.22 Multimastic FB1 - 2x 50 mm no cavity - Busbars


B.1.22.2 Multiple busbars



Position seal:
top, bottom or anywhere
in between

Bottom view

Mulcol® Multiscrew FB 90 mm

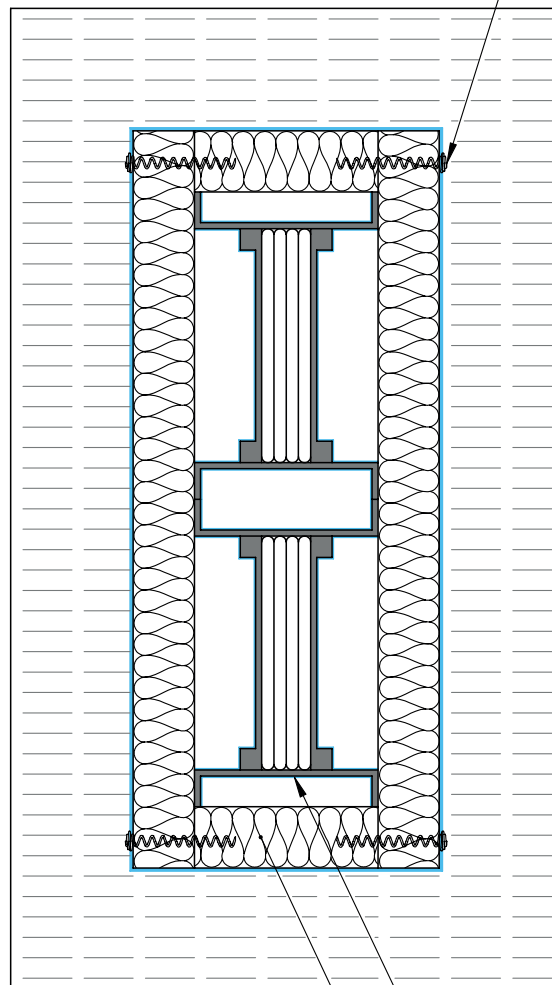


Mulcol® Multimastic FB1
(1x 50 mm, ≥ 1 mm WFT Multimastic C)

Double busbar

Drawing: PBrf-2BB-MFB1.2.10

B.1.23 Multimastic FB1 - 2x 50 mm cavity 50 mm - Busbars

B.1.23.1 Single busbar

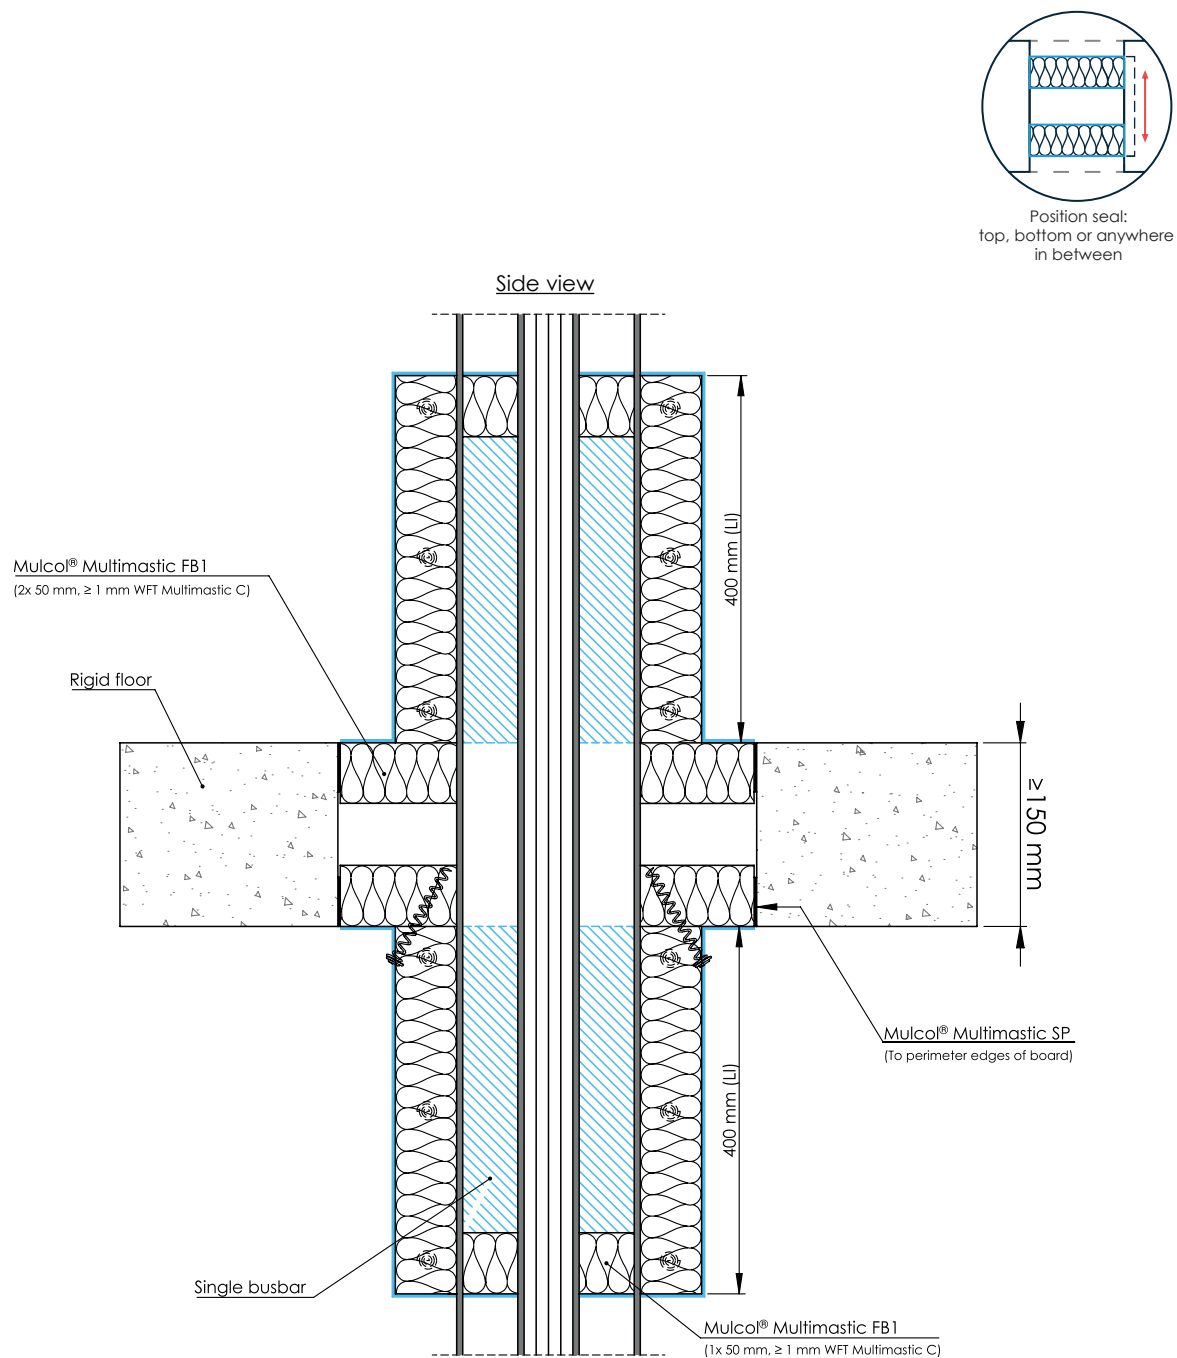

Drawing: PBrf.E-1BB-MFB1.2.10.C


Services	Service dimensions		Insulation			Classification
	Outside dimension	Conductors	Type	Thickness (mm)	Configuration	
Single busbar	≤ 150 x 250 mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 400 / CI	EI 120

B.1.23

Multimastic FB1 - 2x 50 mm cavity 50 mm - Busbars


B.1.23.1

Single busbar




Position seal:
top, bottom or anywhere
in between

Bottom view

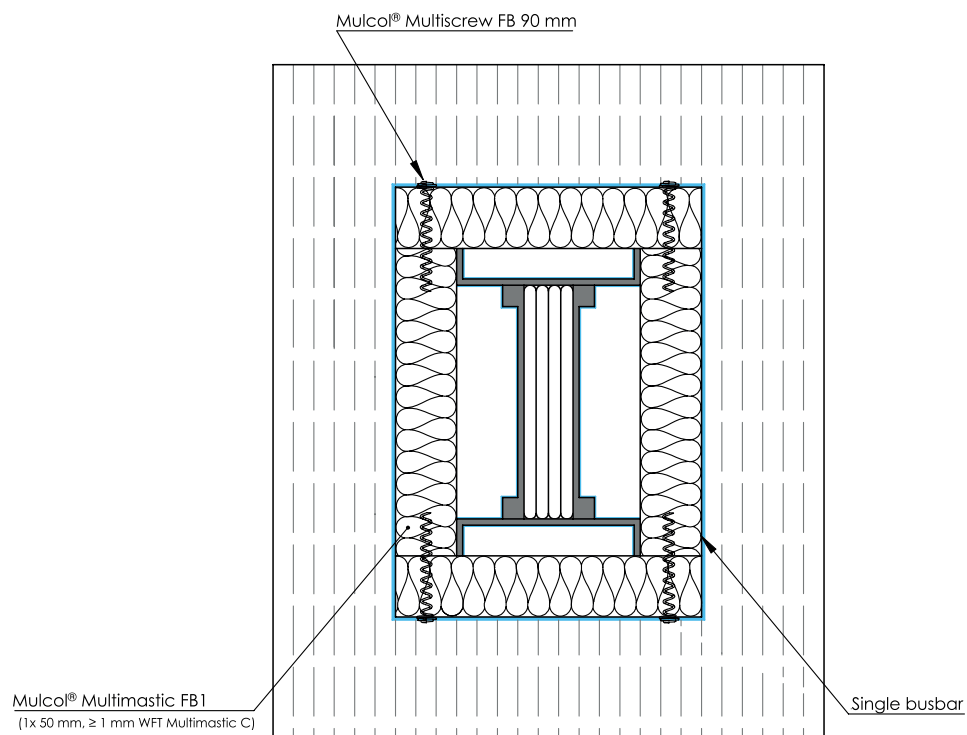

Drawing: PBrf.E-1BB-MFB1.2.10.C


B.1.23.2 Multiple busbars



Services	Service dimensions		Insulation			Classification
	Outside dimension	Conductors	Type	Thickness (mm)	Configuration	
Double busbar	≤ 150 x 500 mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 400 / CI	EI 120

B.1.23 Multimastic FB1 - 2x 50 mm cavity 50 mm - Busbars



B.1.23.2 Multiple busbars

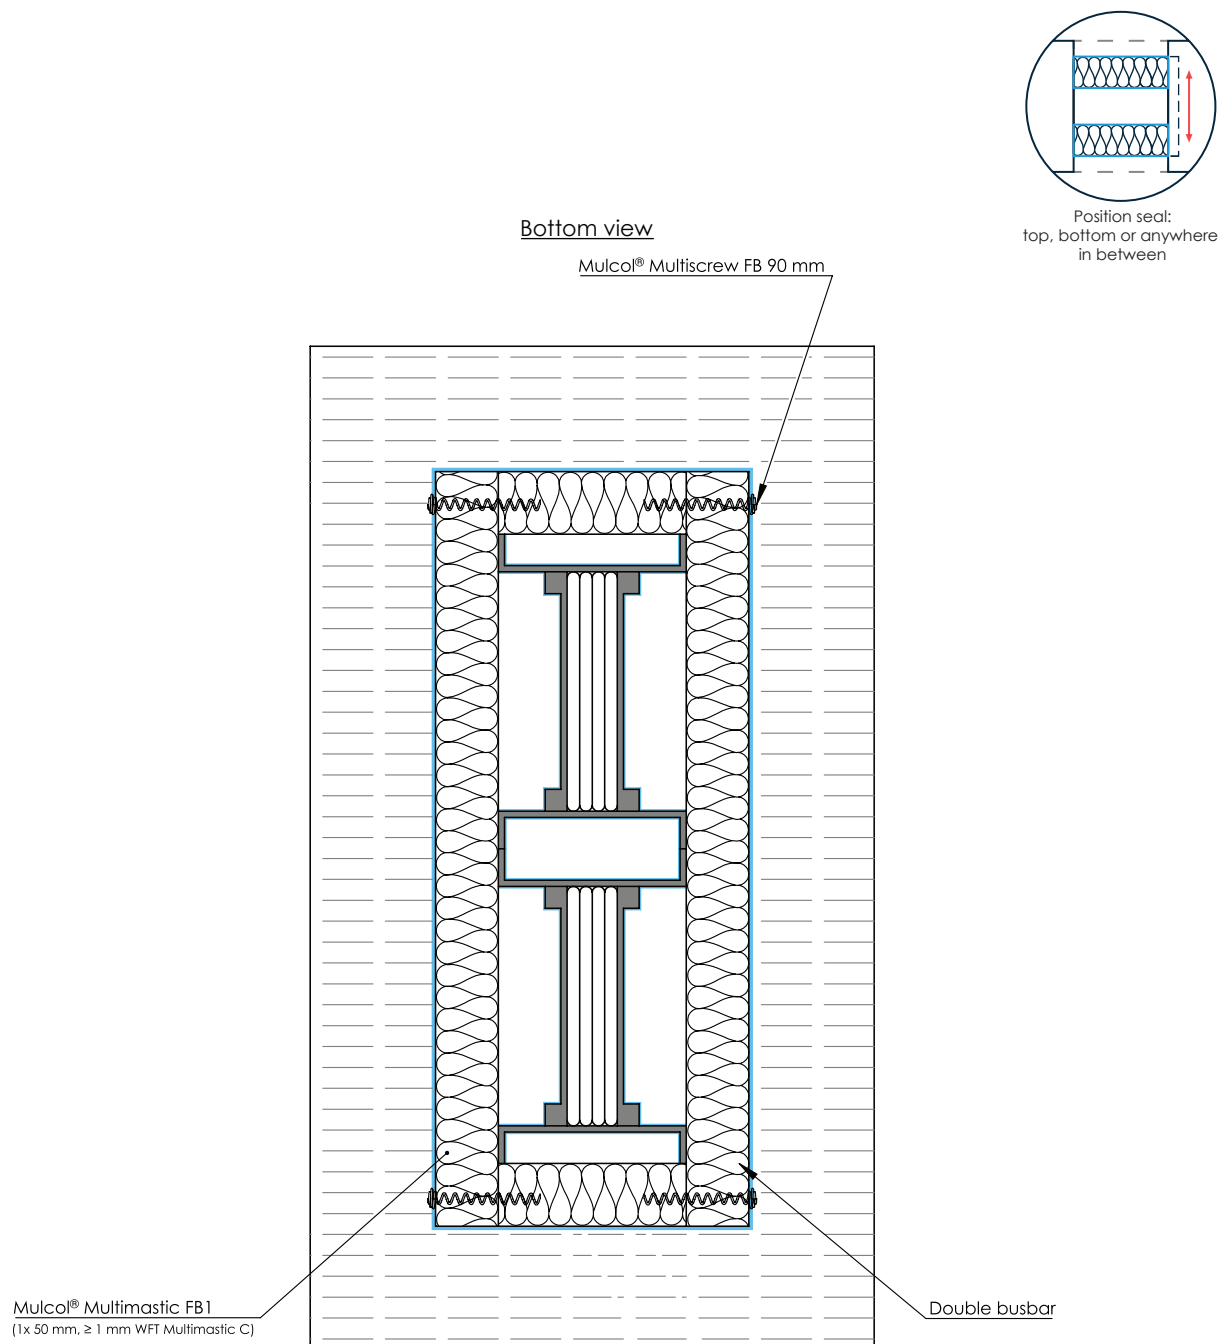

Drawing: PBrf.E-2BB-MFB1.2.10.C

B.1.24 Directly through floor - Cables, trays and conduits

B.1.24.1 Cables, trays and conduits - Multimastic C - 50 mm

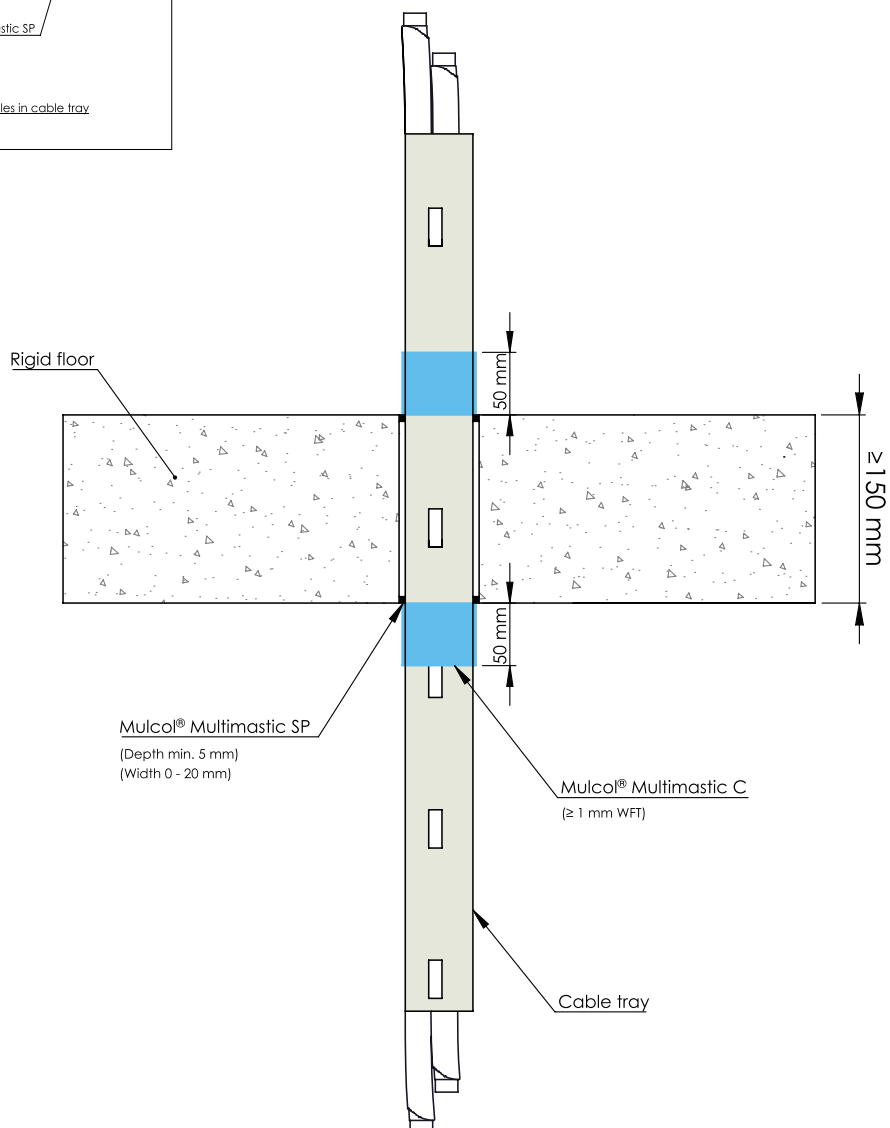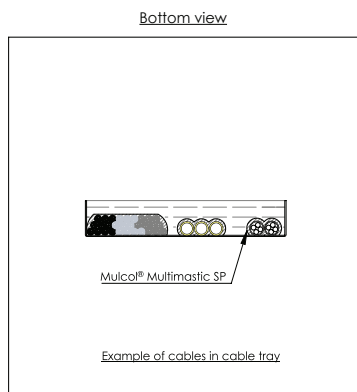


Drawing: RF.E-PB-CT-0.10

Services	Coating	Classification
Metal cable ladders	Coat back 50 mm ≥ 1 mm WFT Multimastic C	EI 90, E 120
Metal (non-)perforated cable trays		EI 60, E 120
Steel wire mesh cable trays (baskets)		EI 90 U/C, E 120 U/C
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 45, E 120
Cables ≤ Ø 50 mm		
Plastic conduits ≤ Ø 16 mm		
Non sheathed cables ≤ Ø 24 mm		

B.1.24 Directly through floor - Cables, trays and conduits

B.1.24.2 Cables, trays and conduits - Multimastic C - 150 mm

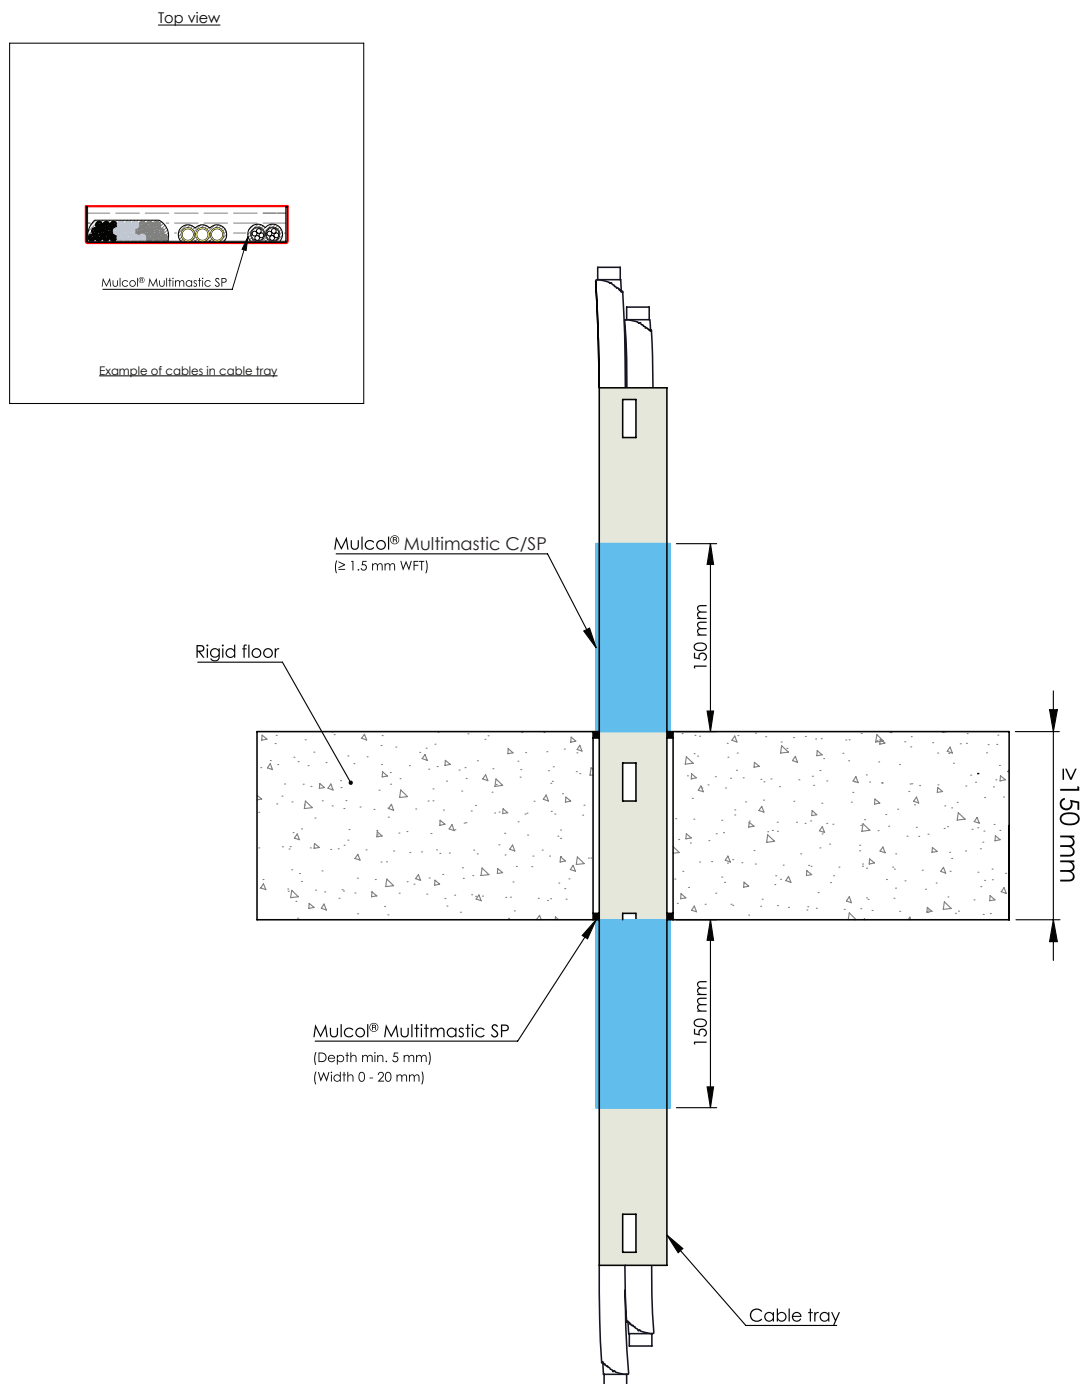


Drawing: RF.E-PB-CT-0.12

Services	Coating	Classification
Metal cable ladders	Coat back 150 mm ≥ 1.5 mm WFT Multimastic SP/C	EI 120
Metal (non-)perforated cable trays		
Steel wire mesh cable trays (baskets)		
Non sheathed cables ≤ Ø 17 mm		
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		
Plastic conduits ≤ Ø 16 mm		EI 120 U/C
Cables ≤ Ø 80 mm		EI 90, E 120

B.1.25 Directly through floor - Busbars

B.1.25.1 Single busbar

Side view

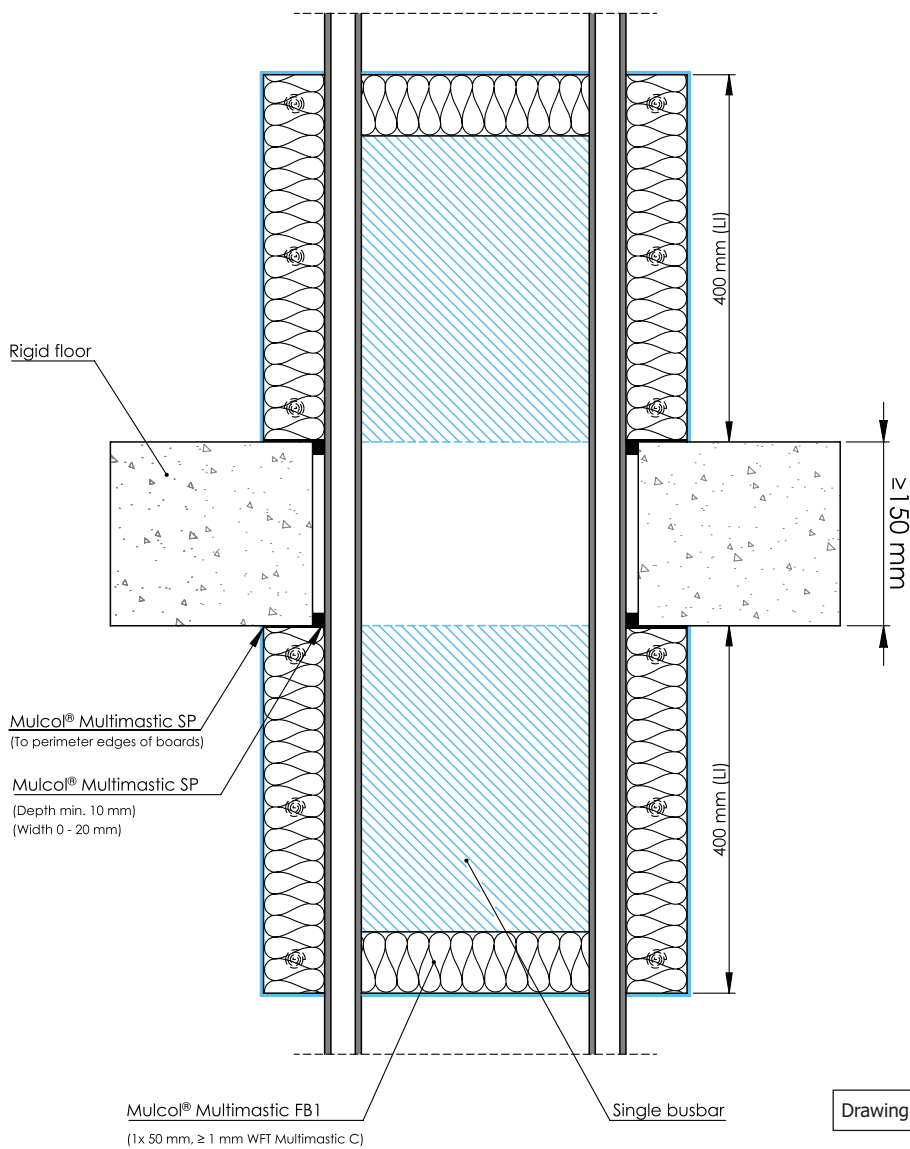


Drawing: RF.E-1BB-0.10

Services	Service dimensions		Insulation			Classification
	Outside dimension	Conductors	Type	Thickness (mm)	Configuration	
Single busbar	≤ 150 x 250 mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 400 / CI	EI 120

B.1.25 Directly through floor - Busbars

B.1.25.1 Single busbar


Bottom view

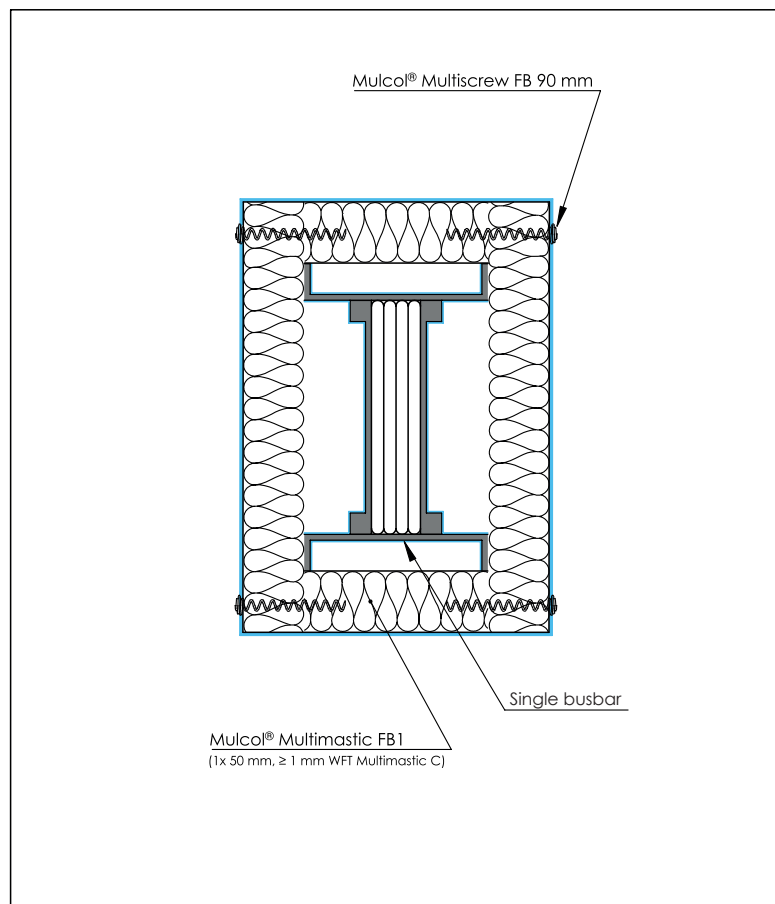

Drawing: RF.E-1BB-0.10

B.1.25 Directly through floor - Busbars

B.1.25.2 Multiple busbars

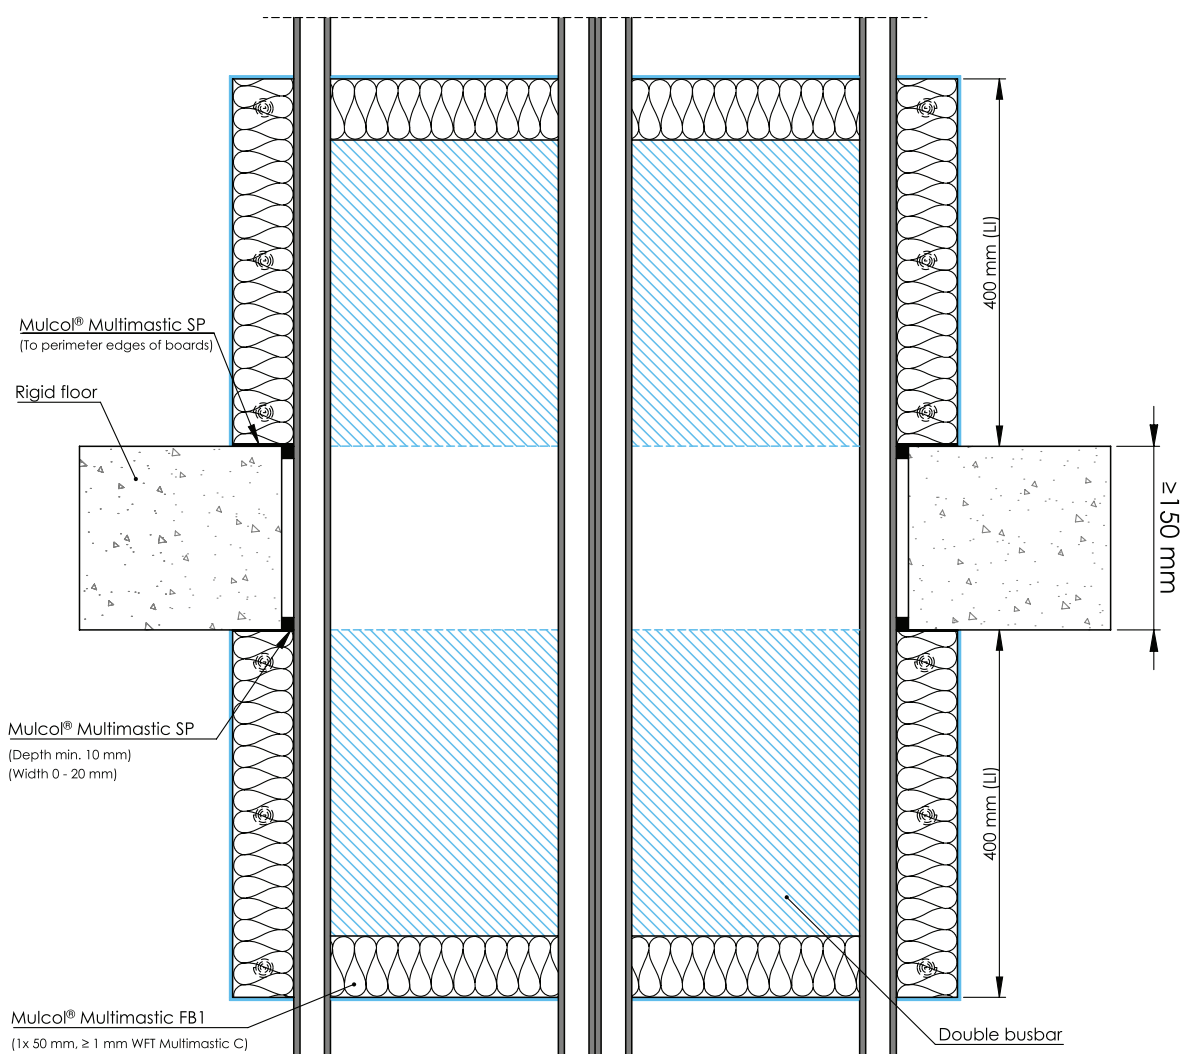


Drawing: RF.E-2BB-0.10

Services	Service dimensions		Insulation			Classification
	Outside dimension	Conductors	Type	Thickness (mm)	Configuration	
Double busbar	≤ 150 x 500 mm	max. 4 x ≤ 200 mm width (per busbar)	Multimastic FB1	50	LI 400 / CI	EI 120

B.1.25 Directly through floor - Busbars

B.1.25.2 Multiple busbars


Bottom view

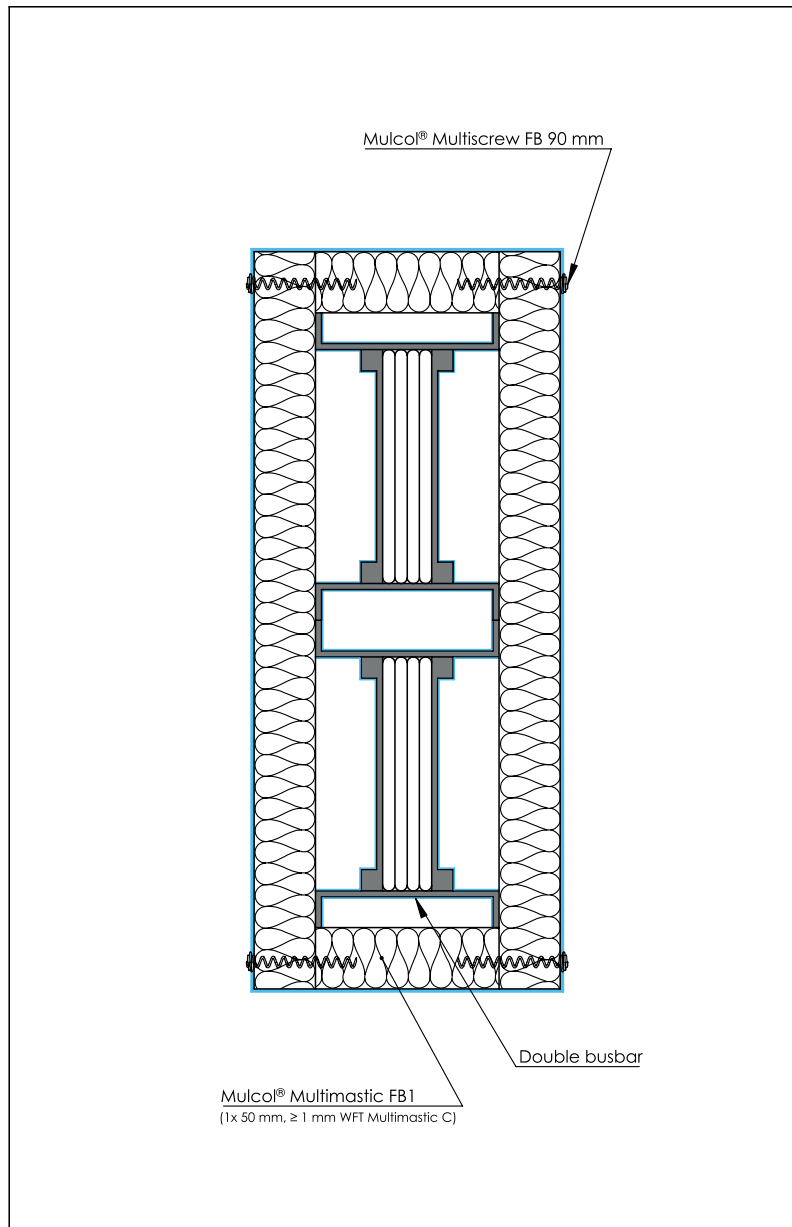

Drawing: RF.E-2BB-0.10

B.2.1 Multimastic FB1 - 2x 50 mm no cavity - Cables, trays and conduits

B.2.1.1 Cables, trays and conduits - Multimastic C



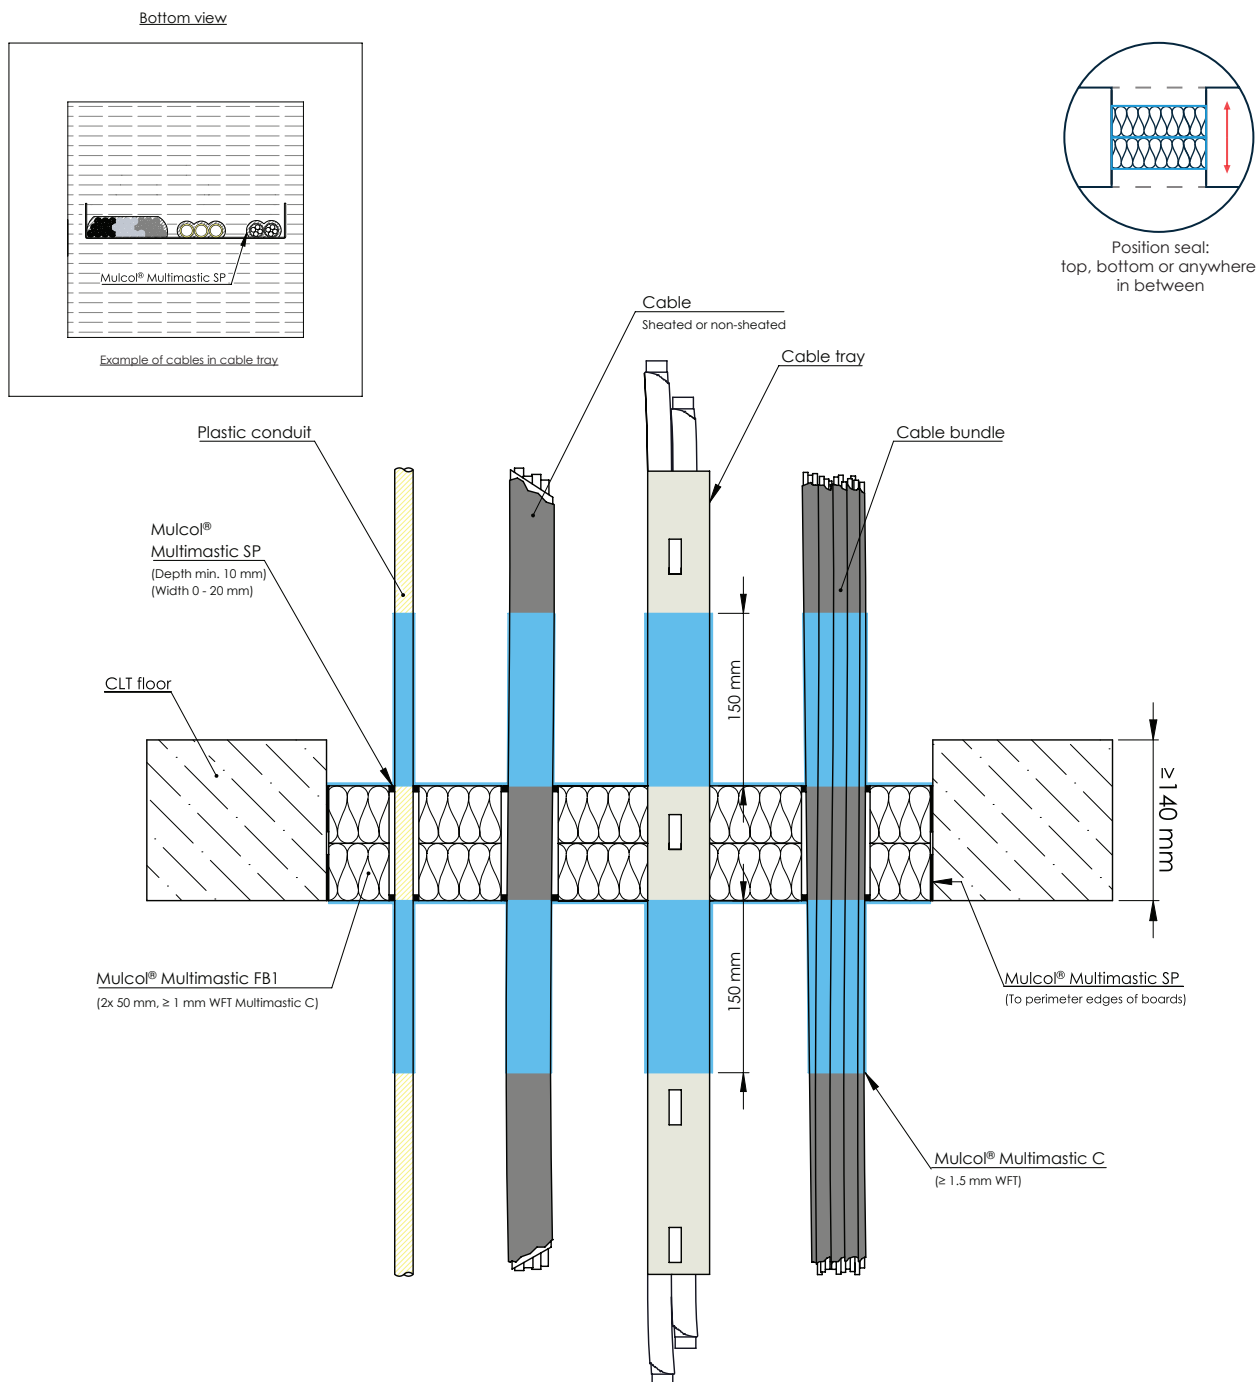


Drawing: FCLT.E-CT-4-MFB1.2.10

Services	Coating	Classification
Metal cable ladders	Coat back 150 mm ≥ 1.5 mm WFT Multimastic C	EI 90, E 120
Metal (non-)perforated cable trays		EI 60, E 120
Steel wire mesh cable trays (baskets)		EI 90 U/C, E 120 U/C
Cables ≤ Ø 21 mm in a tied bundle ≤ Ø 100 mm		EI 45, E 120
Cables ≤ Ø 80 mm		
Plastic conduits ≤ Ø 16 mm		
Non sheathed cables ≤ Ø 24 mm		

B.2.1 Multimastic FB1 - 2x 50 mm no cavity - Cables, trays and conduits

B.2.1.2 Single plastic conduits - Multidisc

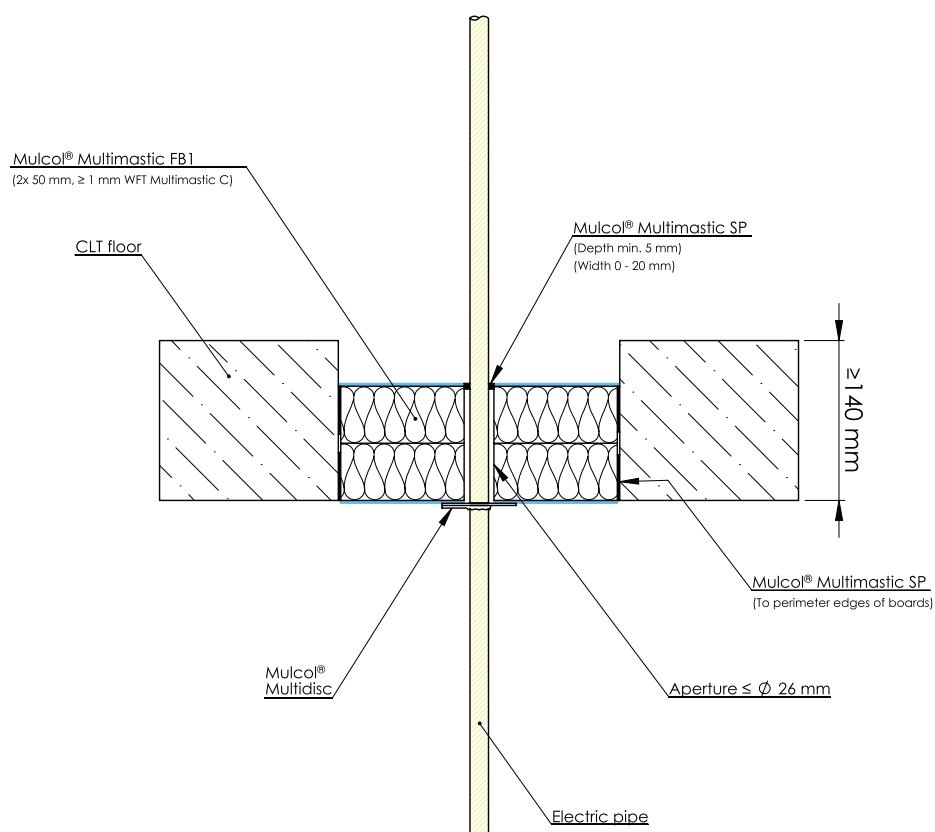

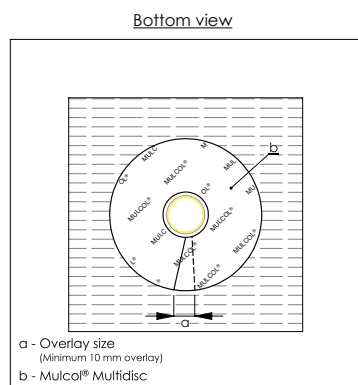


Drawing: PBrf.E-MFB1-EP19-M2.0.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Plastic conduits $\leq \varnothing 19$ mm, with or without cables	Multidisc bottom of floor	$\leq \varnothing 26$	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	E 60 U/C

B.2.1 Multimastic FB1 - 2x 50 mm no cavity - Cables, trays and conduits

B.2.1.3 Single cables - Multidisc

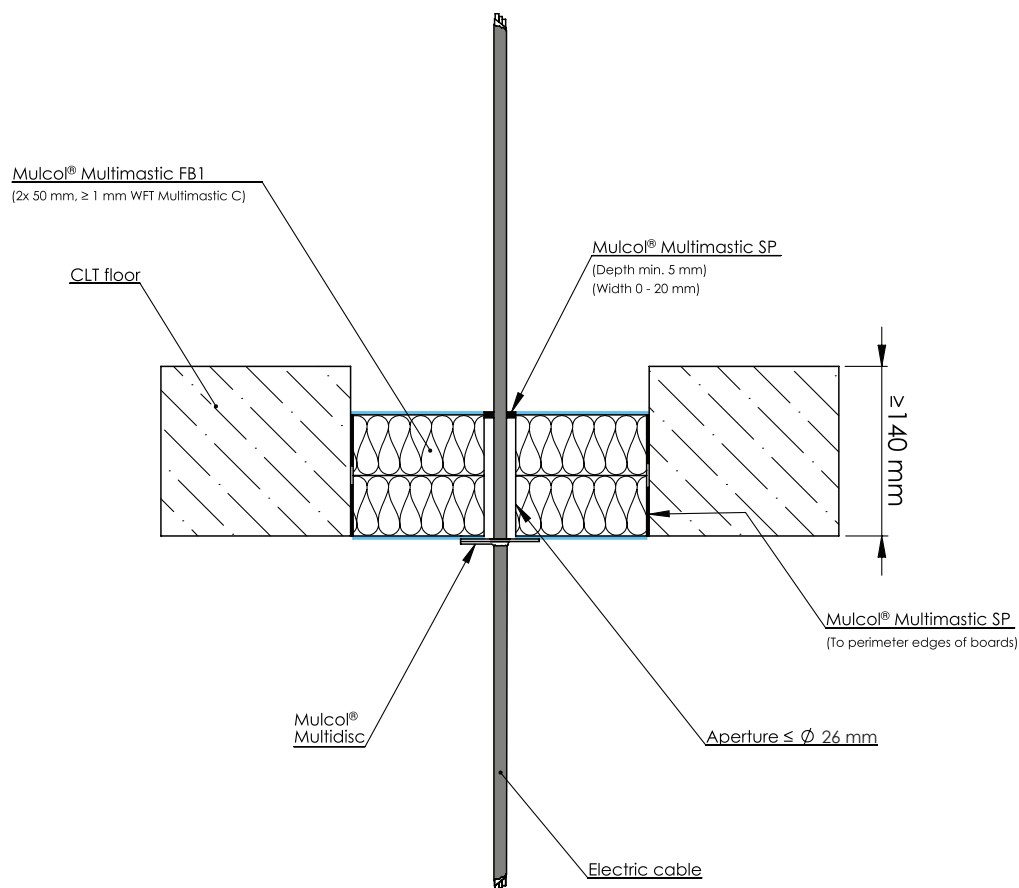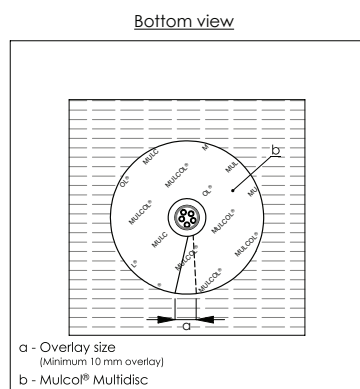


Drawing: PBrf.E-MFB1-EC-M2.0.10

Services	Product	Aperture (mm)	Sealing (mm)	Classification
Cables $\leq \varnothing 12$ mm (e.g. YMKV 5x2.5 mm ²)	Multidisc bottom of floor	$\leq \varnothing 26$	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	E 60


B.2.2 Multimastic FB1 - 2x 50 mm no cavity - Combustible pipes

B.2.2.1 Plastic pipes - Multicollar *Slim*


Bottom view

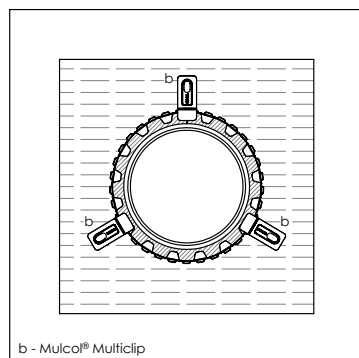

b - Mulcol® Multiclip



Position seal:
top, bottom or anywhere
in between



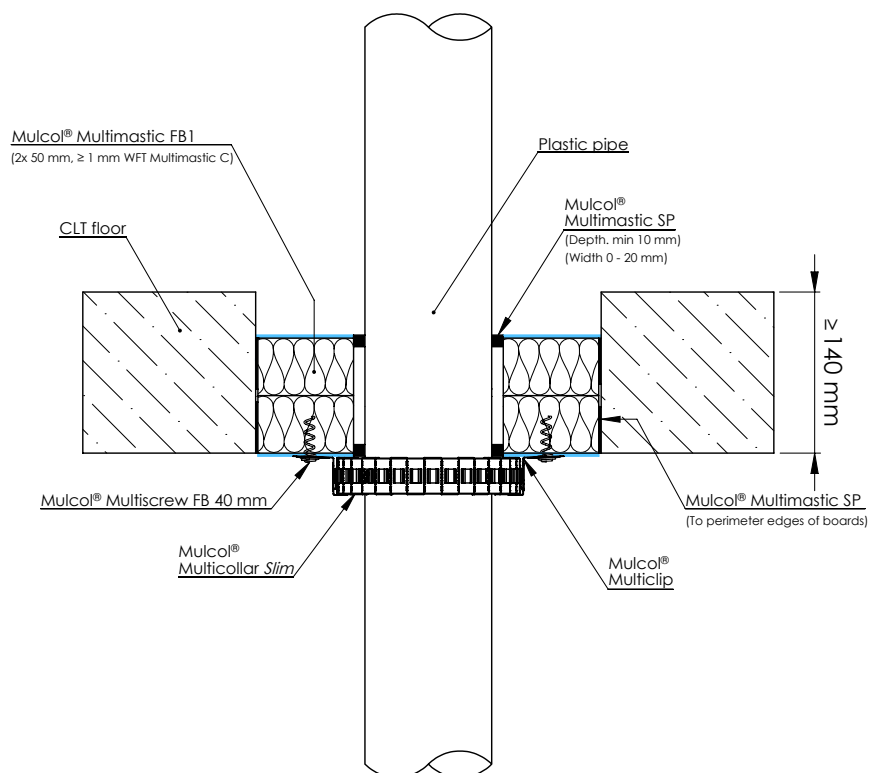


Drawing: FCLT.E-MC30-PP-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
PE(-HD) / PE-X / ABS / SAN+PVC	≤ Ø 110	2.7 - 6.6	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 45 U/U
PP		2.7 - 6.3			
PVC(-U/-C)					

B.2.2 Multimastic FB1 - 2x 50 mm no cavity - Combustible pipes

B.2.2.2 Plastic pipes - Multiwrap

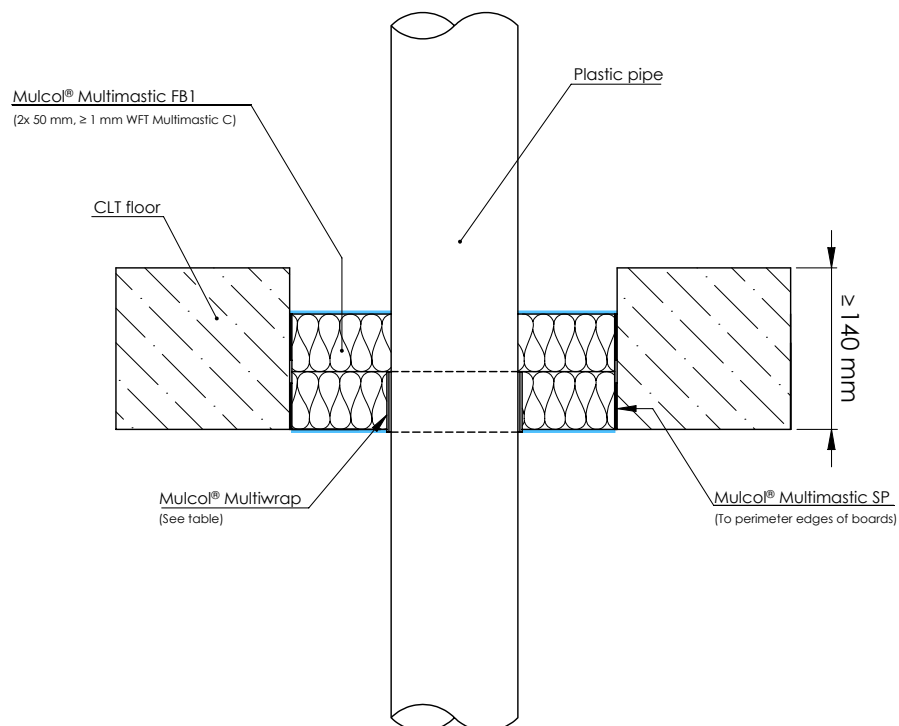

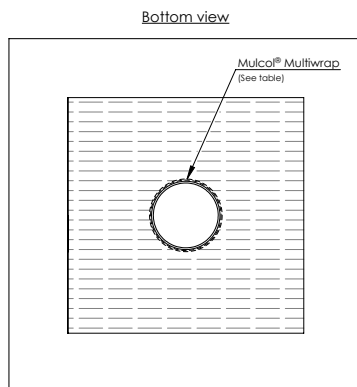


Drawing: FCLT.E-PP-MW2-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
PVC(-U/-C)	≤ Ø 110	3.2	Multiwrap (2 layers)	EI 120 U/C

B.2.2 Multimastic FB1 - 2x 50 mm no cavity - Combustible pipes

B.2.2.3 Plastic pipes (Silent) - Multicollar *Slim*

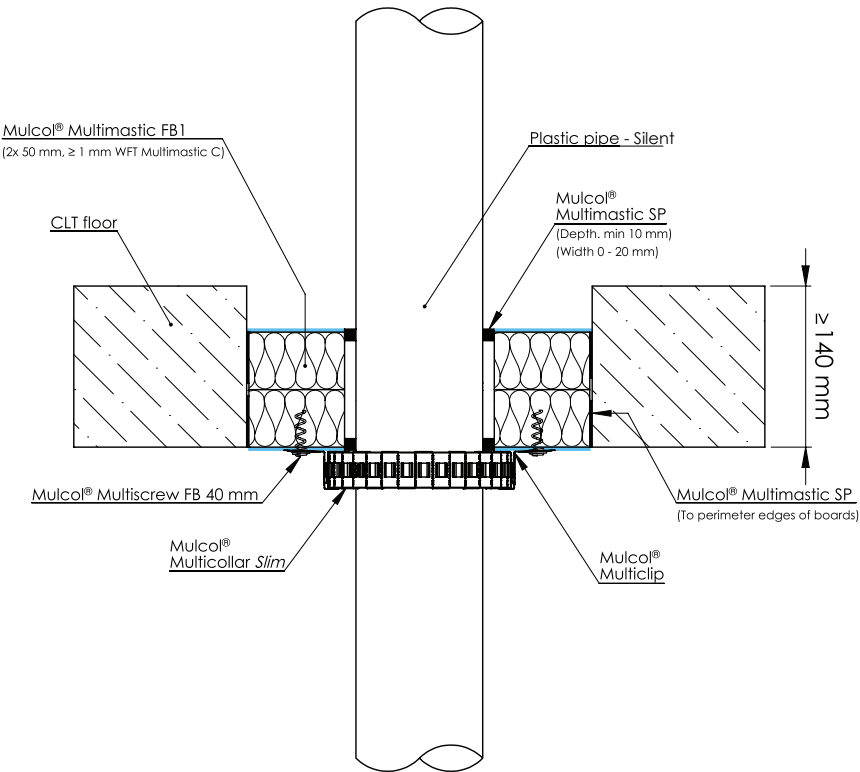

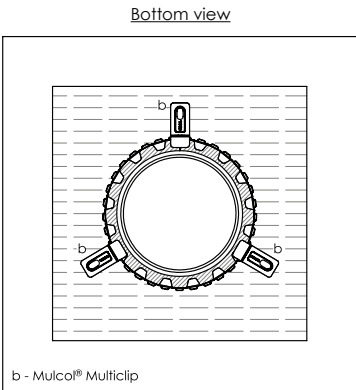


Drawing: FCLT.E-MC30-PP-MFB1.2.10

Services	Pipe dimensions (mm)		System	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Geberit Silent dB20	$\leq \varnothing 110$	6.0	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 10 (wxd)	EI 45 U/U

B.2.2 Multimastic FB1 - 2x 50 mm no cavity - Combustible pipes

B.2.2.4 Plastic pipes (Silent) - Multiwrap

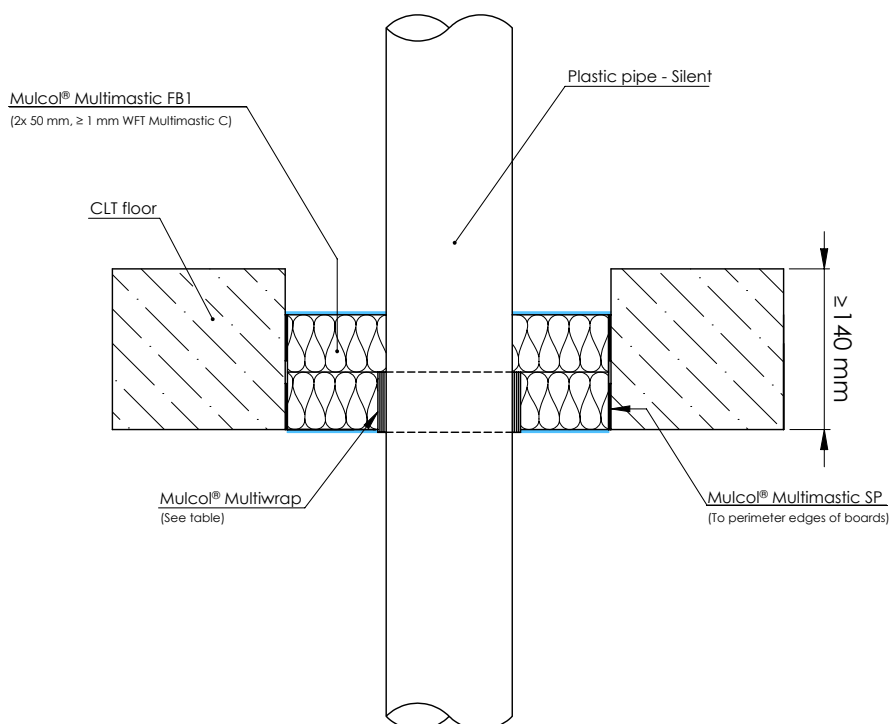




Drawing: PBrf.E-PPS-MW2-MFB1.2.10

Services	Pipe dimensions (mm)		Product	Classification
	Outer dimension	Wall thickness		
Poloplast PoloKal NG	≤ Ø 50	2.0	Multiwrap (2 layers)	EI 120 U/U
	≤ Ø 110	3.4		
Geberit Silent dB20	≤ Ø 56	3.2		EI 120 U/C
	≤ Ø 110	6.0		
Poloplast PoloKal NG	≤ Ø 125	3.9	Multiwrap (4 layers)	

B.2.2 Multimastic FB1 - 2x 50 mm no cavity - Combustible pipes

B.2.2.5 PP-R Multilayer pipes - Multicollar *Slim*

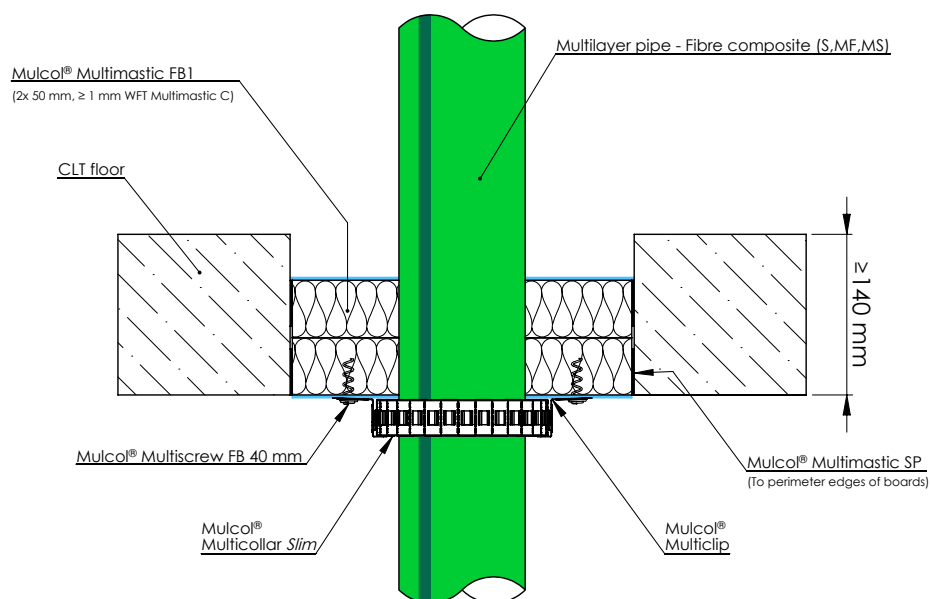

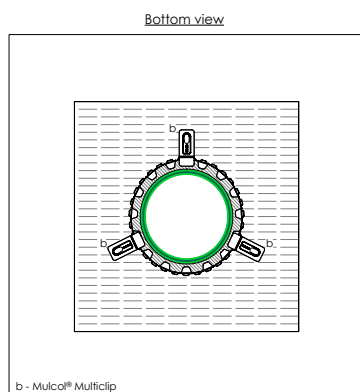


Drawing: FCLT.E-MC30-MLF-MFB1.2.10

Services	Pipe dimensions (mm)		System	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Aquatherm Green	≤ Ø 50	6.9	Multicollar <i>Slim</i>	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 45 U/C
Aquatherm Blue	≤ Ø 110	10.0			

B.2.3 Multimastic FB1 - 2x 50 mm no cavity - Multilayer pipes (MLC)

B.2.3.1 Multilayer pipes (MLC) - Multisealant GR

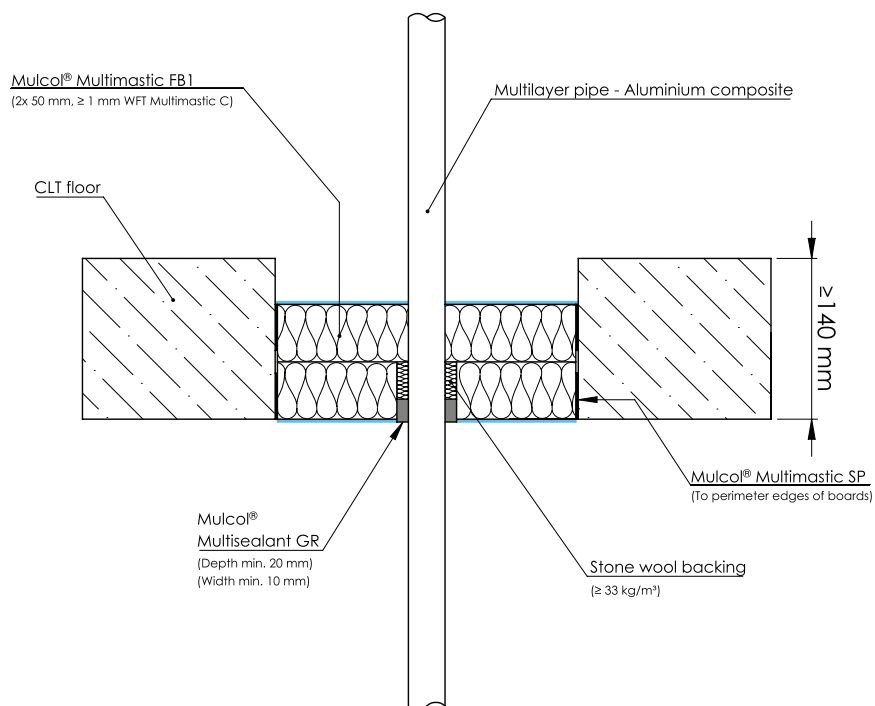

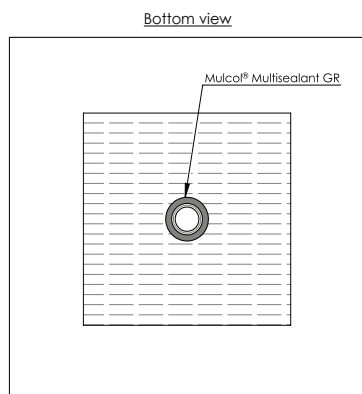


Drawing: FCLT.E-MLA-MFB1-G1.18.10

Services	Pipe dimensions (mm)		Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness			
Multilayer pipes (MLC)	≤ Ø 32	3.0	Multisealant GR ≥ 10 x 20 (wxd)	Stone wool (≥ 33 kg/m³)	EI 30 U/C E 90 U/C

B.2.3 Multimastic FB1 - 2x 50 mm no cavity - Multilayer pipes (MLC)

B.2.3.2 Multilayer pipes (MLC) - Elastomer LS 400 / CS - Multisealant GR

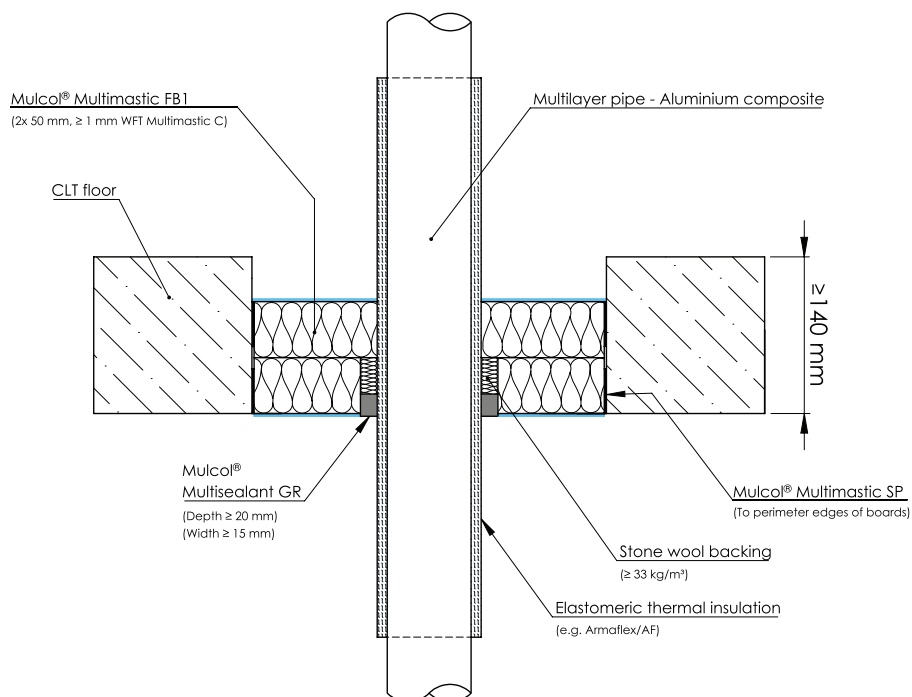

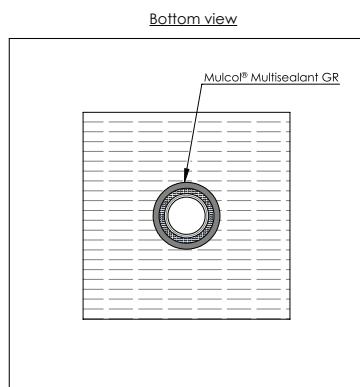


Drawing: FCLT.E-MLA-MFB1-G1.4.22

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Multilayer pipe (MLC)	≤ Ø 75	6.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	9 - 32	LS 400 / CS	Multisealant GR ≥ 15 x 20 (wxd)	Stone wool (≥ 35 kg/m ³)	EI 90 U/C

B.2.3 Multimastic FB1 - 2x 50 mm no cavity - Multilayer pipes (MLC)

B.2.3.3 Multilayer pipes (MLC) - PE foam LS 300 / CS - Multisealant GR

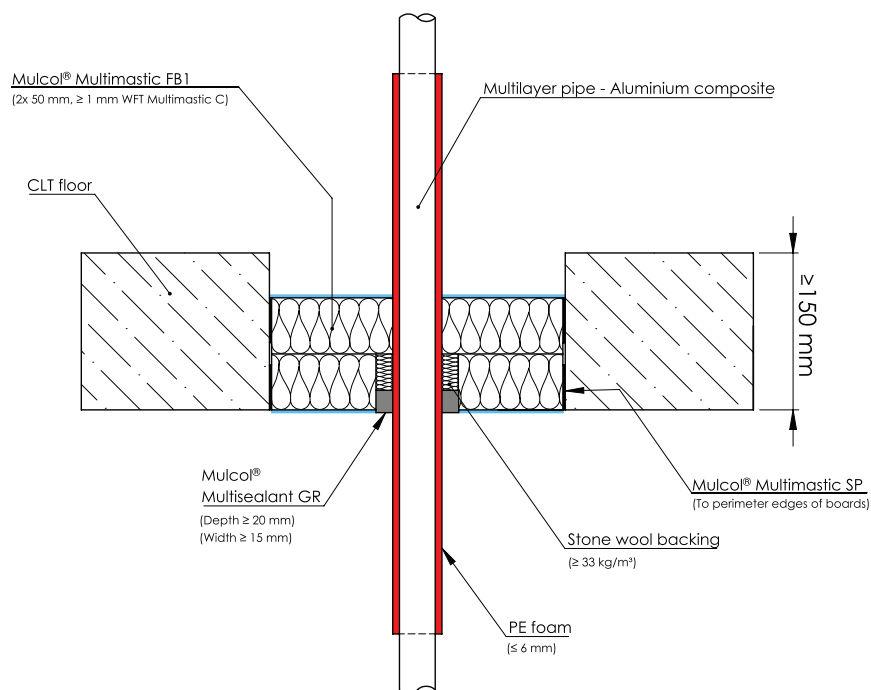




Drawing: FCLT.E-MLA-MFB1-G1.4.23

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Backing	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Multilayer pipe (MLC)	≤ Ø 32	3.0	Henco PE foam	≤ 6	LS 300 / CS LI 300 / CI	Multisealant GR ≥ 15 x 20 (wxd)	Stone wool (≥ 35 kg/m³)	EI 30 U/C E 90 U/C

B.2.3 Multimastic FB1 - 2x 50 mm no cavity - Multilayer pipes (MLC)

B.2.3.4 Multilayer pipes (MLC) - Multidisc

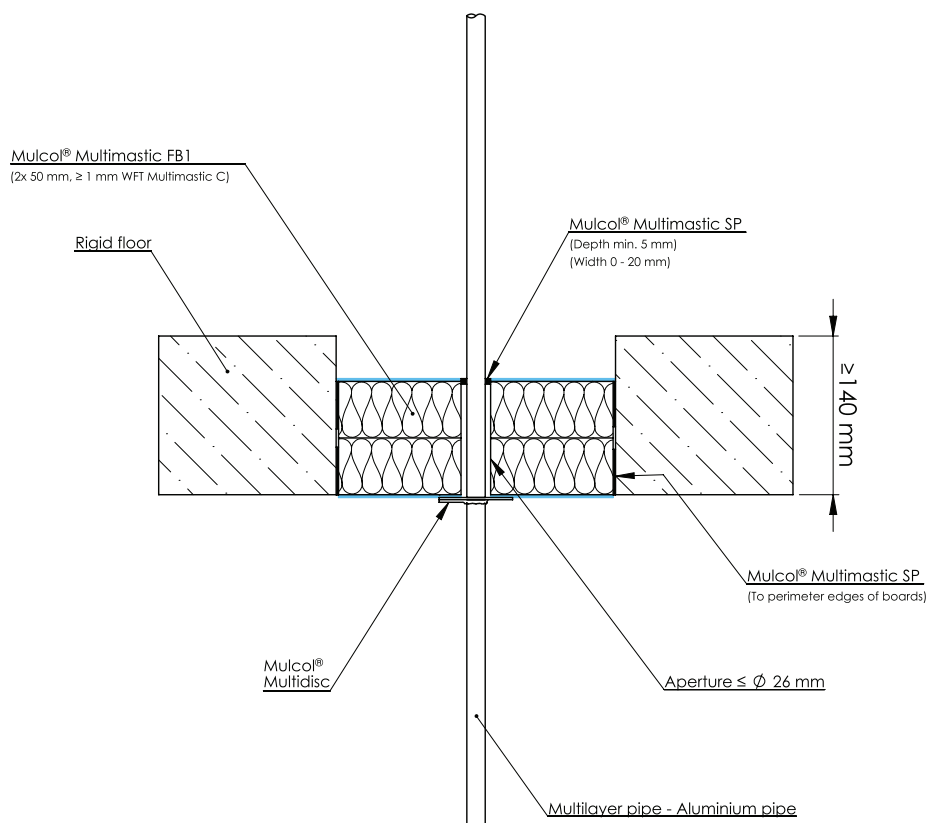


Drawing: FCLT.E-MFB1-MLA-M2.0.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Multilayer pipes (MLC)	$\leq \varnothing 16$	2.0	Multidisc	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	E 60 U/C

B.2.4 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated mineral wool

B.2.4.1 Copper and steel pipes - Stone wool LS 400 / CS

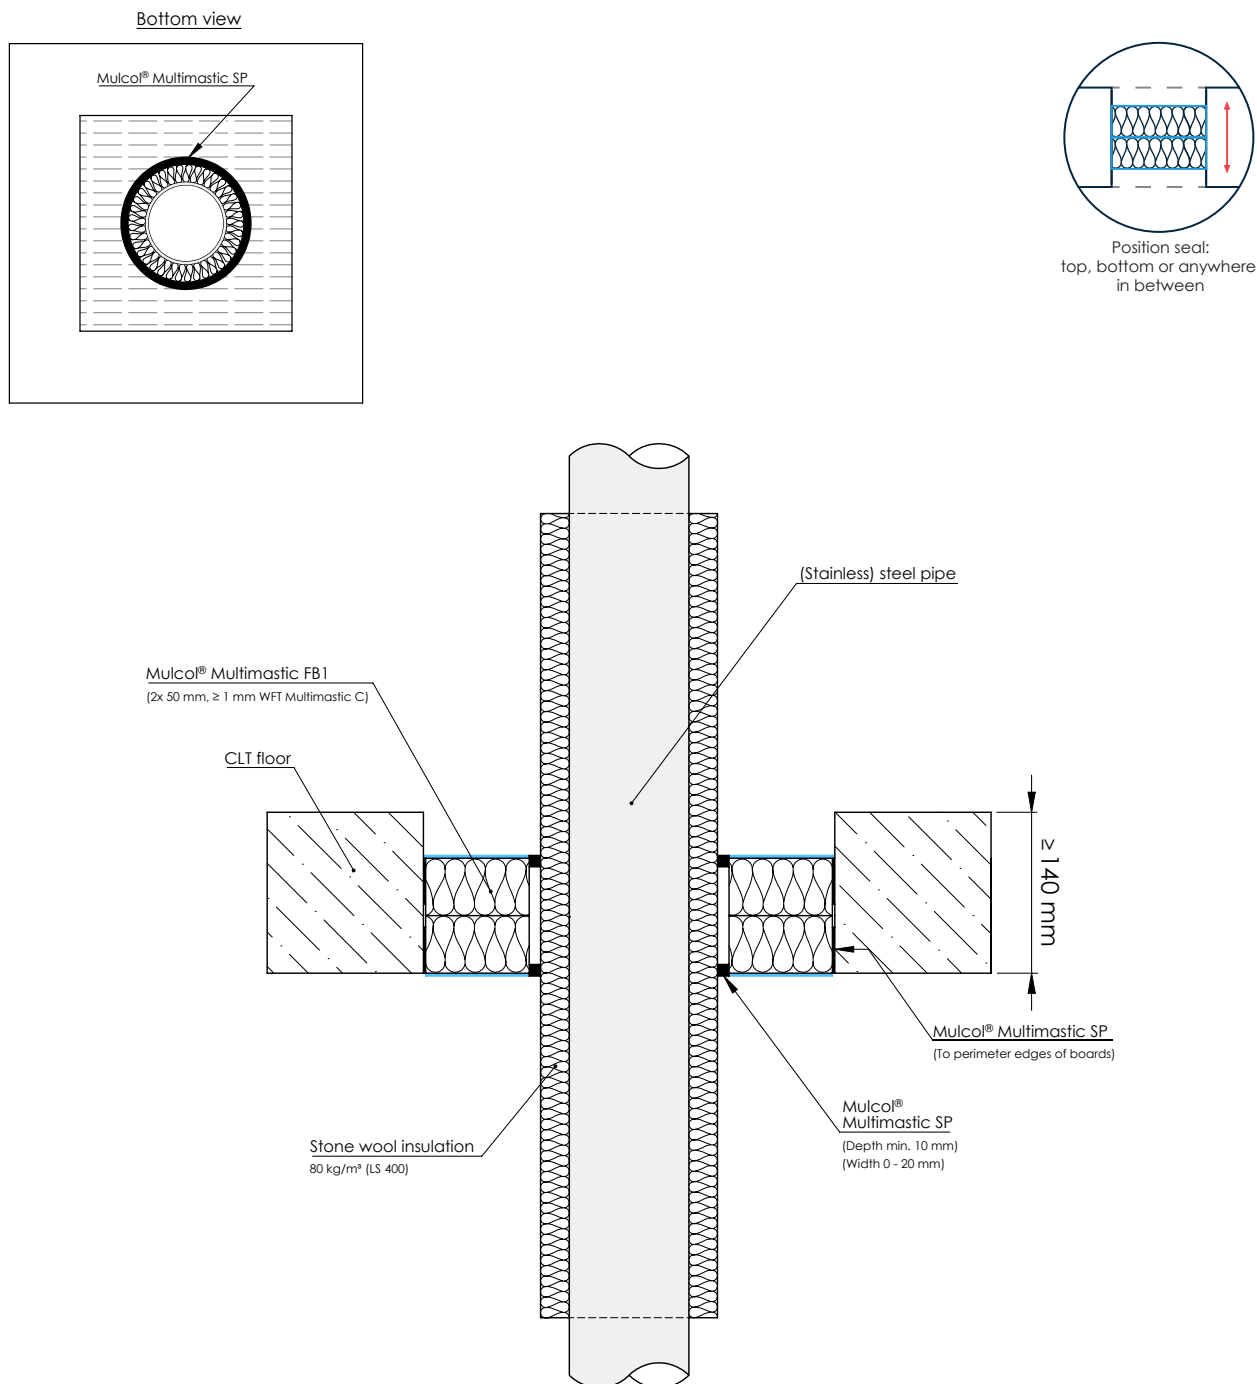


Drawing: FCLT.E-ST-MFB1.2.20

Services	Pipe dimensions (mm)		Insulation			Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration		
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	Stone wool (≥ 80 kg/m³)	25	LS 400 / CS	Multimastic SP 0-20 x ≥ 5 (wxd)	EI 120 C/U
	≤ Ø 54	≥ 1.5					
(Stainless) Steel / cast iron	≤ Ø 114.3	≥ 3.6		30			

B.2.5 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated elastomer

B.2.5.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR

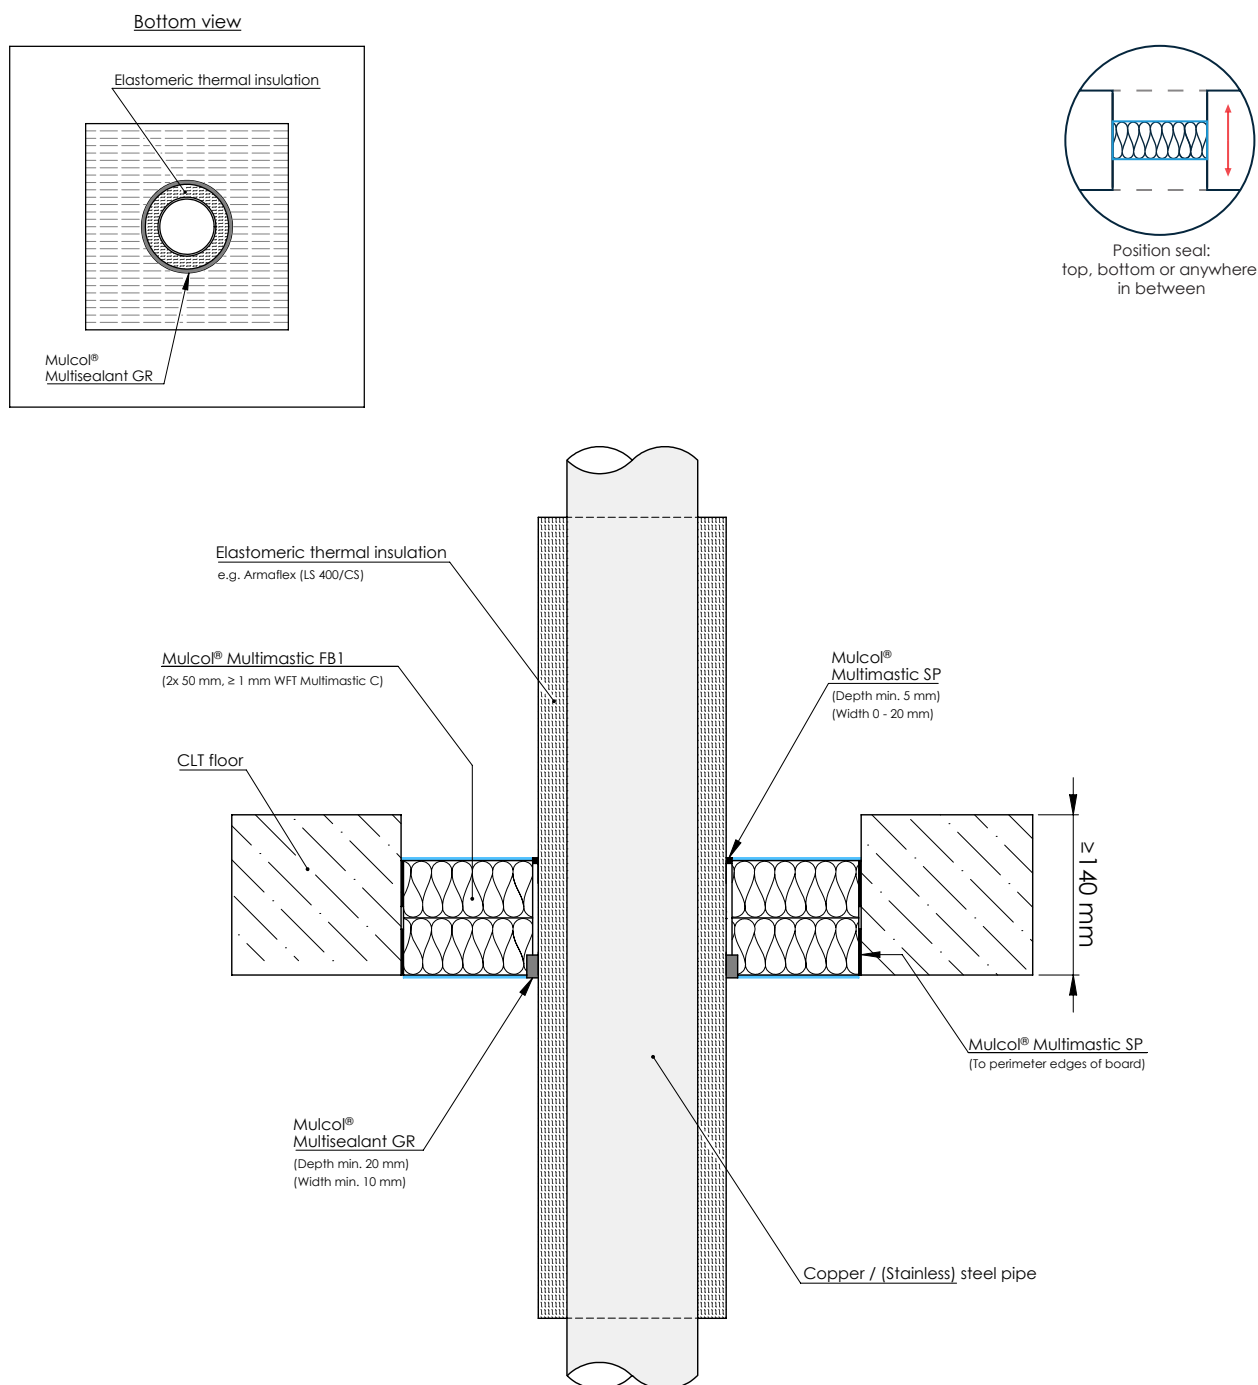

Drawing: FCLT.E-ST-MFB1-G2.4.22

Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	8.5	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 60 C/U, E 120 C/U
				8.5 - 33.5				EI 60 C/U, E 90 C/U
	≤ Ø 54	≥ 1.5		13.5	CS			EI 120 C/U
13.5 - 38				LS 400 / CS	EI 90 C/U, E 120 C/U			
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3			8.5 - 35			LS 400 / CS
	≤ Ø 114.3	≥ 3.6		15	CS			
				15 - 43	LS 400 / CS			EI 90 C/U, E 120 C/U

B.2.5 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated elastomer

B.2.5.1 Copper and steel pipes - Elastomer LS 400 / CS - Multisealant GR



Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
(Stainless) Steel / cast iron	$\leq \varnothing 26.9$	≥ 2.3	Kaiflex KK Plus (min. class B-s2, d0 B _L -s2, d0)	8.5	LS 400 / CS	Multisealant GR $\geq 10 \times 20$ (wxd)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 60 C/U E 120 C/U

Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex NH (min. class D-s3, d0 D _L -S3, d0)	9 - 25	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 120 C/U
	≤ Ø 54	≥ 1.5		13	LS 400 / CS			EI 90 C/U
				13 - 25	LS 400 / CS			
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		9 - 25	LS 400 / CS			
	≤ Ø 114.3	≥ 3.6		19 - 25	LS 400 / CS			EI 120 C/U


Services	Pipe dimensions (mm)		Insulation			Product (mm)	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 22	≥ 1.0	ArmaFlex Ultima (min. class B-s1, d0 B _L -S1, d0)	9 - 25	LS 400 / CS	Multisealant GR ≥ 10 x 20 (wxd)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 60 C/U E 120 C/U
				25 - 32				EI 90 C/U E 120 C/U
	≤ Ø 54	≥ 1.5		13 - 32				EI 60 C/U E 120 C/U
				13 - 32	CS			EI 90 C/U E 120 C/U
				32	LS 400 / CS			EI 90 C/U
(Stainless) Steel / cast iron	≤ Ø 26.9	≥ 2.3		9 - 25				EI 60 C/U E 90 C/U
				25				EI 90 C/U E 120 C/U
	≤ Ø 114.3	≥ 3.6		13				EI 60 C/U E 120 C/U
				13 - 32				

B.2.5 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes insulated elastomer

B.2.5.2 Copper and steel pipes - Elastomer LS 400 / CS - Multiwrap

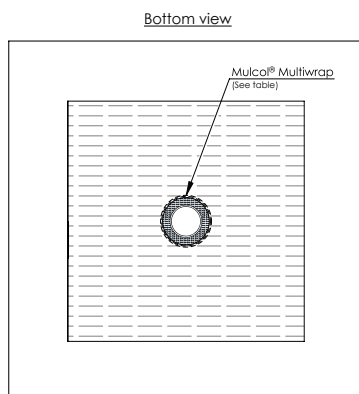

Position seal:
top, bottom or anywhere
in between



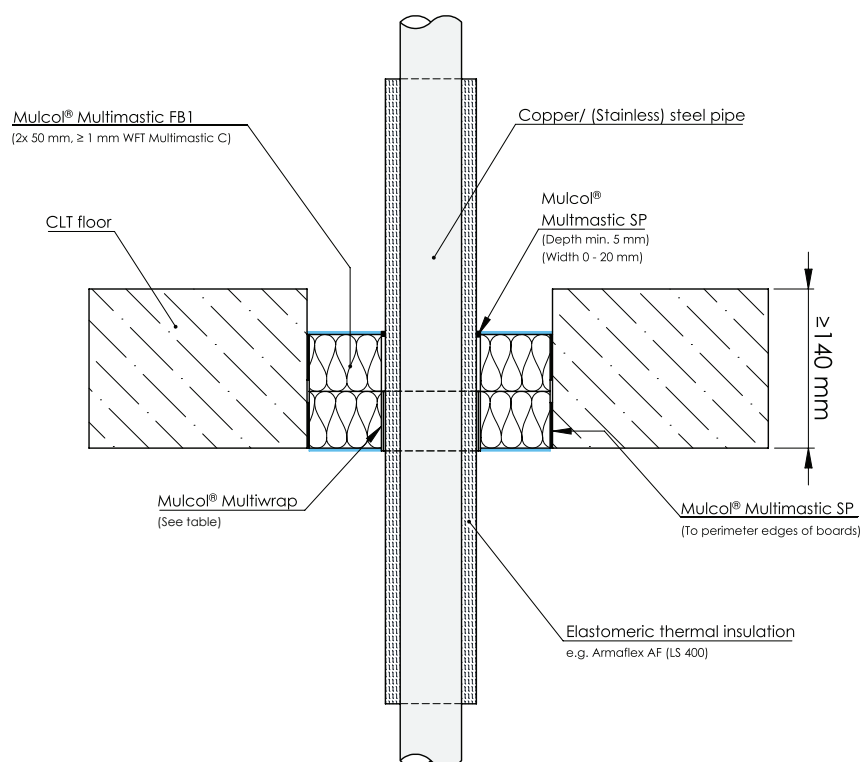


Drawing: FCLT.E-CU-MW2-MFB1.2.22

Services	Pipe dimensions (mm)		Insulation			Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness	Type	Thickness (mm)	Configuration			
Copper / (stainless) steel / cast iron	≤ Ø 12	≥ 1.0	ArmaFlex AF (min. class B-s3, d0 B _L -s3, d0)	11	LS 400 / CS	Multiwrap (2 layers)	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	EI 120 C/U
				11 - 28.5				EI 90 C/U
	≤ Ø 54	≥ 1.5		13.5 - 28.5				EI 45 C/U
				28.5				EI 90 C/U
(Stainless) Steel / cast iron	≤ Ø 168.3	≥ 4.5		13 - 19			EI 45 C/U E 120 C/U	

B.2.6 Multimastic FB1 - 2x 50 mm no cavity - Metal pipes uninsulated

B.2.6.1 Copper and steel pipes - Multidisc

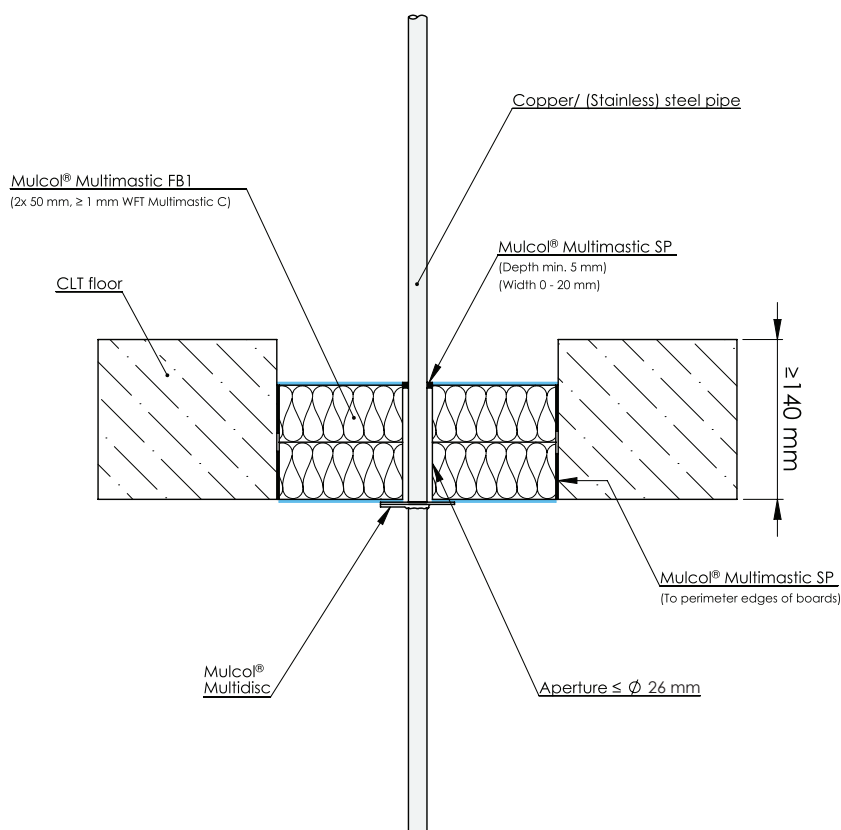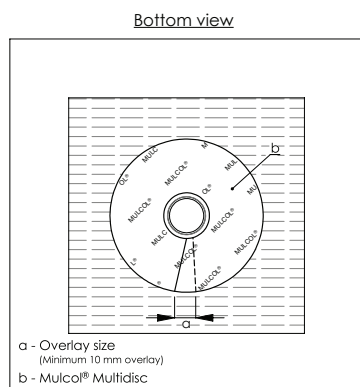


Drawing: FCLT.E-CU-MFB1-M2.0.10

Services	Pipe dimensions (mm)		Product	Sealing (mm)	Classification
	Outer dimension	Wall thickness			
Copper / (stainless) steel / cast iron	≤ Ø 15	≥ 1.0	Multidisc bottom of floor	Multimastic SP 0-20 x ≥ 5 (wxd) top of floor	E 60 C/U

C.1 Wall constructions - General

C.1.1 Mutual distances & distance to first support

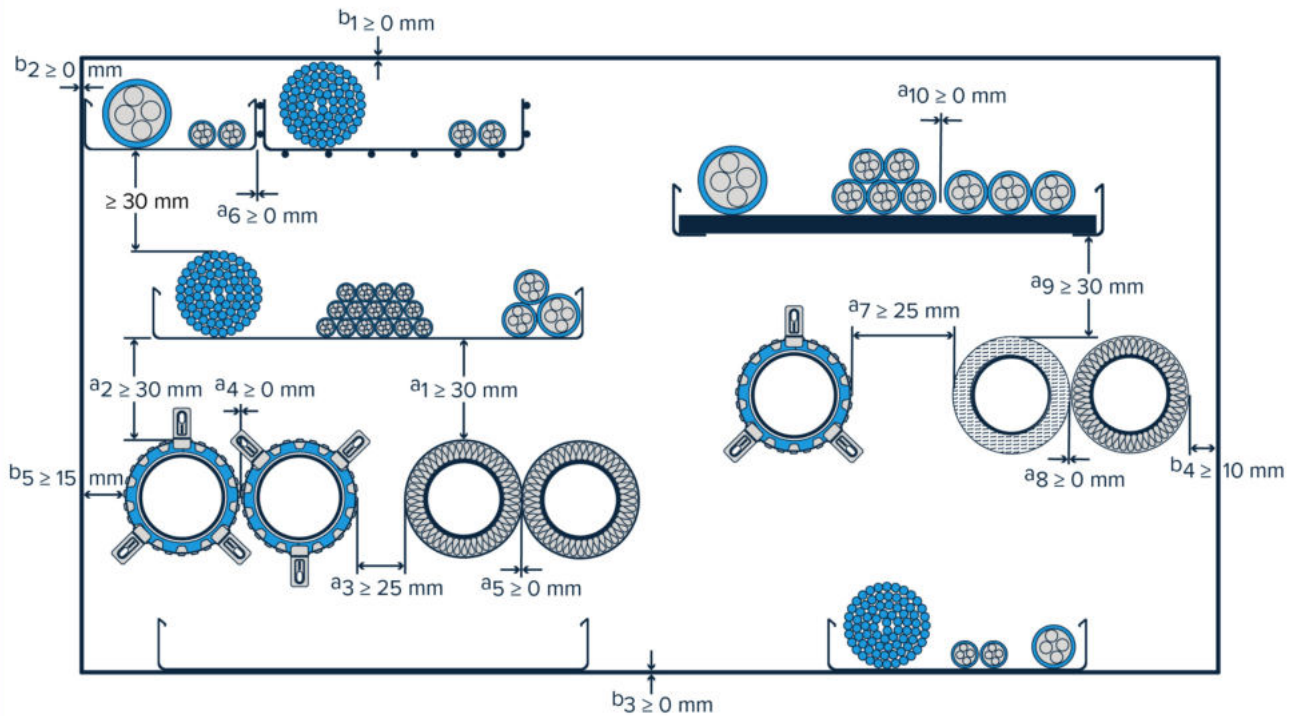



Mutual distances Mixed Penetration Seal – Mulcol® Multimastic C System

- a₁ Distance between cables/cable trays and metal pipes
- a₂ Distance between cables/cable trays and plastic pipes
- a₃ Distance between metal pipes and plastic pipes
- a₄ Distance between plastic pipes
- a₅ Distance between metal pipes with non-combustible insulation
- a₆ Distance between cable trays
- a₇ Distance between plastic pipes and pipes with combustible insulation
- a₈ Distance between pipes with non-combustible insulation and pipes with combustible insulation
- a₉ Distance between cables/cable trays and pipes with combustible insulation
- a₁₀ Distance between cables stacked together or in a row
- b₁ Distance between cables/cable trays and the upper seal edge
- b₂ Distance between cables/cable trays and the side seal edge
- b₃ Distance between cables/cable tray and the lower seal edge
- b₄ Distance between metal pipes and all seal edges
- b₅ Distance between plastic pipes and all seal edges

Service support construction

First support for all services at 450 mm, except cable trays at 250 mm.

C.1.2	Wall constructions - Maximum seal dimensions flexible or rigid wall
C.1.2.1	Maximum seal dimensions - Multimastic FB1 - 2x 50 mm no aperture framing

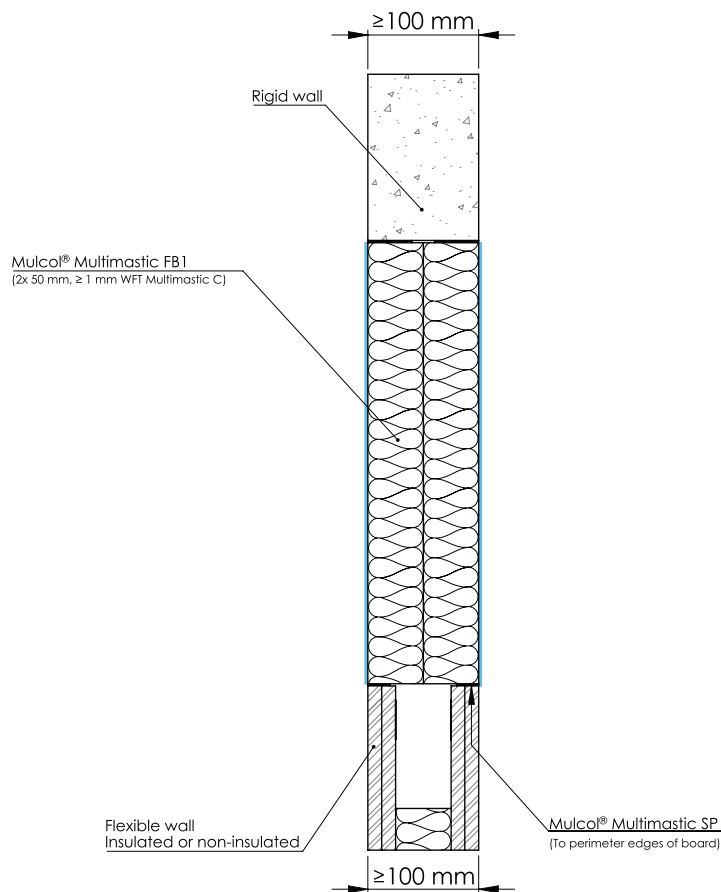

Drawing: PBfw.E-BS-MFB1.2.10


Services	Classification
Maximum seal size 1500 x 2500 mm (width x heigth or height x width) With a maximum surface of 3 m ²	EI 60
Maximum circular seal size Ø 1954 mm	
Maximum seal size 1200 x 1200 mm With a maximum surface of 1.44 m ²	EI 60, E 90
Maximum circular seal size Ø 1354 mm	
Maximum seal size 625 x 475 mm (w x h) With a maximum surface of 0.24 m ²	EI 120
Maximum circular seal size Ø 550 mm	

C.1.2


Wall constructions - Maximum seal dimensions flexible or rigid wall

C.1.2.2

Maximum seal dimensions - Multimastic FB1 - 2x 50 mm with aperture framing




Position seal:
right, left or anywhere
in between

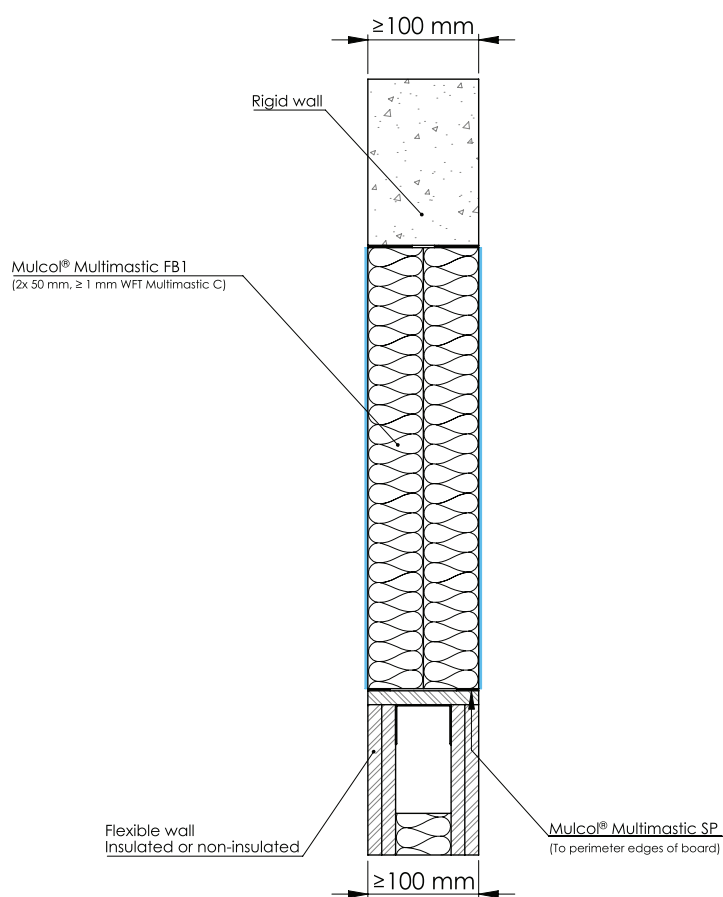

Drawing: PBfw.E-BS-A-MFB1.2.10

Services	Classification
Maximum seal size 1500 x 2500 mm (width x height or height x width) With a maximum surface of 3 m ²	EI 120
Maximum circular seal size Ø 1954 mm	
Maximum seal size 1200 x 2000 mm (width x height or height x width) With a maximum surface of 2.44 m ²	EI 180
Maximum circular seal size Ø 1748 mm	

C.1.2	Wall constructions - Maximum seal dimensions flexible or rigid wall
C.1.2.3	Maximum seal dimensions - Multimastic FB1 - 2x 50 mm - Pattress fixed to the wall

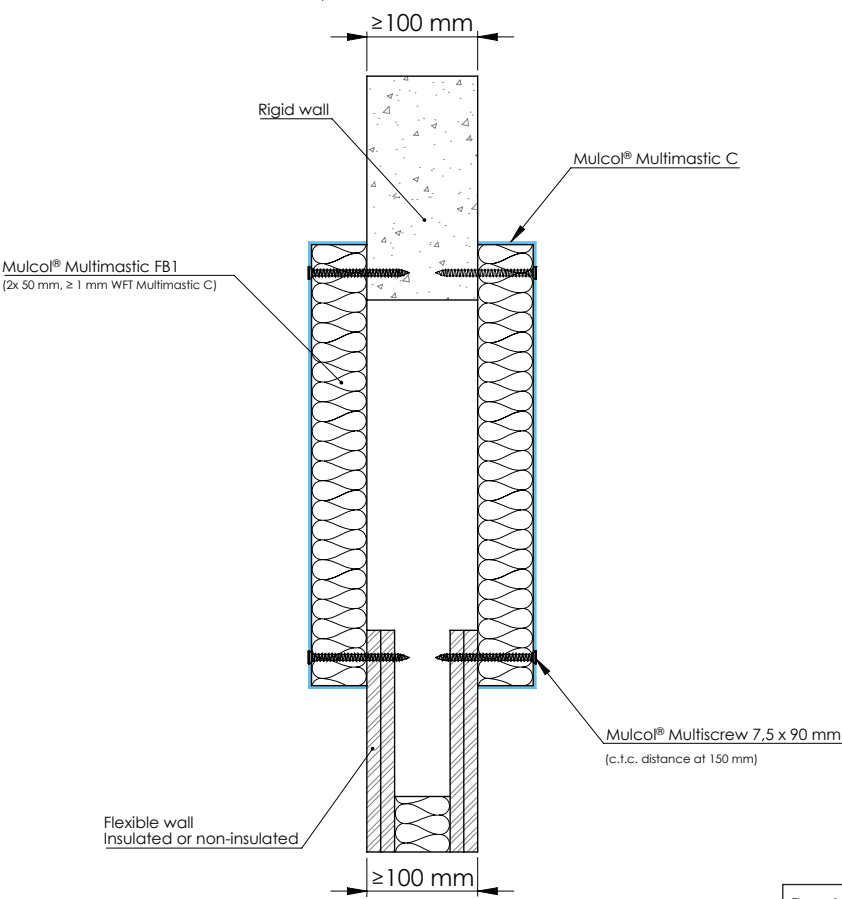

Drawing: PBPfw-BS-MFB1.2.10


Services	Classification
Maximum seal size 750 x 1250 mm (width x heigth or height x width) With a maximum surface of 0.75 m ²	EI 120
Maximum circular seal size Ø 1093 mm	

C.1.2


Wall constructions - Maximum seal dimensions flexible or rigid wall

C.1.2.4

Maximum seal dimensions - Multimastic FB2 - 1x 60 mm with aperture framing



Position seal:
right, left or anywhere
in between

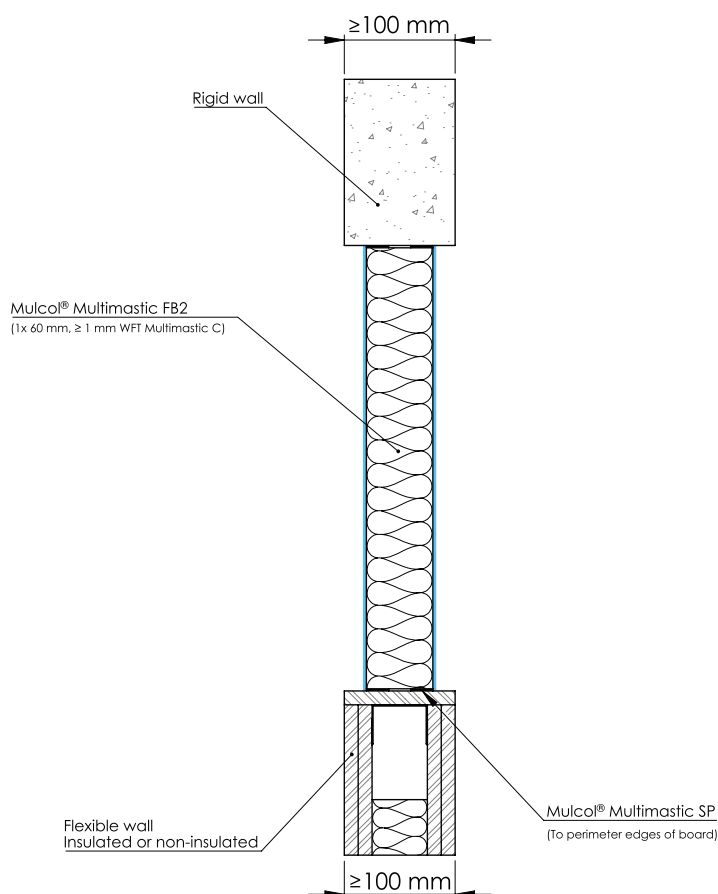

Drawing: PBfw.E-BS-MFB2.1.10


Services	Classification
Maximum seal size 1500 x 2500 mm (width x height or height x width) With a maximum surface of 3.0 m ²	EI 60
Maximum circular seal size Ø 1954 mm	
Maximum seal size 1200 x 1200 mm With a maximum surface of 1.44 m ²	
Maximum circular seal size Ø 1354 mm	EI 60, E 90
Maximum seal size 563 x 525 mm (width x height or height x width) With a maximum surface of 0.24 m ²	
Maximum circular seal size Ø 548 mm	EI 90
Maximum seal size 450 x 420 mm (width x height or height x width) With a maximum surface of 0.19 m ²	
Maximum circular seal size Ø 491 mm	EI 120

C.1.2

Wall constructions - Maximum seal dimensions flexible or rigid wall

C.1.2.5

Maximum seal dimensions - Multimastic FB2 - 1x 60 mm with aperture framing

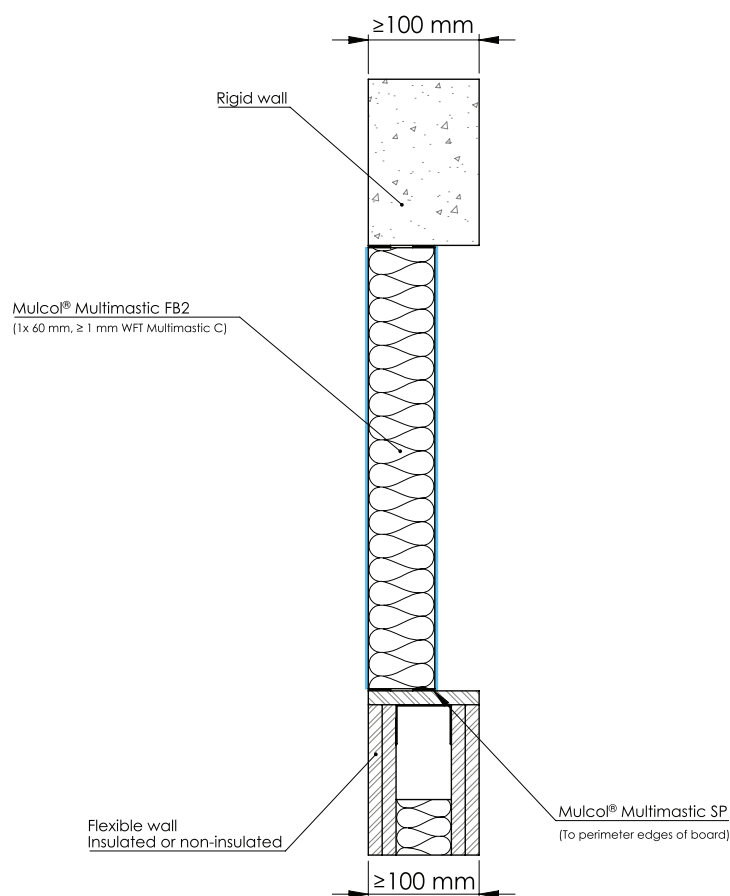


Drawing: PBfw.E-BS-fs-MFB2.1.10


Services	Classification
Maximum seal size 1500 x 2500 mm (width x height or height x width) With a maximum surface of 3.0 m ²	EI 60
Maximum circular seal size Ø 1954 mm	
Maximum seal size 1200 x 1200 mm With a maximum surface of 1.44 m ²	EI 60, E 90
Maximum circular seal size Ø 1354 mm	
Maximum seal size 563 x 525 mm (width x height or height x width) With a maximum surface of 0.24 m ²	EI 90
Maximum circular seal size Ø 548 mm	
Maximum seal size 450 x 420 mm (width x height or height x width) With a maximum surface of 0.19 m ²	EI 120
Maximum circular seal size Ø 491 mm	

C.1.2 Wall constructions - Maximum seal dimensions flexible or rigid wall

C.1.2.6 Maximum seal dimensions - Multimastic FB2 - 2x 60 mm with cavity 30 mm




Position seal:
right, left or any in between

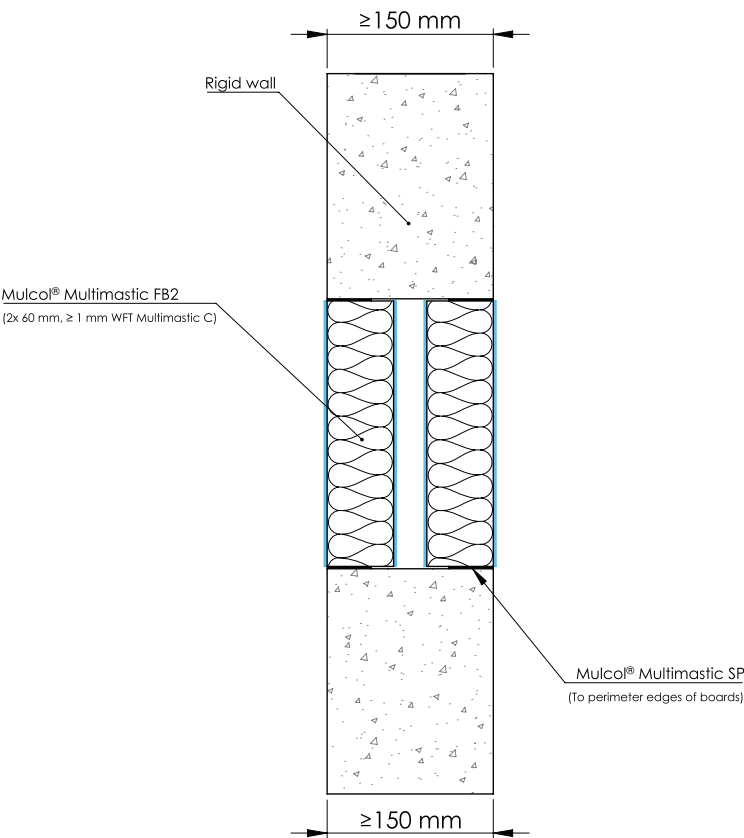

Drawing: RW150.E-BS-MFB2.2.10

Services	Classification
Maximum seal size 1500 x 1500 mm With a maximum surface of 1.8 m ²	EI 240
Maximum circular seal size Ø 1354 mm	

C.1.2	Wall constructions - Maximum seal dimensions flexible or rigid wall
C.1.2.7	Maximum seal dimensions - Multimastic FB2 - 2x 60 mm - Pattress fixed to wall


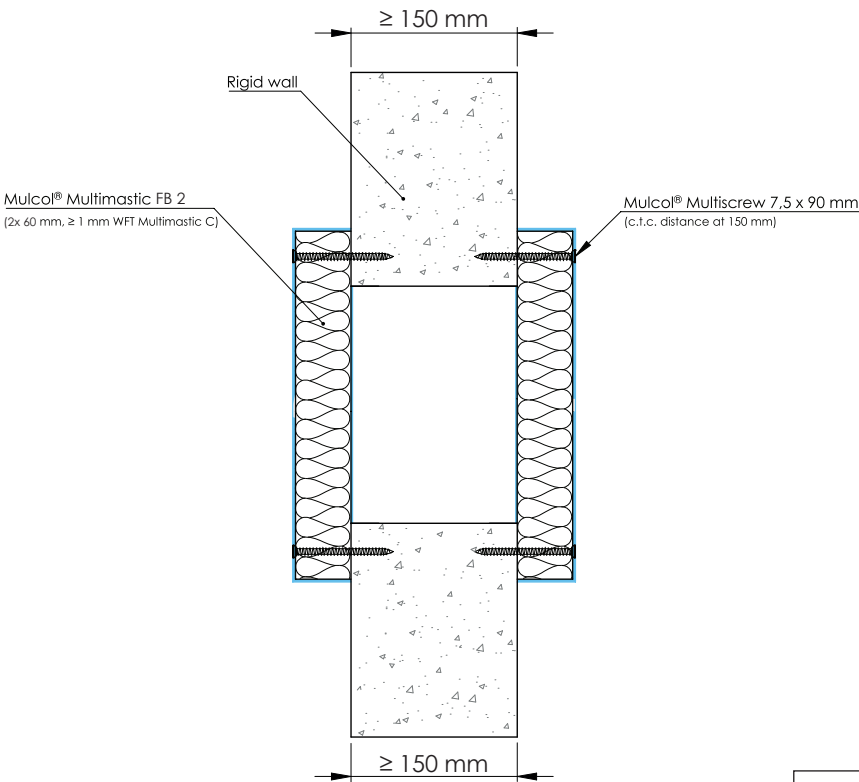


Drawing: PBPrw150.E-BS-MFB2.2.10

Services	Classification
Maximum seal size 750 x 600 mm (width x height or height x width) With a maximum surface of 0.45 m ²	EI 240
Maximum circular seal size Ø 757 mm	

C.1.3

C.1.3.1

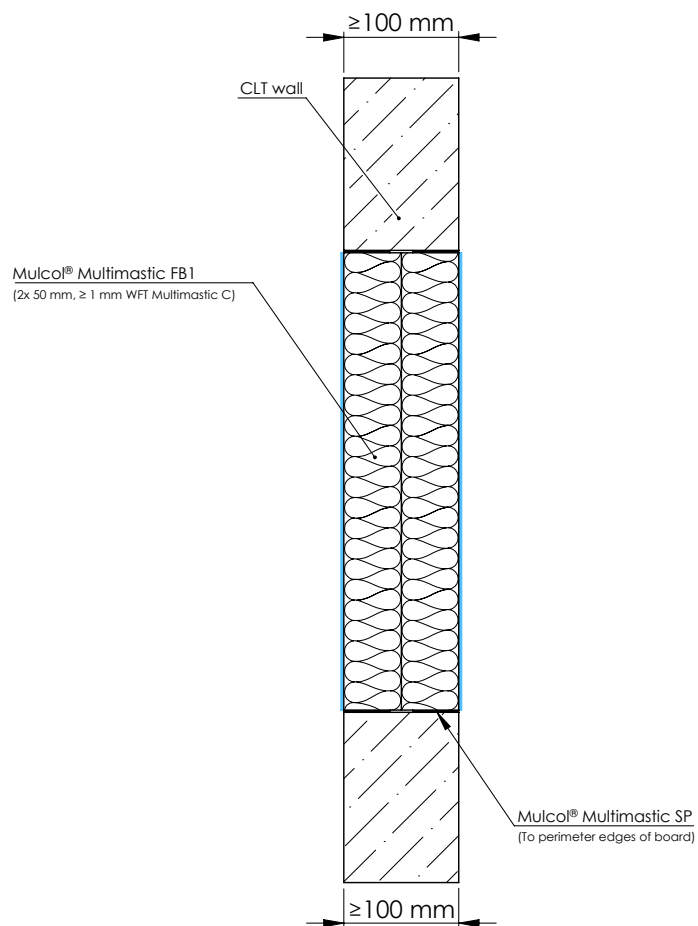



Drawing: WCLT.E-BS-MFB1.2.10

Services	Classification
Maximum seal size 500 x 500 mm With a maximum surface of 0.25 m²	EI 90
Maximum circular seal size Ø 564 mm	

C.1.4 Wall constructions - Maximum seal dimensions Sandwich panel

C.1.4.1 Maximum seal dimensions - Multimastic FB1 - 2x 50 mm no aperture framing

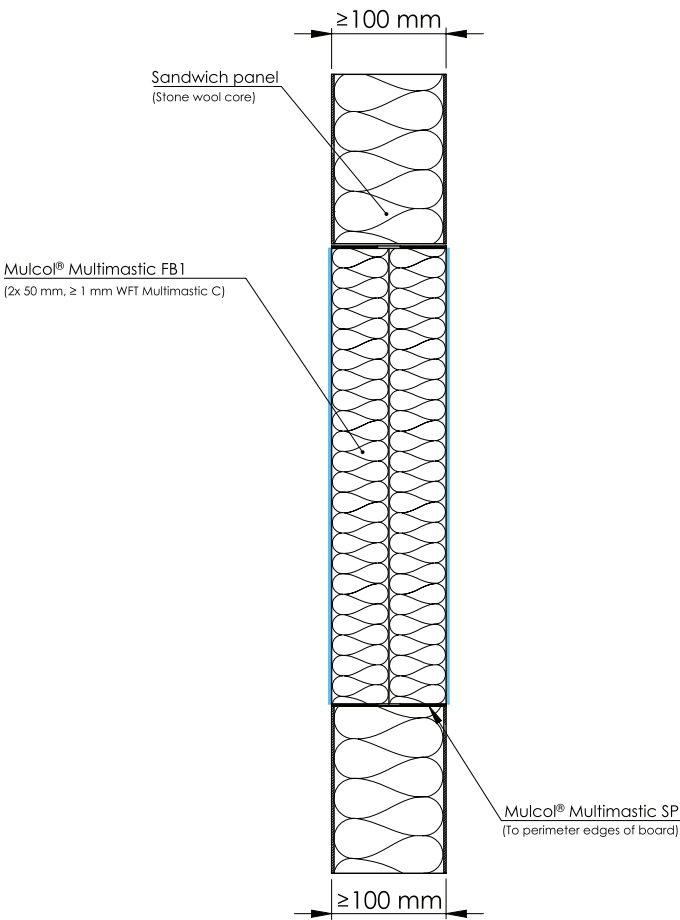


Drawing: SW.E-BS_B-MFB1.2.10


Services	Classification
Maximum seal size 500 x 600 mm (width x height or height x width) With a maximum surface of 0.3 m ²	EI 90
Maximum circular seal size Ø 618 mm	

C.1.4 Wall constructions - Maximum seal dimensions Sandwich panel

C.1.4.2 Maximum seal dimensions - Multimastic FB1 - 2x 50 mm with aperture framing



Position seal:
right, left or anywhere
in between

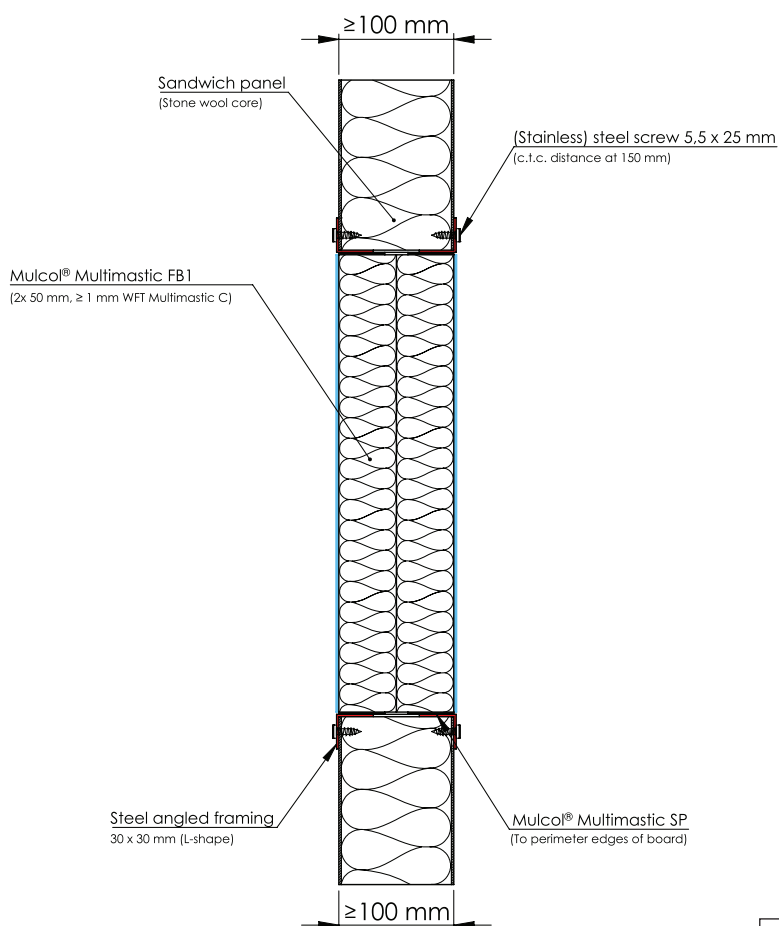

Drawing: SW.E-BS-MFB1.2.10

Services

Maximum seal size 1200 x 1000 mm (width x height or height x width)
With a maximum surface of 1.2 m²


Maximum circular seal size Ø 1236 mm

Classification

EI 120

C.2 Floor constructions - General

C.2.1 Mutual distances & distance to first support

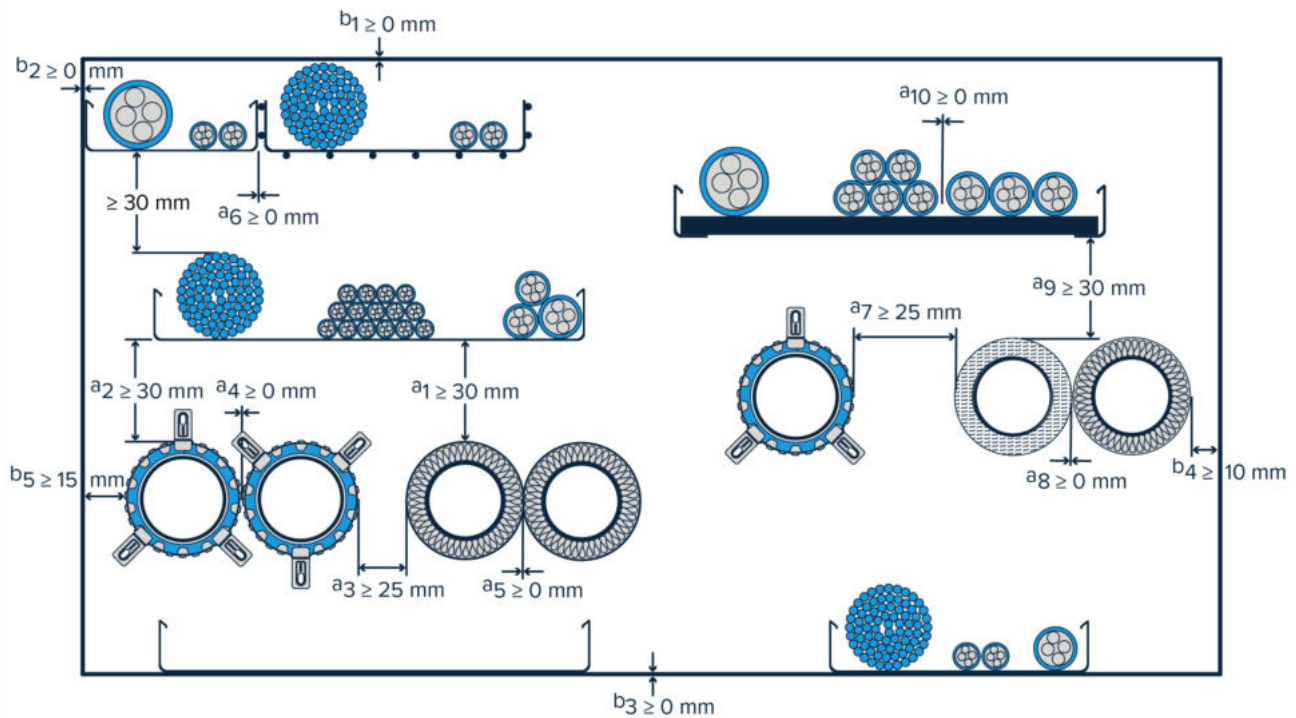

Mutual distances Mixed Penetration Seal – Mulcol® Multimastic C System


- a_1 Distance between cables/cable trays and metal pipes
- a_2 Distance between cables/cable trays and plastic pipes
- a_3 Distance between metal pipes and plastic pipes
- a_4 Distance between plastic pipes
- a_5 Distance between metal pipes with non-combustible insulation
- a_6 Distance between cable trays
- a_7 Distance between plastic pipes and pipes with combustible insulation
- a_8 Distance between pipes with non-combustible insulation and pipes with combustible insulation
- a_9 Distance between cables/cable trays and pipes with combustible insulation
- a_{10} Distance between cables stacked together or in a row
- b_1 Distance between cables/cable trays and the upper seal edge
- b_2 Distance between cables/cable trays and the side seal edge
- b_3 Distance between cables/cable tray and the lower seal edge
- b_4 Distance between metal pipes and all seal edges
- b_5 Distance between plastic pipes and all seal edges

Service support construction


First support for all services at 450 mm, except cable trays at 250 mm.

C.2.2 Floor constructions - Maximum seal dimensions rigid floor

C.2.2.1 Maximum seal dimensions - Multimastic FB1 - 2x 50 mm no cavity



Position seal:
top, bottom or anywhere
in between

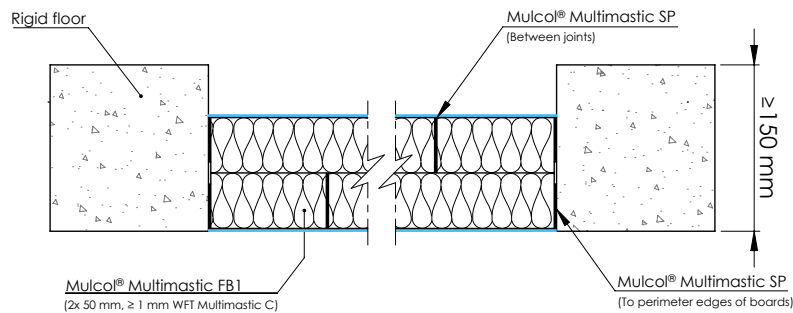


Drawing: PBrf.E-BS-MFB1.2.10


Services	Classification
Maximum seal size 1200 x 1200 mm Maximum seal size 9000 x 900 mm	EI 90, E 120
Maximum circular seal size Ø 1354 mm	
Maximum seal size 600 x 400 mm	EI 120
Maximum circular seal size Ø 553 mm	
Maximum seal size 450 x 450 mm	EI 240
Maximum circular seal size Ø 508 mm	

C.2.2 Floor constructions - Maximum seal dimensions rigid floor

C.2.2.2 Maximum seal dimensions - Multimastic FB1 - 2x 50 mm cavity 50 mm



Position seal:
top, bottom or anywhere
in between

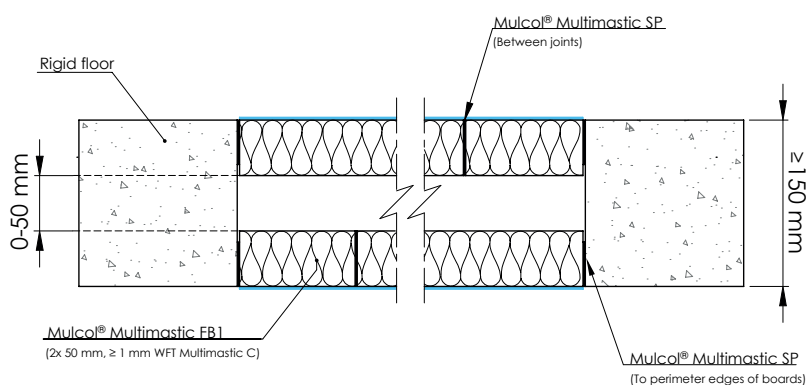


Drawing: PBrf.E-BS-MFB1.2.10.C


Services	Classification
Maximum seal size 1200 x 1200 mm Maximum seal size 9000 x 900 mm	EI 90, E 120
Maximum circular seal size Ø 1354 mm	
Maximum seal size 1200 x 600 mm Maximum seal size 9000 x 600 mm	EI 120
Maximum circular seal size Ø 957 mm	
Maximum seal size 450 x 450 mm Maximum circular seal size Ø 508 mm	EI 240

C.2.2 Floor constructions - Maximum seal dimensions rigid floor

C.2.2.3 Maximum seal dimensions - Multimastic FB2 - 1x 60 mm



Position seal:
top, bottom or anywhere
in between

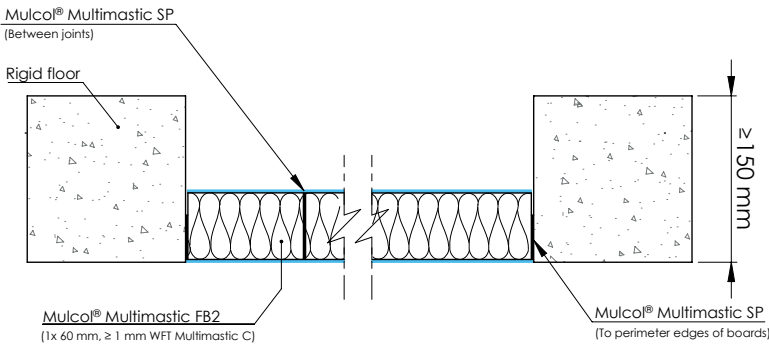


Drawing: PBrf.E-BS-MFB2.1.10


Services	Classification
Maximum seal size 1200 x 1200 mm Maximum seal size 9000 x 900 mm Maximum circular seal size Ø 1354 mm	EI 90, E 120

C.2.3 Floor constructions - Maximum seal dimensions CLT floor

C.2.3.1 Maximum seal dimensions - Multimastic FB1 - 2x 50 mm



Position seal:
top, bottom or anywhere
in between

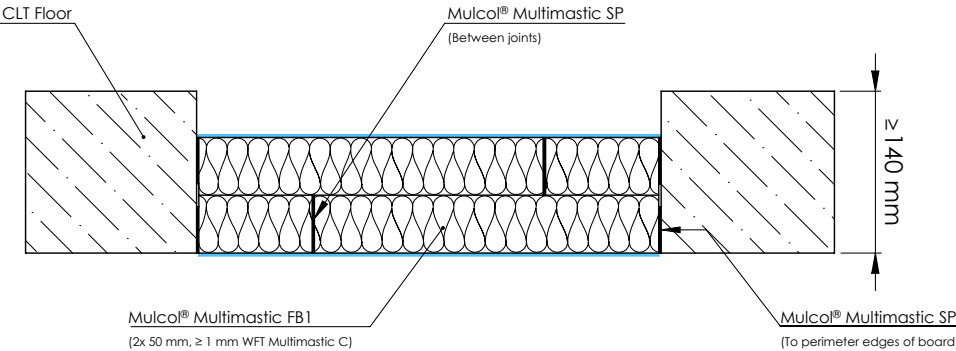

Drawing: FCLT.E-BS-MFB1.2.10

Services	Classification
Maximum seal size 500 x 800 mm	EI 120
Maximum circular seal size Ø 713 mm	

C.3 Wall configurations

C.3.1 Allowed wall configurations

The use of Mulcol® Multimastic C is allowed in all double sided flexible wall constructions (with or without insulation) of the same or higher fire resistance classification in accordance with EN 13501-2, with a lining made of gypsum boards (EN 520) or Calcium Silicate boards which are CE marked for the application as lining of flexible wall, if their construction is in accordance with the rules given below.


Field of direct application rules for double-sided flexible wall constructions:

- flexible wall constructions as shown in solutions given in Annex A of this document;
- flexible wall constructions with the same or higher number of board layers of the same or higher board thickness on each side of the wall, with insulation of any type or without insulation;
- flexible wall constructions with a reduced number of board layers but the same or higher board thickness on each side of the wall as tested, with insulation of any type or without insulation;
- flexible wall constructions with timber studs, no part of the penetration seal closer than 100 mm to any stud or nogging piece, the cavity closed between the penetration seal and the stud/nogging piece with minimum 100 mm of insulation of class A1 or A2 in accordance with EN 13501-1;
- rigid constructions of an overall thickness equal to or greater than that given in the solutions in Annex A and a minimum density of 350 kg/m³. In case of hollow brick wall the same rules regarding aperture framing apply as for double-sided flexible walls.

Allowed constructions (not limited by):


Flexible walls, not insulated, partially removed insulation or fully insulated with any type of insulation.

e.g.:

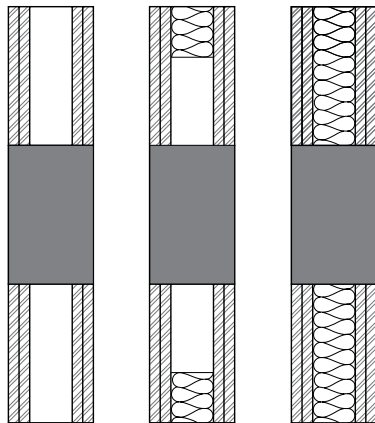

Double stud walls, separated by ≥ 0 mm, not insulated, partially insulated or fully insulated with any type of insulation.

e.g.:

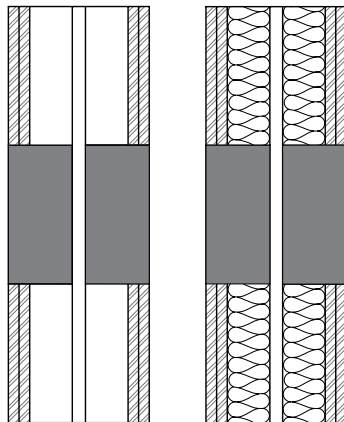


C.3 Wall configurations

C.3.1 Allowed wall configurations

Walls with a reduced number of board layers but the same or higher overall lining thickness on each side of the wall as shown in the solutions in Annex A.

Walls with a higher number of board layers, where individual boards are thinner yet the overall lining thickness is at least that of shown in the solutions in Annex A.

e.g.:

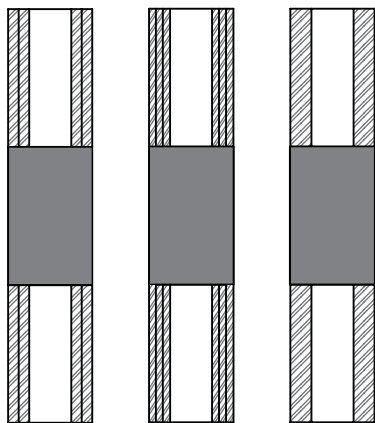

Rigid walls with a density of $\geq 350 \text{ kg/m}^3$

e.g.:

